



**DRAFT**

**Pending Formal Acceptance by City Council**

## **WATER SYSTEM MODEL AND EVALUATION**

**City of Bunker Hill Village**  
Harris County, Texas

IDS Project No. 0517-005-00

April 2026



*Marcel Khouw*  
4/9/2026

TABLE OF CONTENTS

TABLE OF CONTENTS ..... i

SECTION 1.0 EXECUTIVE SUMMARY ..... 1

1.1 Introduction ..... 1

1.2 Existing Water System ..... 1

1.3 Water Supply System Analysis ..... 1

1.3.1 TCEQ Criteria ..... 1

1.4 Water System Head Loss ..... 2

1.5 Recommendations ..... 2

1.5.1 Water Line Replacement ..... 4

1.5.2 Ground Storage Tank Replacement ..... 4

1.5.3 Water Well Replacement ..... 4

1.5.4 Taylorcrest Water Plant (WP No. 1) Electrical Improvements ..... 4

1.5.5 City Hall Water Plant (WP No. 2) Electrical Improvements ..... 5

SECTION 2.0 INTRODUCTION ..... 5

SECTION 3.0 WATER SUPPLY SYSTEM ..... 6

3.1 Existing System ..... 6

3.1.1 Groundwater ..... 6

3.1.2 Surface Water Connections ..... 6

3.1.3 Booster Pumps ..... 7

3.1.4 Storage Facilities ..... 7

SECTION 4.0 ANALYSIS OF WATER SUPPLY SYSTEM REGULATORY COMPLIANCE ..... 8

4.1 Water System Requirements Overview ..... 8

4.1.1 Equivalent Single-Family Connections (ESFC) ..... 8

4.1.2 Well Capacity ..... 8

4.1.3 Pressure Tank Capacity ..... 8

4.1.4 Elevated Storage Capacity ..... 9

4.1.5 Storage Capacity ..... 9

4.1.6 Booster Pump Capacity ..... 9

4.1.7 Water System Inventory ..... 9

4.1.8 Pressure Requirements ..... 10

4.1.9 Fire Flow Requirements ..... 10

SECTION 5.0 HYDRAULIC WATER MODEL ANALYSIS ..... 11

5.1 Methodology ..... 11

5.1.1 Demand Allocation ..... 11

5.1.2 Hydraulic Model Calibration ..... 12

5.2 Steady State Analysis ..... 12

5.2.1 System Pressure Analysis ..... 12

5.2.2 *System Headloss Analysis* .....13

5.2.3 *Fire Flow Analysis* .....14

5.3 *Extended Period Simulation* .....15

5.3.1 *Baseline 24-hr Extended Period Simulation*.....15

5.3.2 *Removal of City of Houston Surface Water* .....15

5.3.3 *Removal of Ground Storage Tanks*.....16

5.3.4 *Emergency Scenario No. 1* .....17

5.3.5 *Emergency Scenario No. 2* .....18

SECTION 6.0 **WATER SYSTEM IMPROVEMENTS**.....19

6.1 **Recommendations** .....19

6.1.1 *Water Line Replacement* .....21

6.1.2 *Ground Storage Tank Replacement* .....22

6.1.3 *Water Well Replacement*.....23

6.1.4 *Taylorcrest Water Plant (WP No. 1) Electrical Improvements*.....23

6.1.5 *City Hall Water Plant (WP No. 2) Electrical Improvements* .....23

**EXHIBITS**

- Exhibit 1 - Water System GIS Map
- Exhibit 1.1 – Water Line Replacement Locations
- Exhibit 2 – Historical Water Use
- Exhibit 3 – Water Use Diurnal Curve
- Exhibit 4 – Steady State Analysis Pressure Map
- Exhibit 5 – Steady State Analysis Pipe Velocity Map
- Exhibit 6 – Fire Flow Availability Map

**APPENDICES**

- Appendix A - Electrical Systems Evaluation Report
- Appendix B - Extended Period Simulation Results
- Appendix C – Water Line Replacement Cost Estimate
- Appendix D - Ground Storage Tank Replacement Cost Estimate
- Appendix E – Water Well Replacement Cost Estimate
- Appendix F – Electrical System Rehabilitation at WP No. 1 Cost Estimate
- Appendix G – Electrical System Rehabilitation at WP No. 2 Cost Estimate
- Appendix H – Water Plant Back-Up Power Improvements Cost Estimate
- Appendix I – Texas Hydrants’ Data

## SECTION 1.0 EXECUTIVE SUMMARY

### 1.1 Introduction

This Technical Memorandum presents the results from the evaluation of the overall water distribution system conducted for the City of Bunker Hill Village (City). The water distribution system evaluation consisted of assessing the system's capacities, pressure, and available fire flow using TCEQ criteria. Additionally, an evaluation was performed using hydraulic water modeling on the City's water distribution system to calculate minimum pressure and available fire flow, develop diurnal curves based on the water system's demands, and perform extended period simulations of several operational scenarios.

### 1.2 Existing Water System

The City's water distribution system includes four (4) groundwater wells, three (3) groundwater storage tanks, eight booster (8) pumps, two (2) surface water supply connections from the City of Houston, and a network of underground water lines. The existing water distribution system components are outlined in the below **SECTION 3.0**. Additionally, IDS was tasked with creating an updated GIS exhibit of the City's water distribution system which is attached as **Exhibit 1**.

### 1.3 Water Supply System Analysis

#### 1.3.1 TCEQ Criteria

The minimum requirements used for evaluating a public water system are stated in Texas Commission on Environmental Quality (TCEQ) Chapter 290.45. These minimum requirements include criteria for minimum pressure, available fire flow, and capacities for wells, storage tanks, and booster pumps.

TCEQ defines a water service connection as equaling a typical single family residential unit. When evaluating the City's water system, the number of water service connections was converted to equivalent single-family connections (ESFCs) as equaling a typical detached residential single-family house. For non-residential and multi-family connections, the actual metered average water usage is divided by 360 gallons per day to convert these connections into ESFCs.

The City provides water service to approximately 1,350 customer accounts. The 1,350 customer accounts primarily residential single-family house accounts and IDS estimated that 10 customer accounts are classified as non-residential. The 1,340 residential customer accounts convert to 1,340 ESFCs and total average flow from the 10 non-residential customer accounts convert to 165 ESFCs. Therefore, the combined ESFCs currently served by the City's water distribution system is 1,505 ESFCs.

A summary of the City's existing water supply facilities, TCEQ criteria, and ESFC capacities are shown below in **Table 1**. It should be noted that in addition to the requirements listed below that the TCEQ

requires water be provided at a minimum pressure of 35 psi under normal operation and 20 psi during fire flow conditions.

**Table 1: Water Supply Facilities Inventory**

Facility	City Water Network Capacity	TCEQ Criteria	City Water Network ESFC Capacity
Surface Water	485,000 gpd <sup>(1)</sup>		
Wells	4,450 gpm	0.6 gpm/ESFC	7,417 ESFCs
Pressure Tank	30,000 gal	2,500 ESFCs (Max)	2,500 ESFCs
Elevated Storage	0 gal	100 gal/ESFC	N/A ESFCs
Ground Storage	1,050,000 gal		
Total Storage	1,080,000 gal	200 gal/ESFC	5,400 ESFCs
Booster Pump	5,600 gpm	2 gpm/ESFC	2,800 ESFCs

Notes:

(1) The TCEQ does not require a total amount of surface water per ESFC.

TCEQ capacity requirements must be met in congruence with each other. Therefore, the overall water distribution system is limited by whichever individual capacity is the smallest. In this case, the City's current water supply is limited by its pressure tank capacity, which can serve 2,500 ESFCs. It should be noted that the TCEQ mandates a maximum of 2,500 ESFCs when relying solely on pressure tanks with no elevated storage, if the City were to expand their capacity to more than 2,500 ESFCs; an elevated storage tank would need to be constructed. Based on the water supply inventory and hydraulic modeling results, the City's water distribution system exceeds the minimum TCEQ criterion by supplying the existing 1,505 ESFCs with the capacity to serve 2,500 ESFCs. Additionally, the City's system exceeds the minimum 35 psi pressure requirement under normal operation as well as the 20-psi requirement during minimum fire flow and unusual conditions.

#### 1.4 Water System Head Loss

Head loss is a measure of the reduction in the total head of the fluid, which are due to the frictional resistance of the piping system. It is important to analyze head loss throughout a piping system to assess which areas of the system may be attributing to inadequate pressure and/or flow. The maximum criteria used for evaluating the head loss gradient within the system's pipe network is given as 7 ft. of head loss per 1,000 ft. of pipe. Generally, the locations in which this criterion was exceeded within the water model were pipes that were smaller than 6" in diameter.

#### 1.5 Recommendations

After reviewing the system against TCEQ requirements, as well as the Hydraulic Model results outlined in further sections of this report, IDS recommends several future improvements to the City's water system. Additionally, after discussion with the City, IDS contracted Guzman Engineering to conduct a site visit and evaluate the condition of various electrical systems associated with the City's water facilities.

The electrical assessment is provided in **Appendix A** and the recommendations outlined in that report are reflected in the following sections. The recommendations that follow are prioritized on the basis of cost versus risk to the City. **Table 1A** below is a summary of all the recommended improvements in order of priority. More detail on IDS's recommended improvements can be found in **Section 6.0**.

**Table 1A. Recommendation Priority Summary**

Proposed Improvement	Type Of Improvement	Opinion of Probable Cost	Overall Priority Ranking
Water Line Replacement (Package 1)	Civil	\$2,280,000	1
Water Well No. 3 Emergency Power Improvements	Electrical	\$50,000	2
Water Plant Back-Up Power Improvements	Electrical	\$140,000	3
Complete Power System Rehabilitation at City Hall Water Plant	Electrical	\$1,550,000	4
Complete Power System Rehabilitation at Taylorcrest Water Plant	Electrical	\$1,800,000	5
Water Line Replacement (Package 2)	Civil	\$1,510,000	6
Water Line Replacement (Package 3)	Civil	\$1,260,000	7
Water Line Replacement (Package 4)	Civil	\$830,000	8
Water Well No. 3 Replacement	Electrical	\$5,830,000	9
Water Line Replacement (Package 5)	Civil	\$1,310,000	10

Note that all amounts referenced in the table above include all engineering, survey, construction phase services, observation, and material testing costs required to complete the project. City projects that are currently in design are not included in the recommendation priority summary.

Additionally, it is recommended that the City implement a drought contingency plan which includes irrigation restrictions during complete power loss events to reduce the high peak demands in the system during typical irrigation. This should be considered while awaiting the emergency power improvements that are recommended in this report.

### 1.5.1 Water Line Replacement

It is recommended that the low pressure and high head loss areas within the water distribution system be rehabilitated/replaced and upsized to a larger diameter. All 2”-4” diameter lines are recommended to be phased out of the system with the lines that increase fire flow in the system taking priority. Followed by the low-pressure locations in the system that are almost exclusively located on 2” to 4” diameter cast iron or asbestos cement lines (See **Section 5.2.1**); these are recommended to be upsized to 6” in diameter and replaced with PVC pipe. The Opinion of Probable cost (OPC) for water line replacement is broken down into five (5) packages based on priority and location of the lines. The Opinion of Probable Cost for the water line replacement is shown in **Table 1B** below and a detailed cost estimate is given in **Appendix C**. Additionally, an exhibit highlighting all areas that are recommended to be replaced is included as **Exhibit 1.1**.

**Table 1B. Water Line Replacement OPC**

Package No.	Opinion of Probable Cost
1	\$2,280,000
2	\$1,510,000
3	\$1,260,000
4	\$830,000
5	\$1,310,000
<b>Total</b>	<b>\$7,190,000</b>

### 1.5.2 Ground Storage Tank Replacement

Per the Preliminary Engineering Report – Inspection and Evaluation of Water Storage Tanks at Water Plant No. 1, GST-1, GST-2, HPT-1, and HPT-2 dated September 2, 2025, it is recommended to replace GST No. 1 at Water Plant No. 1 with a 0.25 MG tank in the same location. The hydraulic modeling performed as part of this evaluation reinforces that the tank does not need to be upsized from its current capacity of 0.25 MG. The Opinion of Probable Cost for this project is **\$1,400,000** and a detailed cost estimate is given in **Appendix D**.

### 1.5.3 Water Well Replacement

It is understood that Water Well No. 3 is currently operating at approximately 8.5% below its design point and it is recommended to plan for the eventual replacement of the well. Replacement of the well would allow the City to maintain adequate water supply during the Emergency Scenarios outlined in **Section 5.0**. The Opinion of Probable cost for the installation of a new well is **\$5,830,000** and a detailed cost estimate is given in **Appendix E**. Note that this does not include costs related to land acquisition for the new water well site. The cost estimate also includes the approximate cost to perform a siting study to evaluate new potential well locations which were outside the scope of this study. It is understood

that no back-up power is located at this off-site well and it is therefore recommended that a generator “quick connect” cabinet be installed on site to be utilized by a trailer mounted generator during emergency scenarios while awaiting the drilling of a new well. The Opinion of Probable cost for the installation of a generator connection point is estimated to be no more than **\$50,000** and a detailed cost estimate is given in **Appendix A**.

#### **1.5.4 Taylorcrest Water Plant (WP No. 1) Electrical Improvements**

This recommendation is for improvements to the electrical systems at the Taylorcrest Water Plant. It is understood that Taylorcrest does not have the necessary emergency power capacity to run the entirety of the water plant’s facilities. Reduction in water supply and booster pump capacity is detrimental to the system in an emergency scenario under high demand. Based on the electrical load analysis and system evaluation presented in **Appendix A**, the existing generators at WP No. 1 and WP No. 2 can be swapped to provide full plant-wide back-up power at both locations. The Opinion of Probable Cost for the generator modifications is **\$140,000** and a detailed cost estimate is given in **Appendix H**. It should be noted that although the existing generator at Taylorcrest is in good condition, the existing generator at City Hall is aging and there is risk associated with its remaining life span. Additionally, based on the age of the motor control center and other electrical items, it is recommended that the City plan for a full power system rehabilitation of the Taylorcrest Water Plant site in the future. The Opinion of Probable Cost for the rehabilitation of the electrical systems is **\$1,800,000** which includes an additive alternate item for a new generator at the plant, and a detailed cost estimate is given in **Appendix F**.

#### **1.5.5 City Hall Water Plant (WP No. 2) Electrical Improvements**

It is understood that the electrical system at WP No. 2 is aging, based on conversations with City and the electrical system evaluation included in **Appendix A**. It is recommended that the City plan for a complete power system rehabilitation of the facility. The Opinion of Probable cost for the rehabilitation is **\$1,550,000** which includes an additive alternate item for a new generator at the plant, and a detailed cost estimate is provided in **Appendix G**.

## **SECTION 2.0 INTRODUCTION**

This Technical Memorandum presents the results from the evaluation of the overall water distribution system conducted for the City of Bunker Hill Village (City). The water distribution system evaluation consisted of assessing the system’s capacities, pressure, and available fire flow using TCEQ criteria. Additionally, IDS performed hydraulic water modeling on the City’s water distribution system to calculate minimum pressure and available fire flow and developed diurnal curves based on the water system’s demands. The hydraulic water model was used to simulate various scenarios in which the City might find themselves and analyze how the water system performed under these different conditions.

## SECTION 3.0 WATER SUPPLY SYSTEM

### 3.1 Existing System

The City owns and operates a water supply system consisting of two (2) water receiving facilities which have ground storage tanks. Representatives of IDS and the City have conducted site visits to evaluate the existing infrastructure to identify all aspects of the existing water facilities to accurately model the City's water system. The site visits assisted IDS's inventory of the water supply facilities and assessment of the facility capacities using TCEQ criteria.

#### 3.1.1 Groundwater

The City owns and operates four groundwater wells. A summary of the well capacities is shown in **Table 2** below.

**Table 2: City's Water Well Facility Breakdown**

Well Name	Tested Capacity <sup>(1)</sup>		Rated Capacity <sup>(2)</sup>		Address
	GPM	MGD	GPM	MGD	
Water Well #1	610	0.88	600	0.86	11700 Taylorcrest Road
Water Well #2	<i>Decommissioned</i>				
Water Well #3	780	1.12	850	1.22	1944 Memorial Drive
Water Well #4	1,025	1.48	1,050	1.51	11977 Memorial Drive
Water Well #5	2,100	3.02	1,950	2.81	11950 Taylorcrest Road
<b>Total Well Capacity</b>	<b>4,515</b>	<b>6.50</b>	<b>4,450</b>	<b>6.41</b>	-
<b>Firm Well Capacity</b>	<b>2,415</b>	<b>3.48</b>	<b>2,500</b>	<b>3.60</b>	-

**Notes:**

<sup>(1)</sup> Tested capacities from 2025 Well Pump Performance Test Reports

<sup>(2)</sup> Rated Capacities from TCEQ Drinking Water Watch (November 2025)

#### 3.1.2 Surface Water Connections

The City has two metered surface water connections from the City of Houston which are located at each of the water receiving facilities (Taylorcrest (WP No. 1) and City Hall (WP No. 2) water plants respectively). Surface water from these connections is conveyed directly to the ground storage tanks at each of the plants. Based on City SCADA data and correspondence with the City operator, the flow of each surface water connection has been estimated in **Table 3** below. A total allocation of 485,000 gallons per day is currently granted to the City.

**Table 3: City's Surface Water Connections**

Connection Location	Observed Flow (GPM)	Address
Taylorcrest Water Plant (WP No. 1)	2,100	11700 Taylorcrest Road
City Hall Water Plant (WP No. 2)	1,050	11977 Memorial Drive

**3.1.3 Booster Pumps**

The City of Bunker Hill Village operates eight (8) total booster pumps with four (4) being located at the Taylorcrest Water Plant and four (4) at the City Hall water plant. The pump capacities are listed in **Table 4** below.

**Table 4: City’s Summary of Pumping Facilities**

Water Receiving Facility	Pump Number	Rated Capacity			
		TCEQ <sup>(1)</sup>		Manufacturer <sup>(2)</sup>	
		GPM	MGD	GPM	MGD
Taylorcrest Water Plant	1	650	0.94	650	0.94
	2	650	0.94	650	0.94
	3	650	0.94	650	0.94
	4	650	0.94	650	0.94
	<b>Total Capacity</b>	2,600	3.74	2,600	3.74
	<b>Firm Capacity</b>	1,950	2.81	1,950	2.81
City Hall Water Plant	1	750	0.94	650	0.94
	2	750	0.94	650	0.94
	3	750	0.94	650	0.94
	4	750	0.94	650	0.94
	<b>Total Capacity</b>	3,000	4.32	2,600	3.74
	<b>Firm Capacity</b>	2,250	3.24	1,950	2.81

Notes:

<sup>(1)</sup> From TCEQ Drinking Water Watch (November 2025)

<sup>(2)</sup> From Pump Nameplates and Correspondence with Manufacturer.

**3.1.4 Storage Facilities**

The City owns and operates four (4) ground storage tanks (GSTs), the City does not utilize any elevated storage tank facilities. Two (2) of the GSTs are located at the Taylorcrest Water Plant and one is located at the City Hall Water Plant. Note that the City also has two (2) pressure tanks which are located at the Taylorcrest Water Plant which are not included in the total storage capacity per TCEQ criteria. A summary of the City’s storage facilities and their capacities is located in **Table 5** below.

**Table 5: City’s Summary of Storage Facilities**

Type	Facility Name	Storage Capacity		Address
		Gallons	MG	
Ground	Taylorcrest Water Plant	250,000	0.25	11700 Taylorcrest Road
		300,000	0.30	11700 Taylorcrest Road
	City Hall Water Plant	500,000	0.50	11977 Memorial Drive
<b>Total Ground Storage Capacity</b>		<b>1,050,000</b>	<b>1.05</b>	-

## SECTION 4.0 ANALYSIS OF WATER SUPPLY SYSTEM REGULATORY COMPLIANCE

### 4.1 Water System Requirements Overview

The minimum requirements used for evaluating a public water system are stated in TCEQ Chapter 290.45. These minimum requirements include criteria for minimum pressure, available fire flow, and capacities for wells, storage tanks, and booster pumps.

#### 4.1.1 *Equivalent Single-Family Connections (ESFC)*

TCEQ defines a water service connection as equaling a typical single family residential unit. When evaluating the City's water system, the number of water service connections was converted to equivalent single-family connections (ESFCs) as equaling a typical detached residential single-family house. For non-residential and multi-family connections, the actual metered average water usage is divided by 360 gallons per day to convert these connections into ESFCs.

The City provides water service to approximately 1,350 customer accounts. The 1,350 customer accounts primarily residential single-family house accounts and IDS estimated that 10 customer accounts are classified as non-residential. The 1,340 residential customer accounts convert to 1,340 ESFCs and total average flow from the 10 non-residential customer accounts convert to 165 ESFCs. Therefore, the combined ESFCs currently served by the City's water system is 1,505 ESFCs.

#### 4.1.2 *Well Capacity*

Per TCEQ Chapter 290.45(b)(1)(D)(i), a system is required to have two or more wells with a total capacity of 0.6 gpm per connection. The City currently owns four (4) active water wells. With a combined capacity of 4,450 gpm as previously shown in **Table 2**.

Based on the City's total well capacity of 4,450 gpm and TCEQ's criteria of 0.6 gpm per connection, the City's well facilities have a calculated capacity of 7,417 ESFCs which is sufficient to serve the 1,505 ESFCs currently served by the City's water system.

#### 4.1.3 *Pressure Tank Capacity*

Per TCEQ Chapter 290.45(b)(1)(D)(iv), a system is required to have an elevated storage capacity or a pressure tank capacity of 20 gallons per connection. The TCEQ notes if pressure tanks are used, a maximum capacity of 30,000 gallons is sufficient for up to 2,500 connections. The City currently owns two (2) pressure tanks with a capacity of 15,000 gallons each for a total capacity of 30,000 gallons.

Based on the City's total pressure tank capacity of 30,000 gallons and the TCEQ's criteria noted above, The City's pressure tanks have a calculated capacity of 2,500 ESFCs. This pressure tank capacity is sufficient to serve the 1,505 ESFCs currently served by the City's water system.

#### 4.1.4 Elevated Storage Capacity

Per TCEQ Chapter 290.45(b)(1)(D)(iv), a system is required to have an elevated storage capacity of 100 gallons per connection or pressure tank capacity of 20 gallons per connection, with the TCEQ noting that 30,000 gallons of pressure tank capacity is sufficient to serve up to 2,500 ESFCs. The City does not currently own or operate any elevated storage tanks and therefore relies on the capacity of their pressure tanks.

#### 4.1.5 Storage Capacity

Per TCEQ Chapter 290.45(b)(1)(D)(ii), a system is required to have a total storage capacity of 200 gallons per connection. The City currently owns three (3) ground storage tanks. The two (2) GST's at the Taylorcrest Water Plant have a total capacity of 550,000 gallons. The GST at the City Hall Water Plant has a capacity of 500,000 gallons which gives the City a total storage capacity of 1,050,000 gallons. Note that the City also has two (2) pressure tanks which are located at the Taylorcrest Water Plant which are not included in the total storage capacity per TCEQ criteria.

Based on the City's total 1,050,000-gallon storage capacity and the TCEQ's requirement of 200 gallons per connection, the City's total storage facilities have the calculated capacity of 5,250 ESFCs. This total storage capacity is sufficient to serve the 1,505 ESFCs of the existing distribution system.

#### 4.1.6 Booster Pump Capacity

Per TCEQ Chapter 290.45(b)(1)(D)(iii), for systems that have two or more pumps, a total capacity 2 gpm per connection are required when no elevated storage is present. The City currently owns eight (8) booster pumps with a total capacity of 5,600 gpm as previously shown in **Table 4**.

When analyzing the City's booster pump capacity of 5,600 gpm with TCEQ's requirement of 2 gpm per connection, the City's booster pump facilities have the capacity to serve 2,800 ESFCs. This booster pump capacity is sufficient to serve the 1,505 ESFCs currently served by the City's water system.

#### 4.1.7 Water System Inventory

A summary of the City's water supply facilities and TCEQ criteria are shown below in **Table 6**.

**Table 6: Water Supply Facilities Inventory**

Facility	City Water Network Capacity	TCEQ Criteria	City Water Network ESFC Capacity
Surface Water	485,000 Gpd <sup>(1)</sup>		
Wells	4,450 gpm	0.6 gpm/ESFC	7,417 ESFCs
Pressure Tank	30,000 gal	12 gal/ESFC <sup>(2)</sup>	2,500 ESFCs
Elevated Storage	0 gal	100 gal/ESFC	N/A ESFCs
Ground Storage	1,050,000 gal		

Facility	City Water Network Capacity	TCEQ Criteria	City Water Network ESFC Capacity
Total Storage	1,050,000 gal	200 gal/ESFC	5,400 ESFCs
Booster Pump	5,600 gpm	2 gpm/ESFC	2,800 ESFCs

Notes:

- (1) The TCEQ does not require a total amount of surface water per ESFC.

#### 4.1.8 Pressure Requirements

Per TCEQ Chapter 290.45(a)(2), a system is required to maintain a normal operation pressure of 35 pounds per square inch (psi) throughout its entire system. A hydraulic model was created and calibrated by IDS using WaterGEMS™ to determine if the City's water distribution system met this criterion.

The water distribution system was modeled under a peak hourly demand to determine minimum pressure in the system. The peak hourly demand was calculated by analyzing the three highest total water use months in the City's system (August, September, October) in 2024. The usage was then averaged to obtain an average day demand for the period in which the City uses the highest amount of water. Based on correspondence with City personnel, a substantial amount of water is used for irrigation within the City. Due to the large amount of irrigation used, a diurnal curve was developed using City smart meter data to obtain a peaking factor, which was then applied to the average day demand to obtain a maximum peak hourly demand. The maximum peak hourly demand is listed in **Section 5.0**

Based on the hydraulic modeling results, the minimum pressure for the peak hourly demand scenario was above 35 psi which meets the minimum TCEQ criterion. A further analysis of pressure within the City's water distribution system is given in **Section 5.0**.

#### 4.1.9 Fire Flow Requirements

Per TCEQ Chapter 290.45(a)(2), a system is required to maintain a minimum pressure of 20 psi throughout its entire system during firefighting, line flushing, and other unusual conditions. The hydraulic model was used to determine if the City's water distribution system met this criterion.

In the hydraulic model, available fire flow was calculated for each fire hydrant in the water distribution system when setting the overall system pressure to 20 psi. A minimum fire flow of 500 gpm was used to identify hydrants within the water distribution system that were unable to provide sufficient fire flow.

Based on the hydraulic modeling results, the water distribution system meets the minimum criteria for TCEQ. However, there are areas in the water distribution that show to have lower available fire flow than is generally accepted as standard by the City. These low available fire flow areas are detailed further in **SECTION 5.0**.

## SECTION 5.0 HYDRAULIC WATER MODEL ANALYSIS

### 5.1 Methodology

IDS utilized the hydraulic water modeling program WaterGEMS to simulate the City's water distribution network under various scenarios. IDS received GIS data and record drawings for water facilities within the City which were then imported to the WaterGEMS program. IDS conducted several site visits and coordinated with City staff to refine the accuracy of the infrastructure within the model including the City's storage, wells, surface water connections, booster pump facilities, fire hydrant locations, water line materials, and water line sizing.

When running the water model analysis, two calculation options were used. A steady state analysis was used initially to capture a "snapshot" of the City's system under peak hourly demand. This allowed IDS to collect results from the City's system under the most strenuous condition anticipated. The second calculation option used was an extended period simulation, this allowed IDS to observe how the system would react within various scenarios over time. Several scenarios were analyzed during the extended period simulation to determine if the City's system could keep up with demand and how feasible running the system under the scenarios would be.

#### 5.1.1 Demand Allocation

IDS analyzed water supply data provided by the City from 2014 to 2024, a graph of the City's historical water use over the past five (5) years is provided in **Exhibit 2**. Over the 5-year period, water use has been consistent between 300 and 400 million gallons per year with variations attributed to weather trends. The anticipated water consumption for the City was assumed to remain flat with minimal undeveloped tracts that could be developed within the City limits. Additionally, the City limits are likely to remain at their current location with no room to expand the City boundary due to being surrounded by other municipalities. The 2024 usage data was used to determine two (2) values for an average day demand. IDS analyzed the three (3) highest water use months within the City (August, September, October) to obtain an average summer day demand to be used in the water model as well as the three (3) lowest water use months (December, January, and February) to obtain an average winter day demand.

As discussed in **SECTION 3.0** of this report, the City's water connections are primarily residential, with approximately 10 non-residential connections. In the hydraulic model, demands for the non-residential connections are assigned based on water billing data provided by the City. The residential demands were allocated evenly between all connections in the system to achieve the average demand.

A diurnal curve was then developed by using smart meter data within the district, data from approximately 50 residential meters was analyzed over the course of several months to develop the

diurnal curve. After analysis, it was determined that the peak hourly demand occurs around 5:00 AM when residents are typically irrigating, the peak hourly multiplier was determined to be 4.6 times the average demand and a copy of the diurnal curve is in **Exhibit 3**. The values for the calculated average day demands and peak hourly demand are in **Tables 7 and 8** below.

**Table 7: Water Model Average Demand Values**

Average Summer Day Demand (MGD)	Average Winter Day Demand (MGD)	Maximum Day Demand (MGD)
1.58	0.51	1.82

**Table 8: Water Model Peak Demand Values**

Peak Summer Demand (GPM)	Peak Winter Demand (GPM)	Peak Demand (GPM)
5,055	1,640	5,800

### 5.1.2 Hydraulic Model Calibration

The hydraulic water model was calibrated using fire hydrant testing data. On October 27, 2025, representatives from IDS, Texas Hydrants, and the City performed and oversaw five (5) fire hydrant static flow tests within the City's water distribution network. In addition to the static flow tests, three (3) pressure loggers were installed on hydrants throughout the City's network and left to collect data for a period of approximately three weeks. The pressure loggers were removed and data provided to IDS on November 25, 2025. The static flow test data was used to calibrate the water mains within the distribution network model. Each of the static flow tests was modeled within WaterGEMS, the roughness coefficient of water mains within the City with similar properties were then modified to achieve the same residual pressure that was measured in the field within the model. This was done iteratively with each of the five (5) static flow tests until the model was calibrated. The data collected from the pressure loggers was then used to further refine and confirm the accuracy of the diurnal curve developed using the smart meter data. A copy of Texas Hydrants' static flow tests and pressure logger data is provided in **Appendix I**.

## 5.2 Steady State Analysis

### 5.2.1 System Pressure Analysis

It was noted in **SECTION 3.0** that the City's water distribution system meets the minimum TCEQ mandated pressure of 35 psi throughout the system when subjected to the peak expected demands. A list of the 5 lowest pressure locations within the system during each demand scenario is given in **Tables 9-11** below.

**Table 9: Minimum Pressure Evaluation (Peak Winter Demand)**

Pressure Value	Water Line Diameter	Water Line Material	Location
50 psi	2"	Cast Iron	Knipp Forest St.
50 psi	2"	Cast Iron	Belin Manor Dr.
50 psi	2"	Cast Iron	Laurie Ln.
49 psi	2"	Cast Iron	Coachman Ln.
48 psi	2"	Cast Iron	Musket Ln.

Notes:

- (1) Scenario was run with one booster pump running at each Water Plant.
- (2) Pressure leaving the Water Plants was approximately 52 psi.

**Table 10: Minimum Pressure Evaluation (Peak Summer Demand)**

Pressure Value	Water Line Diameter	Water Line Material	Location
39 psi	2"	Cast Iron	Knipp Forest St.
41 psi	2"	Cast Iron	Coachman Ln.
42 psi	2"	Cast Iron	Laurie Ln.
42 psi	2"	Cast Iron	Belin Manor Dr.
42 psi	2"	Cast Iron	Musket Ln.

Notes:

- (1) Scenario was run with three booster pumps running at City Hall and two booster pumps running at Taylorcrest
- (2) Pressure leaving the Water Plants was approximately 52 psi.

**Table 11: Minimum Pressure Evaluation (Peak Demand)**

Pressure Value	Water Line Diameter	Water Line Material	Location
38 psi	2"	Cast Iron	Knipp Forest St.
39 psi	2"	Cast Iron	Belin Manor Dr.
39 psi	2"	Cast Iron	Coachman Ln.
40 psi	2"	Cast Iron	Laurie Ln.
41 psi	2"	Cast Iron	Musket Ln.

Notes:

- (1) Scenario was run with three booster pumps running at each Water Plant.
- (2) Pressure leaving the Water Plants was approximately 54 psi.

A pressure map of the City's water distribution system under each of the steady state analysis scenarios is included as **Exhibit 4**.

### 5.2.2 System Headloss Analysis

Head loss is a measure of the reduction in the total head of the fluid, which are due to the frictional resistance of the piping system. It is important to analyze head loss throughout the City's system to assess which areas of the system may be attributing to inadequate pressure and/or flow. The maximum criteria used for evaluating the head loss gradient within the system's pipe network is given as 7 ft. of head loss per 1,000 ft. of pipe.

Based on the hydraulic modeling results, there are several water lines within the City that exceed the maximum criteria presented above. The water lines which exceed the criteria are displayed in **Table 13** below. The headloss evaluation was hydraulically modeled using an average summer day peak demand.

**Table 13: Headloss Evaluation Results**

Headloss Gradient (ft/1,000 ft)	Water Line Diameter	Water Line Material	Location
40	2"	Cast Iron	Knipp Forest St.
34	2"	Cast Iron	Musket Ln.
34	2"	Cast Iron	Belin Manor Dr.
32	6"	Asbestos Cement	City Hall Water Plant
28	2"	Cast Iron	Stepping Stone Ln.
28	2"	Cast Iron	Coachman Ln.
22	2"	Cast Iron	Doncaster Rd.
22	2"	Cast Iron	Laurie Ln.
22	2"	Cast Iron	Timberknoll St.
22	2"	Cast Iron	Brandon Way
17	2"	Cast Iron	Stoney Ridge Ln.
17	2"	PVC	Surrey Ln.
13	2"	Cast Iron	Concord Cir.
13	2"	Cast Iron	Stuckey Ln.
13	2"	Cast Iron	Carl Ln.
9	3"	Asbestos Cement	Longworth Ln.

A velocity map of the City's system under the peak demand scenario is included in this report as **Exhibit 5**.

### 5.2.3 Fire Flow Analysis

It was noted in **SECTION 3.0** that the City's water distribution system meets the minimum TCEQ requirements for fire flow. However, IDS further analyzed available fire flow by using a minimum available capacity of 1,500 gpm per the City's request. The water model was set to peak demand during an average summer day with all available booster pumps running (six total) and a list of each hydrant's available fire flow was produced. A fire hydrant fails the criteria when it cannot produce at least 1,500 gpm while maintaining a residual pressure of 20 psi in the surrounding area. **Table 14** below is a list of the three (3) hydrants that would not be able to produce at least 1,500 gpm during peak demand while maintaining a residual pressure of 20 psi. A map showing the available fire flow for all hydrants in the system while meeting the criteria outlined above is available as **Exhibit 6**.

**Table 14: Failed Fire Criteria Evaluation**

Available Fire Flow (gpm)	Hydrant Location
1,217	Tamerlaine Drive
1,268	Tamerlaine Drive
1,367	Gentilly Place

To increase the available fire flow at these three (3) locations above 1,500 gpm, the existing 3" Asbestos Cement water lines located on Longworth Lane and Gentilly Place should be upsized to 6" PVC water lines. A list of all recommended rehabilitation locations is shown in **Exhibit 1.1**.

### 5.3 Extended Period Simulation

The extended period simulations were run for the average summer, average winter, and maximum expected day demands. Each scenario was run for a period of 24 hours. IDS analyzed several factors during the extended period simulations including the total amount of water stored vs. water demanded over time, minimum pressure in the system over time, and run time of the wells and booster pumps. Each of the trends was compared to a baseline simulation that was run of the City's existing infrastructure. All hydraulic model extended period simulation results can be viewed in **Appendix B**.

#### 5.3.1 Baseline 24-hr Extended Period Simulation

A baseline extended period simulation was conducted to compare against the other extended period simulations in **Section 5.3.2** through **Section 5.3.5**. In the baseline scenario all City water infrastructure is kept active and available. As discussed in the steady state analysis section, the water system is capable of operating effectively while under the three demand scenarios given in **Table 8**, with system pressure being maintained and water supply outweighing the demand in the system. See **Table 14A** below for a summary of the water supply runtimes in each demand scenario.

**Table 14A: Baseline EPS Water Supply Summary**

Demand Scenario	Water Well No. 1 Runtime	Water Well No. 3 Runtime	Water Well No. 4 Runtime	Water Well No. 5 Runtime	COH SW Runtime (WP No. 1)	COH SW Runtime (WP No. 2)
Average Winter	0 hr/day	4 hr/day	4 hr/day	0 hr/day	0 hr/day	0.5 hr/day
Average Summer	3 hr/day	13 hr/day	13 hr/day	3 hr/day	1 hr/day	1.5 hr/day
Maximum Day	4 hr/day	13 hr/day	13 hr/day	4 hr/day	1 hr/day	3 hr/day

#### 5.3.2 Removal of City of Houston Surface Water

The first extended period simulation that was run in the hydraulic model simulated the removal of the City's surface water supply lines. All other City infrastructure was kept active in this scenario.

The results of the simulation indicate that the system is feasible to operate under these conditions in the three demand scenarios given in **Table 8**. A slight increase in Water Well runtime is seen during the

scenario to compensate for the loss of the surface water connection. A summary of the model results is in **Table 15** below.

**Table 15: Removal of COH Surface Water EPS Summary**

<i>Demand Scenario</i>	<i>Water Supply/Storage Adequate?</i>	<i>Adequate System Pressure Maintained?</i>	<i>Increase in Water Supply Runtime from Baseline (Taylorcrest)</i>	<i>Increase in Water Supply Runtime from Baseline (City Hall)</i>
Average Winter	Yes	Yes	0 hr/day	0.5 hr/day
Average Summer	Yes	Yes	0 hr/day	0.5 hr/day
Maximum Day	Yes	Yes	0.5 hr/day	2 hr/day

### 5.3.3 Removal of Ground Storage Tanks

The second extended period simulation that was run in the hydraulic model simulated the removal of the City's GST 1 at the Taylorcrest Water Plant. This tank is set to be taken out of service, demolished, and replaced in 2026. All other City infrastructure was kept active during this scenario.

The results of the simulation indicate that the system is feasible to operate under these conditions in all demand scenarios. A minor increase in water well runtime at the Taylorcrest plant is seen in the maximum demand scenario. Overall, the removal of the GST from service has a minimal impact on the system and it is not recommended to increase the capacity of the tank when replaced. A summary of the model results is in **Table 16** below.

**Table 16: Removal of GST 1 at Taylorcrest EPS Summary**

<i>Demand Scenario</i>	<i>Water Supply/Storage Adequate?</i>	<i>Adequate System Pressure Maintained?</i>	<i>Increase in Water Supply Runtime from Baseline (Taylorcrest)</i>	<i>Increase in Water Supply Runtime from Baseline (City Hall)</i>
Average Winter	Yes	Yes	0 hr/day	0 hr/day
Average Summer	Yes	Yes	0 hr/day	0 hr/day
Maximum Day	Yes	Yes	0.5 hr/day	0 hr/day

The system was then modeled by removing GST No. 2 at the Taylorcrest Water Plant. This scenario was run to give information on how the system would operate if GST No. 2 is ever taken out of service for rehabilitation or maintenance. Overall, the system performed similarly to the removal of GST No. 1 and the water system is feasible to operate under these conditions with a minimal impact. A summary of the model results is in **Table 16A** below.

**Table 16A: Removal of GST 2 at Taylorcrest EPS Summary**

Demand Scenario	Water Supply/Storage Adequate?	Adequate System Pressure Maintained?	Increase in Water Supply Runtime from Baseline (Taylorcrest)	Increase in Water Supply Runtime from Baseline (City Hall)
Average Winter	Yes	Yes	0 hr/day	0 hr/day
Average Summer	Yes	Yes	0 hr/day	0 hr/day
Maximum Day	Yes	Yes	0.5 hr/day	0 hr/day

The system was then modeled by removing the City Hall water plant from service. This scenario was run to simulate the City Hall water plant GST being taken out of service for maintenance or rehabilitation. The model indicated that under summer and maximum day demands that system pressure fall below 20 psi due to not being able to utilize the storage and booster pump facilities located at the plant. It is recommended that if this water plant is taken out of service for maintenance it be during winter months or that a drought contingency plan be implemented that includes irrigation restrictions, this is to flatten out the demand over the course of the day and eliminate high peak demands in the system. A summary of the model results is in **Table 16B** below.

**Table 16B: Removal of City Hall GST EPS Summary**

Demand Scenario	Water Supply/Storage Adequate?	Adequate System Pressure Maintained?	Increase in Water Supply Runtime from Baseline (Taylorcrest)	Increase in Water Supply Runtime from Baseline (City Hall)
Average Winter	Yes	Yes	4 hr/day	N/A
Average Summer	Yes	No	9 hr/day	N/A
Maximum Day	Yes	No	9 hr/day	N/A

#### 5.3.4 Emergency Scenario No. 1

After discussion with the City, IDS developed two (2) emergency scenarios in which to run the extended period simulation. The first emergency scenario analyzes a total loss of power to the City water facilities while having to rely on emergency generator backup power. In the first scenario, the following facilities are offline:

- GST No. 1 at the Taylorcrest WP,
- Two (2) booster pumps at the Taylorcrest WP,
- Water Well No. 3,
- Both City of Houston surface water connections.

Note that the remaining off-site well (Water Well No. 5) would remain online in an emergency as it has its own emergency backup power.

The results of the simulation indicate that the system under these conditions is feasible to operate during the average winter demands, with a notable increase in Water Well No. 4 runtime to account for the loss of other wells and the City of Houston surface water in the system. During the average summer demand scenario, the lack of booster pumps in operation at Taylorcrest contributed to a loss of pressure in the system below 20 psi during peak usage hours which would result in a boil water notice. Additionally, the City Hall Water Plant cannot refill at a fast enough rate due to the lack of water supply, resulting in an empty tank at peak hours. The same loss of system pressure occurs during the maximum day demand scenario in addition to demand outweighing the supply of water. Full-plant backup power at Taylorcrest as well as replacement of Water Well No. 3 and installation of a generator at the well site would allow feasible operation under an emergency scenario year-round . A summary of the model results is in **Table 18** below.

**Table 18: Emergency Scenario No. 1 EPS Summary**

Demand Scenario	Water Supply/Storage Adequate?	Adequate System Pressure Maintained?	Increase in Water Supply Runtime from Baseline (Taylorcrest)	Increase in Water Supply Runtime from Baseline (City Hall)
Average Winter	Yes	Yes	0 hr/day	4.5 hr/day
Average Summer	No	No	0 hr/day	7.5 hr/day
Maximum Day	No	No	1.5 hr/day	5.5 hr/day

### 5.3.5 Emergency Scenario No. 2

In the second emergency scenario, the following facilities are offline:

- GST No. 1 at the Taylorcrest WP,
- Water Well No. 1,
- Water Well No. 3,
- Both City of Houston surface water connections.

Note that the difference in offline facilities from the first emergency scenario is due to the emergency generator at the Taylorcrest WP only being able to power either all booster pumps or the on-site well (Water Well No. 1).

The results of the simulation indicate that the system under these conditions is feasible to operate during the average winter demands, with a notable increase in Water Well No. 4 and Water Well No. 5

runtimes to account for the loss of other wells and the City of Houston surface water in the system. During the average summer demand scenario, adequate pressure in the system is maintained due to keeping all booster pumps online. However, the loss of the onsite well at Taylorcrest contributes to supply not being able to keep up with demand during both the summer and maximum day scenarios during peak usage hours. This configuration is recommended in lieu of Emergency Scenario No. 1 due to this configuration being able to maintain adequate pressure in the system during the three demand scenarios that were analyzed. Full-plant backup power at Taylorcrest as well as replacement of Water Well No. 3 and installation of a generator at the well site would allow feasible operation under an emergency scenario year-round. A summary of the model results is in **Table 20** below.

**Table 20: Emergency Scenario No. 2 EPS Summary**

Demand Scenario	Water Supply/Storage Adequate?	Adequate System Pressure Maintained?	Increase in Water Supply Runtime from Baseline (Taylorcrest)	Increase in Water Supply Runtime from Baseline (City Hall)
Average Winter	Yes	Yes	1 hr/day	3.5 hr/day
Average Summer	No	Yes	1 hr/ day	5 hr/day
Maximum Day	No	Yes	1.5 hr/day	5.5 hr/day

## SECTION 6.0 WATER SYSTEM IMPROVEMENTS

### 6.1 Recommendations

Based on the Hydraulic Modeling results outlined in **Section 5.0**, rehabilitation of areas within the water distribution system, as well as replacement of various water infrastructure components, is recommended to further ensure that the City's water system operates efficiently during high demand scenarios and emergency situations. Additionally, after discussion with the City, IDS contracted Guzman Engineering to conduct a site visit and evaluate the condition of various electrical systems associated with the City's water facilities. The electrical assessment is provided in **Appendix A** and the recommendations outlined in that report are reflected in the following sections. It is anticipated that the City will phase these improvements over the course of several years through their Capital Improvement Plan (CIP). The **Table 20A** below contains a summary of the recommendations and the proposed improvements, the recommendations are listed in order of priority and were evaluated on the basis of cost versus overall benefit to the City's water system. Risk of failure and the impact of a failure was also evaluated when prioritizing the improvements.

Table 20A. Recommendation Priority Summary

Proposed Improvement	Cost	Project Driving Factors	Risk of Failure <sup>3</sup>	Result of Failure <sup>4</sup>	Overall Priority Ranking
Water Line Replacement (Package 1) <sup>2</sup>	\$2,280,000	<ul style="list-style-type: none"> <li>•Reduces pressure loss in the water distribution system and increases capacity.</li> <li>•Increases available fire flow to more than 1,500 GPM.</li> <li>•Reduces risk of water line breaks and maintenance.</li> </ul>	M	L	1
Water Well No. 3 Emergency Power Improvements (Portable Generator Connection)	\$50,000	<ul style="list-style-type: none"> <li>•Provides additional supply to water system during power loss events.</li> <li>•Provides resiliency to the existing system while planning for a new well.</li> </ul>	M	M	2
Water Plant Back-Up Power Improvements – Generator Swap between Water Plants <sup>5</sup>	\$140,000	<ul style="list-style-type: none"> <li>• Allows both water plants to operate at full capacity during emergency power loss events.</li> <li>• Reduces the risk of pressure falling below 20 psi in the system during emergency power loss events.</li> <li>• Improves amount of available water supply during emergency power loss events.</li> </ul>	M	H	3
Complete Power System Rehabilitation at City Hall Water Plant <sup>6</sup>	\$1,550,000	<ul style="list-style-type: none"> <li>• Reduces the risk of MCC and electrical system failure in the future.</li> <li>• A more modern system allows for easier access to maintenance services and replacement parts.</li> </ul>	H	H	4
Complete Power System Rehabilitation at Taylorcrest Water Plant <sup>6</sup>	\$1,800,000	<ul style="list-style-type: none"> <li>• Reduces the risk of MCC and electrical system failure in the future.</li> <li>• A more modern system allows for easier access to maintenance services and replacement parts.</li> </ul>	H	H	5
Water Line Replacement (Package 2)	\$1,510,000	<ul style="list-style-type: none"> <li>•Reduces pressure loss in the water distribution system and increases capacity.</li> <li>•Increases available fire flow.</li> <li>•Reduces risk of water line breaks and maintenance.</li> </ul>	M	L	6
Water Line Replacement (Package 3)	\$1,260,000	<ul style="list-style-type: none"> <li>•Reduces pressure loss in the water distribution system and increases capacity.</li> <li>•Increases available fire flow.</li> <li>•Reduces risk of water line breaks and maintenance.</li> </ul>	M	L	7
Water Line Replacement (Package 4)	\$830,000	<ul style="list-style-type: none"> <li>•Reduces pressure loss in the water distribution system and increases capacity.</li> <li>•Increases available fire flow.</li> <li>•Reduces risk of water line breaks and maintenance.</li> </ul>	M	L	8
Water Well No. 3 Replacement	\$5,830,000	<ul style="list-style-type: none"> <li>• Increased water supply flow in the system.</li> <li>• Reduces the risk of water well no. 3 failure and maintenance.</li> </ul>	L	L	9
Water Line Replacement (Package 5)	\$1,310,000	<ul style="list-style-type: none"> <li>•Reduces pressure loss in the water distribution system and increases capacity.</li> <li>•Increases available fire flow.</li> <li>•Reduces risk of water line breaks and maintenance.</li> </ul>	M	L	10

## Notes:

- (1) Estimates shown include Construction, Design, Surveying, CPS, Observation, and Material Testing Costs.
- (2) Limits of water line replacement to be discussed with the City and confirmed prior to start of design.
- (3) Risk of failure was evaluated as Low (L), Medium (M), or High (H).
- (4) An existing system failure was evaluated as a Low (L), Medium (M), or High (H) impact to the City's water system.
- (5) Existing generator at City Hall Water Plant is approximately 20-years old.
- (6) Existing Motor Control Centers are currently 40-years old.

It is recommended that while awaiting the completion of the Emergency Backup Power Improvements project that the City incorporates drought restrictions on water use during emergencies when high demand in the system is present. It is also recommended to implement these restrictions if the City Hall water plant is taken out of service for any period of time outside of the Winter months. IDS calculated that a 50% reduction in peak usage is required during summer and maximum demand periods to maintain adequate pressure in the system under all emergency or construction scenarios. This was calculated to be a maximum demand of 2,930 GPM. Limiting water distribution to this flow rate will allow the city to operate efficiently with the current infrastructure during emergency conditions. Recommendations based on the water modeling evaluation and discussion with the City included in the following sections.

### **6.1.1 Water Line Replacement**

It is recommended that the low pressure and high head loss areas within the water distribution system be rehabilitated/replaced and upsized to a larger diameter. All 2"-4" diameter lines are recommended to be phased out of the system with the lines that increase fire flow in the system taking priority. Followed by the low-pressure locations in the system that are almost exclusively located on 2" to 4" diameter cast iron or asbestos cement lines (See **Section 5.2.1**); these are recommended to be upsized to 6" in diameter and replaced with PVC pipe. A list of the streets where water modeling indicated low fire flow, high headloss, or low pressures line is given in **Table 21** below.

**Table 21: Water Line Replacement Recommendation Summary (High Priority)**

Existing Water Line Diameter	Existing Water Line Material	Location	Proposed Water Line Diameter	Proposed Water Line Material
2"	Cast Iron	Knipp Forest St.	6"	PVC
2"	Cast Iron	Belin Manor Dr.	6"	PVC
2"	Cast Iron	Laurie Ln.	6"	PVC
2"	Cast Iron	Coachman Ln.	6"	PVC
2"	Cast Iron	Doncaster Rd.	6"	PVC
2"	Cast Iron	Musket Ln.	6"	PVC
2"	Cast Iron	Stoney Ridge Ln.	6"	PVC
2"	Cast Iron	Stuckey Ln.	6"	PVC
2"	Cast Iron	Concord Cir.	6"	PVC
2"	Cast Iron	Brandon Way	6"	PVC
2"	Cast Iron	Stepping Stone Ln.	6"	PVC
2"	Cast Iron	Timberknoll St.	6"	PVC
2"	Cast Iron	Stoney Ridge Ln.	6"	PVC
2"	PVC	Surrey Ln.	6"	PVC
3"	Asbestos Cement	Longworth Ln.	6"	PVC
3"	Asbestos Cement	Gentilly Pl.	6"	PVC
6"	Asbestos Cement	City Hall WP	12"	PVC

The Opinion of Probable cost (OPC) for water line replacement is broken down into five (5) packages based on priority and location of the lines. The Opinion of Probable Cost for the water line replacement is shown in **Table 21A** below and a detailed cost estimate is given in **Appendix C**. Additionally, an exhibit highlighting all areas that are recommended to be replaced is included as **Exhibit 1.1**.

**Table 21A. Water Line Replacement OPC**

Package No.	Opinion of Probable Cost
1	\$2,280,000
2	\$1,510,000
3	\$1,260,000
4	\$830,000
5	\$1,310,000
<b>Total</b>	<b>\$7,190,000</b>

**6.1.2 Ground Storage Tank Replacement**

Per the Preliminary Engineering Report – Inspection and Evaluation of Water Storage Tanks at Water Plant No. 1, GST-1, GST-2, HPT-1, and HPT-2 dated September 2, 2025 it is recommended to replace GST No. 1 at Water Plant No. 1 with a 0.25 MGD tank in the same location. The modeling evaluation and regulatory compliance checks contained within this report confirm that the City’s storage capacity is

adequate and the tank size does not need to be increased. The Opinion of Probable Cost for this project is **\$1,400,000** and a detailed cost estimate is given in **Appendix D**.

Additional recommendations for long term planning in related to the City's water storage facilities were included in the Preliminary Engineering Report – Inspection and Evaluation of Water Storage Tanks at Water Plant No. 1, GST-1, GST-2, HPT-1, and HPT-2 dated September 2, 2025. These recommendations included the inspection and rehabilitation of GST-2, and the inspection and rehabilitation of HPT-1 and HPT-2. These recommendations should be considered in future Capital Improvements planning.

### **6.1.3 Water Well Replacement**

It is understood that Water Well No. 3 is currently operating at approximately 8.5% below its design point and it is recommended to plan for the eventual replacement of the well. Replacement of the well would allow the City to maintain adequate water supply during the Emergency Scenarios outlined in **Section 5.0**. The Opinion of Probable cost for the installation of a new well is **\$5,780,000** and a detailed cost estimate is given in **Appendix E**. Note that this does not include costs related to land acquisition for the new water well site. The cost estimate also includes the approximate cost to perform a siting study to evaluate new potential well locations which were outside the scope of this study. It is understood that no back-up power is located at this off-site well and it is therefore recommended that a generator “quick connect” cabinet be installed on site to be utilized by a trailer mounted generator during emergency scenarios while awaiting the drilling of a new well. The Opinion of Probable cost for the installation of a generator connection point is estimated to be no more than **\$50,000** and a detailed cost estimate is given in **Appendix A**.

### **6.1.4 Taylorcrest Water Plant (WP No. 1) Electrical Improvements**

This recommendation is for improvements to the electrical systems at the Taylorcrest Water Plant. It is understood that Taylorcrest does not have the necessary emergency power capacity to run the entirety of the water plant's facilities. Reduction in water supply and booster pump capacity is detrimental to the system in an emergency scenario under high demand. Based on the electrical load analysis and system evaluation presented in **Appendix A**, the existing generators at WP No. 1 and WP No. 2 can be swapped to provide full plant-wide back-up power at both locations. The Opinion of Probable Cost for the generator modifications is **\$140,000** and a detailed cost estimate is given in **Appendix H**. It should be noted that although the existing generator at Taylorcrest is in good condition, the existing generator at City Hall is aging and there is risk associated with its remaining life span. Additionally, based on the age of the motor control center and other electrical items, it is recommended that the City plan for a full power system rehabilitation of the Taylorcrest Water Plant site in the future. The Opinion of Probable Cost for the rehabilitation of the electrical systems is **\$1,800,000** and a detailed cost estimate is given in **Appendix F**.

**6.1.5 City Hall Water Plant (WP No. 2) Electrical Improvements**

It is understood that the electrical system at WP No. 2 is aging, based on conversations with City and the electrical system evaluation included in **Appendix A**. It is recommended that the City plan for a complete power system rehabilitation of the facility. The Opinion of Probable cost for the rehabilitation is **\$1,550,000** and a detailed cost estimate is provided in **Appendix G**.

EXHIBITS

**Exhibit 1**  
**Water System GIS Map**



**Legend**

- Hydrant
- Valves

**Material**

- AC
- Cast Iron
- PVC C90
- City Limits

This product is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and represents only the approximate relative location of property boundaries.

**IDS Engineering Group**

13430 NW Freeway Suite 700  
Houston, Texas 77040  
713.462.3178  
TxEng Firm 2726  
TxSurv Firm 10110700

**CITY OF BUNKER HILL VILLAGE**


**WATER LINE COMPARISON**

0 200 400 800 1,200 1,600 Feet

1 inch = 400 feet

N


**Exhibit 1.1**  
**Water Line Replacement Locations**

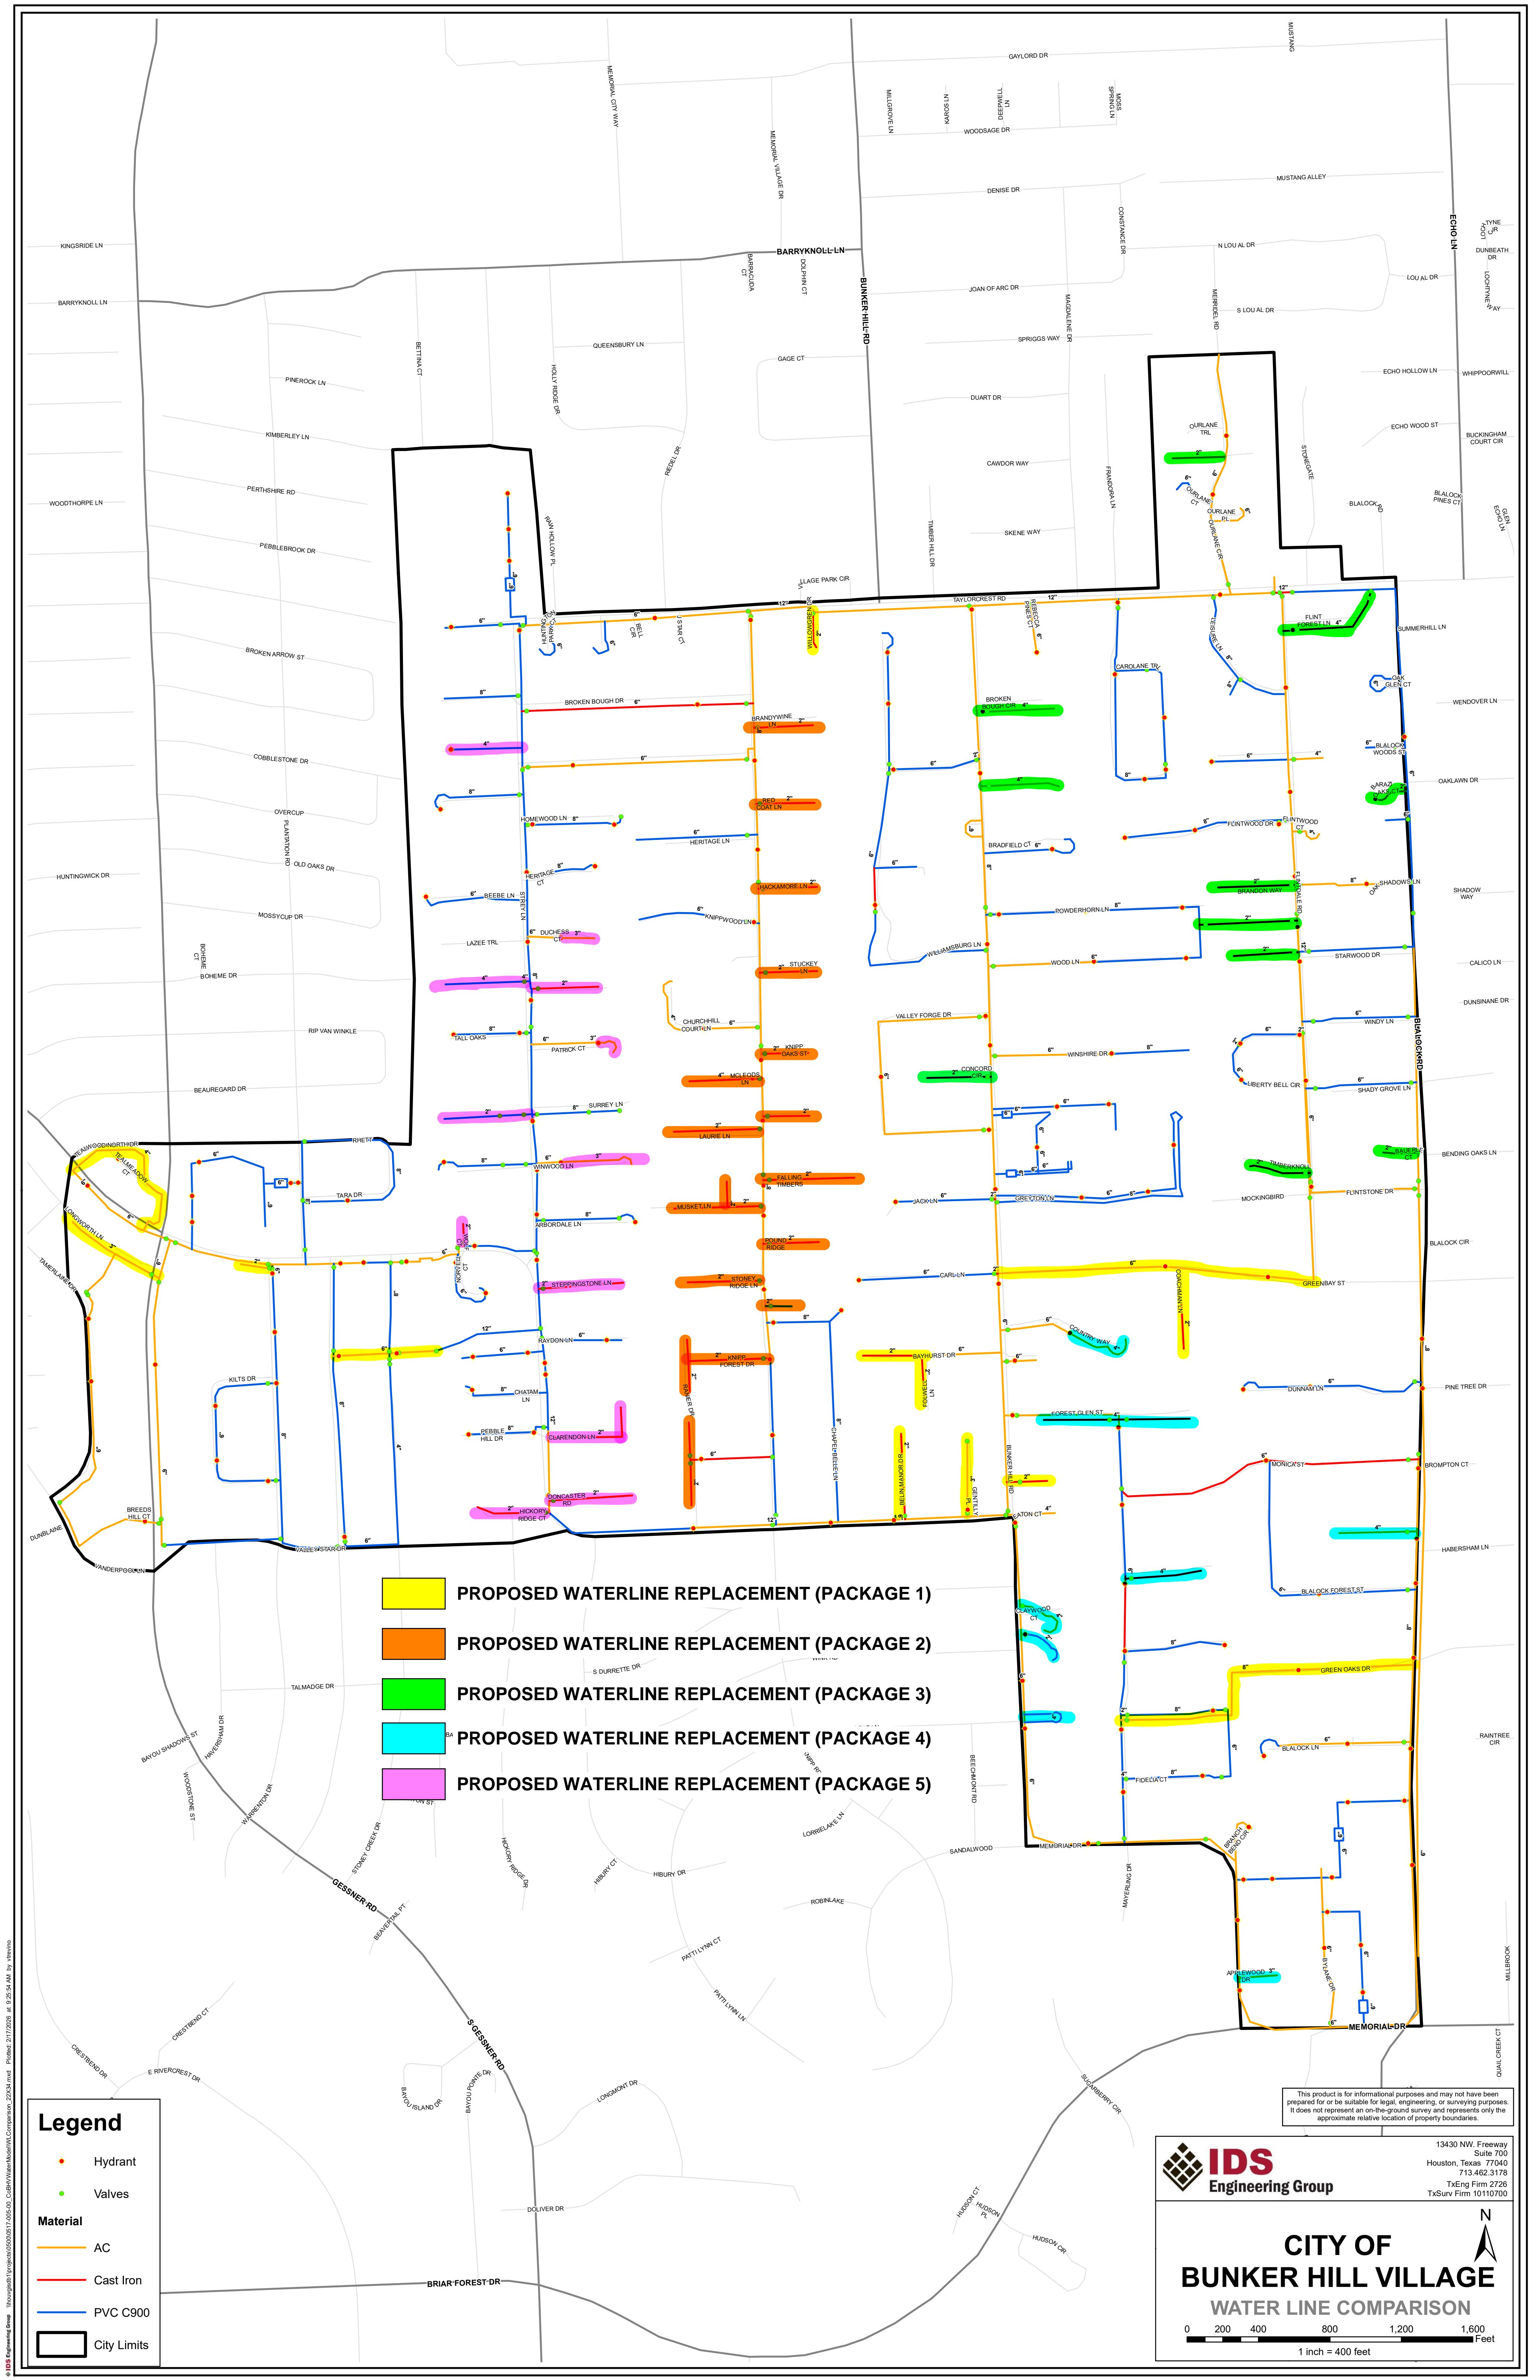

- PROPOSED WATERLINE REPLACEMENT (PACKAGE 1)
- PROPOSED WATERLINE REPLACEMENT (PACKAGE 2)
- PROPOSED WATERLINE REPLACEMENT (PACKAGE 3)
- PROPOSED WATERLINE REPLACEMENT (PACKAGE 4)
- PROPOSED WATERLINE REPLACEMENT (PACKAGE 5)

- Legend**
- Hydrant
  - Valves
- Material**
- AC
  - Cast Iron
  - PVC C900
  - City Limits

This product is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and represents only the approximate relative location of property boundaries.




**IDS**  
Engineering Group

13430 NW Freeway  
Suite 700  
Houston, Texas 77040  
713.462.3178  
TxEng Firm 2726  
TxSurv Firm 10110700

**CITY OF**  
**BUNKER HILL VILLAGE**  
**WATER LINE COMPARISON**

0 200 400 800 1,200 1,600  
Feet


1 inch = 400 feet




© IDS Engineering Group - 1/20/2025 10:00:00 AM - 1/20/2025 10:00:00 AM - Project: 21722025 - at 2:25:54 AM by: jhmoore

**Exhibit 2**  
**Historical Water Use**

### Historical Annual Water Consumption

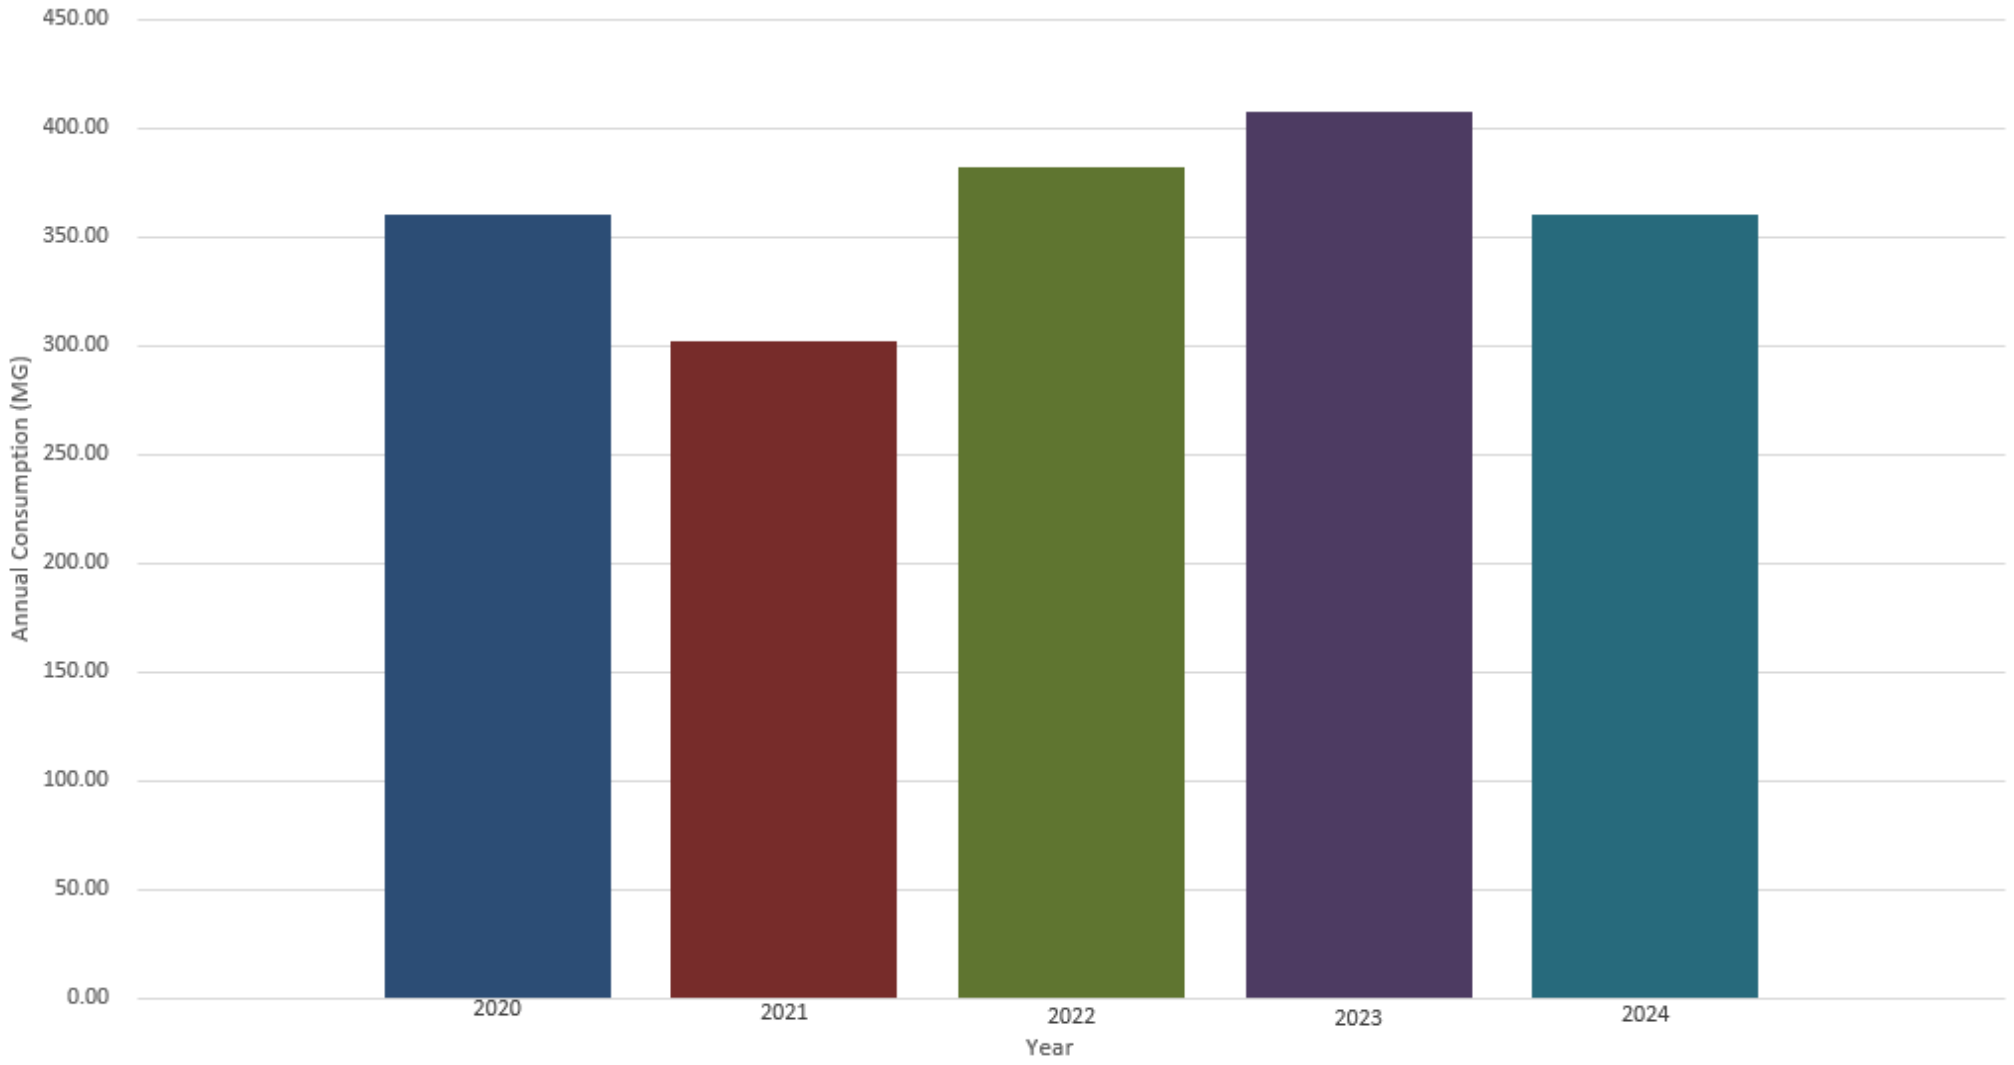


### Historical Monthly Water Consumption

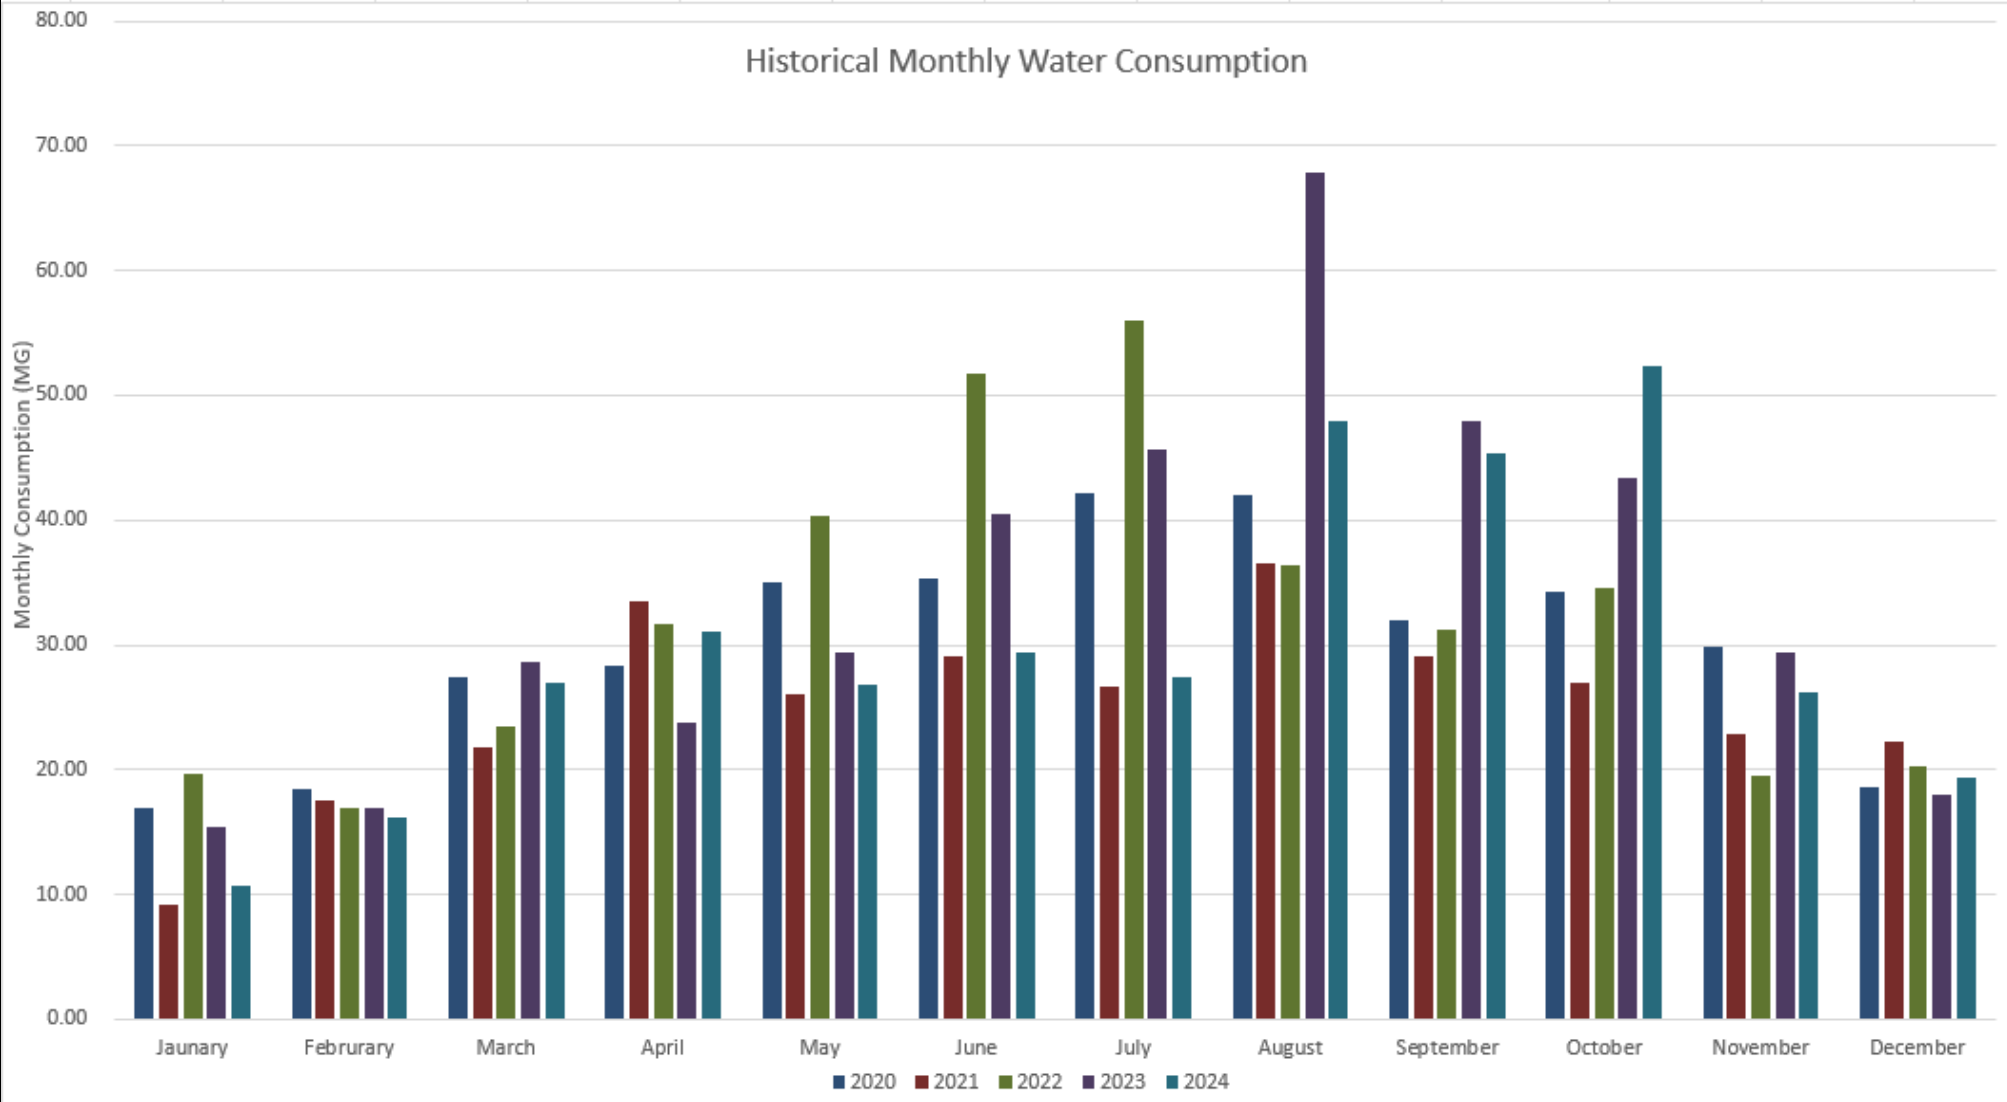


**Exhibit 3**  
**Water Use Diurnal Curve**

Demand Dirurnal Curve

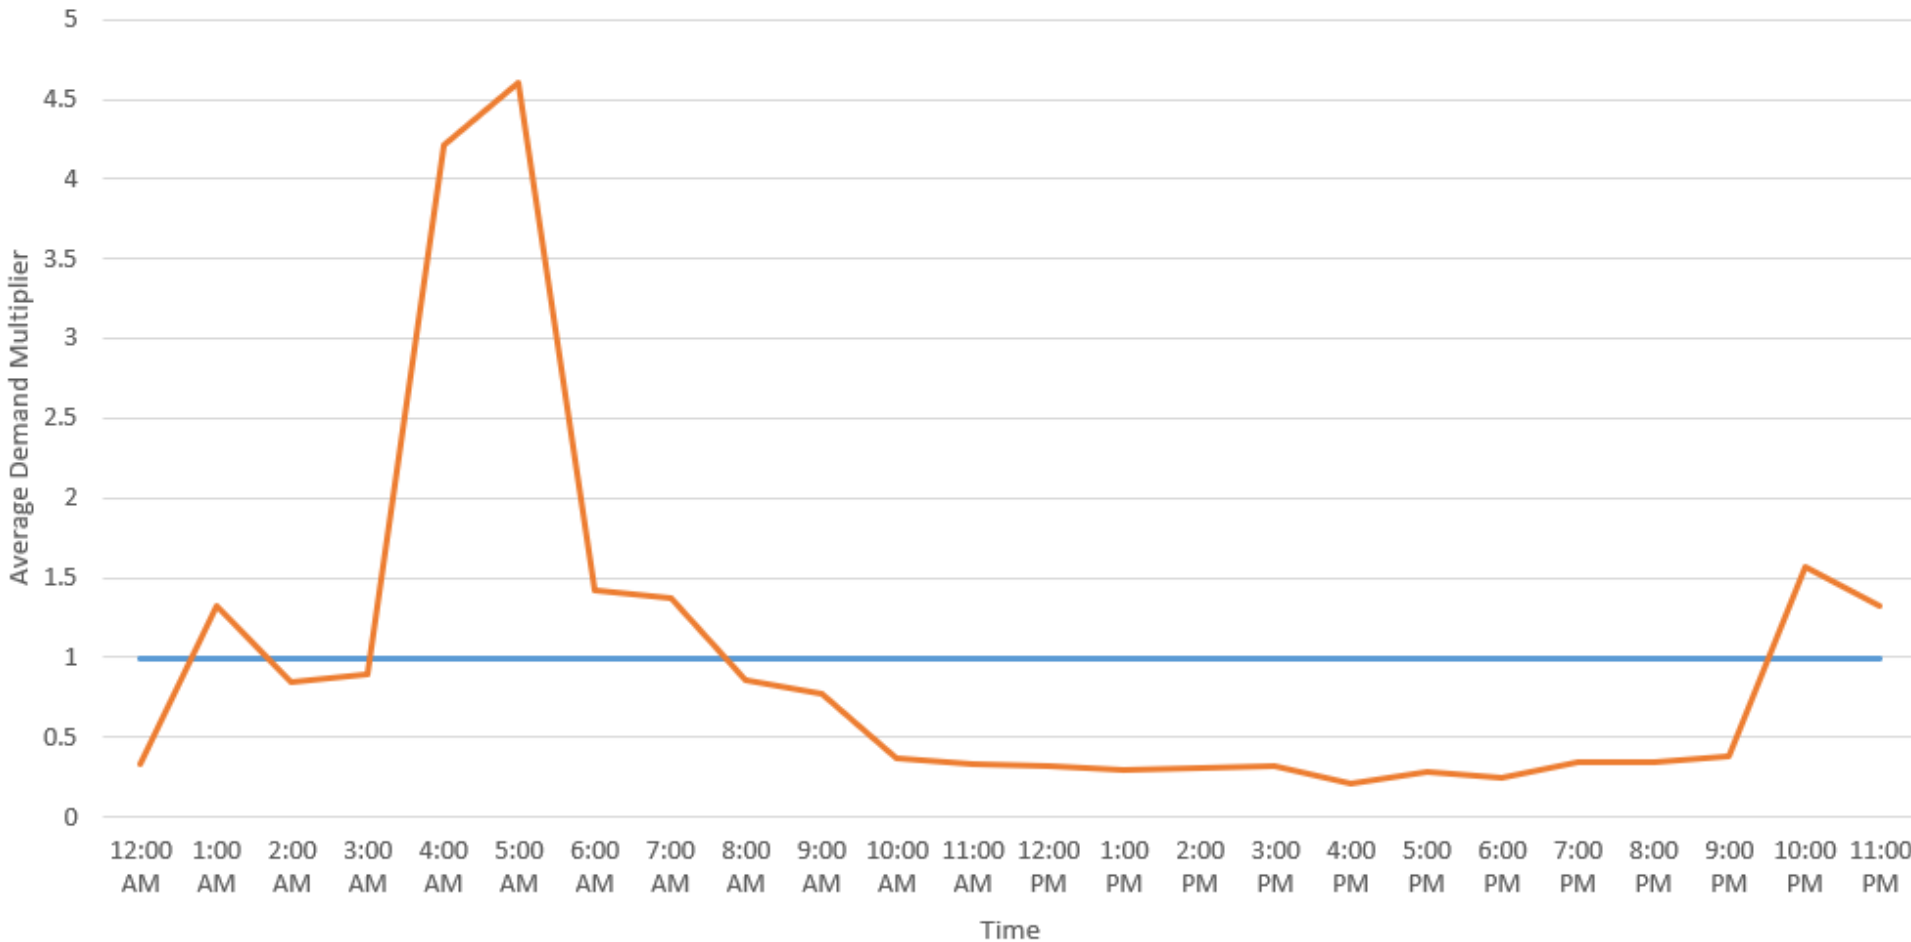

— Average Demand — Demand vs. Time

**Exhibit 4**  
**Steady State Analysis Pressure Maps**

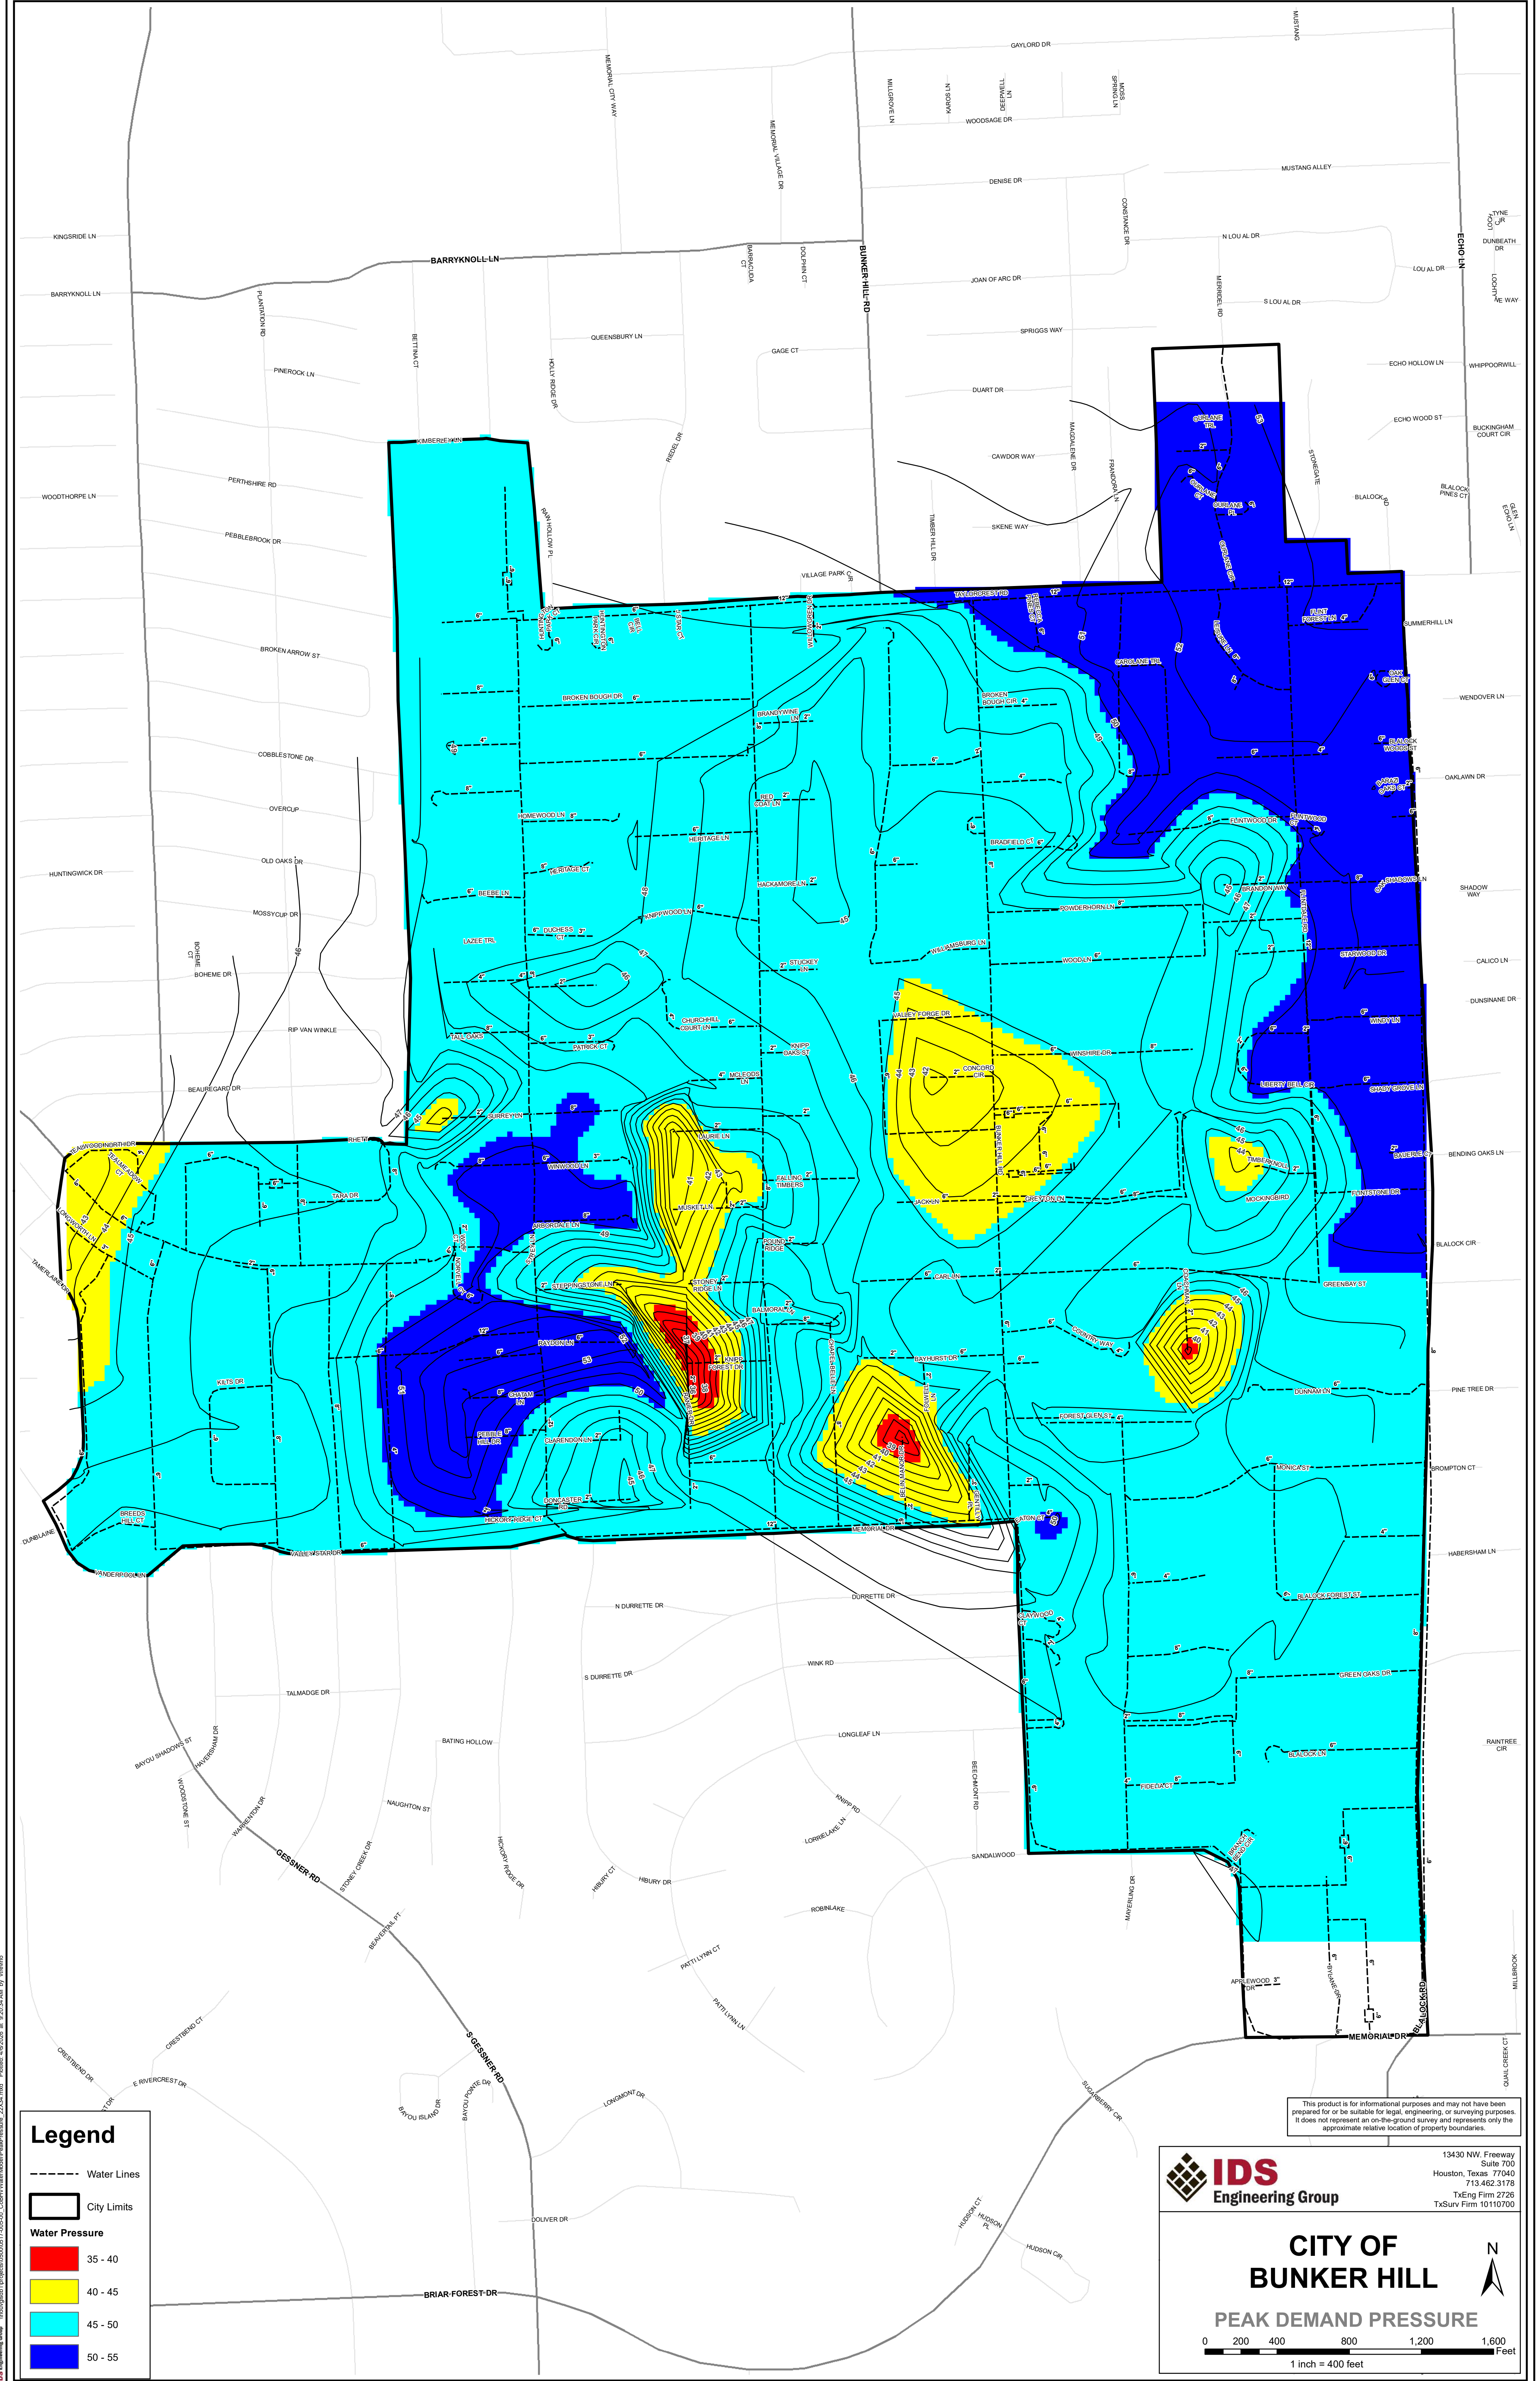


© 2024 Engineering Group. This drawing is the property of Engineering Group and is not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Engineering Group.

This product is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and represents only the approximate relative location of property boundaries.

**Legend**

- Water Lines
- City Limits
- Water Pressure**
- 35 - 40
- 40 - 45
- 45 - 50
- 50 - 55




**IDS**  
Engineering Group

13430 NW Freeway  
 Suite 700  
 Houston, Texas 77040  
 713.462.3178  
 TxEng Firm 2726  
 TxSurv Firm 10110700

**CITY OF BUNKER HILL**

**PEAK DEMAND PRESSURE**




0 200 400 800 1,200 1,600  
Feet

1 inch = 400 feet

© 2024 Engineering Group. This drawing is the property of Engineering Group and is not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of Engineering Group.

**Exhibit 5**  
**Steady State Analysis Pipe Velocity Maps**

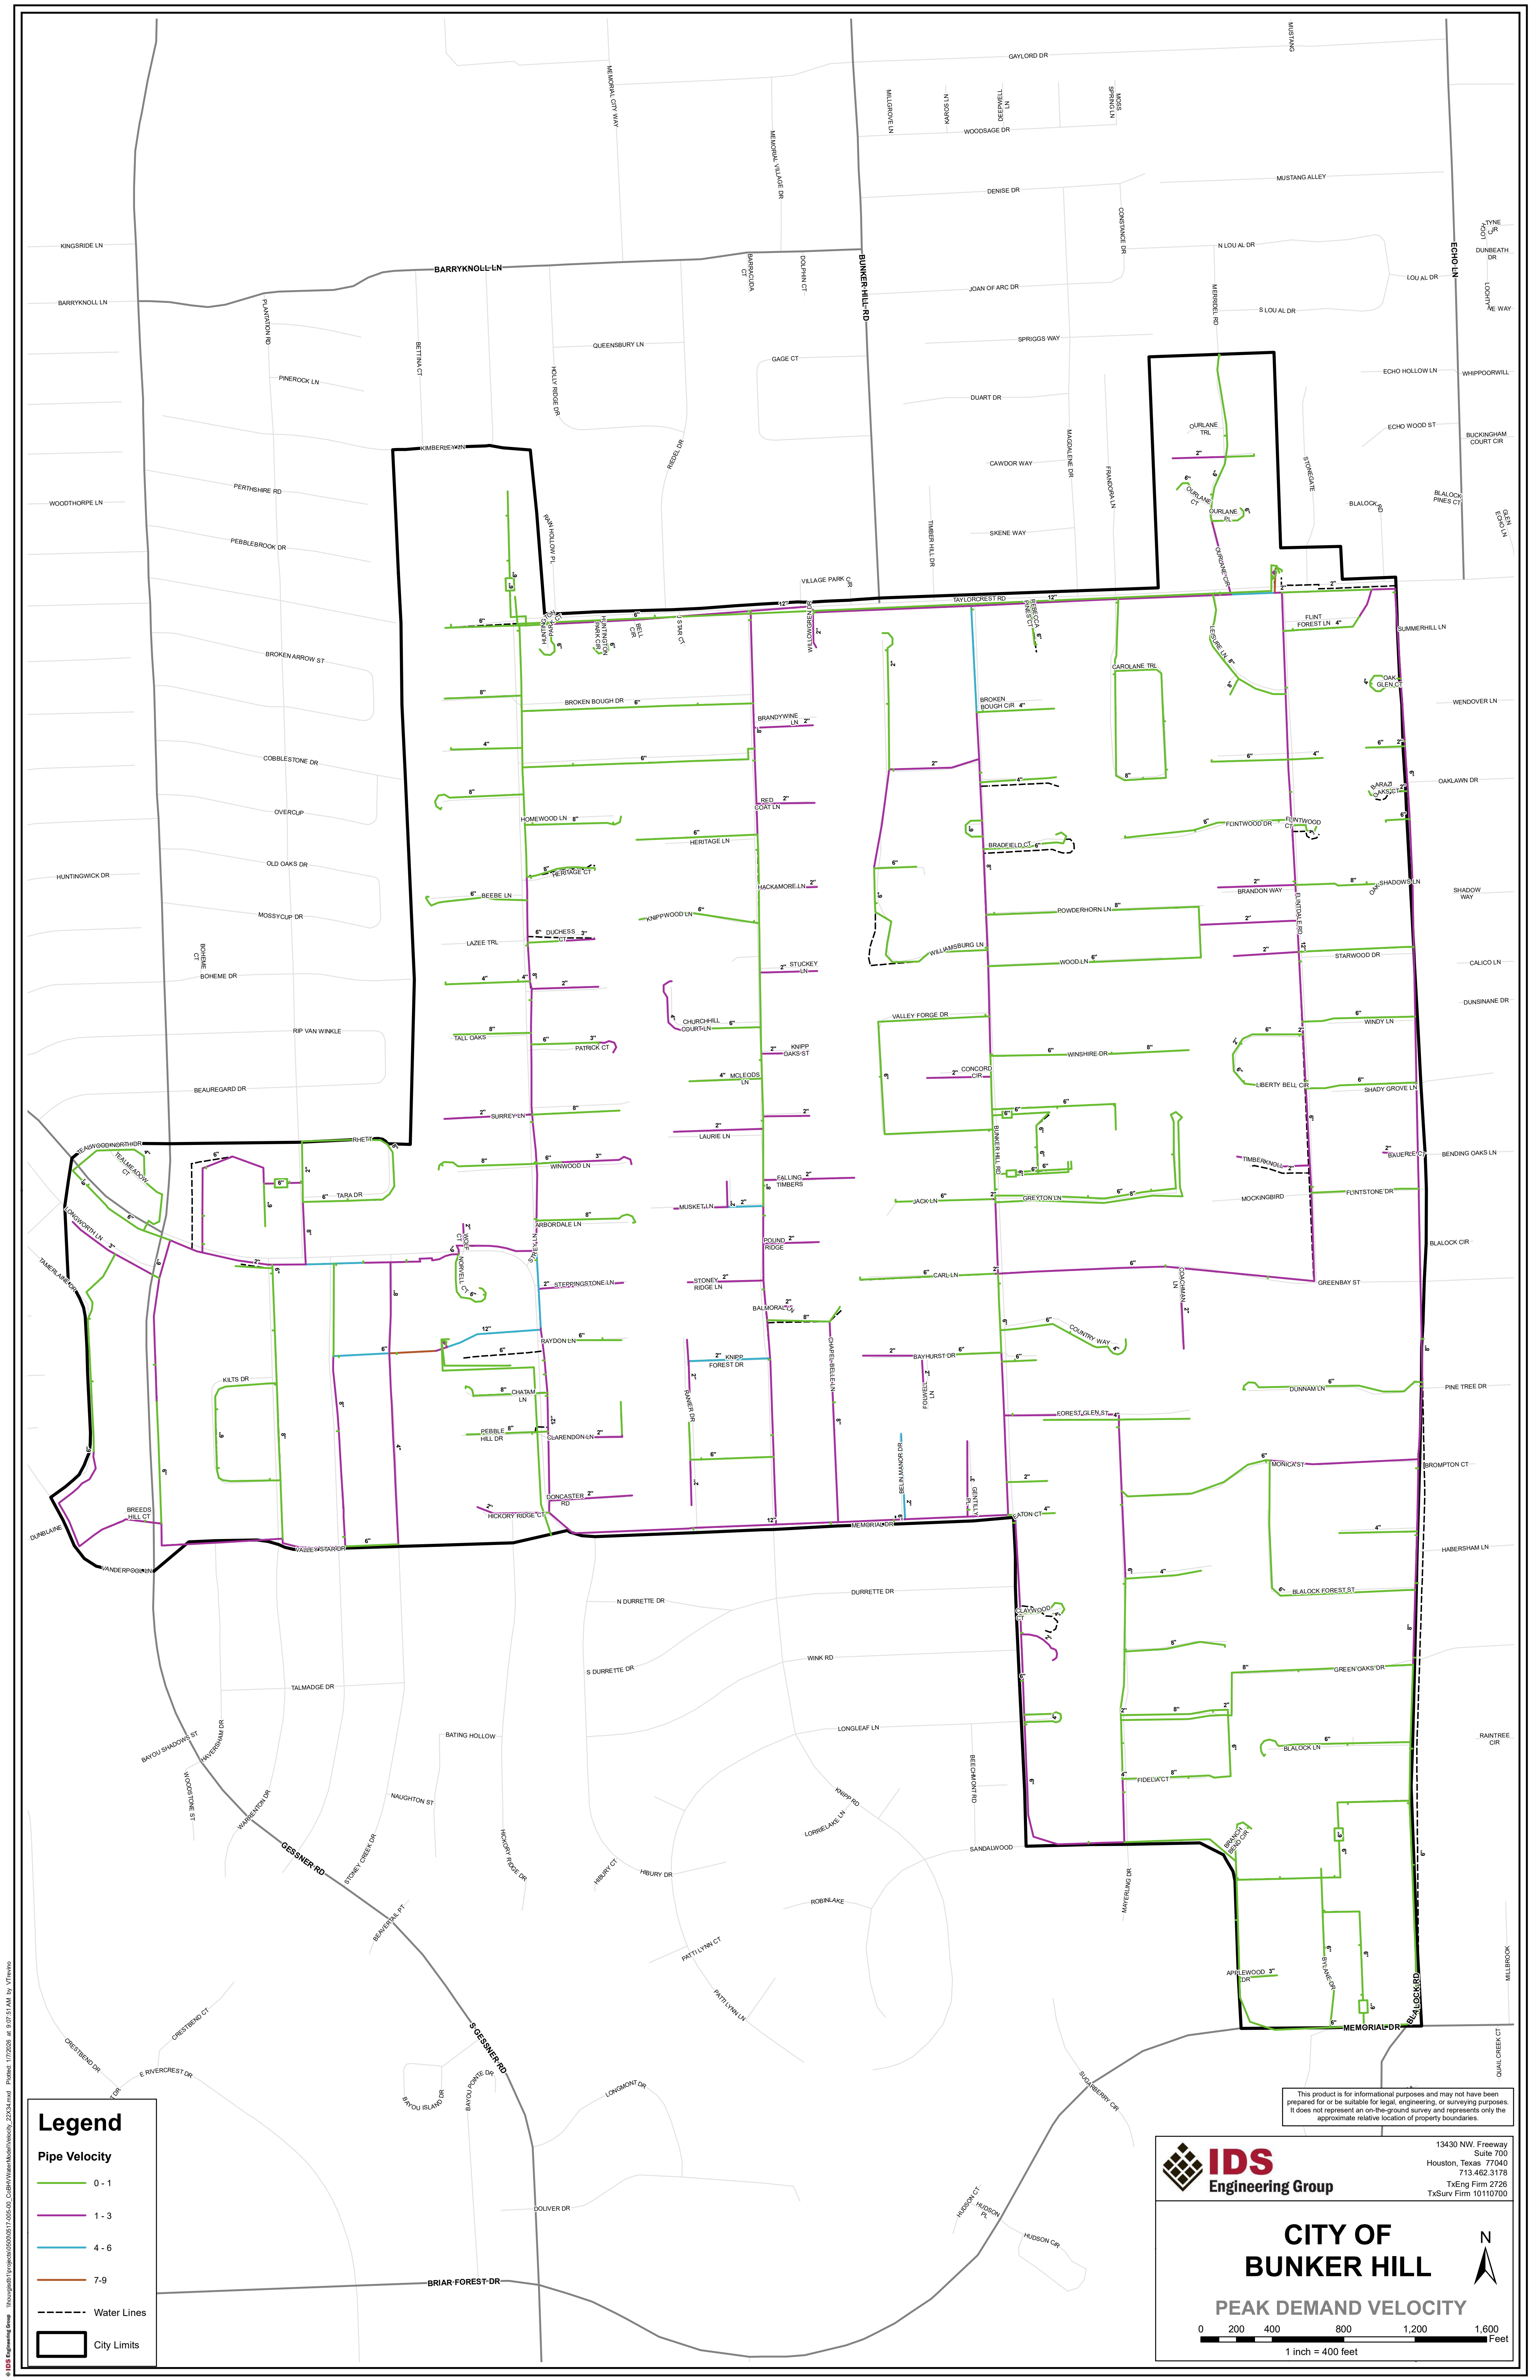

**Legend**

**Pipe Velocity**

- 0 - 1
- 1 - 3
- 4 - 6
- 7 - 9

Water Lines

City Limits

This product is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and represents only the approximate relative location of property boundaries.

**IDS**  
Engineering Group

13430 NW Freeway  
Suite 700  
Houston, Texas 77040  
713.462.3178  
TxEng Firm 2726  
TxSurv Firm 10110700

**CITY OF BUNKER HILL**

**PEAK DEMAND VELOCITY**


0 200 400 800 1,200 1,600  
Feet

1 inch = 400 feet

N

© IDS Engineering Group - 3/30/2024 10:00:00 AM - 17:20:00 - 2/23/24.mxd - Printed: 1/17/2025 at 9:07:51 AM by V.Tran

**Exhibit 6**  
**Fire Flow Availability Map**

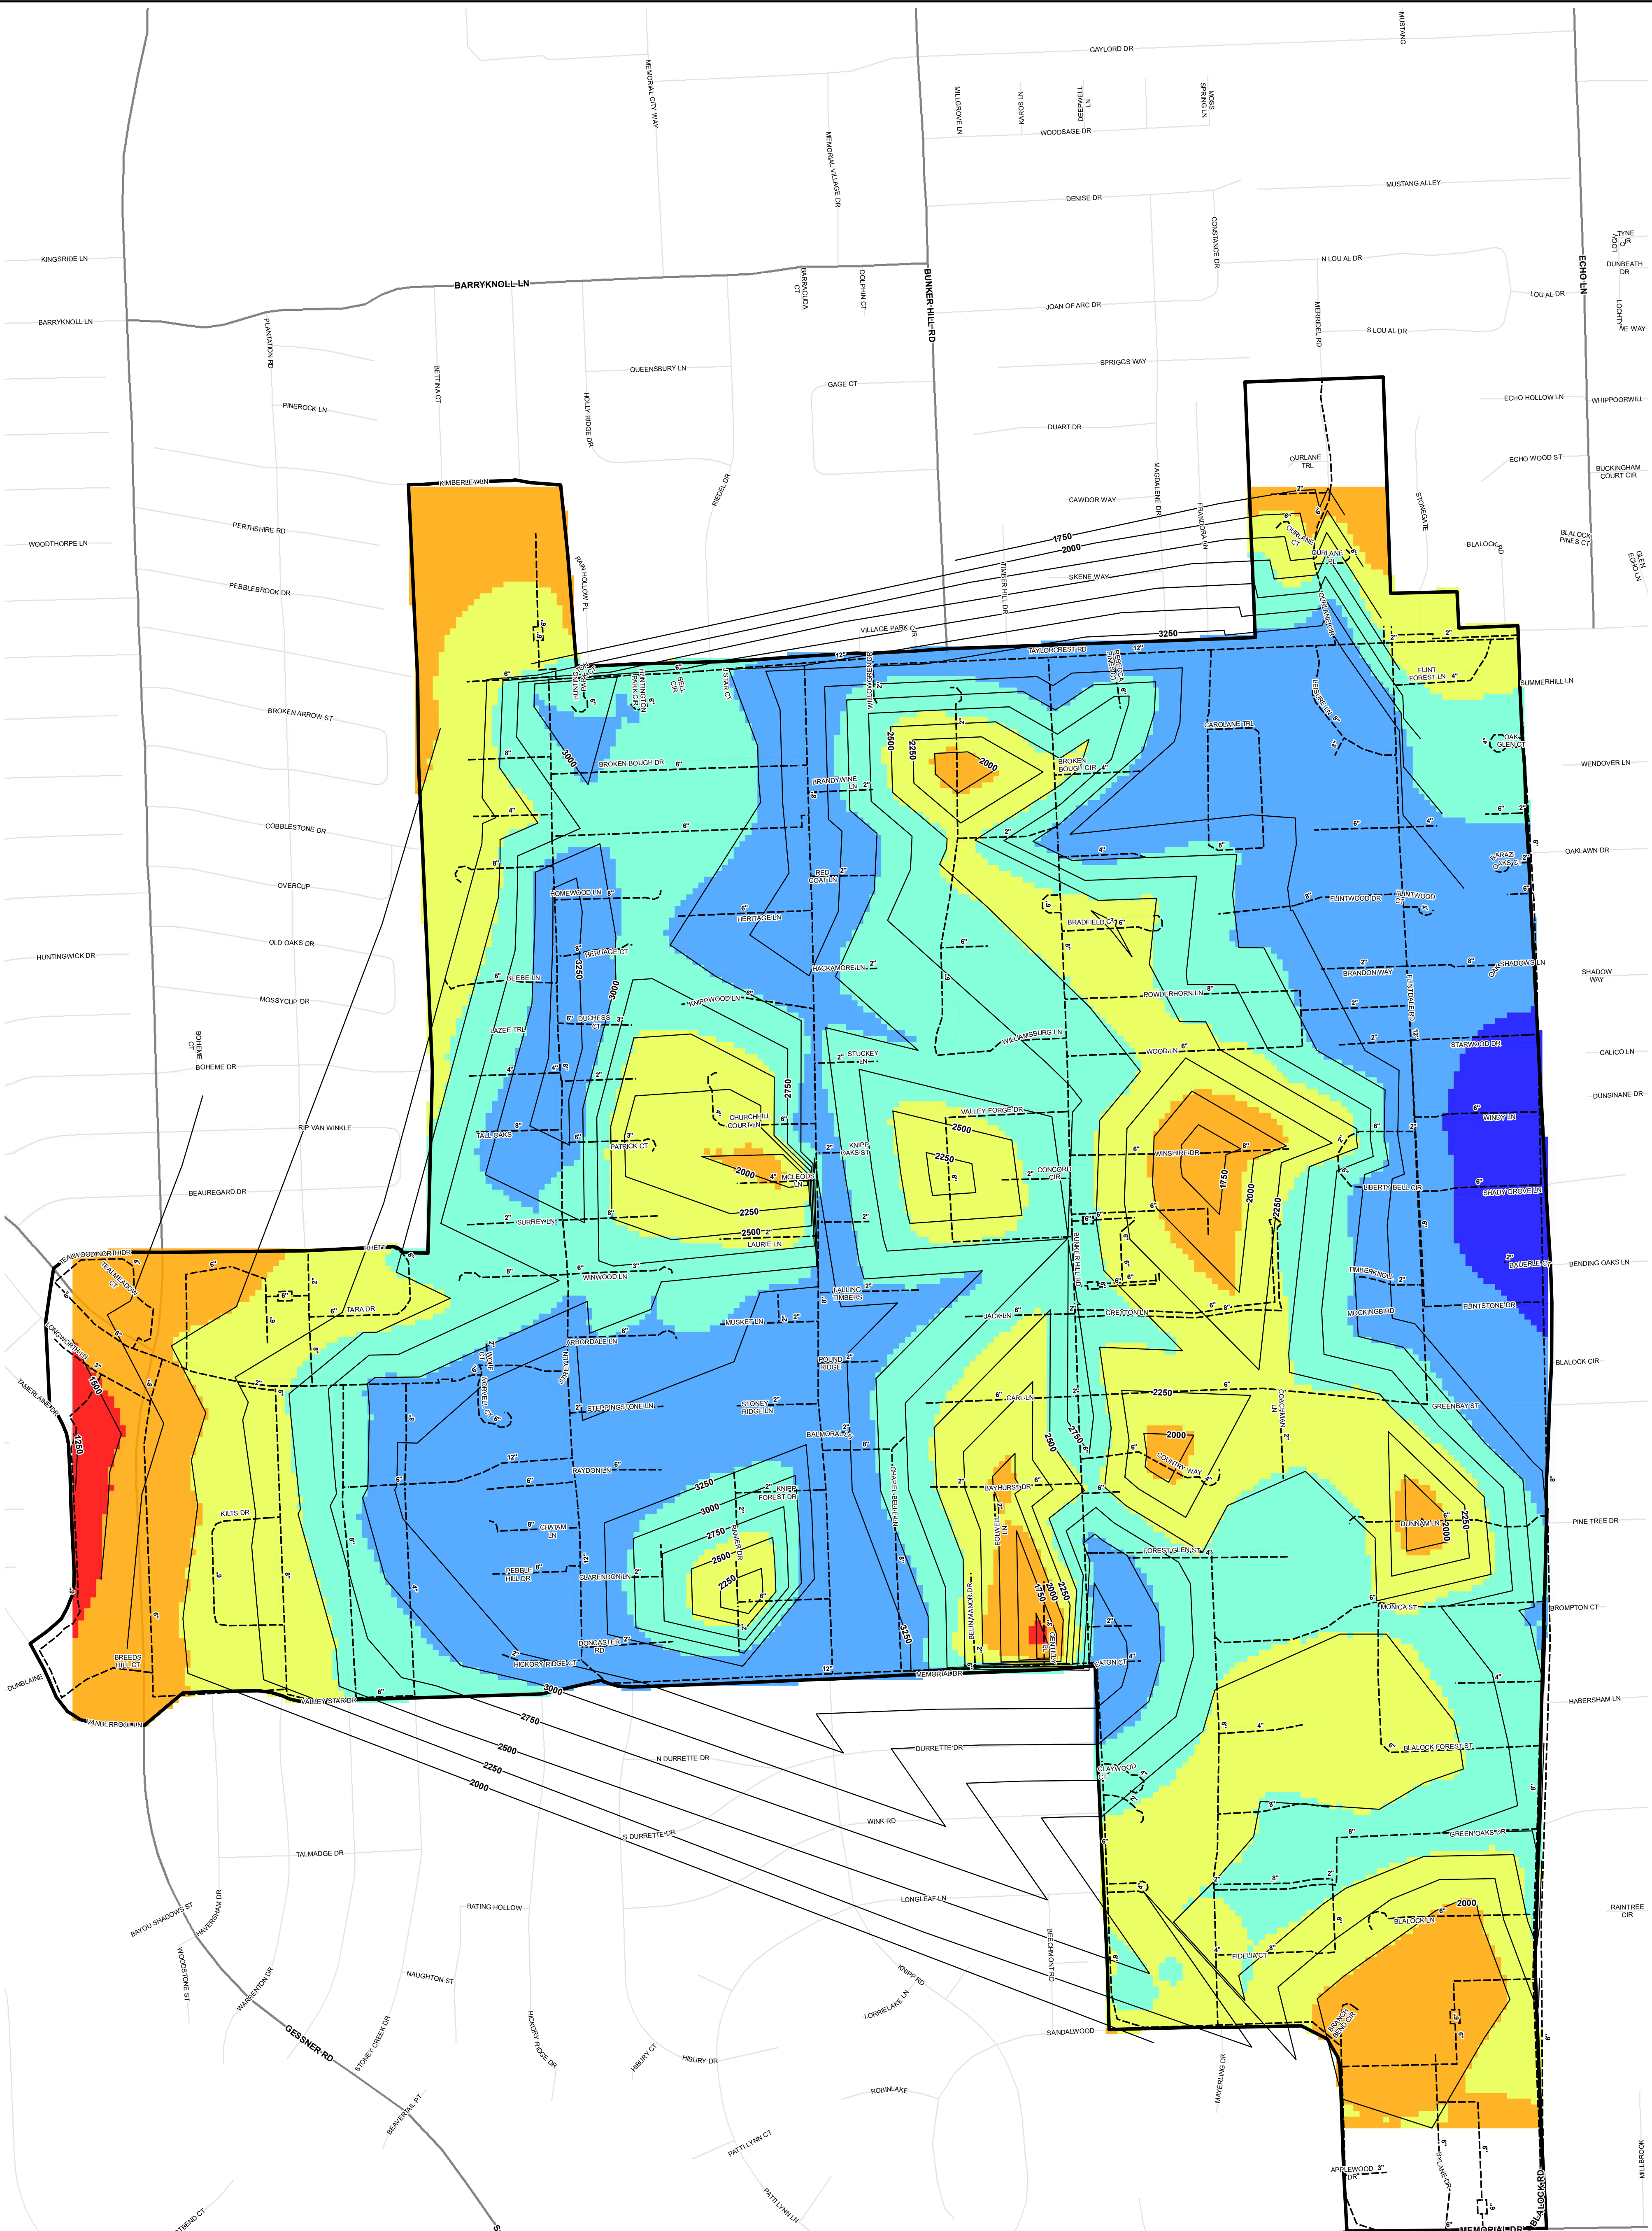

**Legend**

- Water Lines
- City Limits
- Available Fire Flow**
- 1,000 - 1,500
- 1,500 - 2,000
- 2,000 - 2,500
- 2,500 - 3,000
- 3,000 - 3,500
- 3,500 - 4,000

This product is for informational purposes and may not have been prepared for or be suitable for legal, engineering, or surveying purposes. It does not represent an on-the-ground survey and represents only the approximate relative location of property boundaries.

**IDS Engineering Group**

13430 NW Freeway Suite 700  
Houston, Texas 77040  
713.462.3178  
TxEng Firm 2726  
TxSurv Firm 10110700

**CITY OF BUNKER HILL**  
**PEAK DEMAND AVAILABLE**  
**FIRE FLOW**

0 200 400 800 1,200 1,600 Feet  
 1 inch = 400 feet

N

© IDS Engineering Group - 1/20/2024 12:26:00 - C:\Users\mike\OneDrive\Documents\Bunker Hill\Bunker Hill Peak Demand Available Fire Flow.mxd - Plotted: 1/22/2024 at 9:02:20 AM by VITRINO

**APPENDICES**

**Appendix A**  
**Electrical Systems Evaluation Report**



Bunker Hill Village

## WATER SYSTEM ELECTRICAL EVALUATION

Submitted: March 24, 2026

Prepared by:  
Richard Guzman, PE



March 24, 2026



# GUZMAN ENGINEERING

## Table of Contents

<b>1. EXECUTIVE SUMMARY.....</b>	<b>3</b>
I.    WATER PLANT NO. 2 (CITY HALL): .....	4
II.   REMOTE WELL NO. 3: .....	4
III.  WATER PLANT NO. 1:.....	4
IV.   RECOMMENDED MODIFICATIONS: .....	5
<b>2. PRIORITIES.....</b>	<b>5</b>
<b>3. FACILITY LOAD ANALYSIS.....</b>	<b>6</b>
<b>4. ENGINEER’S OPINION OF PROBABLE CONSTRUCTION COSTS (OPCC) .....</b>	<b>7</b>
<b>5. CONCLUSION.....</b>	<b>9</b>

## 1. Executive Summary

Guzman Engineering (GE) has been contracted by IDS Engineering Group to provide an Electrical Engineering inspection and evaluation of the existing power system for three (3) facilities in the Bunker Hill Village area. Documentation and information gathered are based on field investigation and available documentation. The purpose of this report is to evaluate age of power system, document existing loads, ensure code compliance with the National Electrical Code relevance where large CIP is performed, concerns for anticipated planned upgrades, and recommendations for a more reliable system. Recommendations are based on industry standard practices for similar facilities, interviews with operations, and with previous experience of operational schemes for added safety/efficiency.

### Facilities Visited:

- City Hall Water Plant No. 2 – 11977 Memorial Drive, Houston, Texas 77024
- Remote Well No. 3 – 11915 Doncaster Road, Houston, Texas 77024
- Water Plant No. 1 – 700 Outland Circle, Houston, Texas 77024

### General Observations (Water Plant No. 2):

- The existing gear is noted as 480/277V, 3 phase, 1200A rated gear
- The existing motor control center at Water Plant No. 2 showed a date of 1981. Industry standards recommend age for replacement is 30 years and this gear is now 45 years old. It is recommended the facility plan a capital improvement project to replace electrical equipment to reduce chances of sudden failure with equipment requiring difficult to procure parts.
- Electrical gear in building has been modified extensively, and items are reducing National Electrical Code working space compliance.
- Per operations, the water plant cannot go down for any prolonged period and as such any new motor control center equipment will require a new building.
- The existing generator is rated at 400KW/3 phase.
- Four (4) 30 HP booster pumps
- Two (2) 15 KVA low voltage transformers
- The existing site has a new SCADA system tied to the overall village system.

### General Observations (Remote Well No. 3)

- The existing gear is noted as 480/277V, 3 phase 600A manufactured in December 1991.
- The existing well is 125 HP with an existing soft start.
- The existing generator is not operational, and city is interested in a quick connection to allow for a portable generator to be brought on site as necessary.
- The existing well site has a SCADA system tied to the overall village SCADA system.

### General Observations (Water Plant No. 1)

- The facility existing power system is rated at 480/277V, 3 phase, 600A with a Square D Model 6 Motor Control Center
- Noted nameplate documents a manufacturer testing date of December 1989 which puts the gear at 37 years.
- Four (4) 50 HP Booster Pumps exist that replaced the previous two (2) 25 HP pumps.
- A Taylor Natural Gas 150 with engine rating of 185KW (231 KVA) generator with a 225A generator circuit breaker

- The generator has a DGC-2020HD Basler controller which does allow parallel generator setup.
- The generator is currently only sized to run one (1) 50 HP booster pump and ancillary 120V supporting low voltage transformers.
- A backup control system utilizing Mercoid mercury-based switches.
- The submersible well is rated at 100HP and was replaced a vertical turbine well with dedicated backup diesel engine in 2018.
- All loads now currently work under electrical power only with a single emergency natural gas generator.

Based on all items noted on report in subsequent pages, the below calculations were made for the existing system to document undersized generators, anticipated size equipment needed, and anticipated phasing approach for each site.

I. Water Plant No. 2 (City Hall):

- The original gear was sized at 1200A to cover existing loads and a previously installed well.
- The well has since been removed and as such the same size gear is not required.
- Considering Four (4) 30 HP booster pumps, a 400A motor control center would be sufficient to power the system for the next 30-year phase.
- With no expected plans to upgrade the current facility, a 150KW generator may be utilized to run all four (4) 30 HP booster pumps.

II. Remote Well No. 3:

- The gear appears oversized for the current 125 HP well.
- A 200A – 400A motor control center can be utilized to extend the life of the facility over the next phase of the remote well.

III. Water Plant No. 1:

- The existing 150KW Taylor generator is undersized for the current installed electrically powered motors on site. This is due to multiple upgrades since 2002 including replaced of the two (2) 25 HP booster pumps with four (4) 50 HP booster pumps. These booster pumps are all operating on across the line starters.
- The previous vertical turbine well had a natural gas backup engine tied directly to the well. This vertical well was replaced circa 2018 with an electrically only powered submersible well.
- Based on calculations, running four (4) 25 HP booster pumps would of required a 150KW Generator.
- In order to run a 100 HP well and three (3) 50 HP booster pumps an additional parallel 150KW unit would be required.
- Calculations do show that all four (4) booster pumps can also run on the same additional 150KW unit but will be running at 90% percent rated which is not a concern since all four booster pumps should never operate at the same time.

#### IV. Recommended Modifications:

##### Water Plant No. 2 (City Hall)

- Due to the overall age of the facility electrical equipment; GE recommends a complete rehabilitation of the power system to an adequate for current future sizing of equipment.
- Perform design package to swap existing generators at Water Plant No. 1 and No. 2 since water plant no. 1 no longer has an on-site well and water plant no. 2 removed a stand-alone generator for the on-site well. It should be understood that the existing generator at City Hall is over 20 years old and there is risk with moving the generators. The engineer recommends the engineer coordinate with manufacturers for the exact models' technical data and perform a feasibility for this option.

##### Remote Well No. 3

- Due to the overall age of the facility electrical equipment; GE recommends a complete rehabilitation of the power system to an adequate for current future sizing of equipment.
- Install cam lock connection box behind existing gear, or new gear, to allow a trailer mounted generator to connect to power system and run the well/controls.

##### Water Plant No. 1

- Due to the overall age of the facility electrical equipment; GE recommends a complete rehabilitation of the power system to an adequate for current future sizing of equipment.
- Due to the critical nature of this facility; GE recommends a new motor control center be installed at a different (adjacent) location of the site to reduce down time and swap overloads in a phased sequence.
- Costs have been included in the report OPCC for replacement of MCC in place for stakeholder evaluation in comparison to installing it at an adjacent location.
- Perform design package to swap existing generators at Water Plant No. 1 and No. 2 since water plant no. 1 no longer has an on-site well and water plant no. 2 removed a stand-alone generator for the on-site well. It should be understood that the existing generator at City Hall is over 20 years old and there is risk with moving the generators. The engineer recommends the engineer coordinate with manufacturers for the exact models' technical data and perform a feasibility for this option.

## 2. Priorities

Guzman Engineering understands the scope of this report is to analyze, quantify, document, provide recommendations, priorities, and cost estimates. Although we recommend all recommended modifications should be performed as soon as possible, based on interviews with operations and IDS Engineering Group; we understand a priority list may allow stakeholders to properly plan and fund future capital improvement projects.

GE has the below priority list for stakeholder analysis:

1. Initiate a design package to swap generators between water plant no. 1 and no. 2.
2. Install cam lock connector box at remote well no. 3
3. Complete power system rehab at water plant no. 2
4. Complete power system rehab at water plant no. 1
5. Complete power system rehab at remote well no. 3

### 3. Facility Load Analysis

Load Analysis - Water Plant No. 2					
Load	HP	KVA	Amps		
			PH A	PH B	PH C
Booster Pump No. 1	30	29	35	35	35
Booster Pump No. 2	30	29	35	35	35
Booster Pump No. 3	30	29	35	35	35
Booster Pump No. 4	30	29	35	35	35
MPZ		15	31	0	31
MPZ		15	31	0	31
25% of Largest Load		7	9	9	9
Total Load		<b>158</b>	<b>211</b>	<b>211</b>	<b>211</b>
Service Ampacity @ 480V, 3PH, 4W		299	400	400	400
Spare Ampacity			189	189	189
Generator Load			211	211	211
Generator Ampacity (1 - 150KW)		188	226	226	226
Generator Spare			16	16	16

Load Analysis - Remote Well No. 3					
Load	HP	KVA	Amps		
			PH A	PH B	PH C
Well No. 1	150	124	149	149	149
	0	0	0	0	0
MPZ		15	31	0	31
25% of Largest Load		0	0	0	0
Total Load		<b>135</b>	<b>180</b>	<b>180</b>	<b>180</b>
Service Ampacity @ 480V, 3PH, 4W		149	200	200	200
Spare Ampacity			20	20	20
Generator Load			180	180	180
Generator Ampacity (1 - 400KW)		500	602	602	602
Generator Spare			422	422	422

Load Analysis - Water Plant No. 1					
Load	HP	KVA	Amps		
			PH A	PH B	PH C
Well No. 1	100	119	143	143	143
Booster Pump No. 1	50	49	59	59	59
Booster Pump No. 2	50	49	59	59	59
Booster Pump No. 3	50	49	59	59	59
Booster Pump No. 4	50	49	59	59	59
T1		10	18	0	18
T2		15	31	0	31
25% of Largest Load		27	36	36	36
<b>Total Load</b>		<b>347</b>	<b>464</b>	<b>464</b>	<b>464</b>
Service Ampacity @ 480V, 3PH, 4W		<b>448</b>	<b>600</b>	<b>600</b>	<b>600</b>
Spare Ampacity			136	136	136
Generator Load			464	464	464
Generator Ampacity (2 - 150KW)		375	452	452	452
Generator Spare			12	12	12

#### 4. Engineer's Opinion of Probable Construction Costs (OPCC)

GE has the below expected OPCC for each priority list for stakeholder analysis:

1. Initiate a design package to swap generators between water plant no. 1 and no. 2.
  - a. Engineer design fee \$8,500.00
  - b. Construction estimate
    - i. Crane Rental \$16,000.00
    - ii. Wiring Modifications \$25,000.00
    - iii. Transportation and Installation Costs \$10,000.00
    - iv. Miscellaneous/Contingency \$15,000.00
    - v. Gas Allowance \$8,000.00
    - vi. **Grand Total:** **\$82,500.00**
  
2. Install cam lock connector box at remote well no. 3
  - a. Engineer Design fee \$5,000.00
  - b. Construction Estimate
    - i. 600A camlock connector box \$17,000.00
    - ii. Wiring Modifications \$5,000.00
    - iii. Miscellaneous/Contingency \$5,000.00
    - iv. General Mobilization \$5,000.00
    - v. **Grand Total:** **\$37,000.00**

3. Complete power system rehab at water plant no. 2	
a. Engineer Design fee	\$52,000.00
b. Construction Estimate	
i. 400A Motor Control Center	\$350,000.00
ii. Conduit and Conductors	\$40,000.00
iii. Phasing Installation	\$15,000.00
iv. Wiring Modifications	\$25,000.00
v. Miscellaneous Electrical	\$15,000.00
vi. Contingency	\$100,000.00
<b>vii. <u>Grand Total</u></b>	<b>\$597,000.00</b>
4. Complete power system rehab at water plant no. 1 – (Adjacent MCC)	
a. Engineer Design fee	\$35,000.00
b. Construction Estimate	
i. 600A Motor Control Center	\$300,000.00
ii. Conduit and Conductors	\$22,000.00
iii. Phasing Installation	\$10,000.00
iv. Wiring Modifications	\$25,000.00
v. Miscellaneous Electrical	\$15,000.00
vi. Contingency	\$110,000.00
<b>vii. <u>Grand Total</u></b>	<b>\$517,000.00</b>
5. Complete power system rehab at water plant no. 1 – (Replace MCC in place)	
a. Engineer Design fee	\$42,000.00
b. Construction Estimate	
i. 600A Motor Control Center	\$300,000.00
ii. Temporary MCC for Phasing	\$180,000.00
iii. Conduit and Conductors	\$50,000.00
iv. Phasing Installation	\$50,000.00
v. Wiring Modifications	\$25,000.00
vi. Miscellaneous Electrical	\$25,000.00
vii. Contingency	\$190,000.00
<b>viii. <u>Grand Total</u></b>	<b>\$862,000.00</b>
6. Complete power system rehab at remote well no. 3	
a. Engineer Design fee	\$14,500.00
b. Construction Estimate	
i. 200A Rack Mounted Equipment	\$80,000.00
ii. Conduit and Conductors	\$15,000.00
iii. Wiring Modifications	\$15,000.00
iv. Miscellaneous Electrical	\$5,000.00
v. Contingency	\$30,000.00
<b>vi. <u>Grand Total:</u></b>	<b>\$159,500.00</b>

## 5. CONCLUSION

Upon inspection of the overall power system for all three (3) water facilities, several recommendations have been made to allow the village to extend the overall life of the system. It is highly recommended to ensure failures can be corrected with up to date readily available equipment. Equipment at this age is more likely to fail after the 30-year expected life and older equipment has harder to find parts. GE recommends all CIP items are planned and implemented to maintain operation of the village drinking water system.


GE recommends an engineer be utilized for both coordination and verification with generator manufactures prior to swapping out generators. Age and lack of exact equipment calculations with vendors pose a risk for the city if work is done without engineers supervision.

**Appendix B**  
**Extended Period Simulation Results**

**City of Bunker Hill Village Existing  
Water Infrastructure - Baseline  
Extended Period Simulation**


# **24-Hour Average Winter Day Simulation**

Calculation Summary Graph

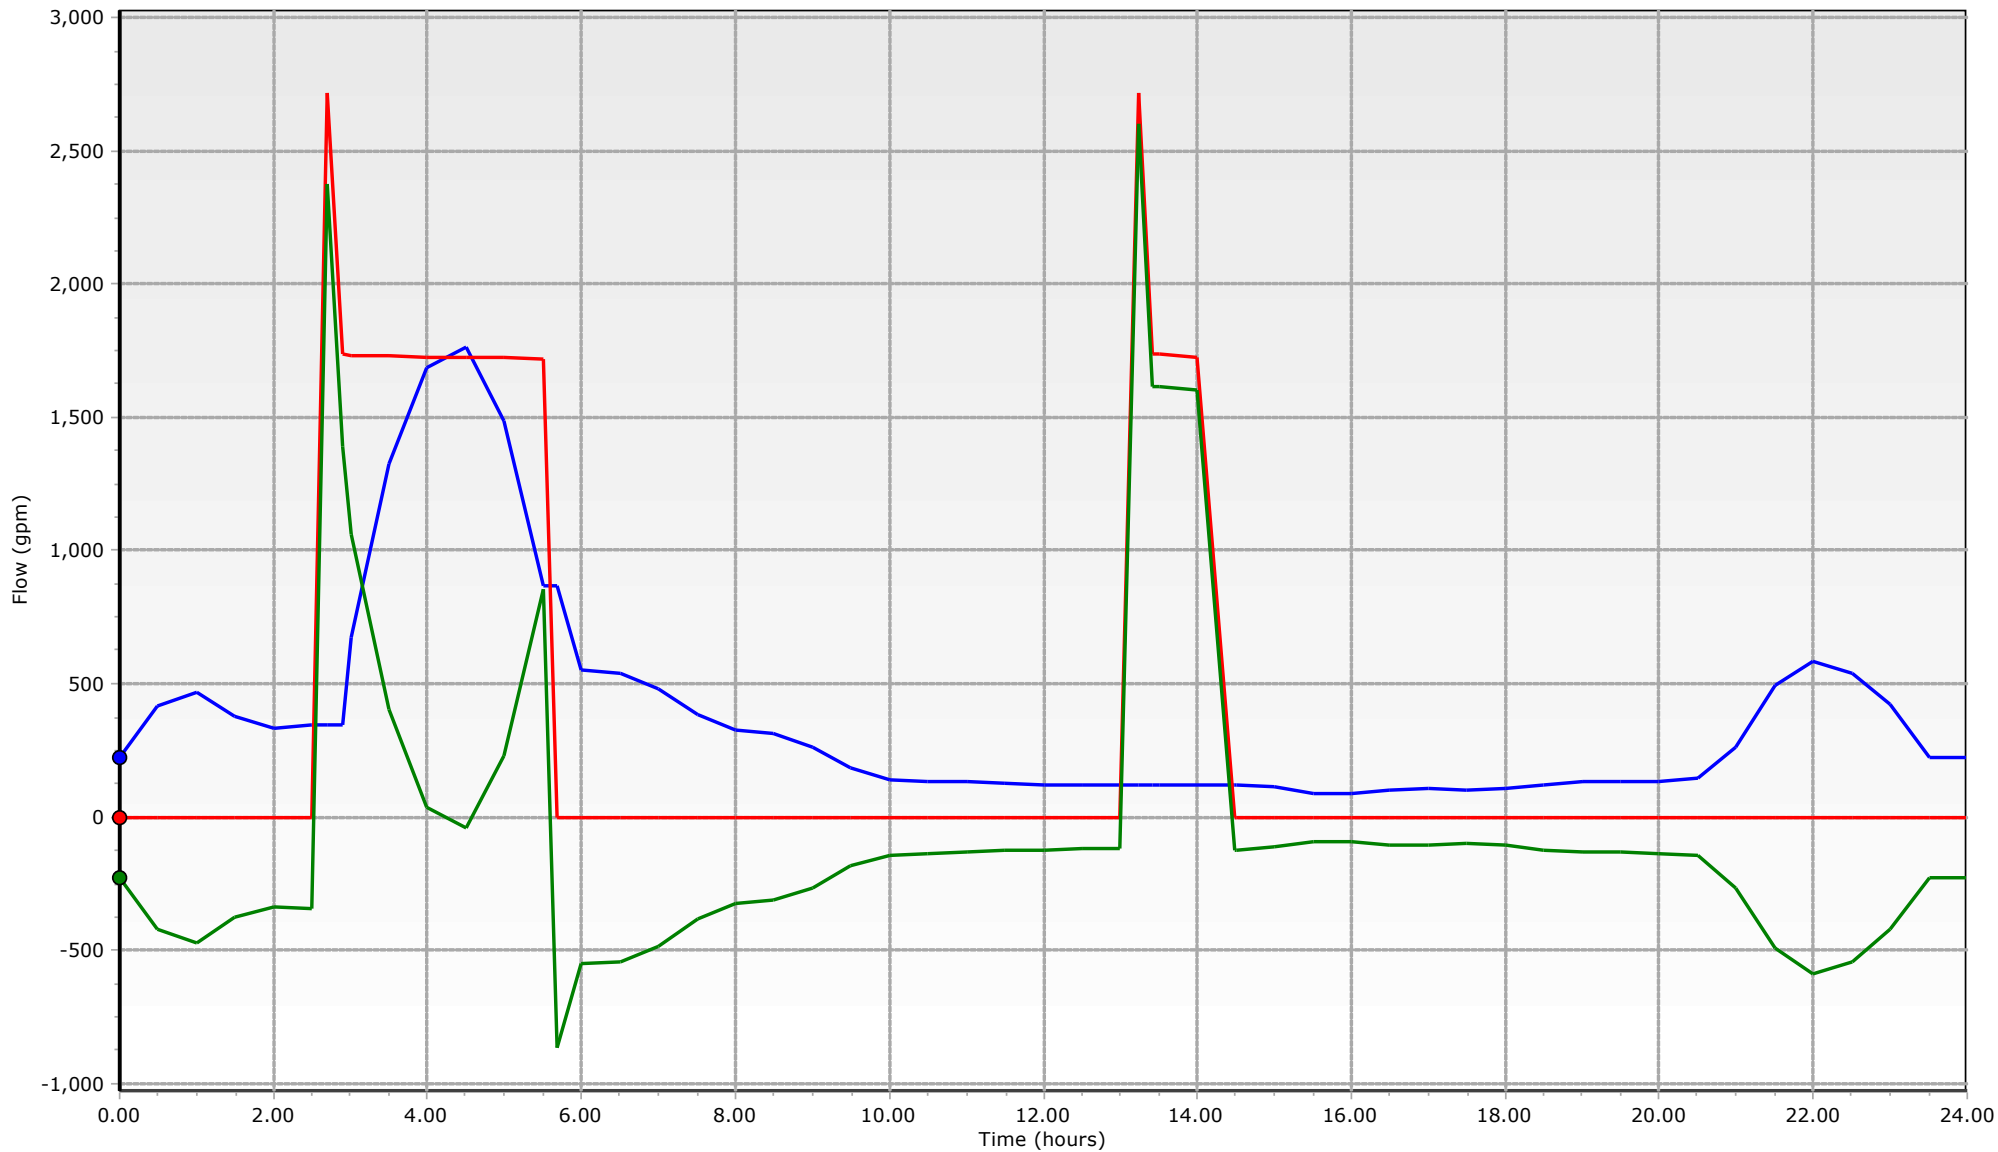

Average Demand EPS - Winter - Flow Demanded    Average Demand EPS - Winter - Flow Supplied    Average Demand EPS - Winter - Flow Stored

WP 1 Tank Levels

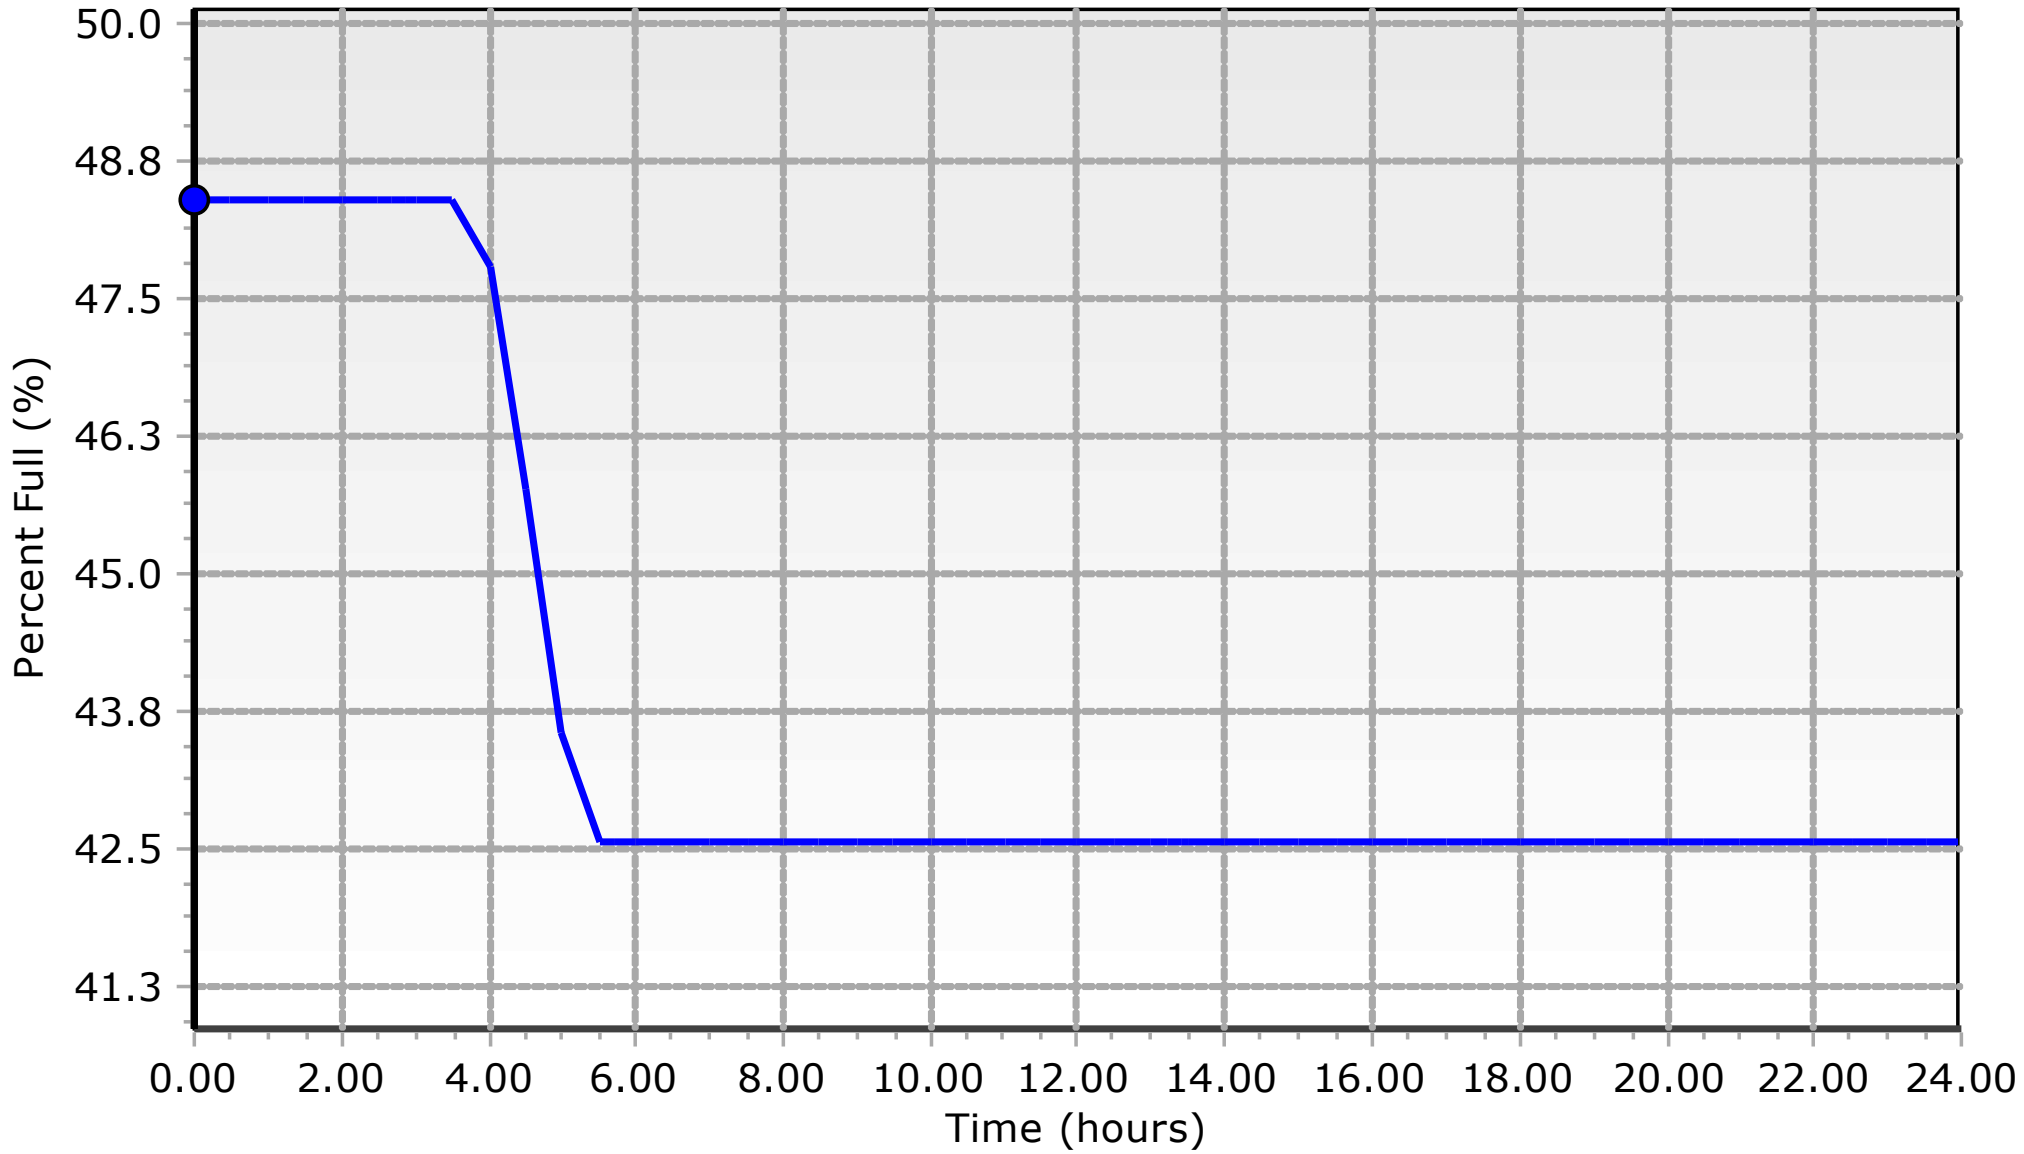


WP 1 GST 1 & 2 - Average Demand EPS - Winter - Percent Full

### WP 1 Water Sources




WP 2 Tank Level

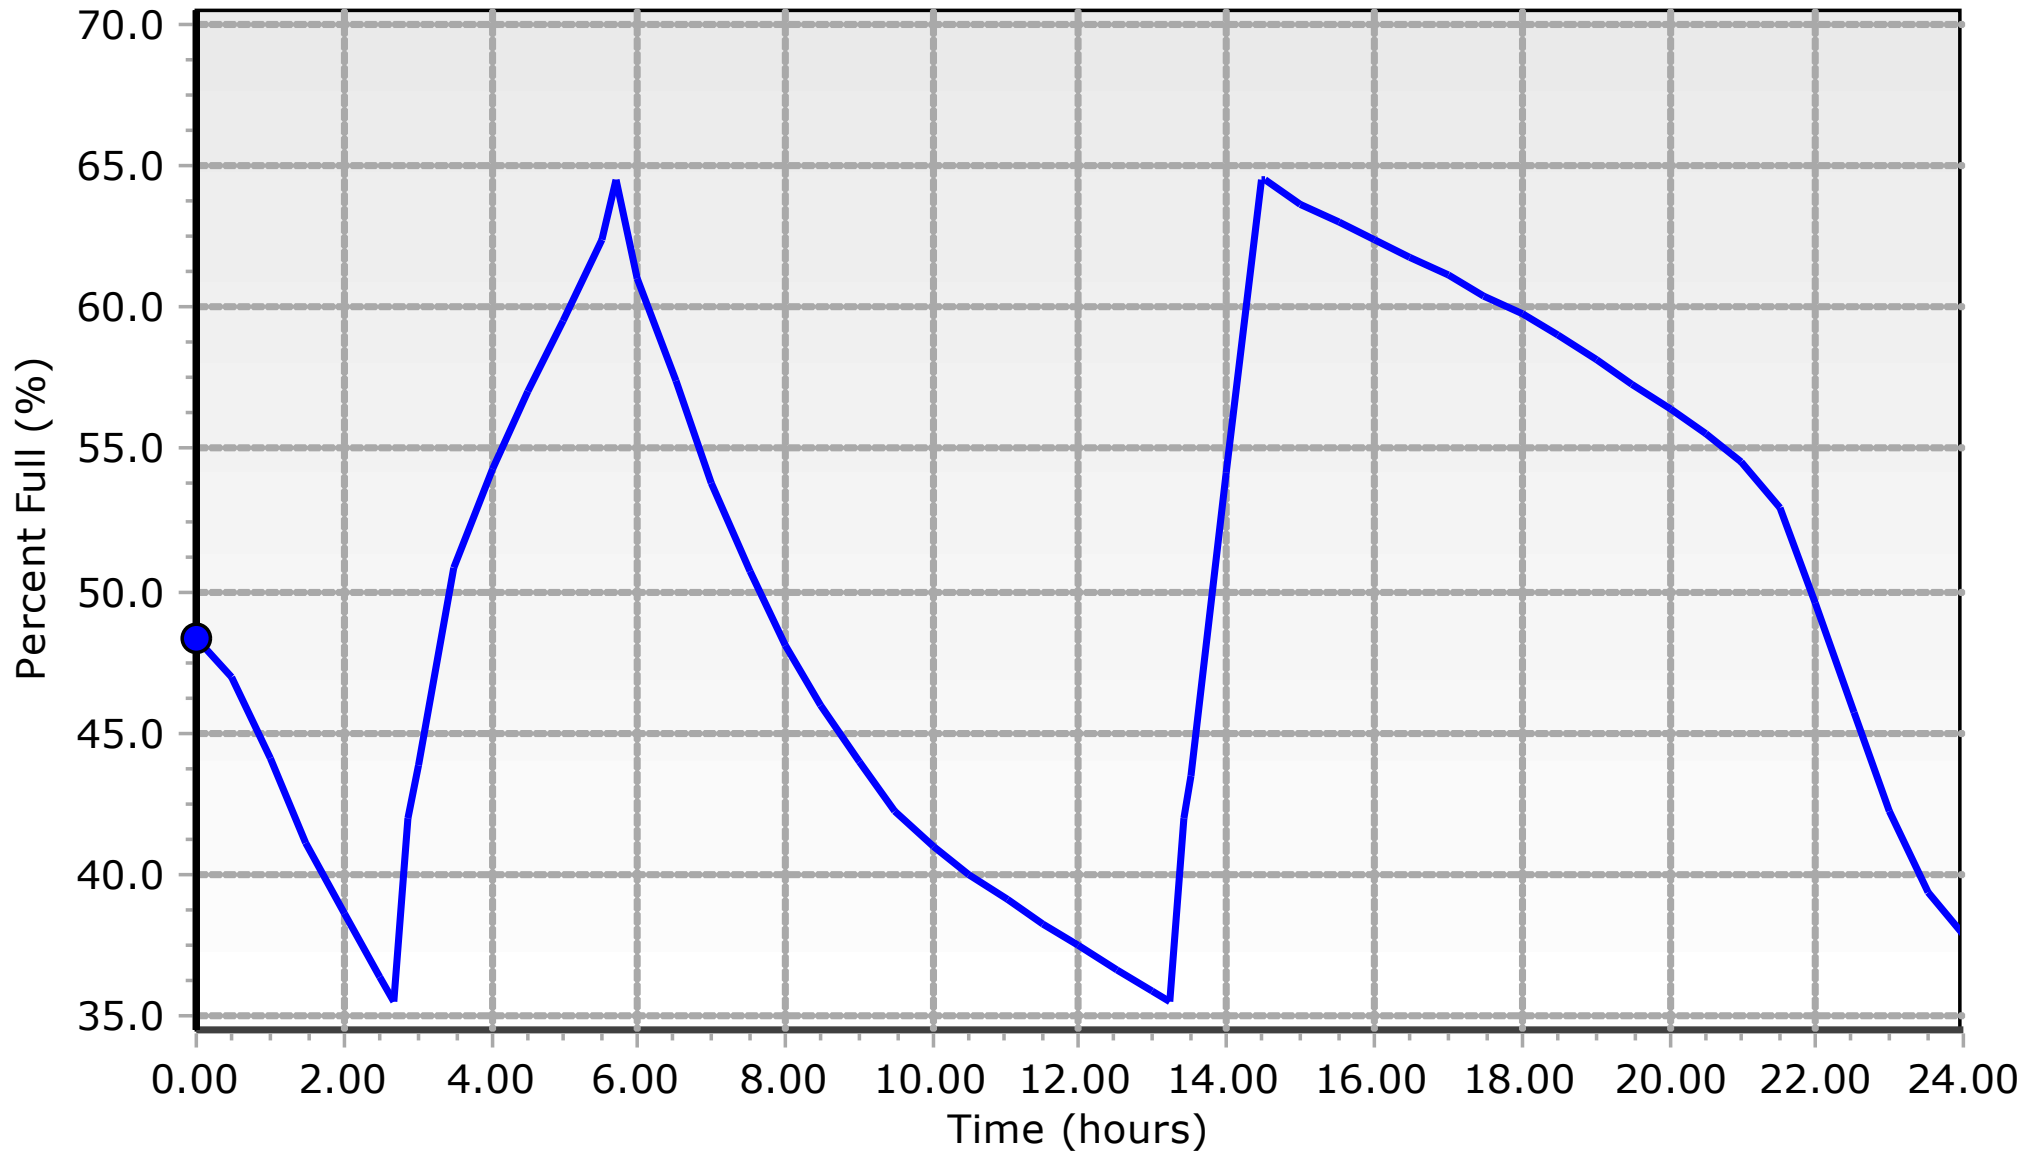

WP 2 GST 1 - Average Demand EPS - Winter - Percent Full


### WP 2 Water Sources

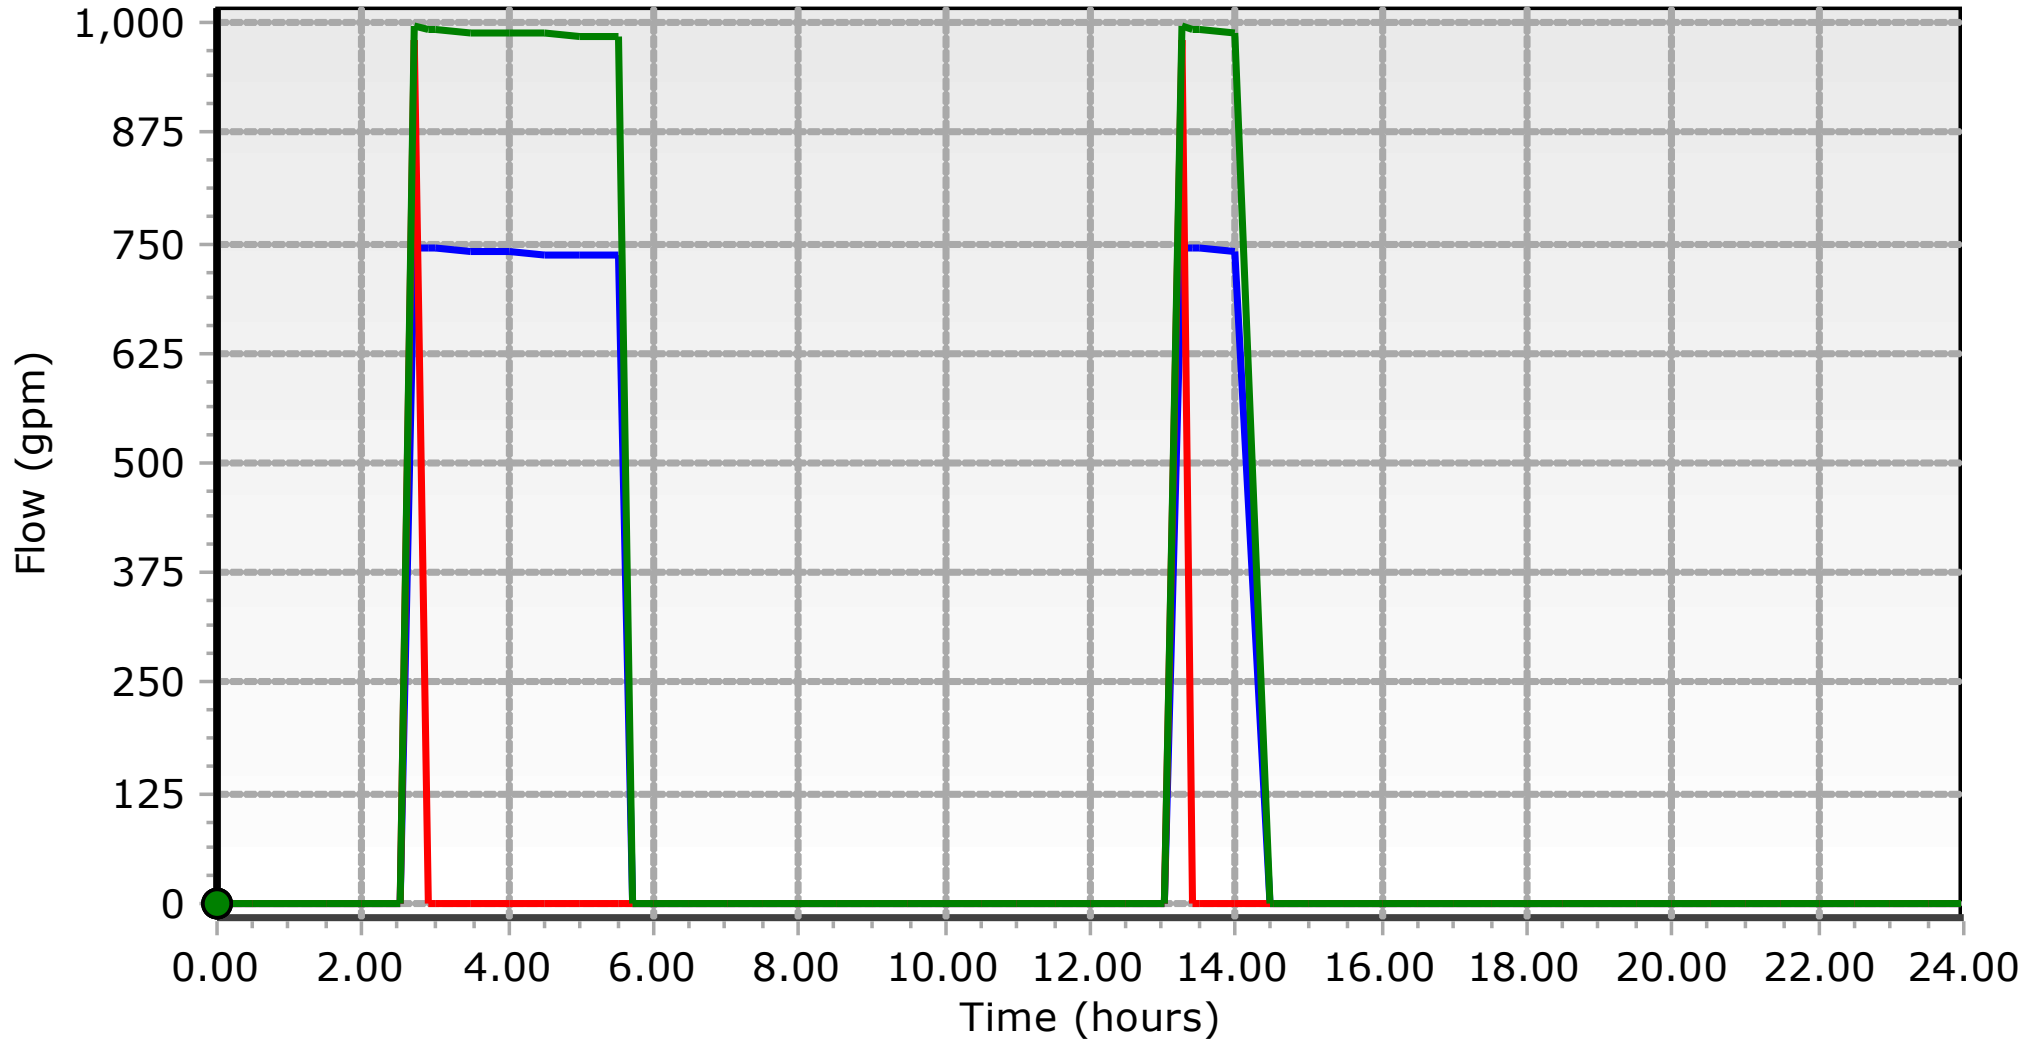

- WW 3 - Average Demand EPS - Winter - Flow (Total)
- COH SW 2 - Average Demand EPS - Winter - Flow (Total)
- WW 4 - Average Demand EPS - Winter - Flow (Total)


# **24-Hour Average Summer Day Simulation**

Calculation Summary Graph

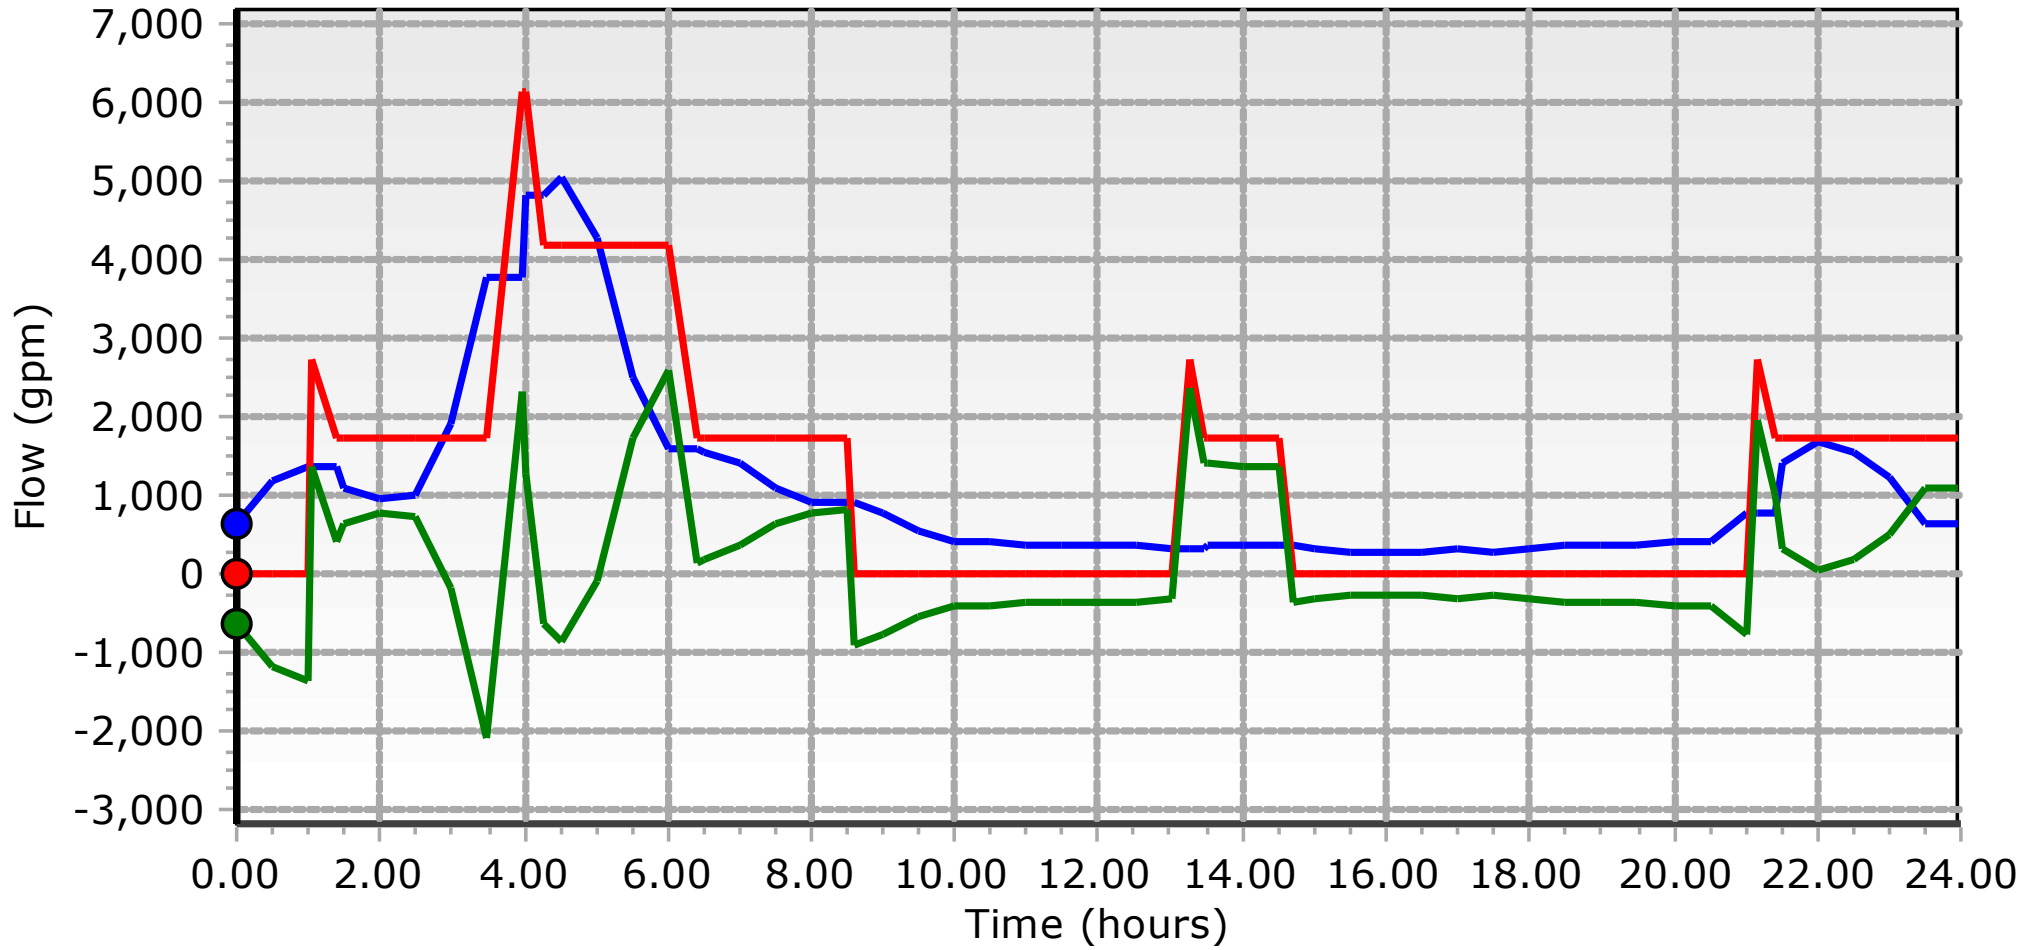


- Average Demand EPS - Summer - Flow Demanded
- Average Demand EPS - Summer - Flow Supplied
- Average Demand EPS - Summer - Flow Stored

WP 1 Tank Levels

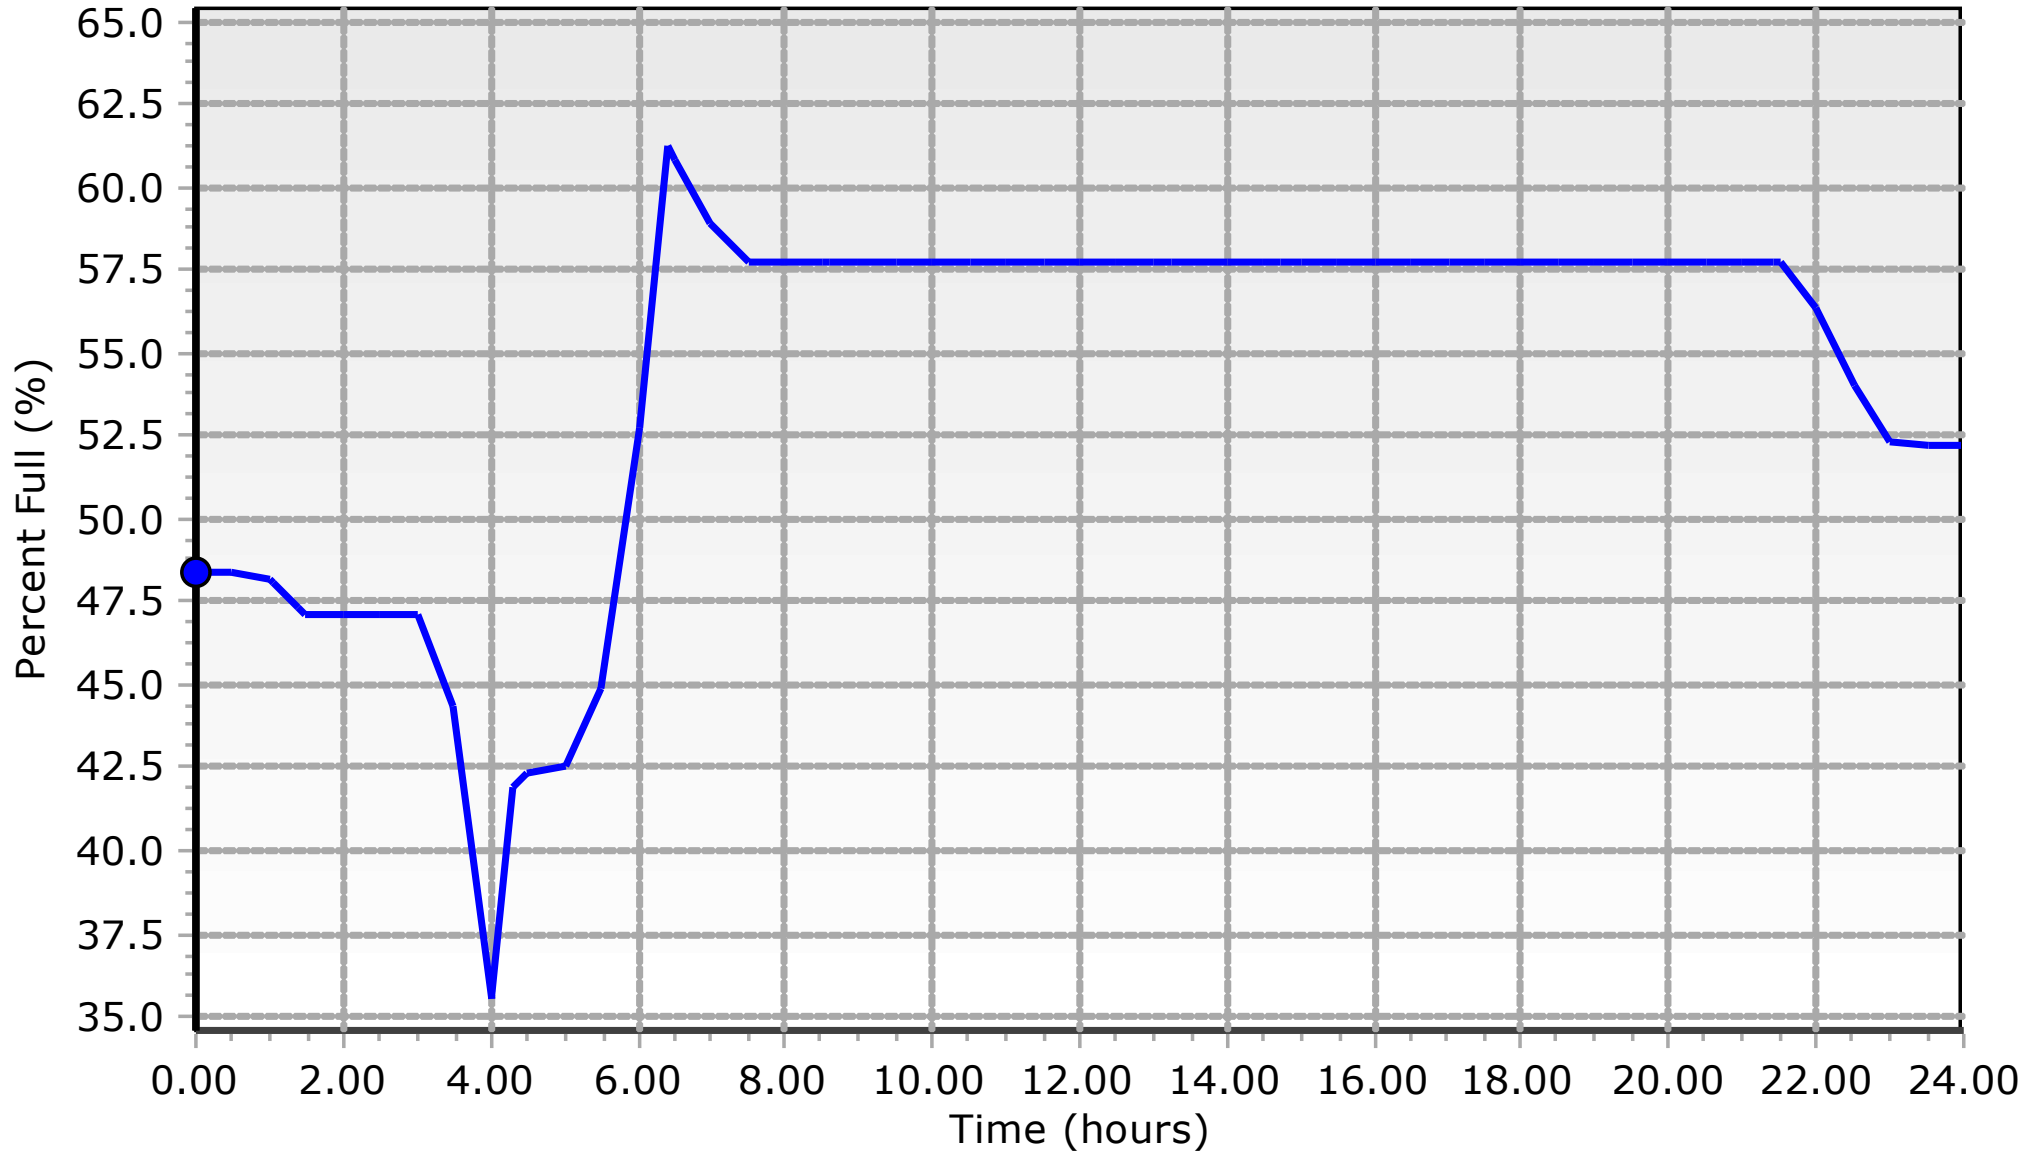


WP 1 GST 1 & 2 - Average Demand EPS - Summer - Percent Full

### WP 1 Water Sources

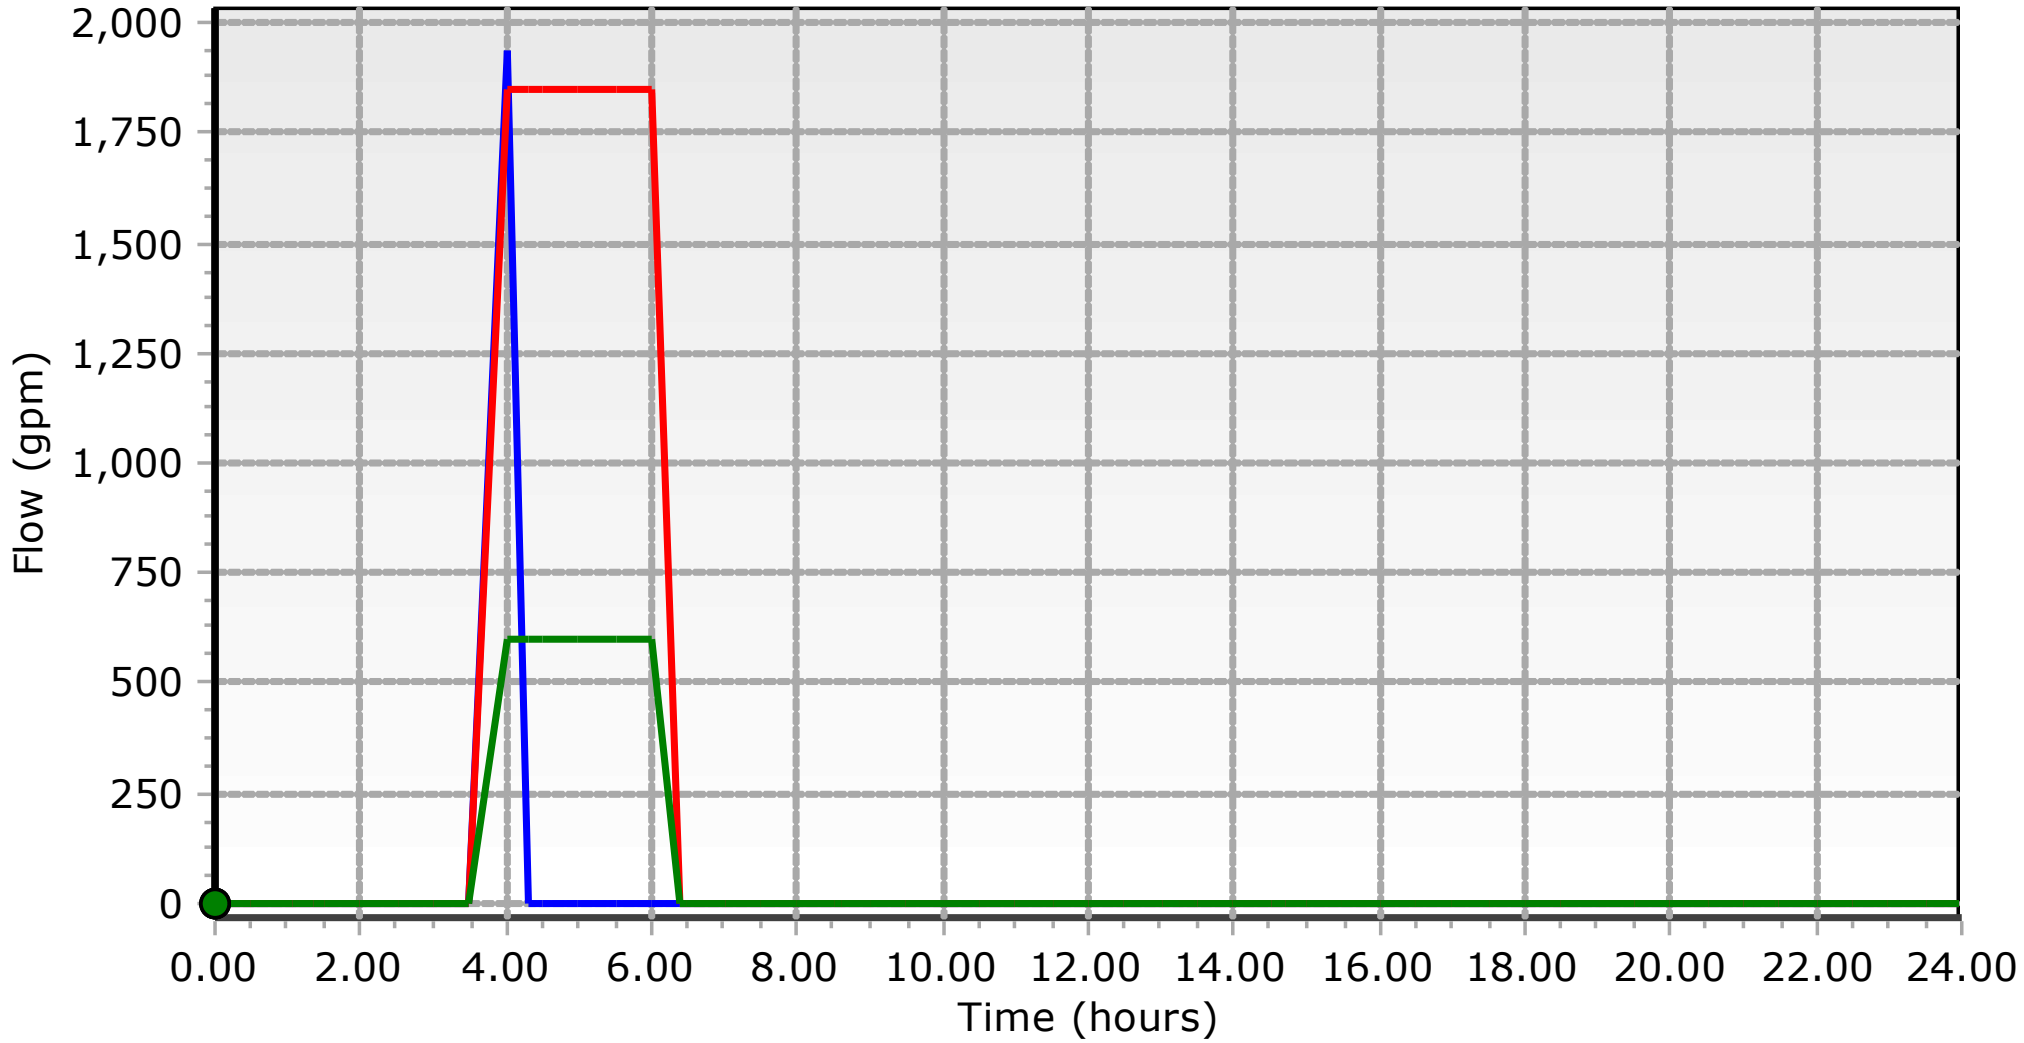


- COH SW 1 - Average Demand EPS - Summer - Flow (Total)
- WW 5 - Average Demand EPS - Summer - Flow (Total)
- WW 1 - Average Demand EPS - Summer - Flow (Total)

WP 2 Tank Level

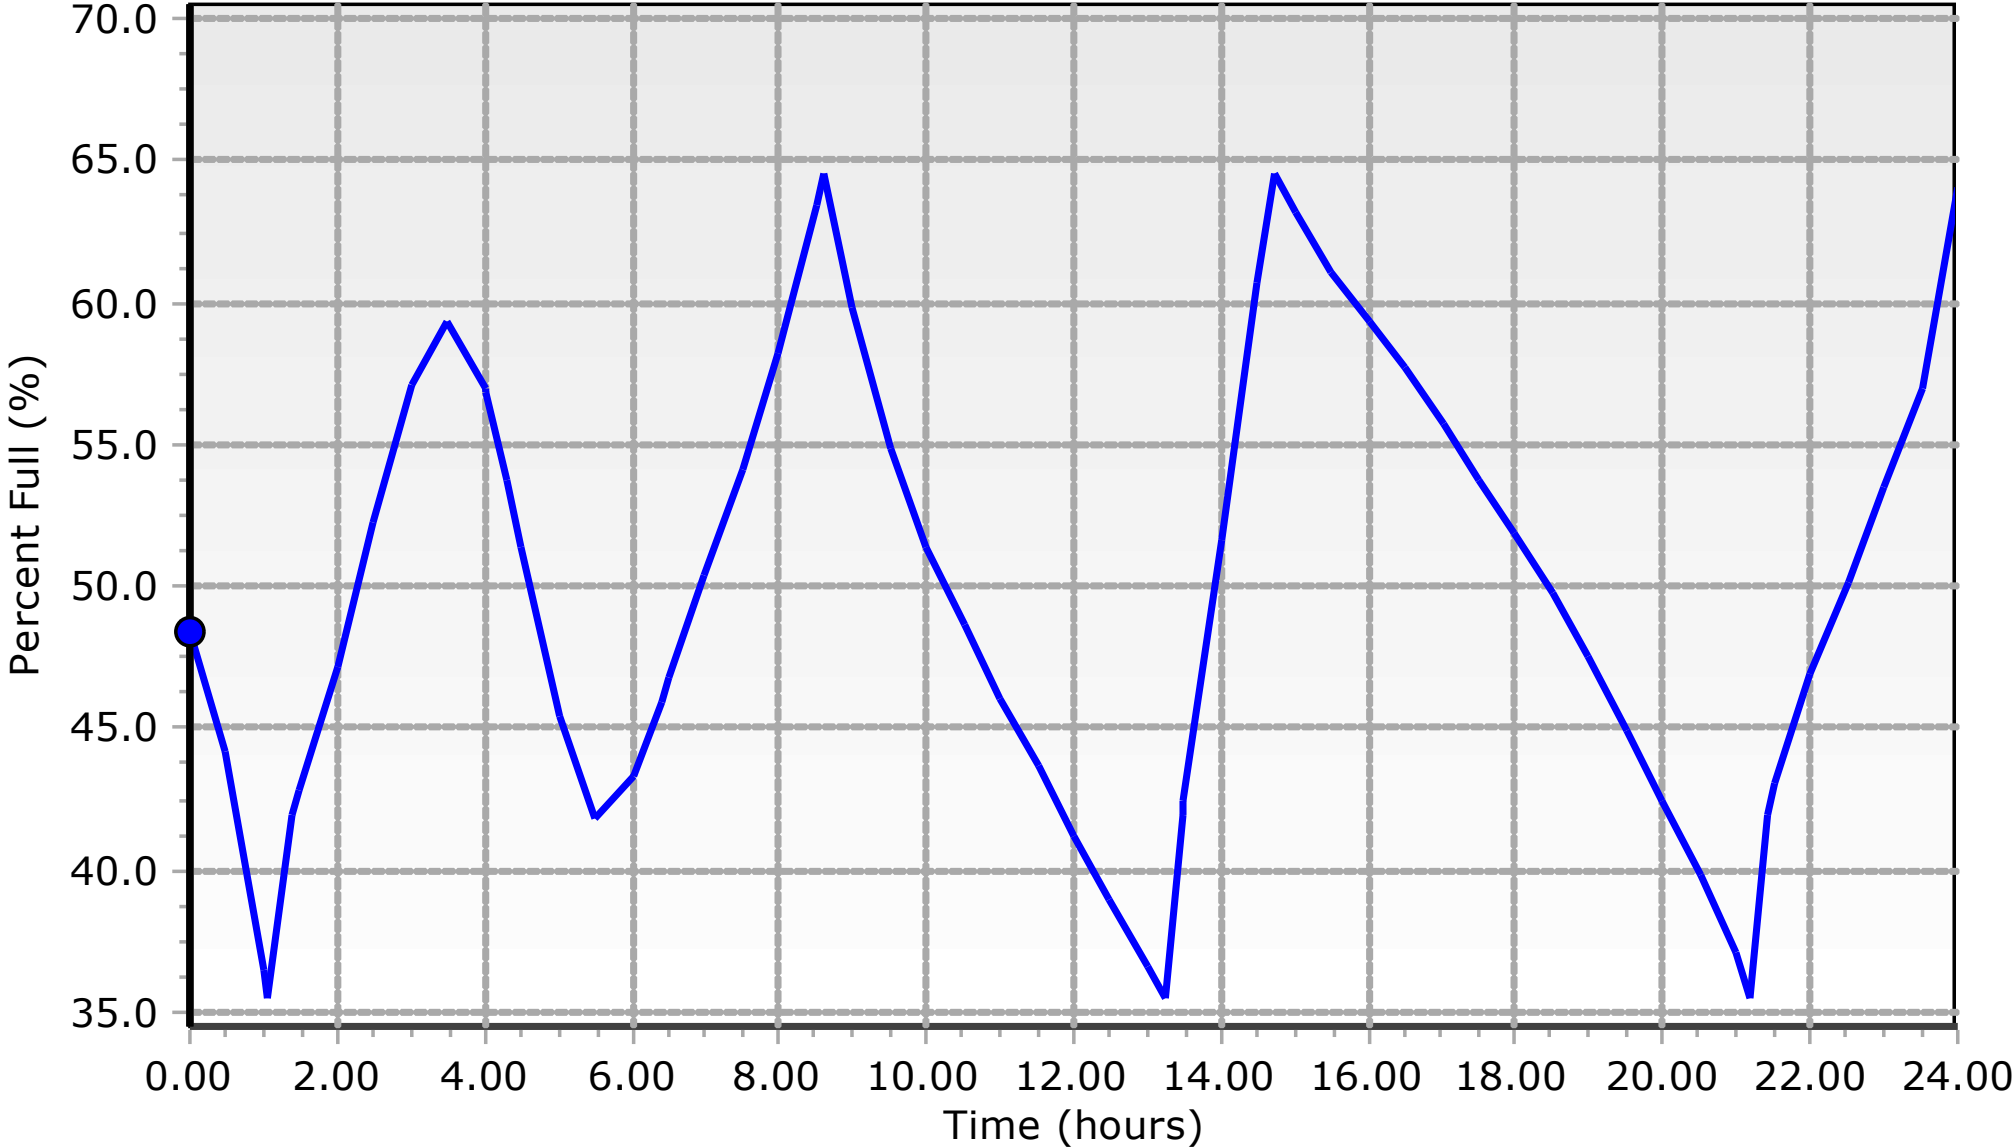

WP 2 GST 1 - Average Demand EPS - Summer - Percent Full


### WP 2 Water Sources

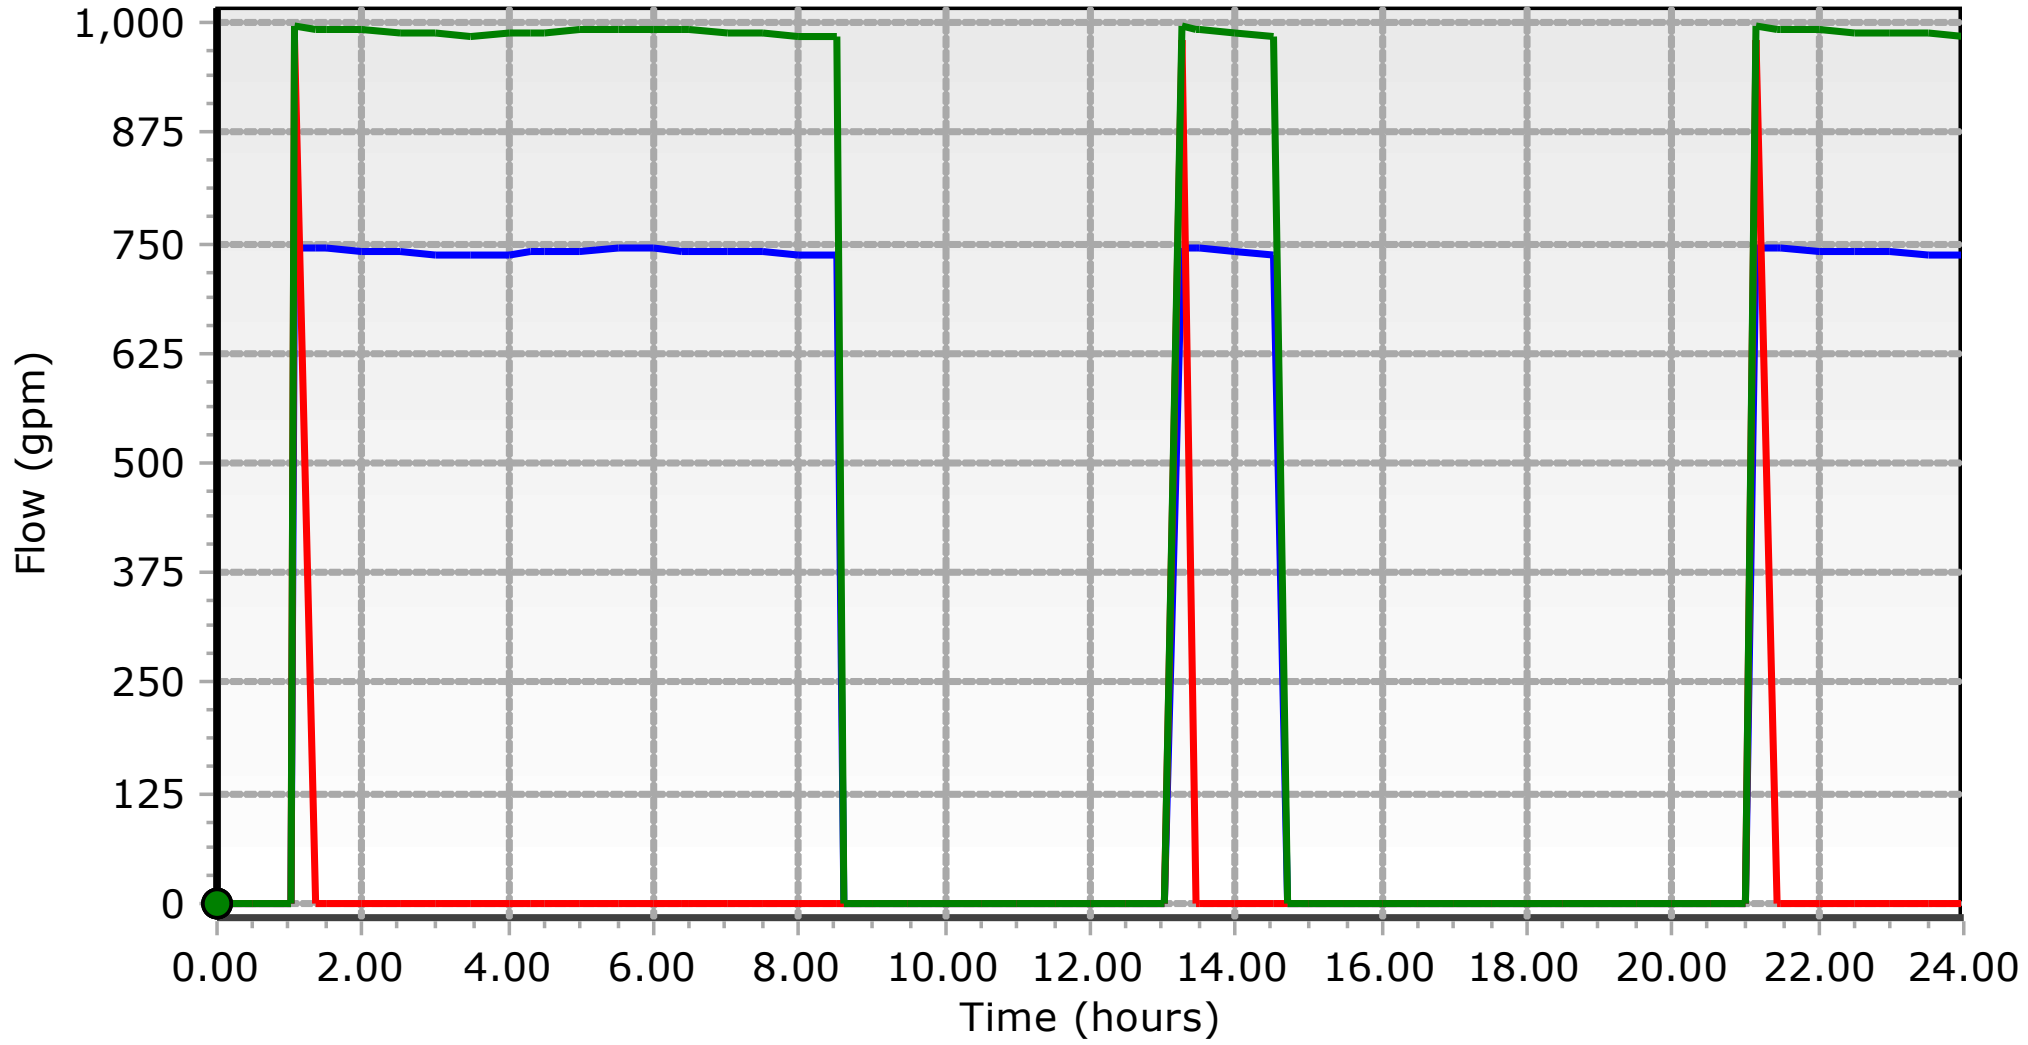

- WW 3 - Average Demand EPS - Summer - Flow (Total)
- COH SW 2 - Average Demand EPS - Summer - Flow (Total)
- WW 4 - Average Demand EPS - Summer - Flow (Total)


# **24-Hour Maximum Day Simulation**

Calculation Summary Graph

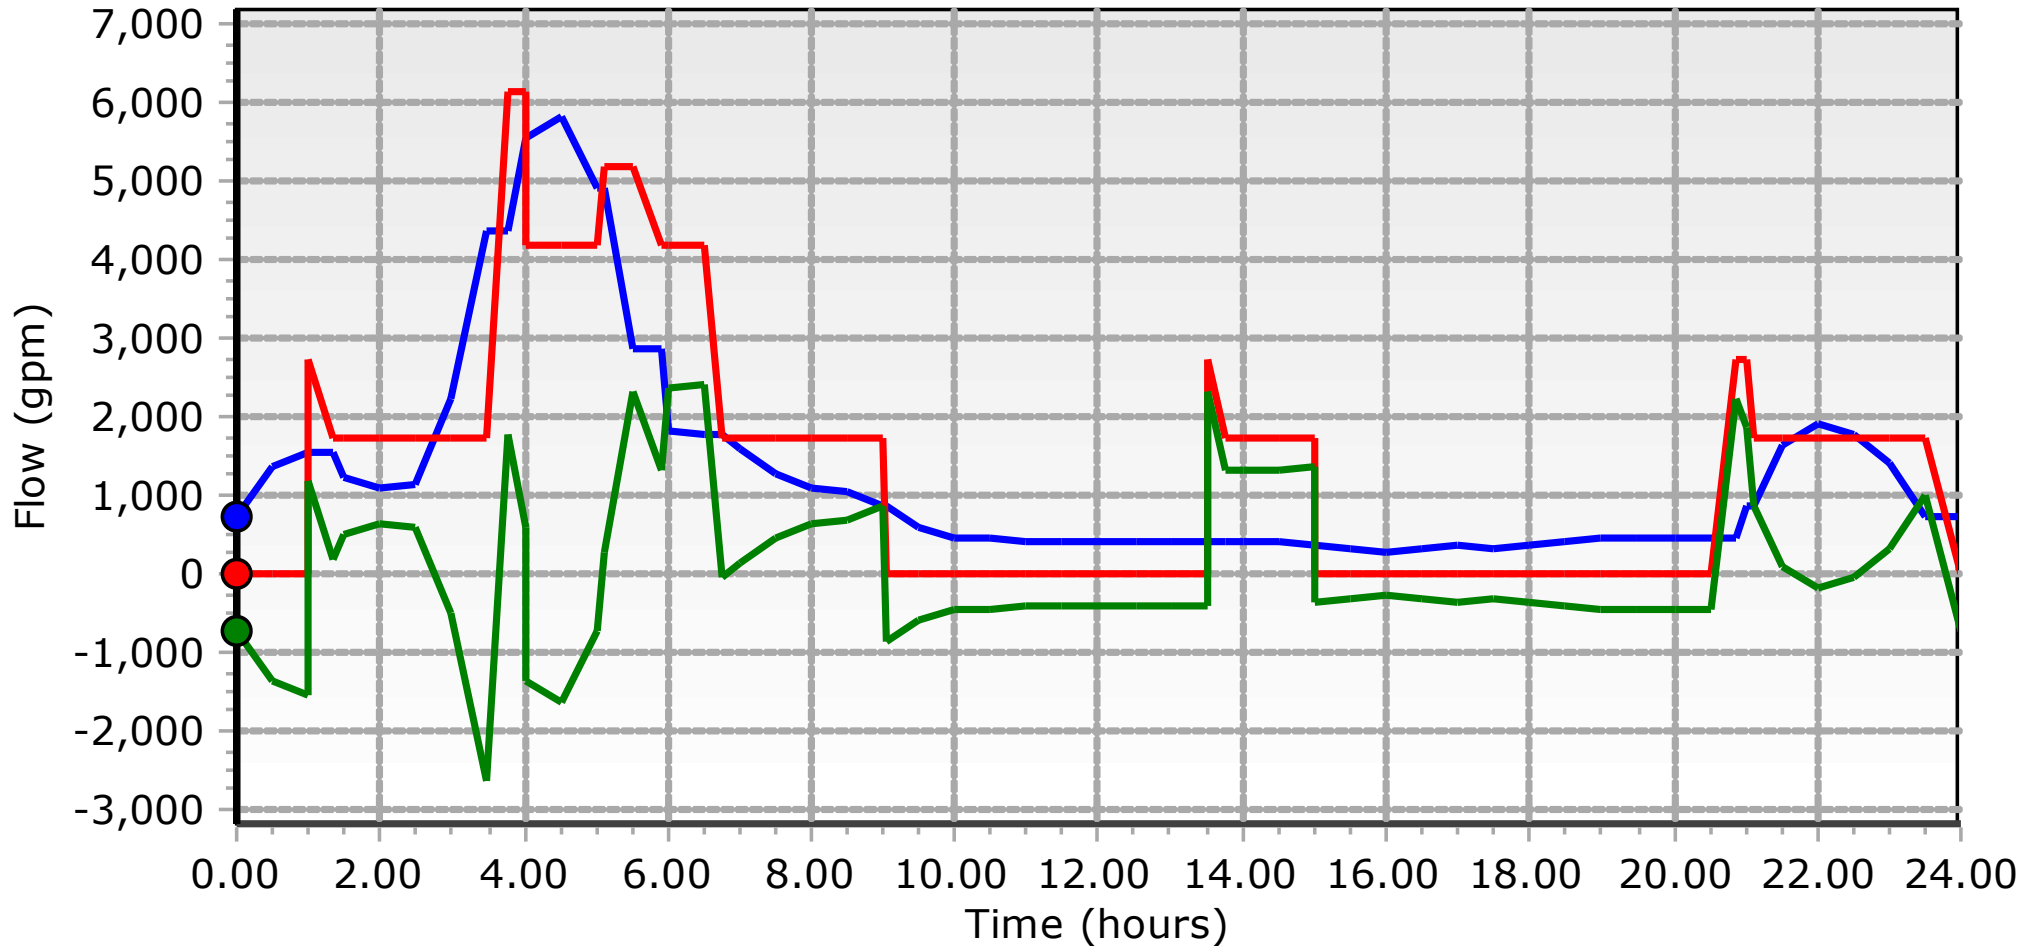


- Maximum Day EPS - Flow Demanded
- Maximum Day EPS - Flow Supplied
- Maximum Day EPS - Flow Stored

WP 1 Tank Levels

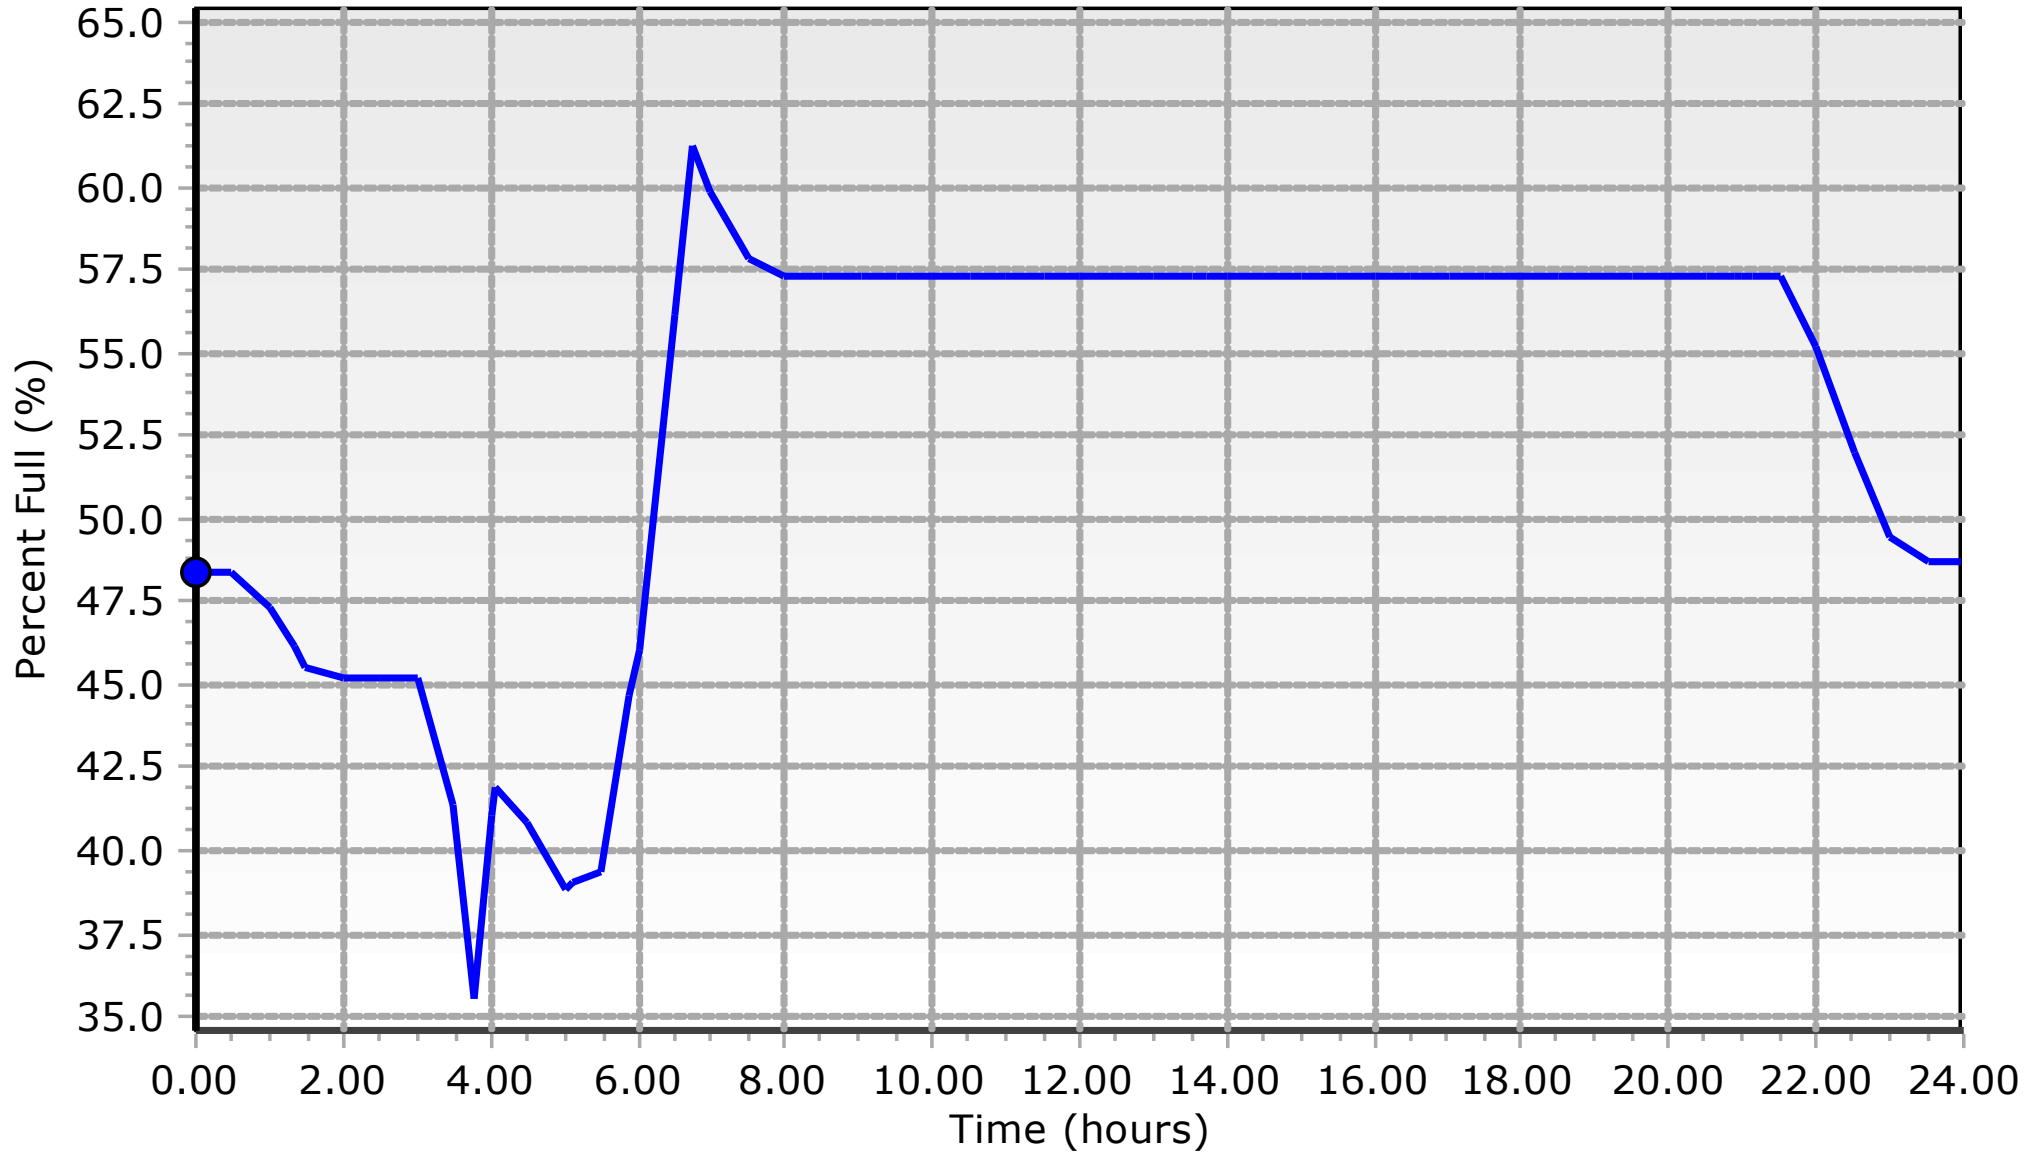


WP 1 GST 1 & 2 - Maximum Day EPS - Percent Full

WP 1 Water Sources

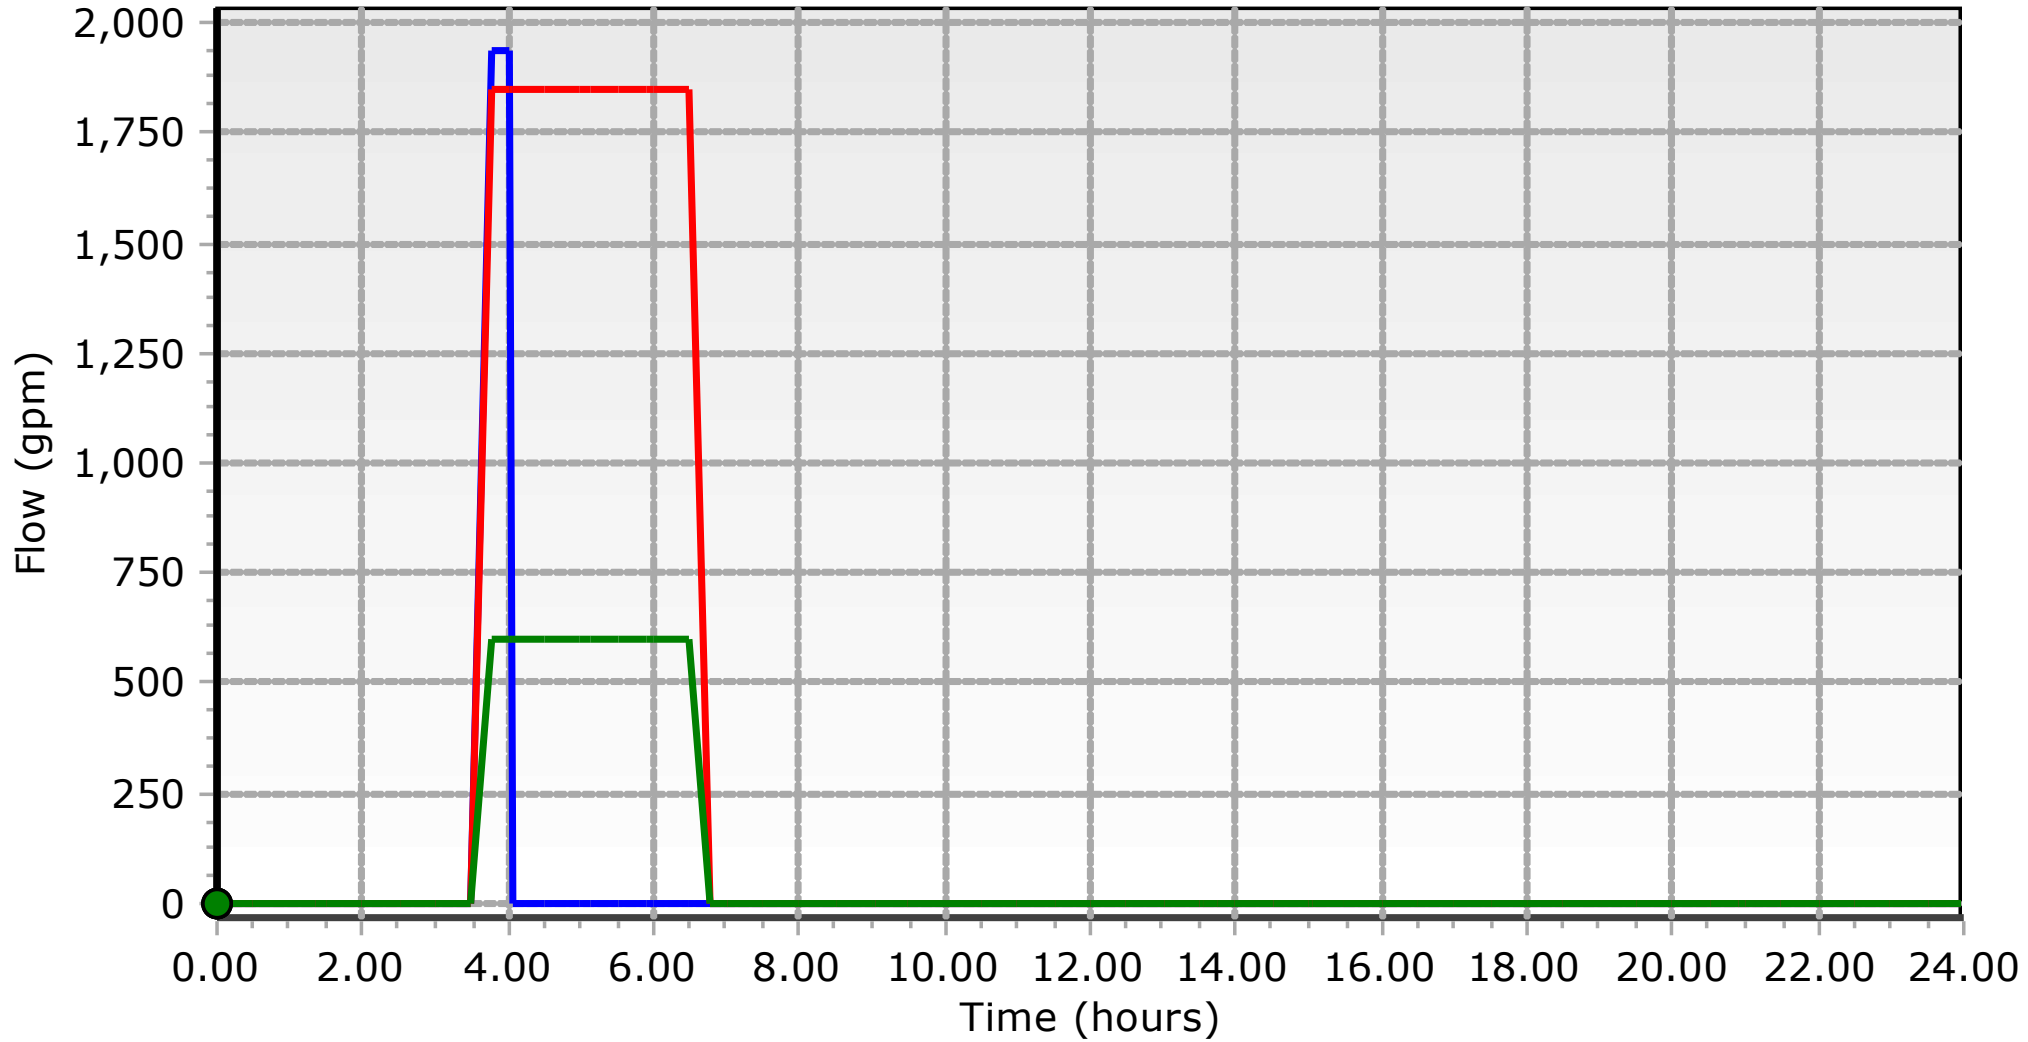



- COH SW 1 - Maximum Day EPS - Flow (Total)
- WW 5 - Maximum Day EPS - Flow (Total)
- WW 1 - Maximum Day EPS - Flow (Total)

WP 2 Tank Level

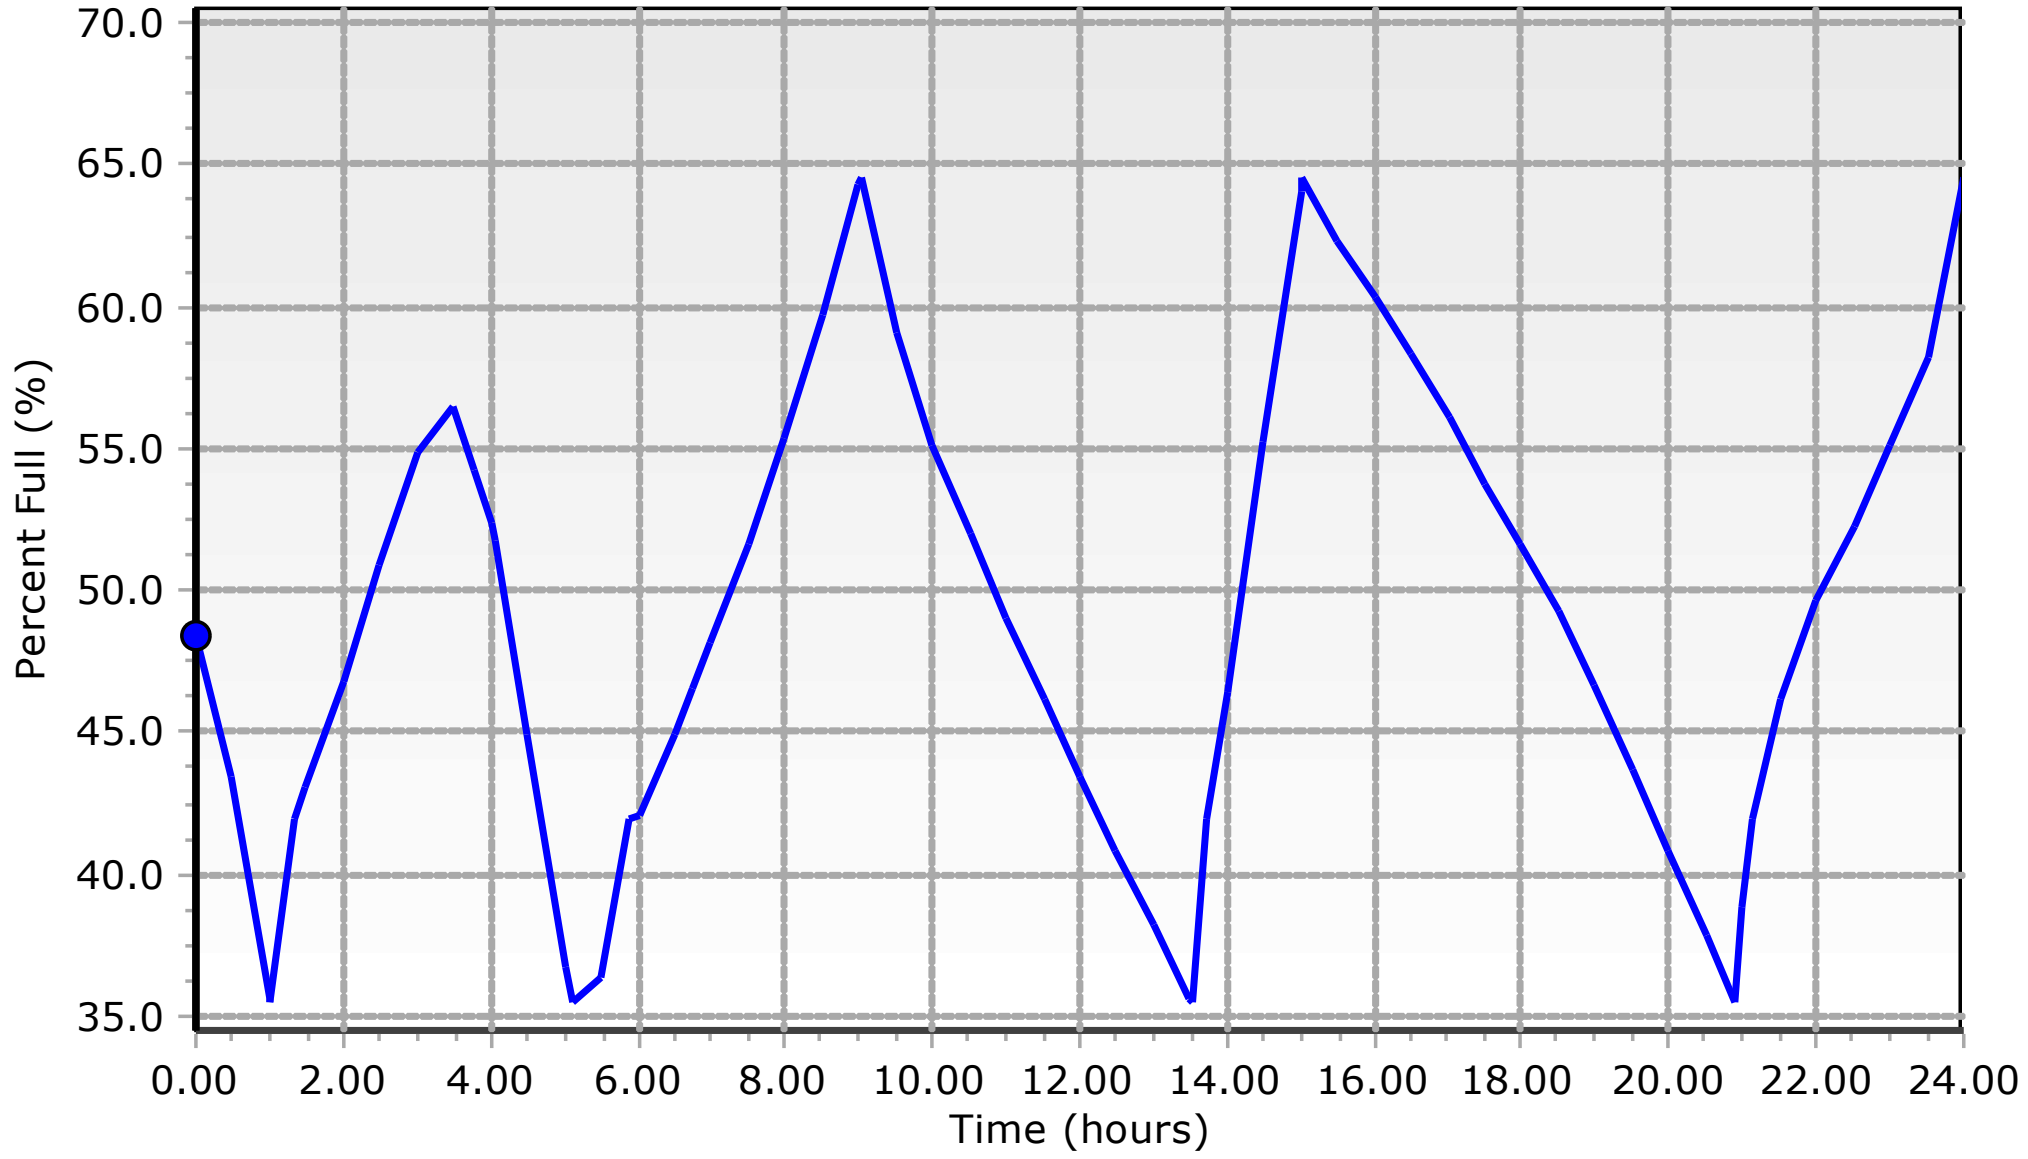

WP 2 GST 1 - Maximum Day EPS - Percent Full


### WP 2 Water Sources

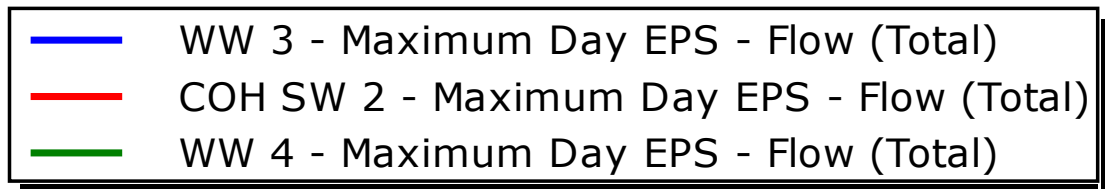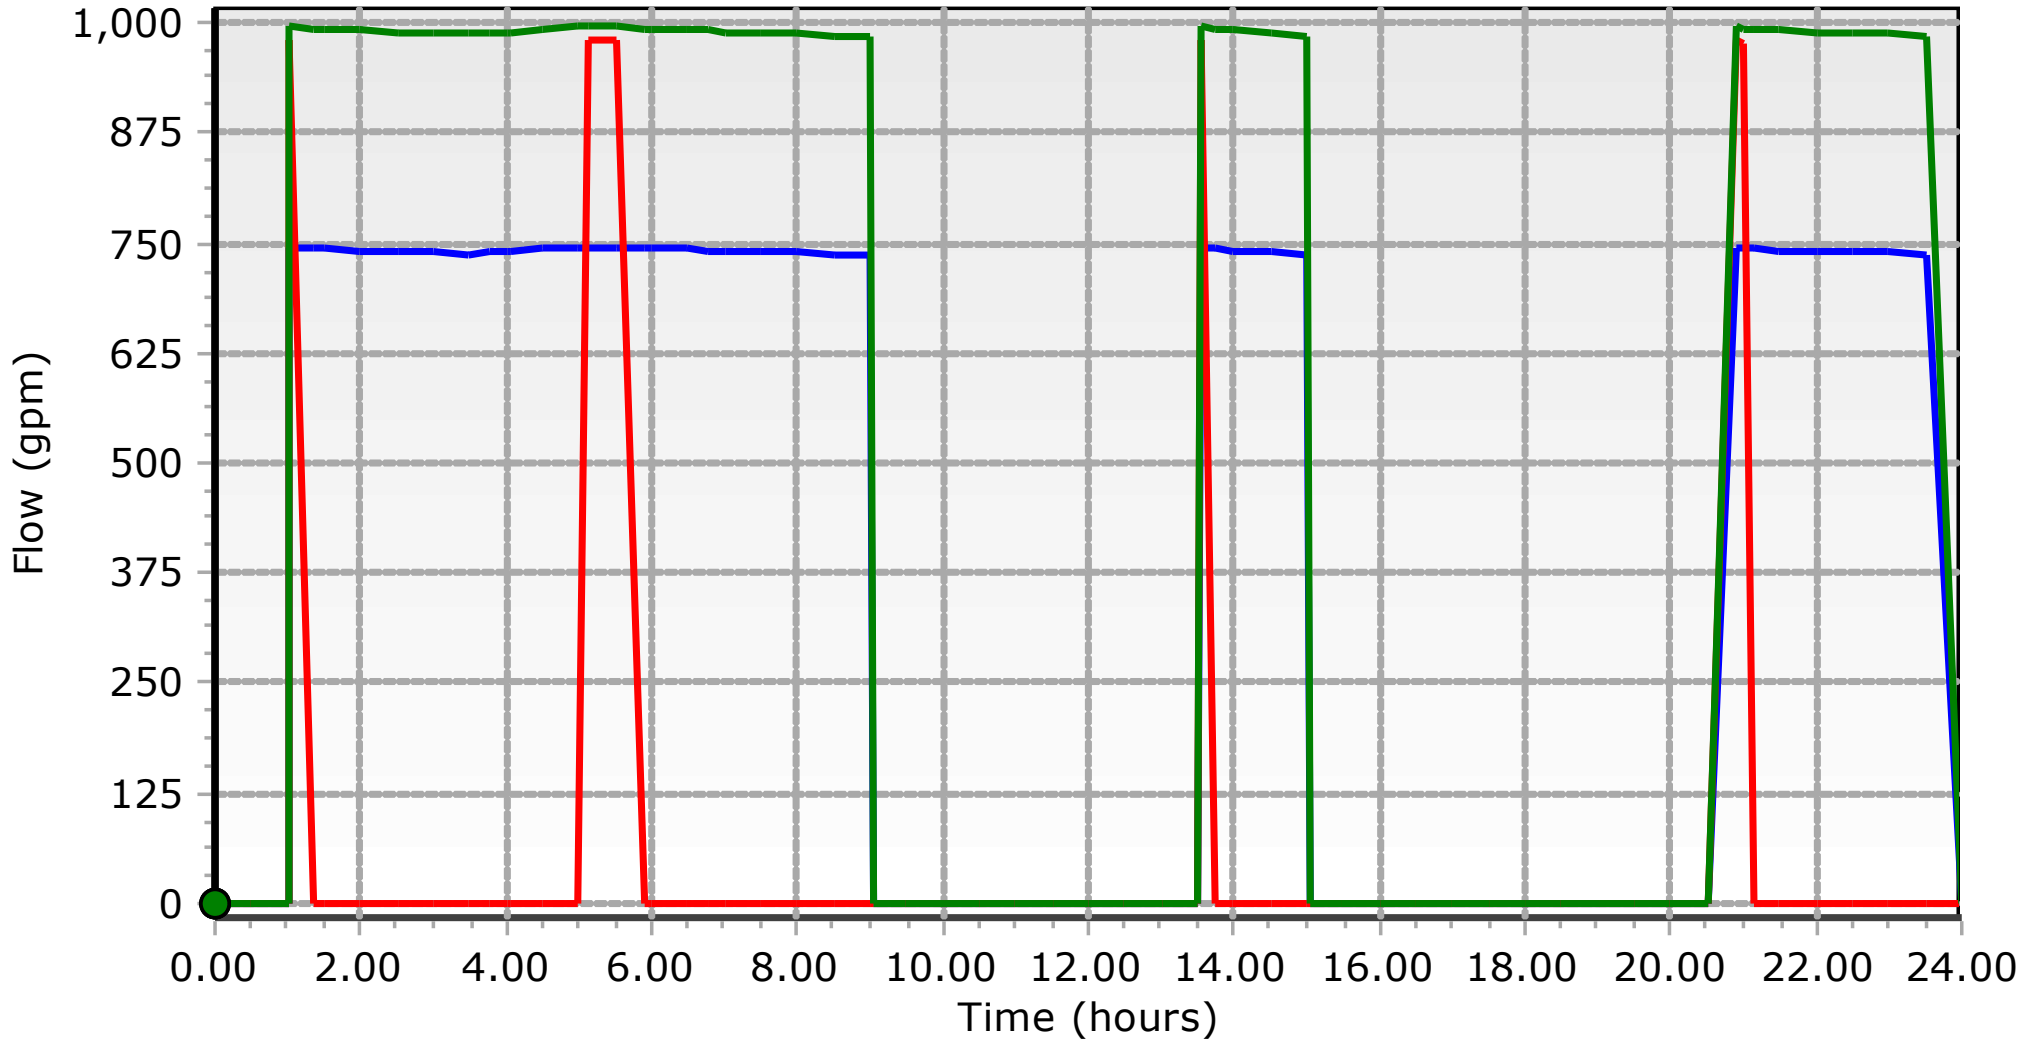

**City of Bunker Hill Village Removal of  
City of Houston Surface Water -  
Extended Period Simulation**


# **24-Hour Average Winter Day Simulation**

Calculation Summary Graph

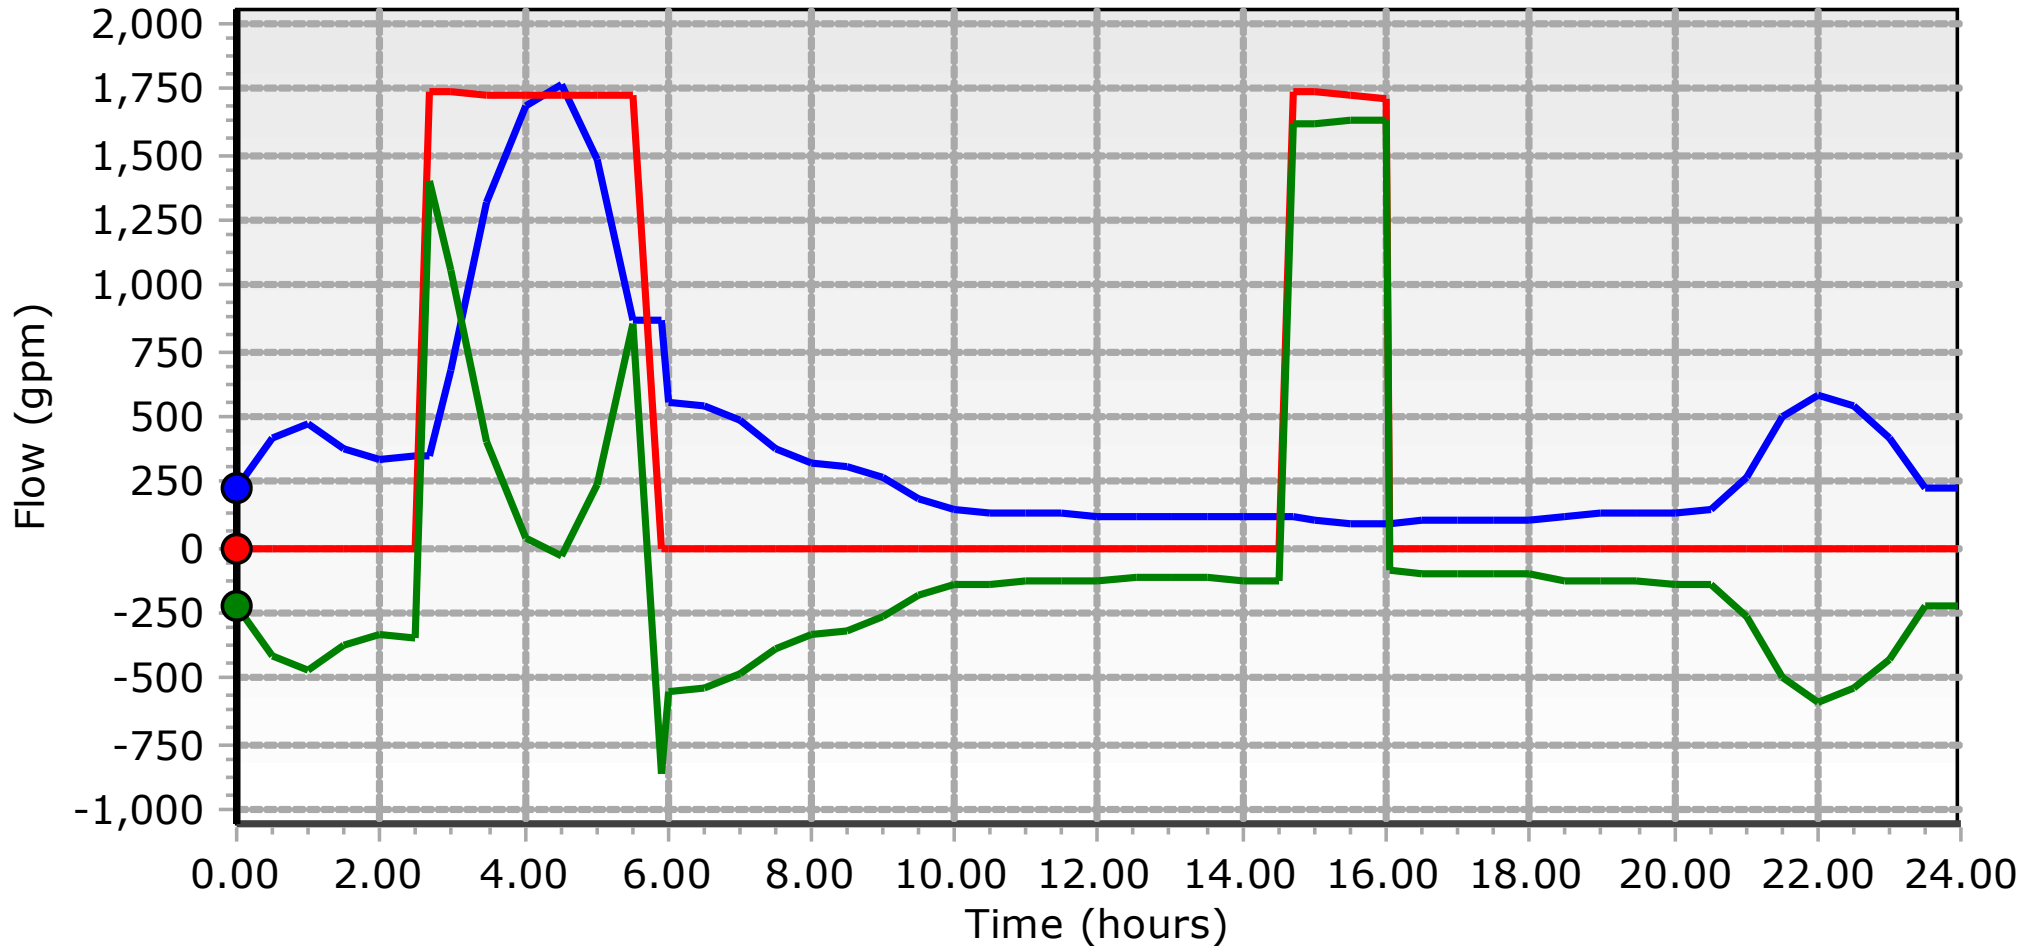



- Average Demand EPS - Winter - Flow Demanded
- Average Demand EPS - Winter - Flow Supplied
- Average Demand EPS - Winter - Flow Stored

WP 1 Tank Levels

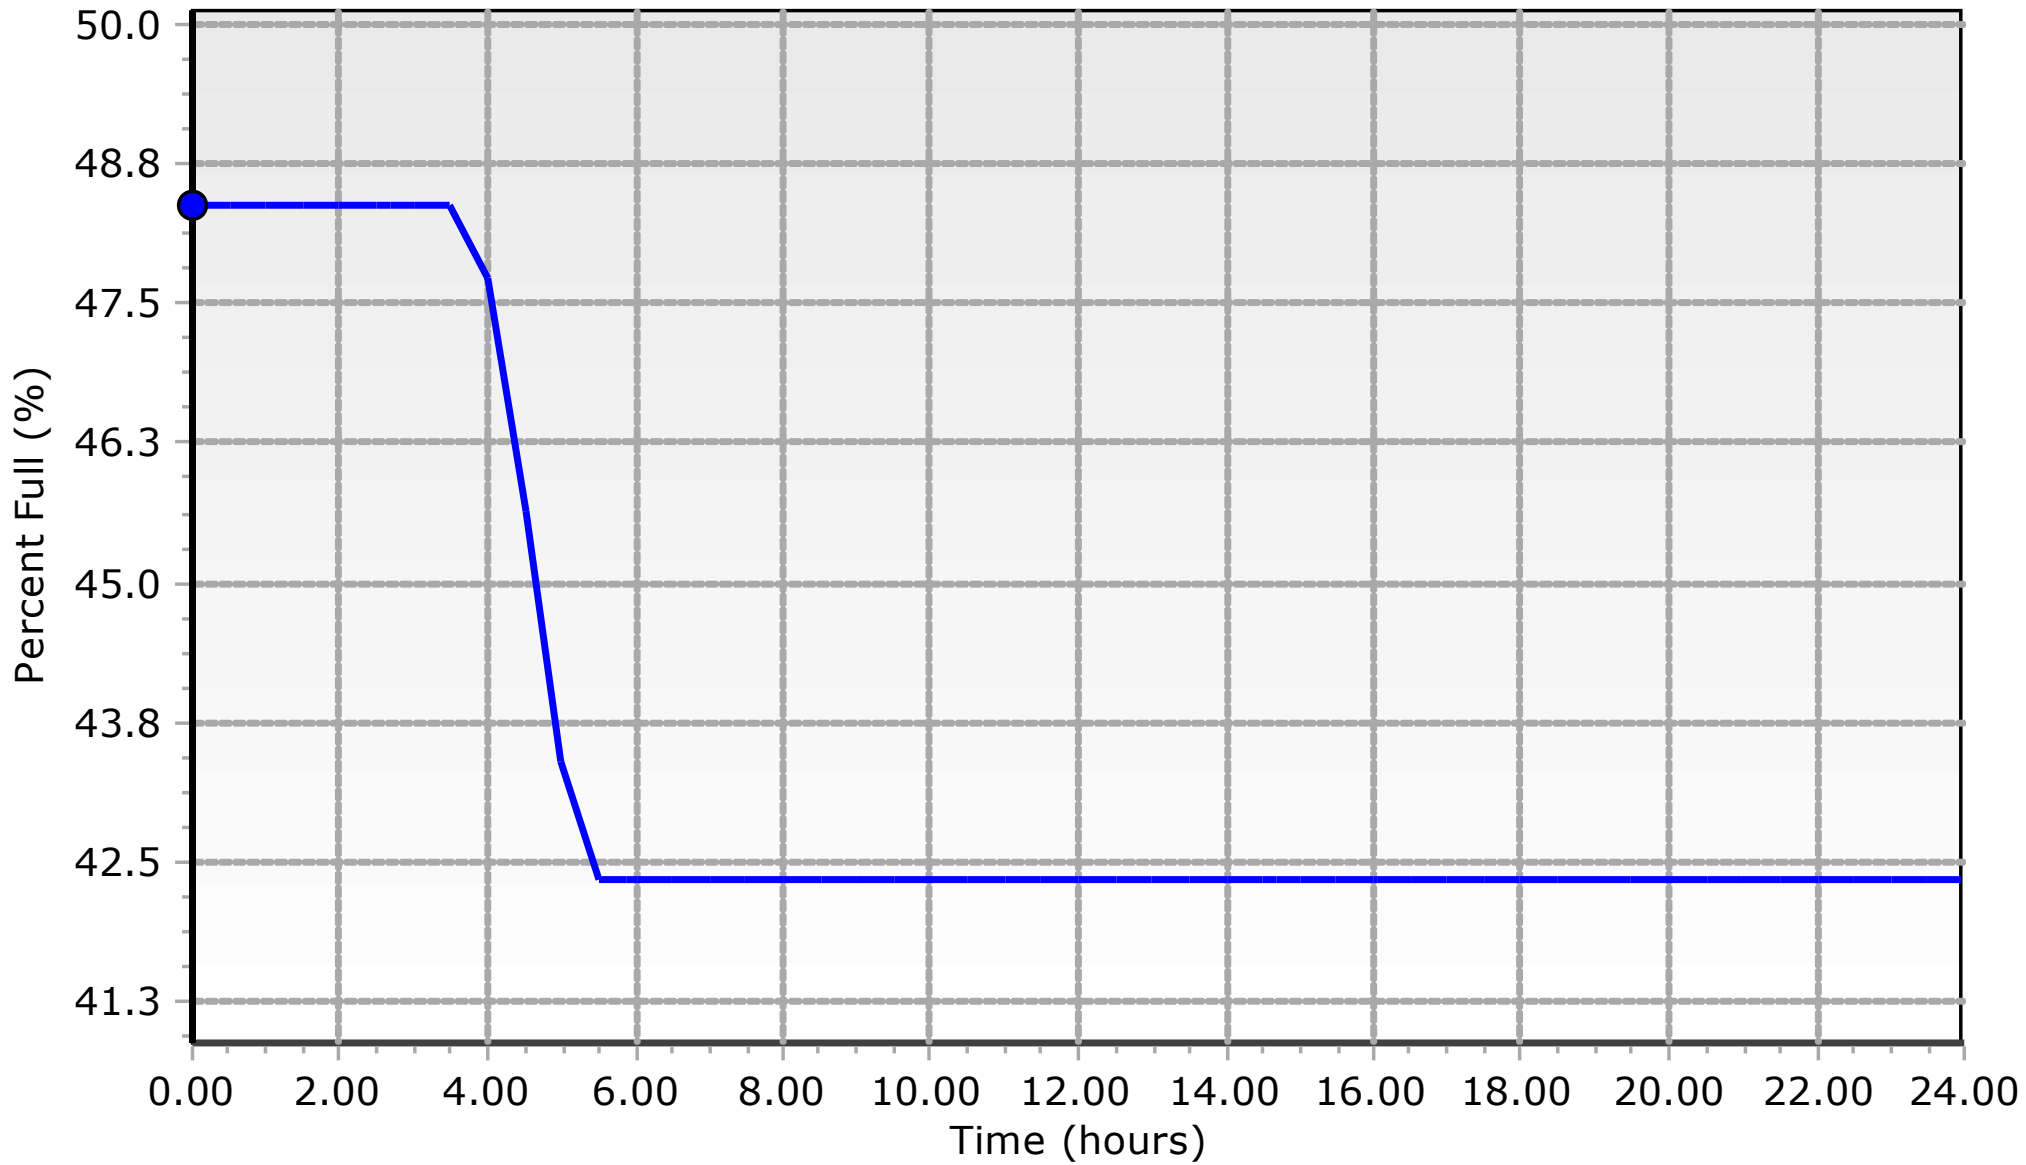


WP 1 GST 1 & 2 - Average Demand EPS - Winter - Percent Full

# WP 1 Water Sources

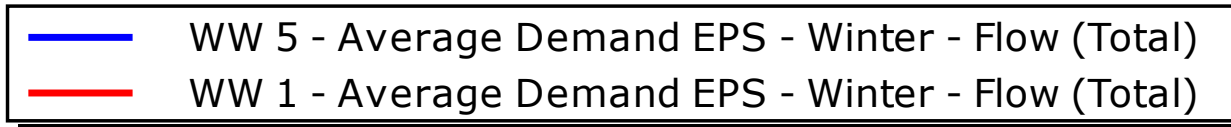
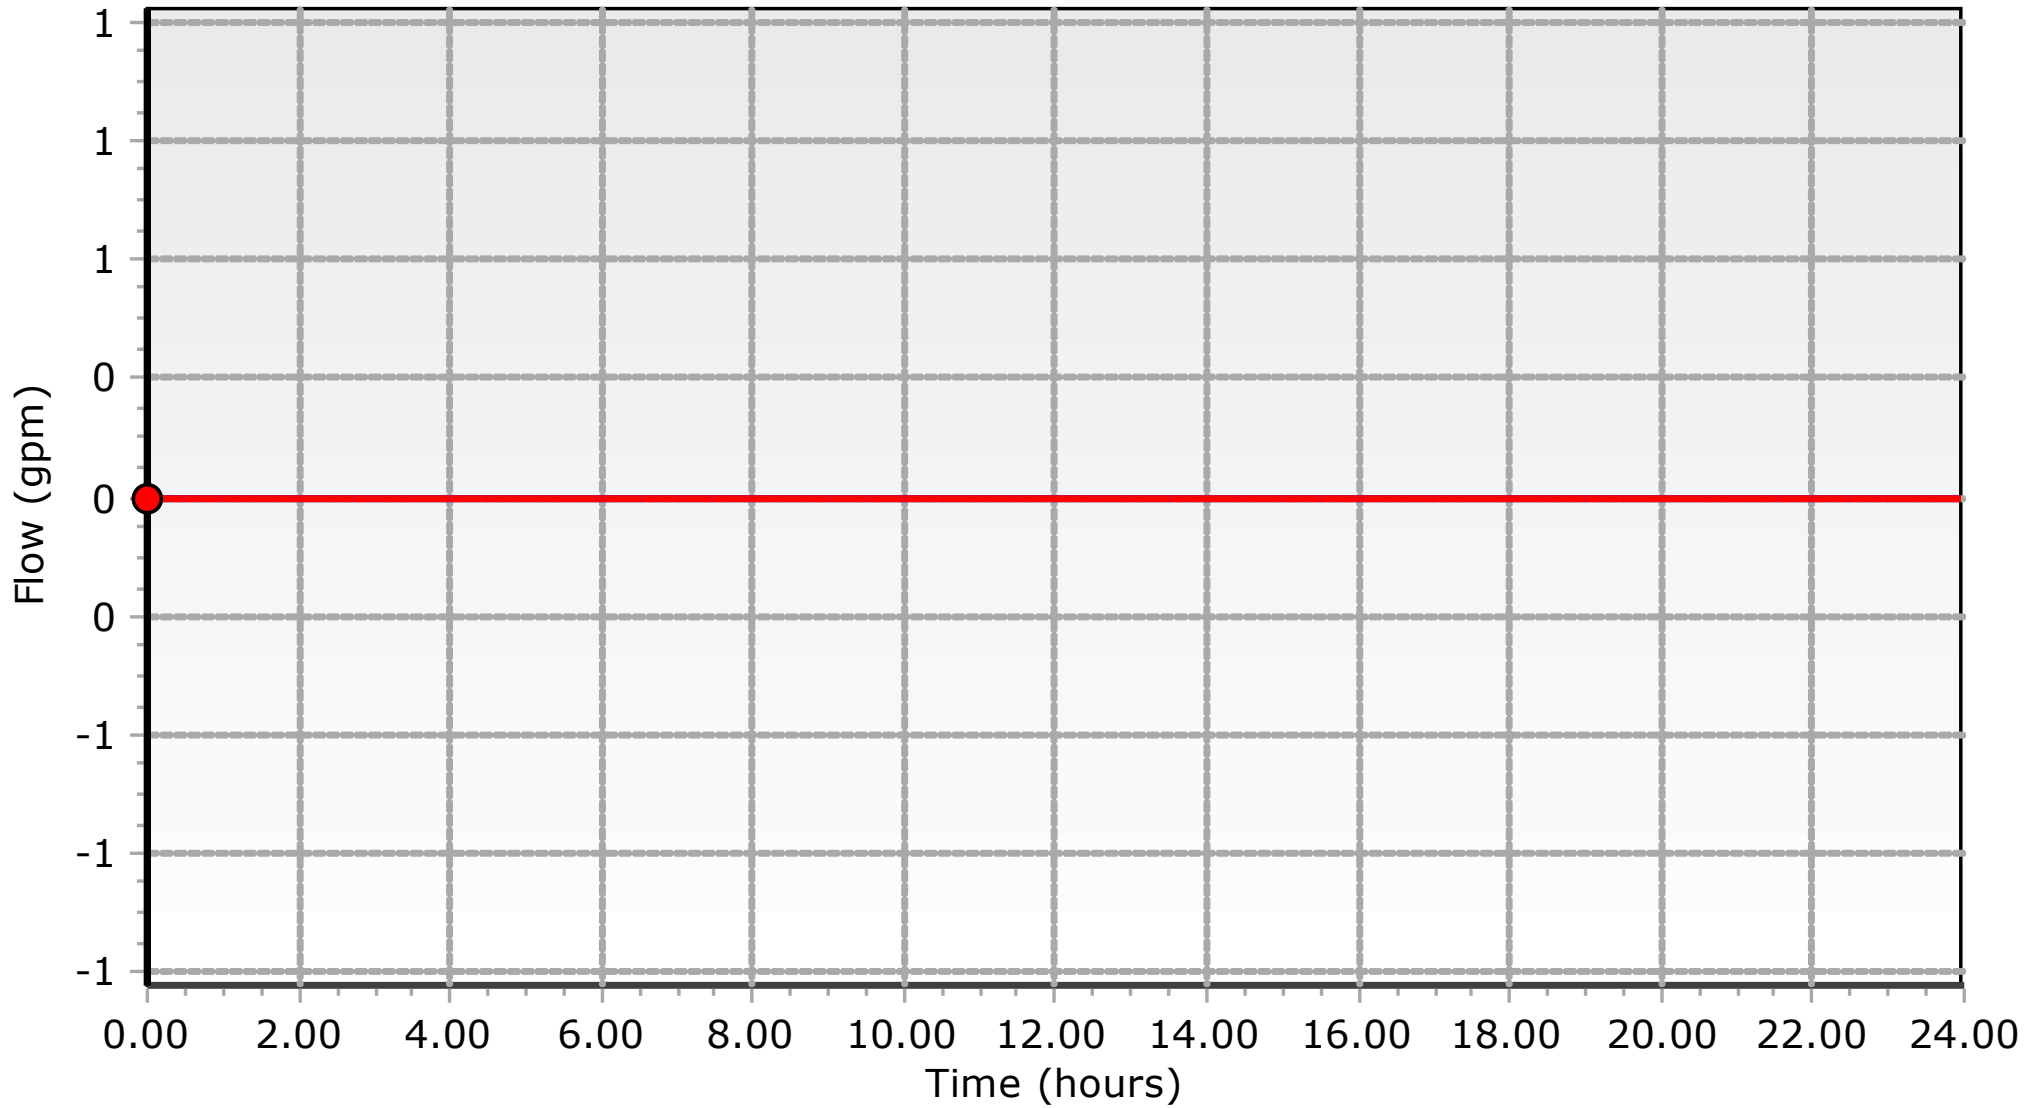


WP 2 Tank Level

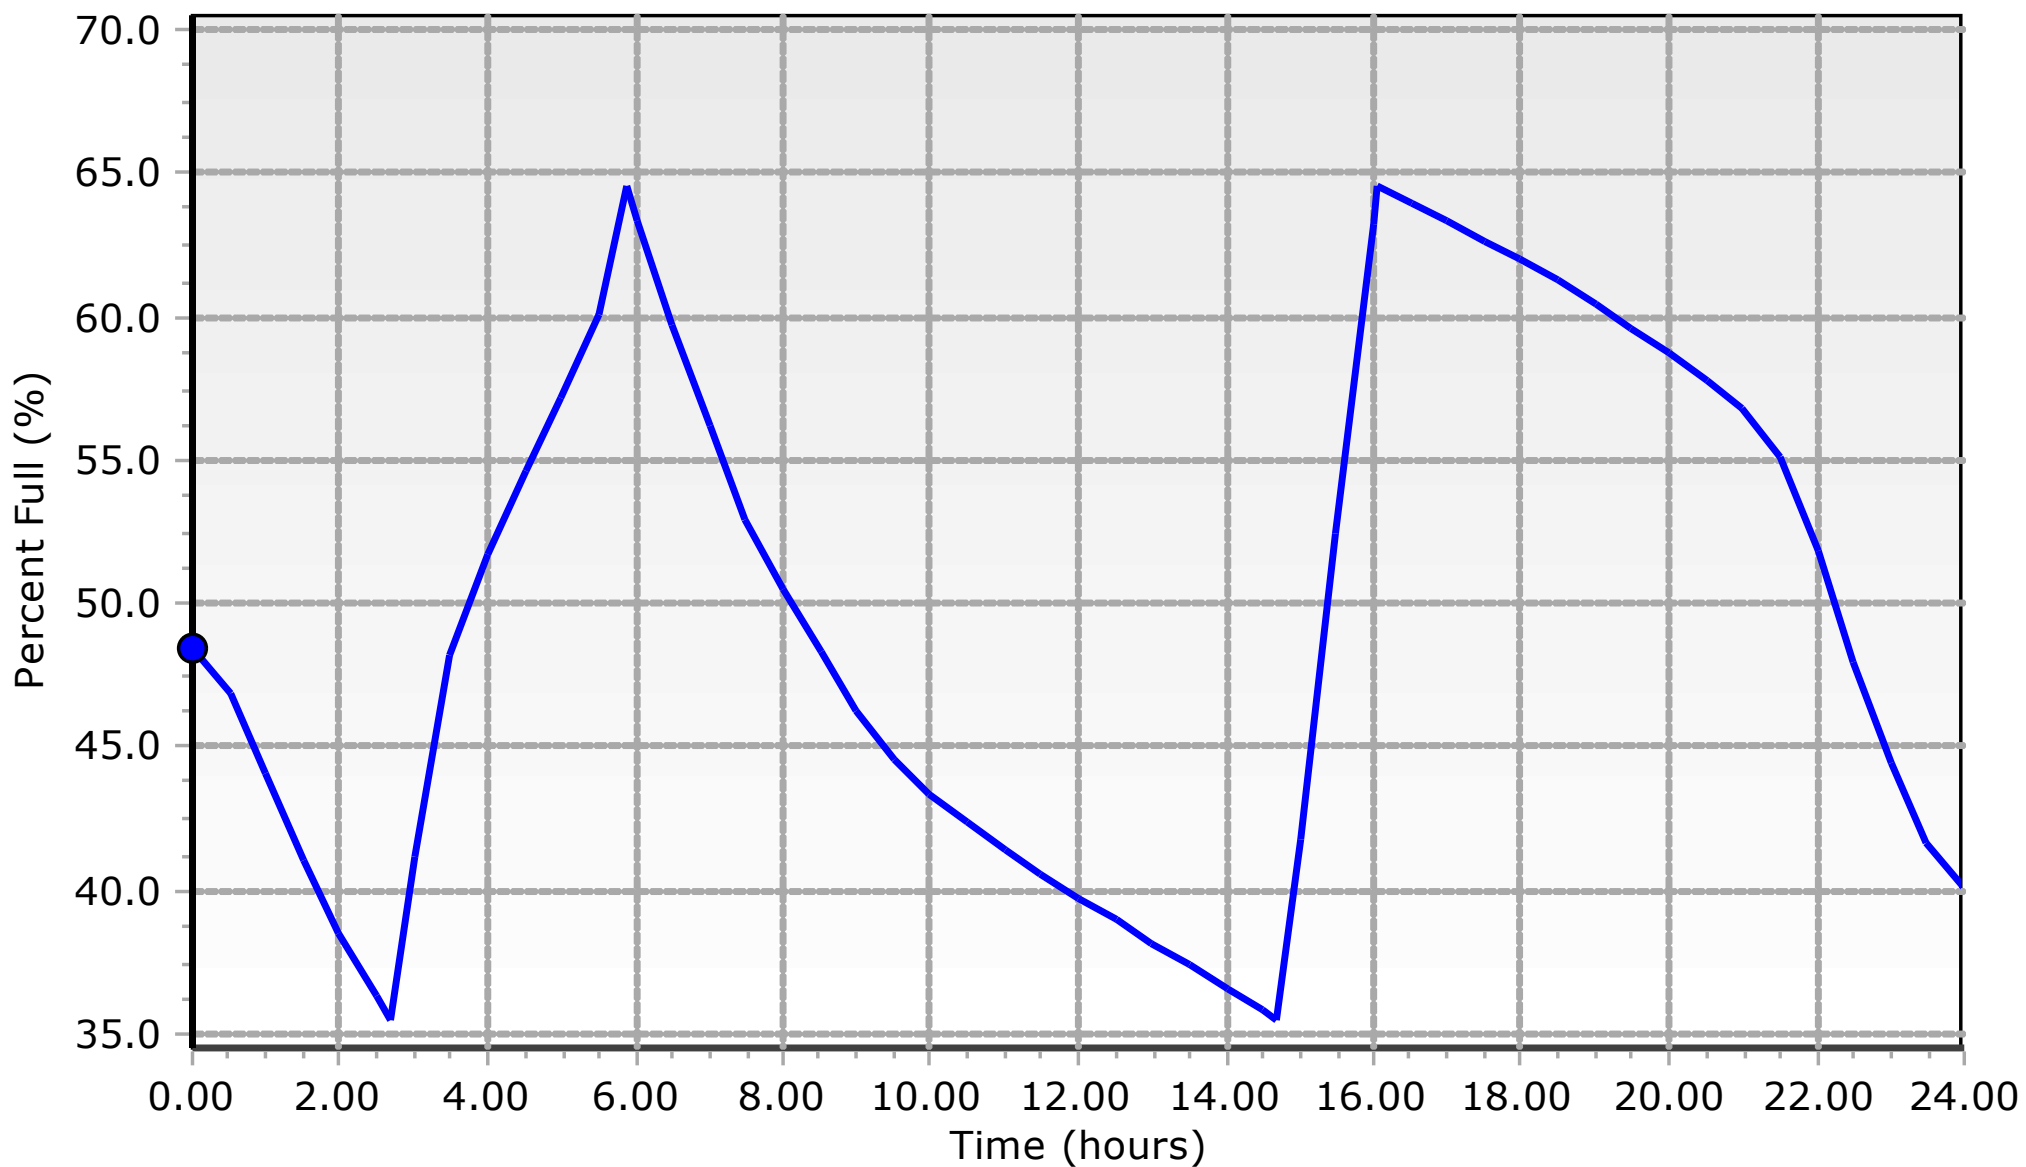



WP 2 GST 1 - Average Demand EPS - Winter - Percent Full

### WP 2 Water Sources

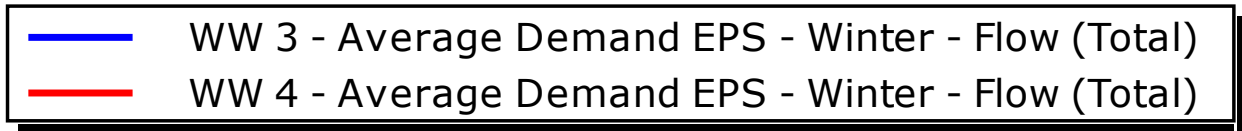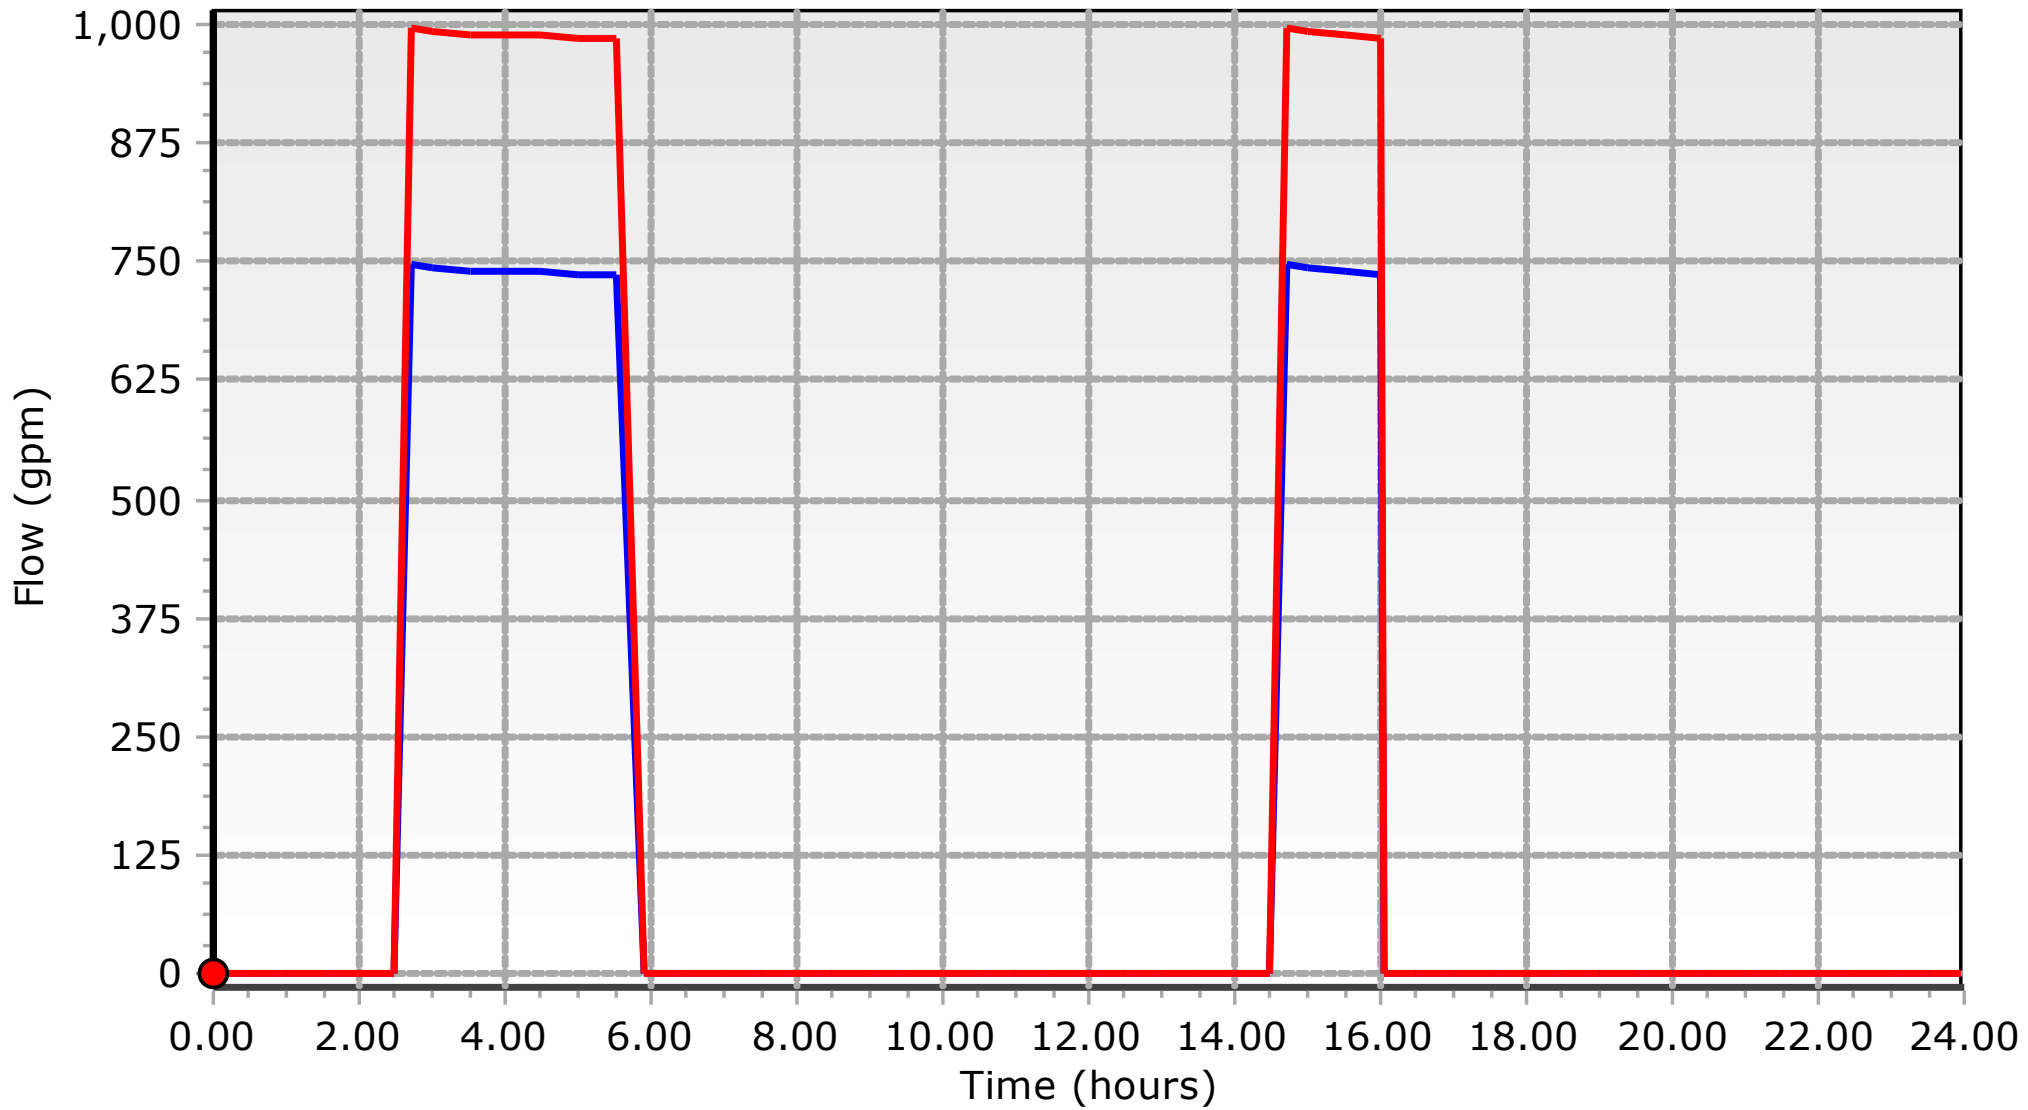


# **24-Hour Average Summer Day Simulation**

Calculation Summary Graph

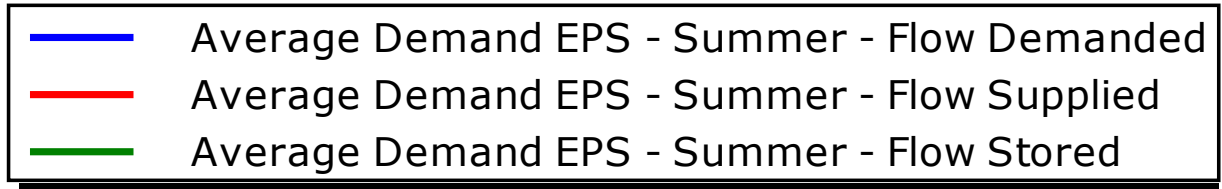
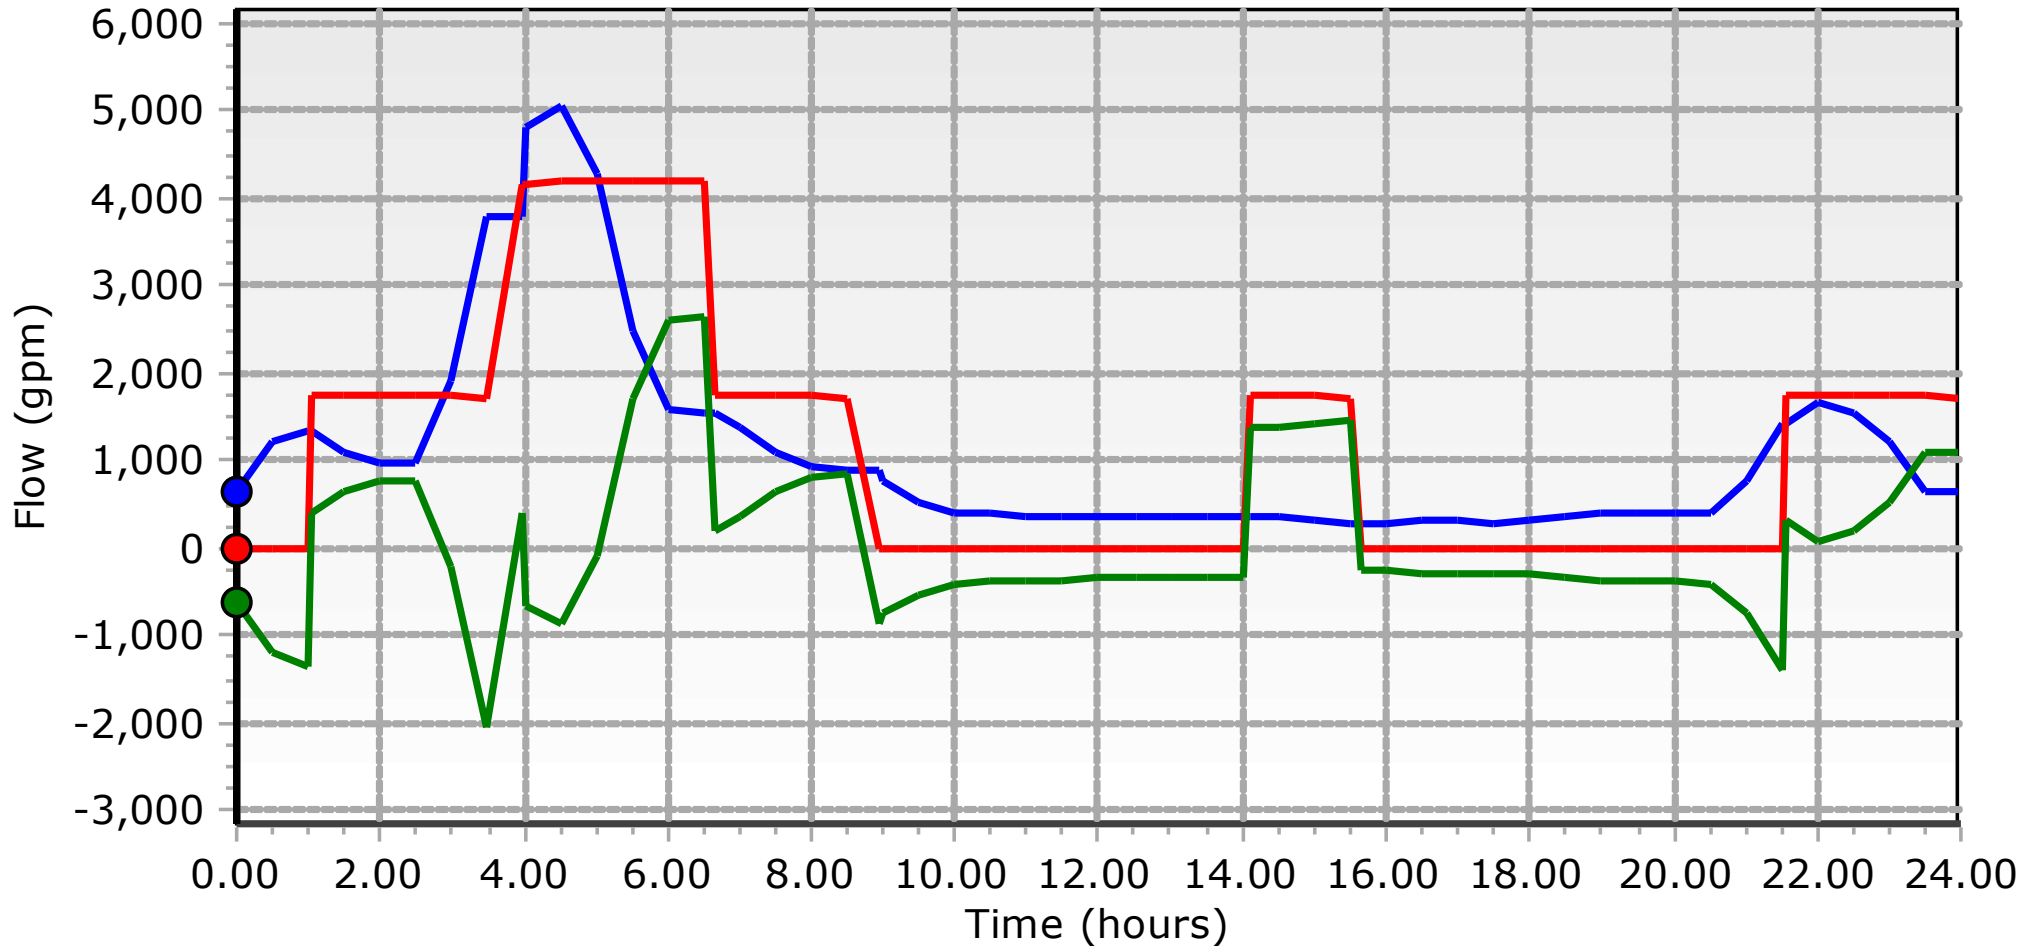


WP 1 Tank Levels

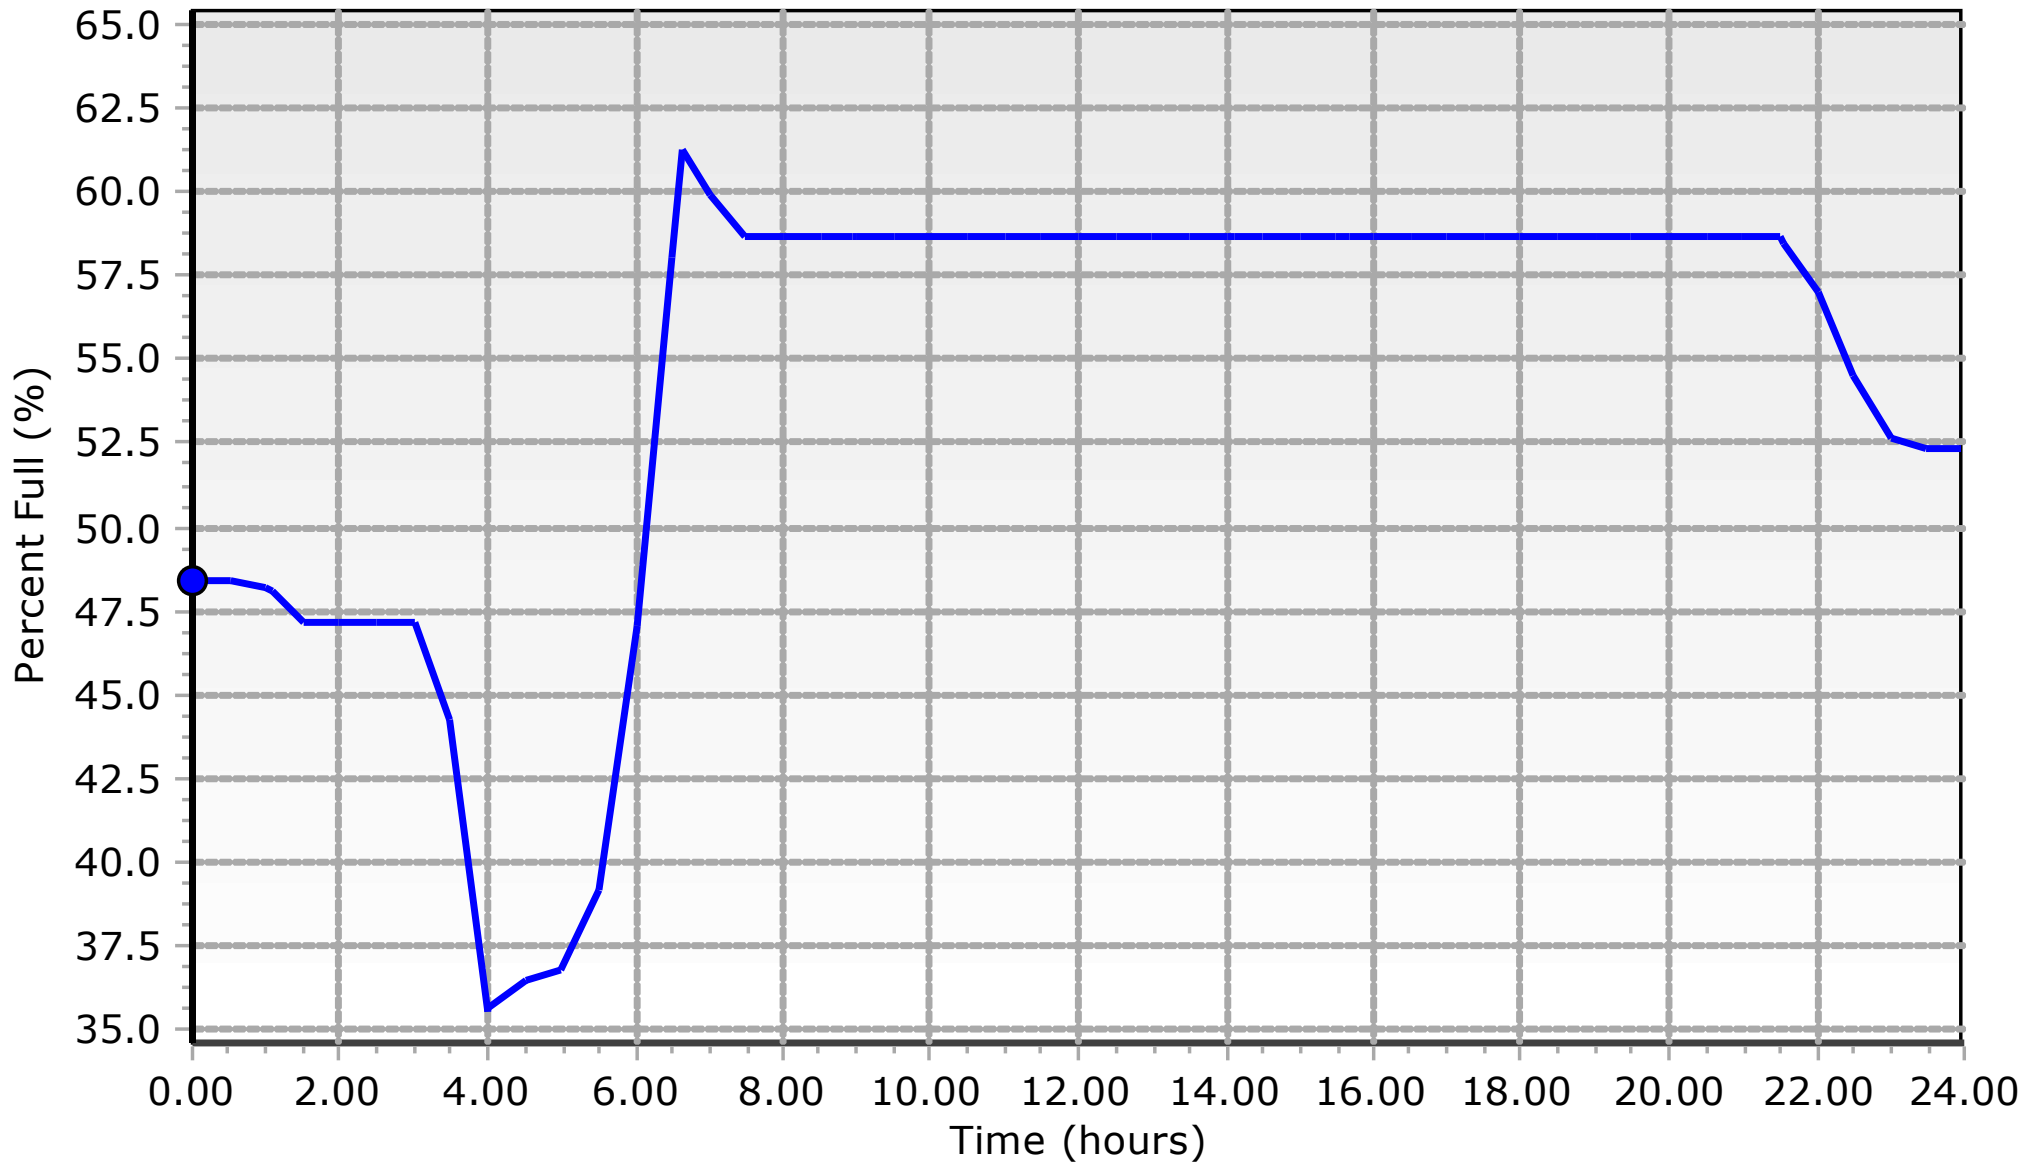


WP 1 GST 1 & 2 - Average Demand EPS - Summer - Percent Full

# WP 1 Water Sources

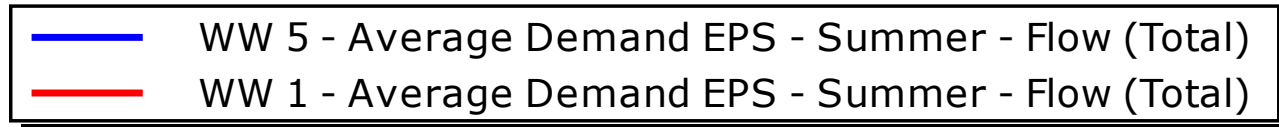
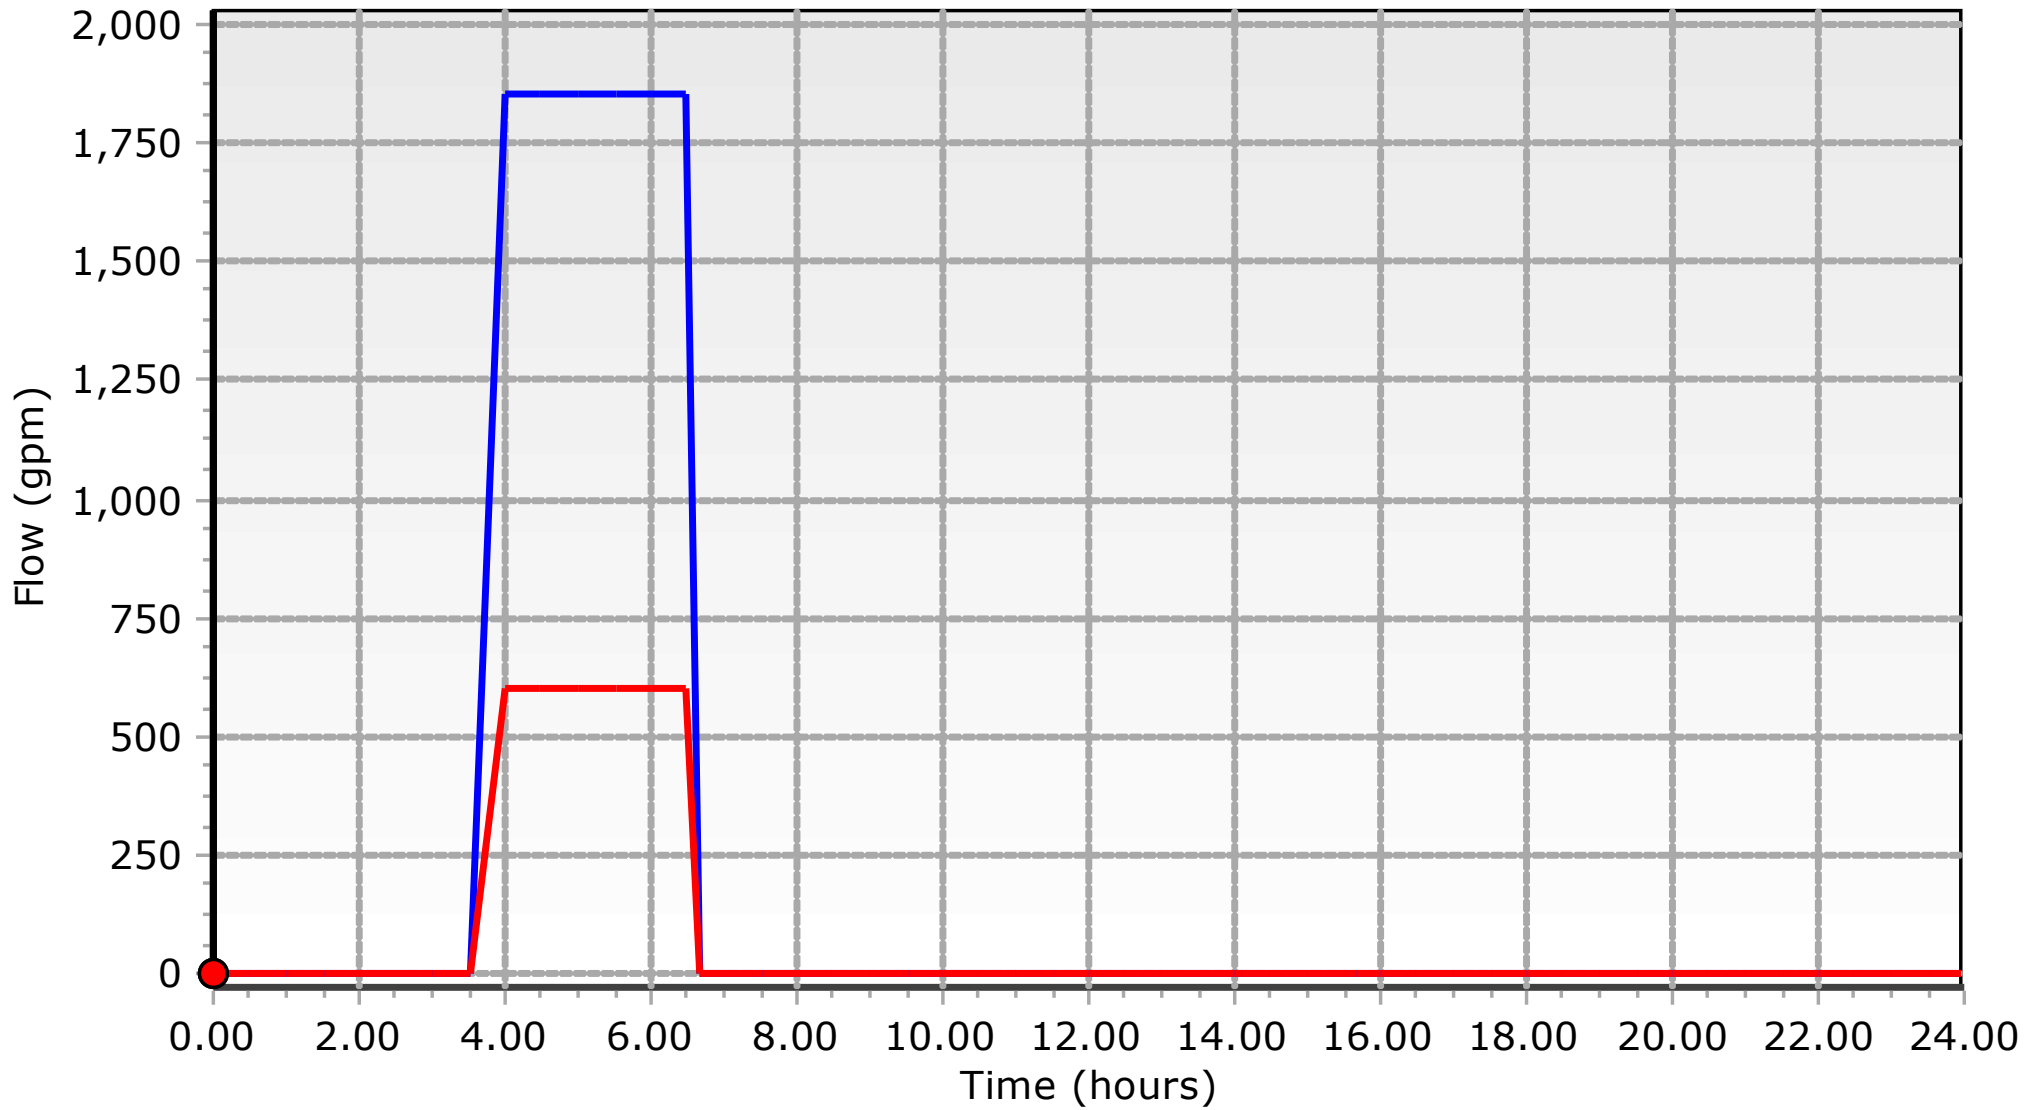


WP 2 Tank Level

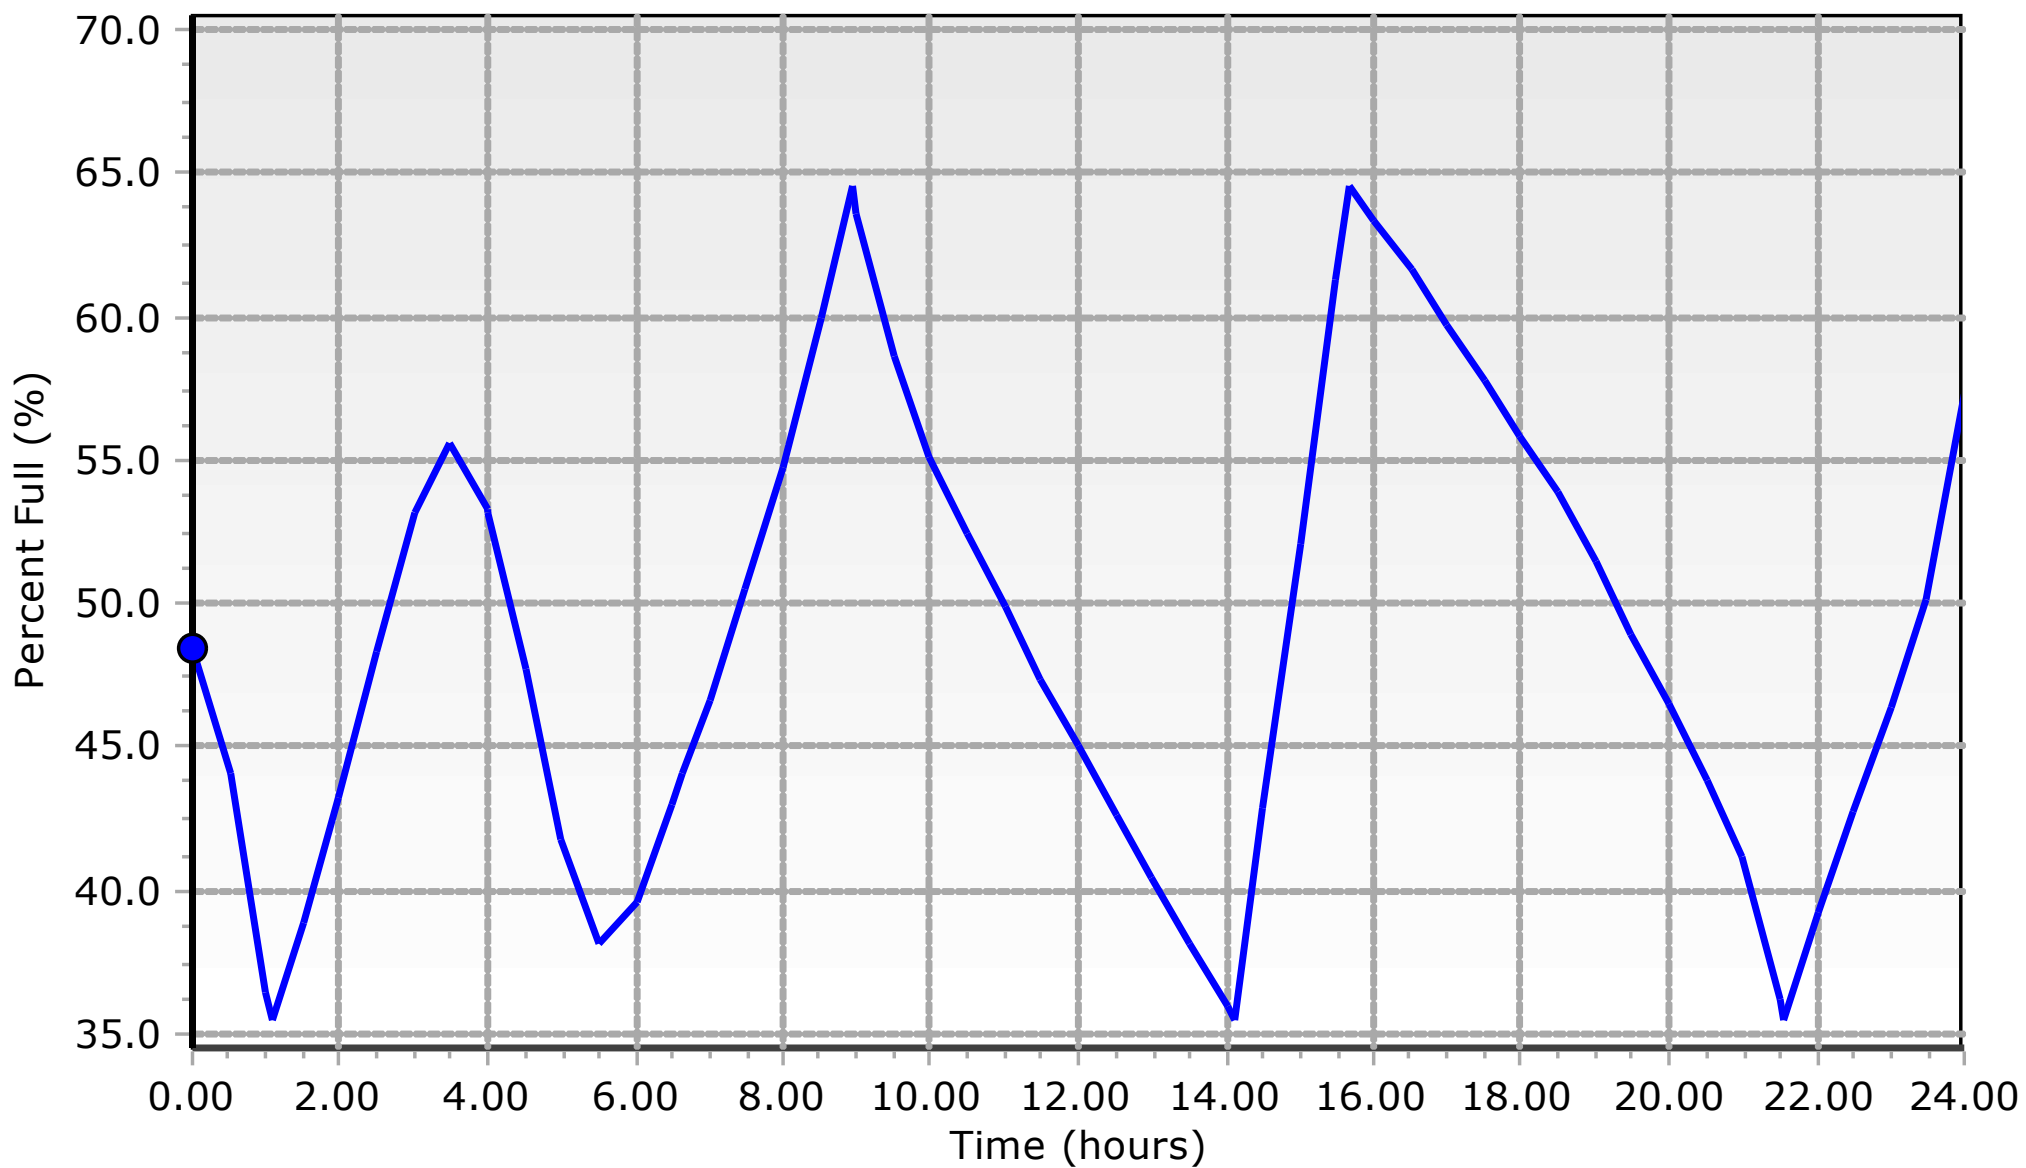


WP 2 GST 1 - Average Demand EPS - Summer - Percent Full

### WP 2 Water Sources

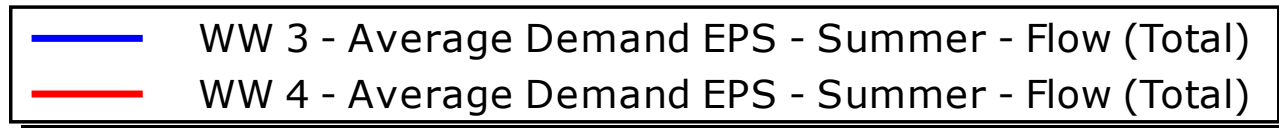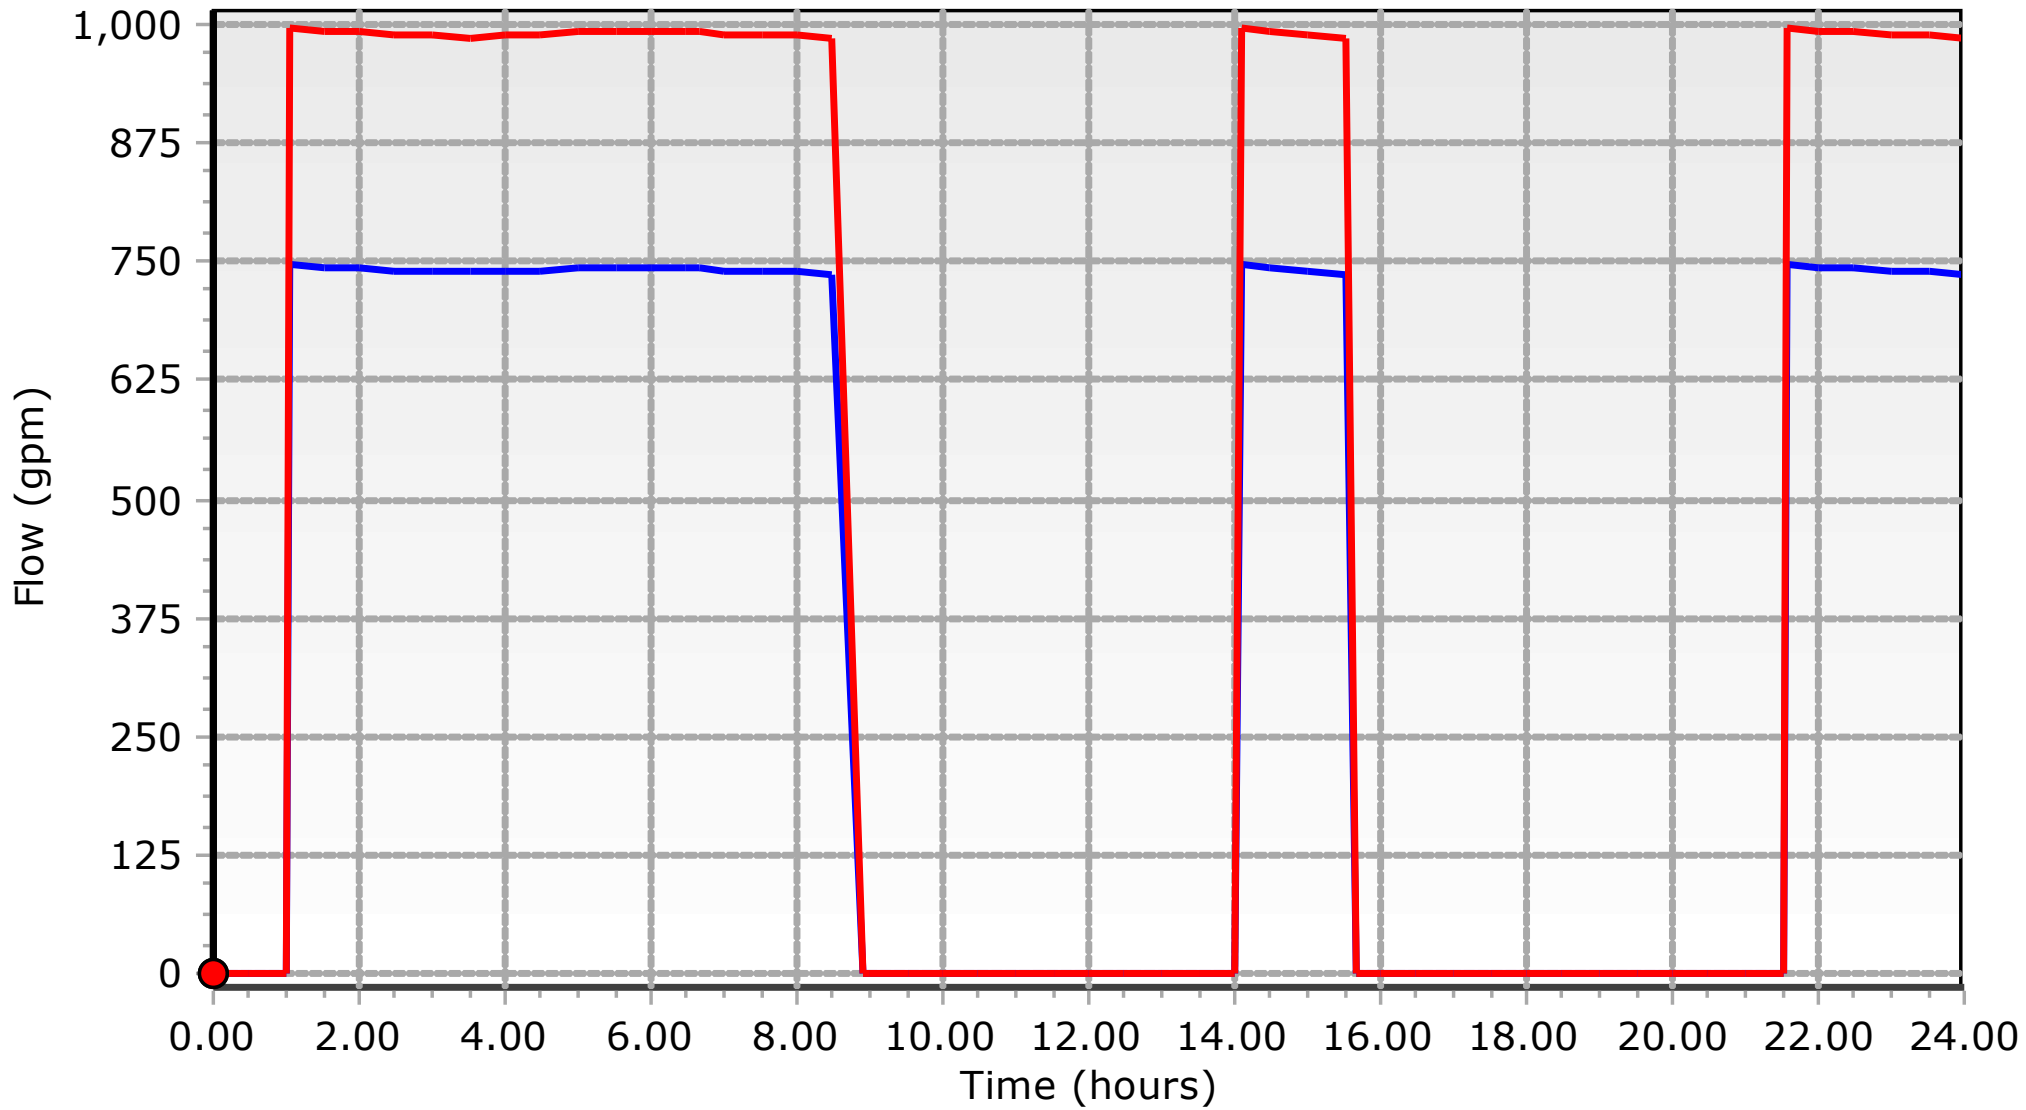


# **24-Hour Maximum Day Simulation**

Calculation Summary Graph

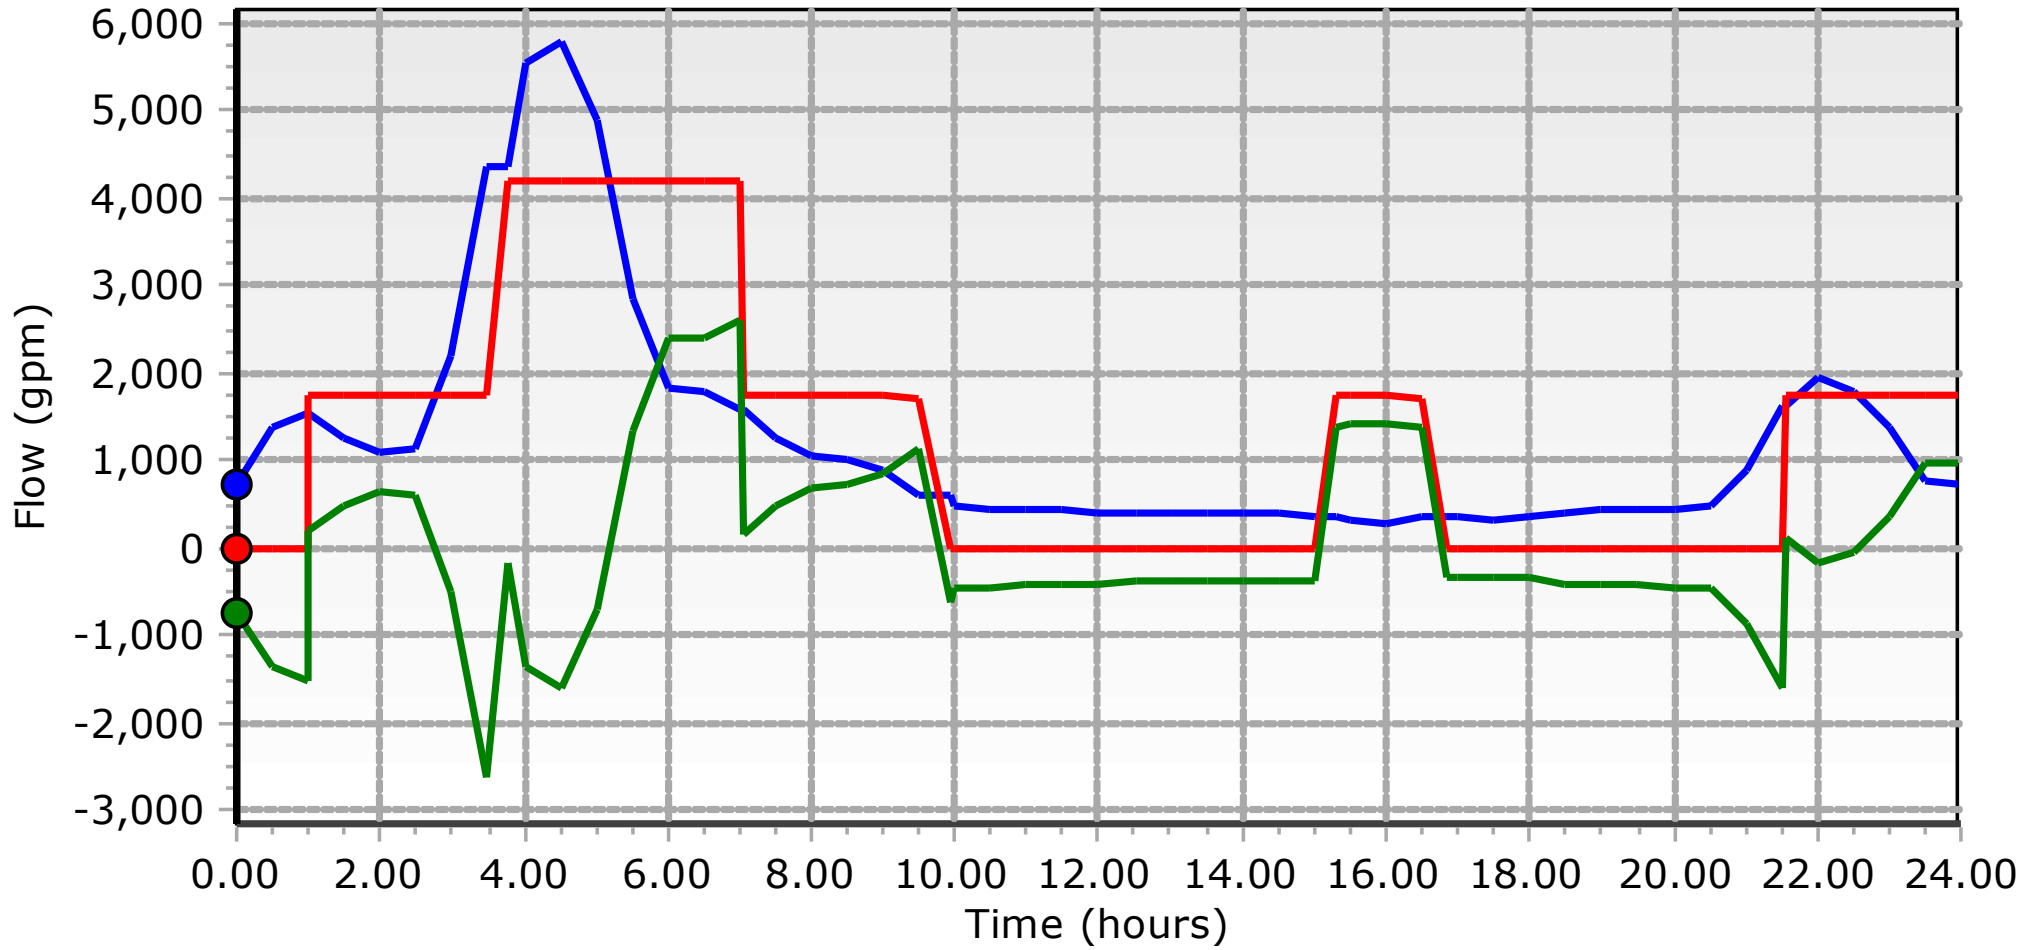



- Maximum Day EPS - Flow Demanded
- Maximum Day EPS - Flow Supplied
- Maximum Day EPS - Flow Stored

WP 1 Tank Levels

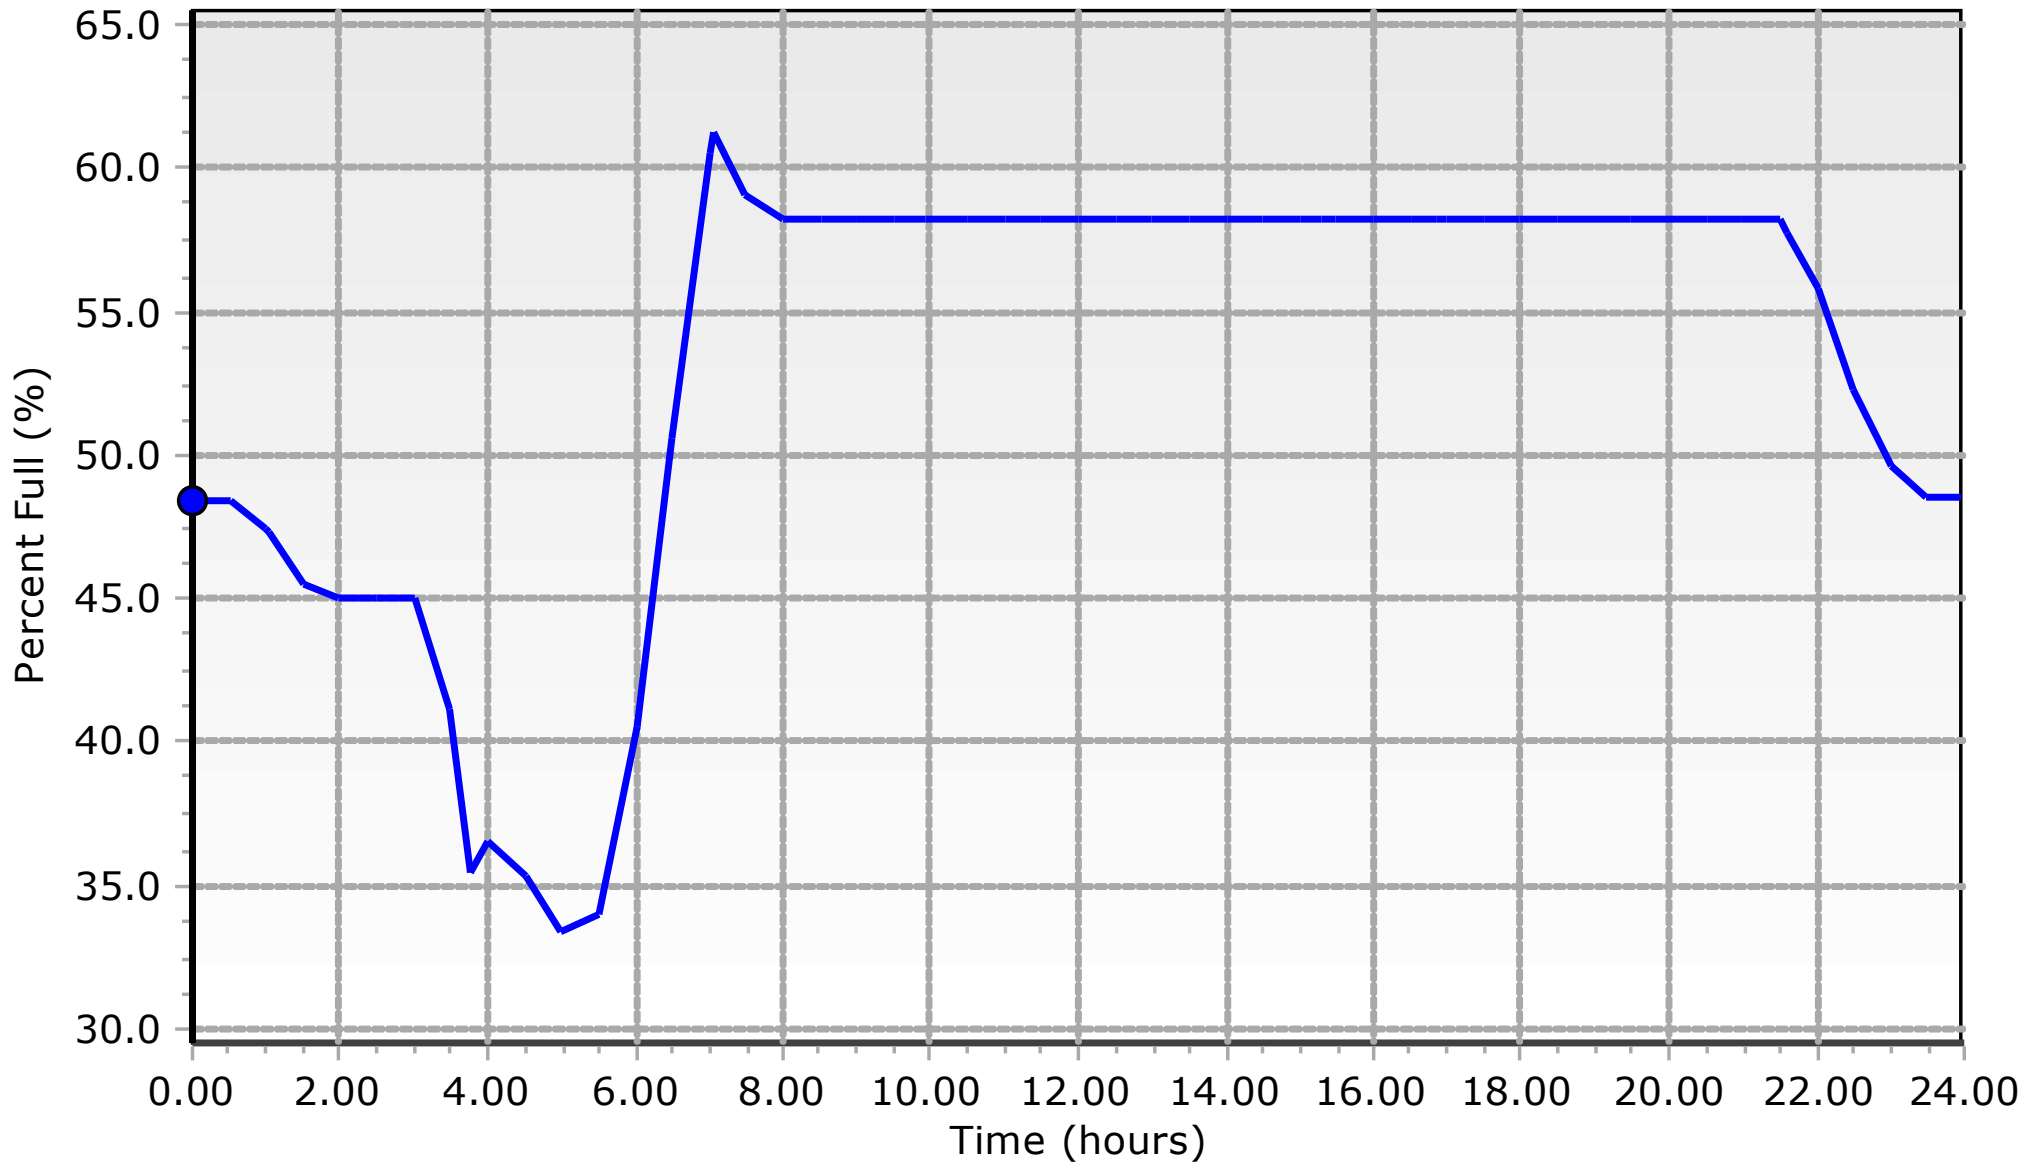


WP 1 GST 1 & 2 - Maximum Day EPS - Percent Full

# WP 1 Water Sources

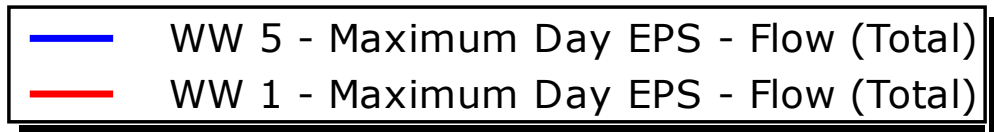
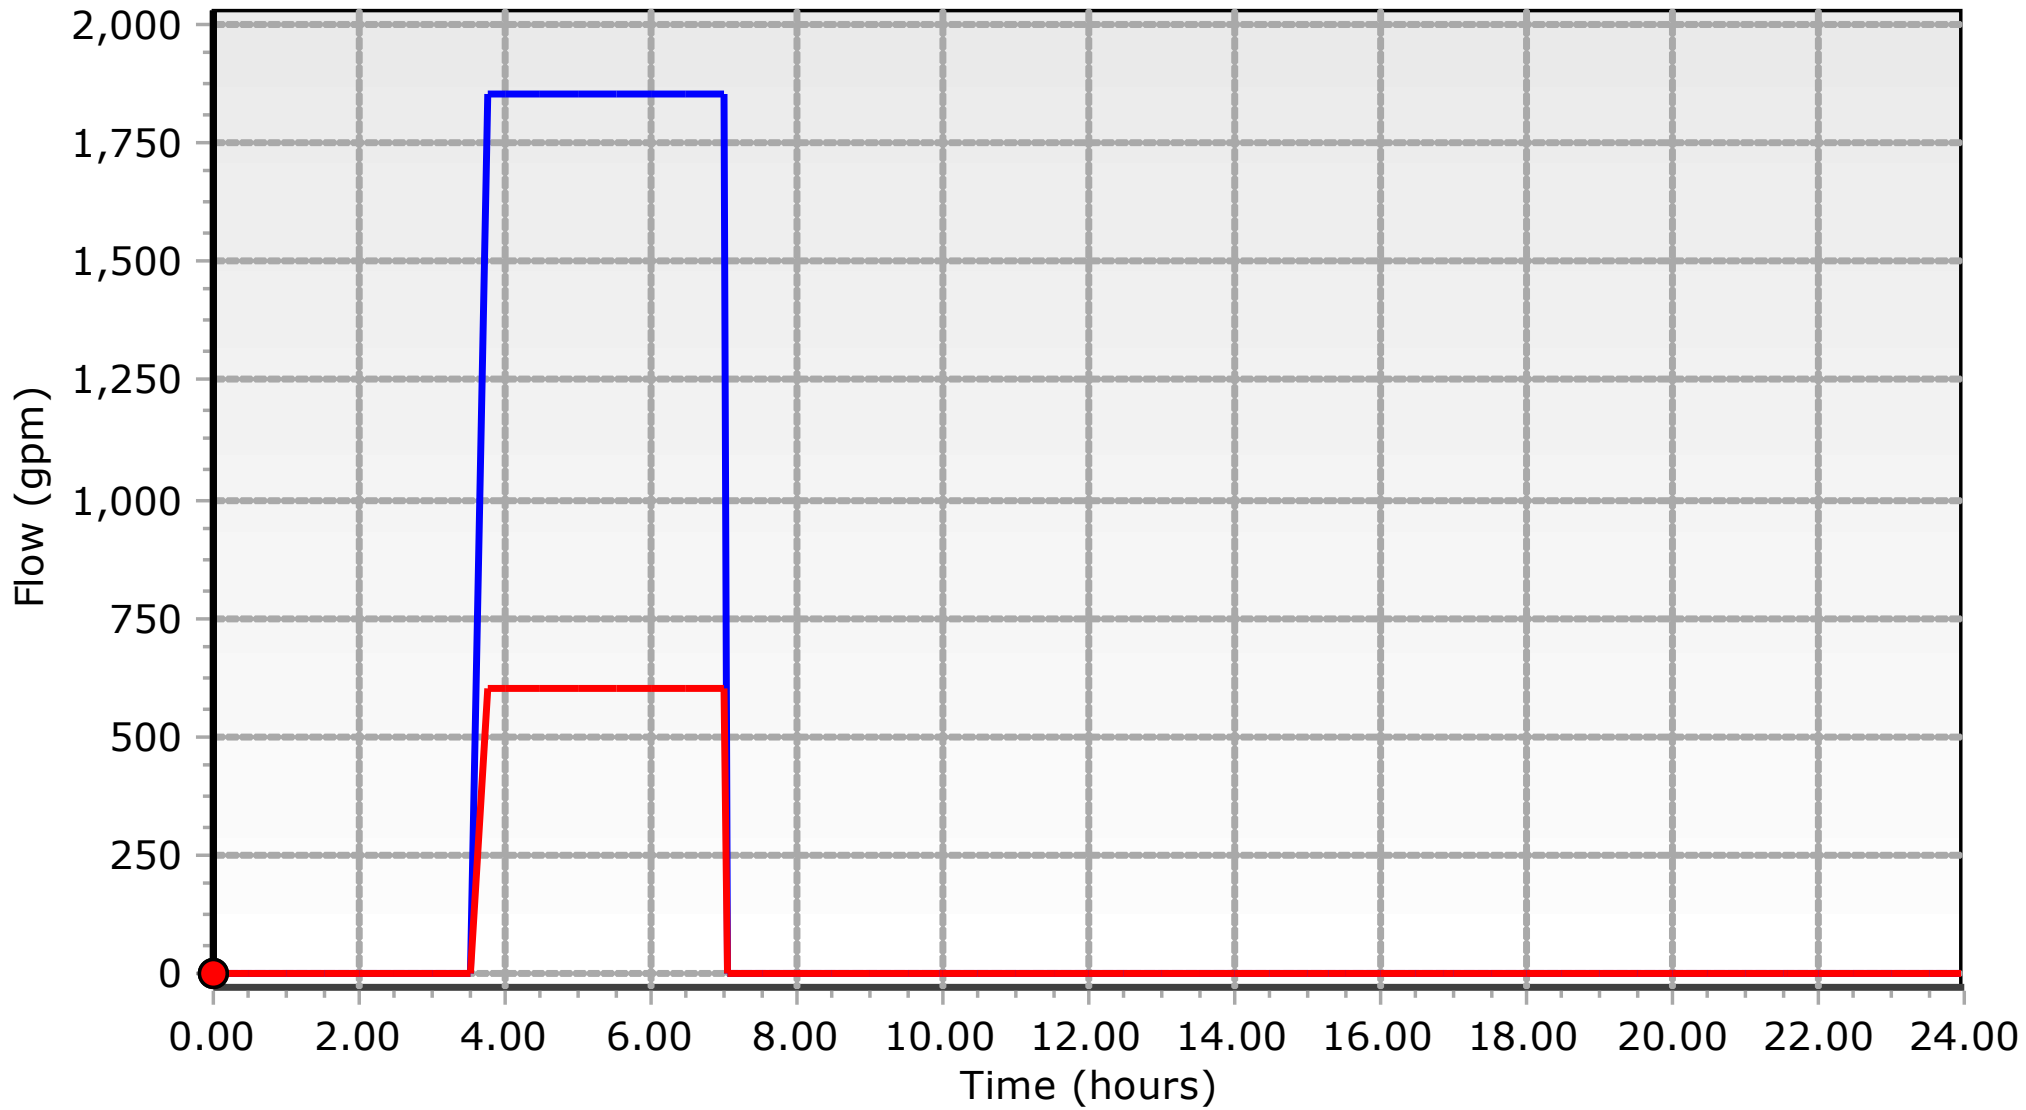


WP 2 Tank Level

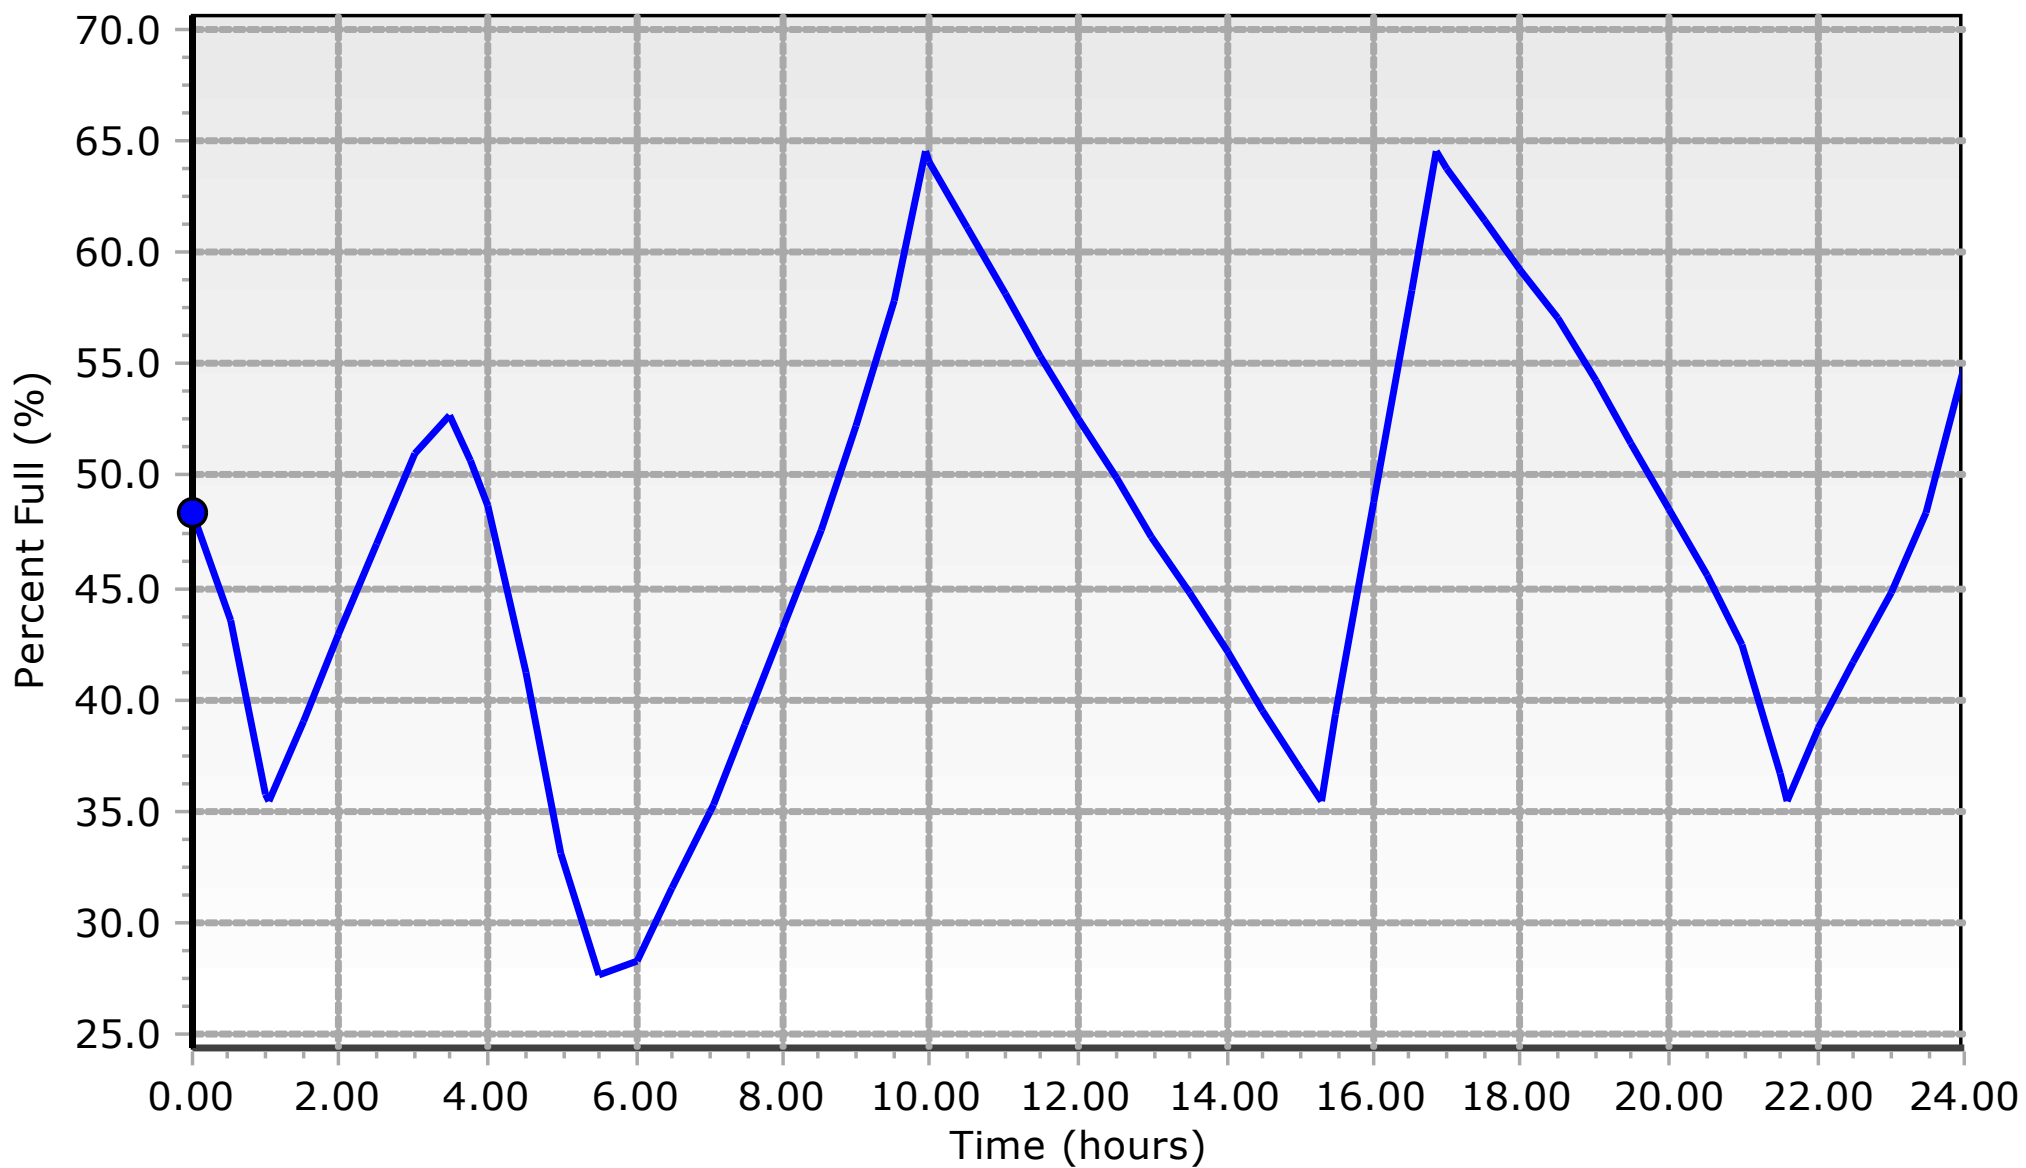

WP 2 GST 1 - Maximum Day EPS - Percent Full



### WP 2 Water Sources

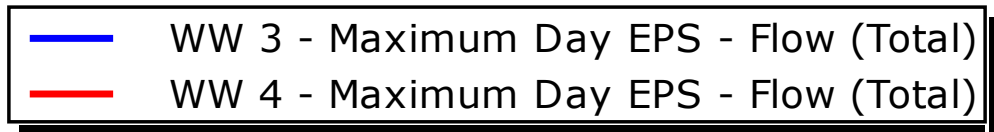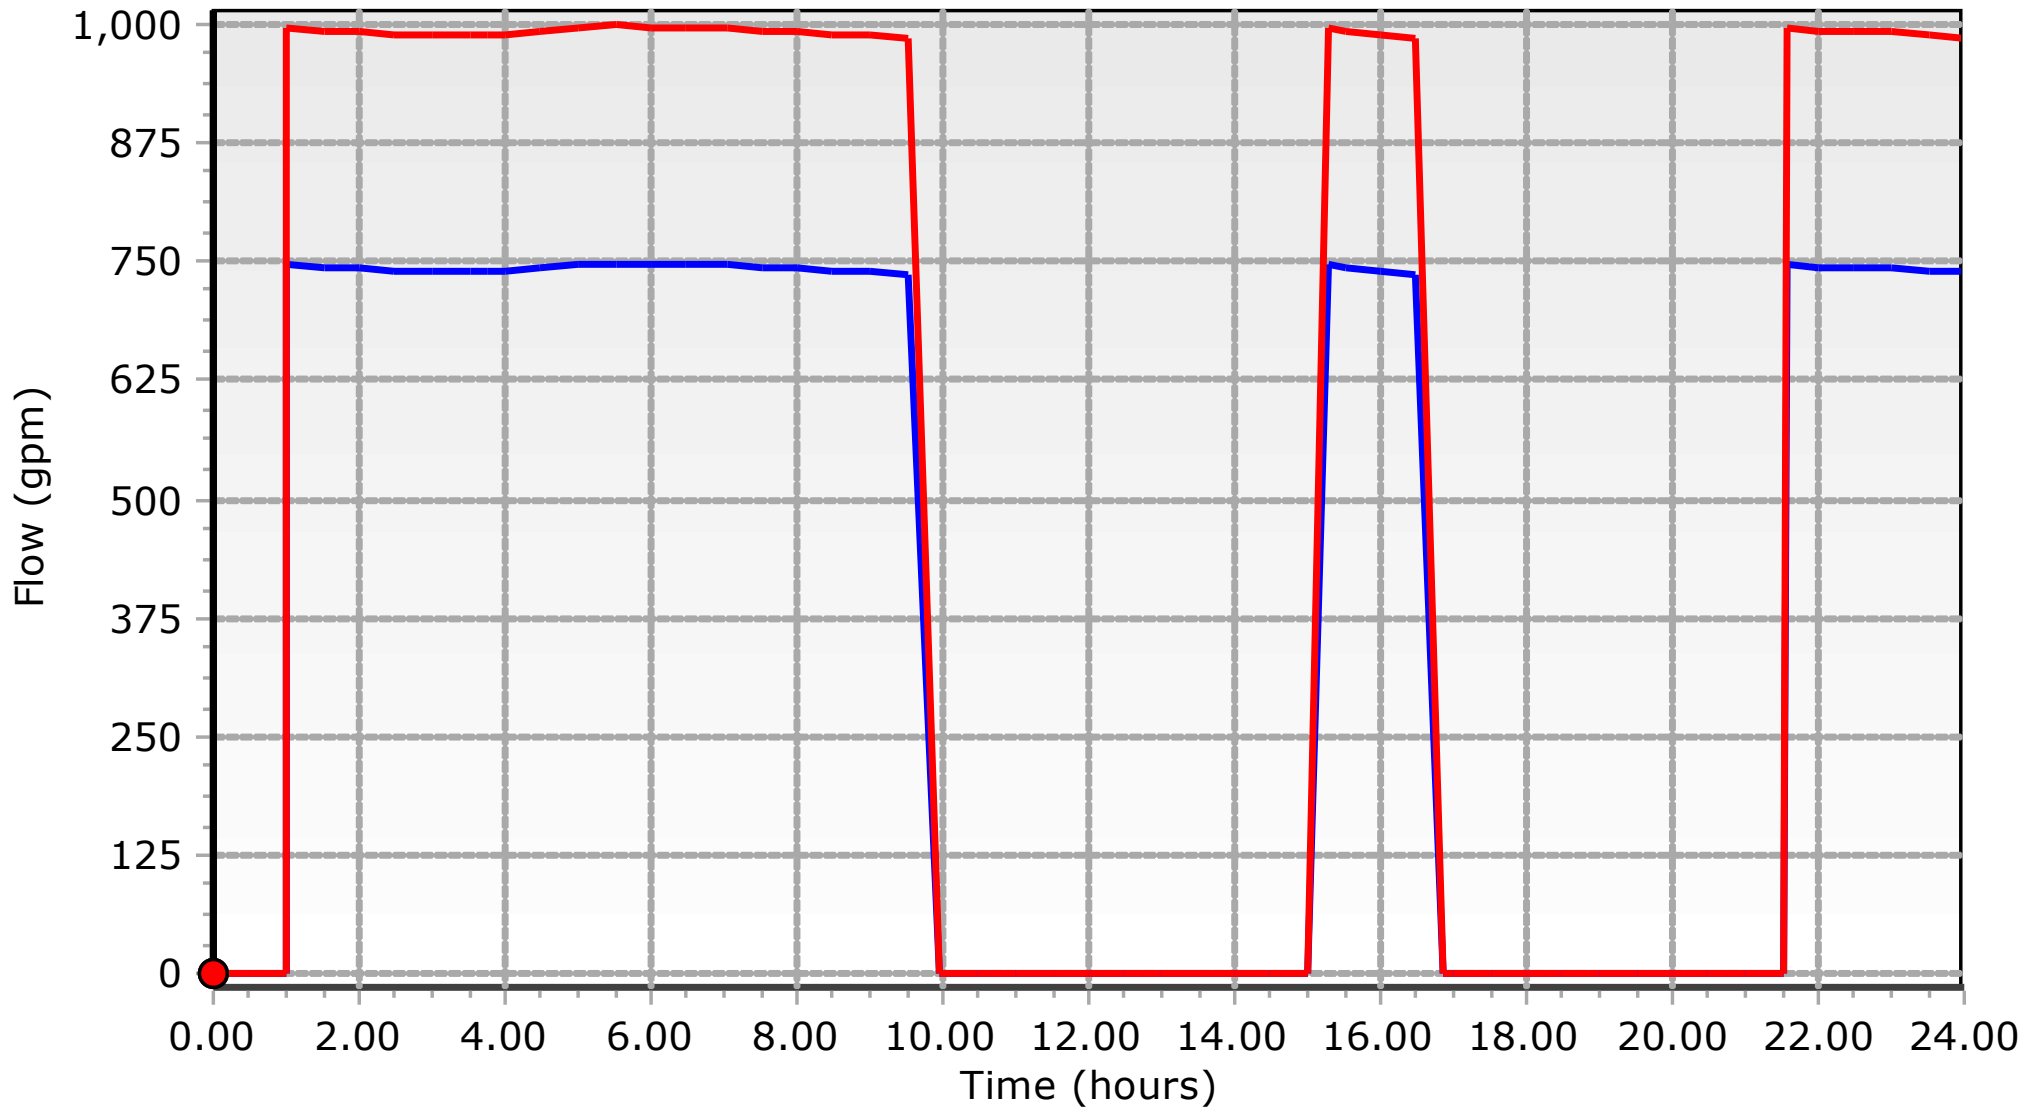


**City of Bunker Hill Village Removal of  
GST 1 at Taylorcrest WP - Extended  
Period Simulation**

# **24-Hour Average Winter Day Simulation**

Calculation Summary Graph

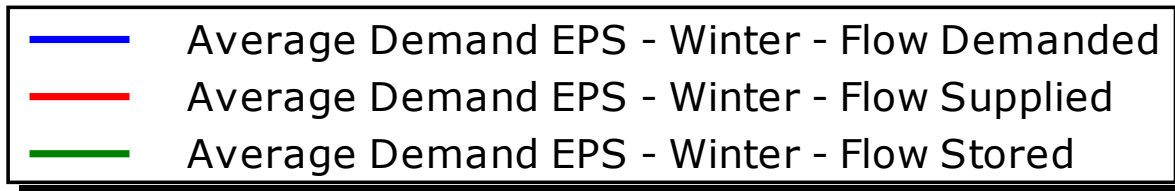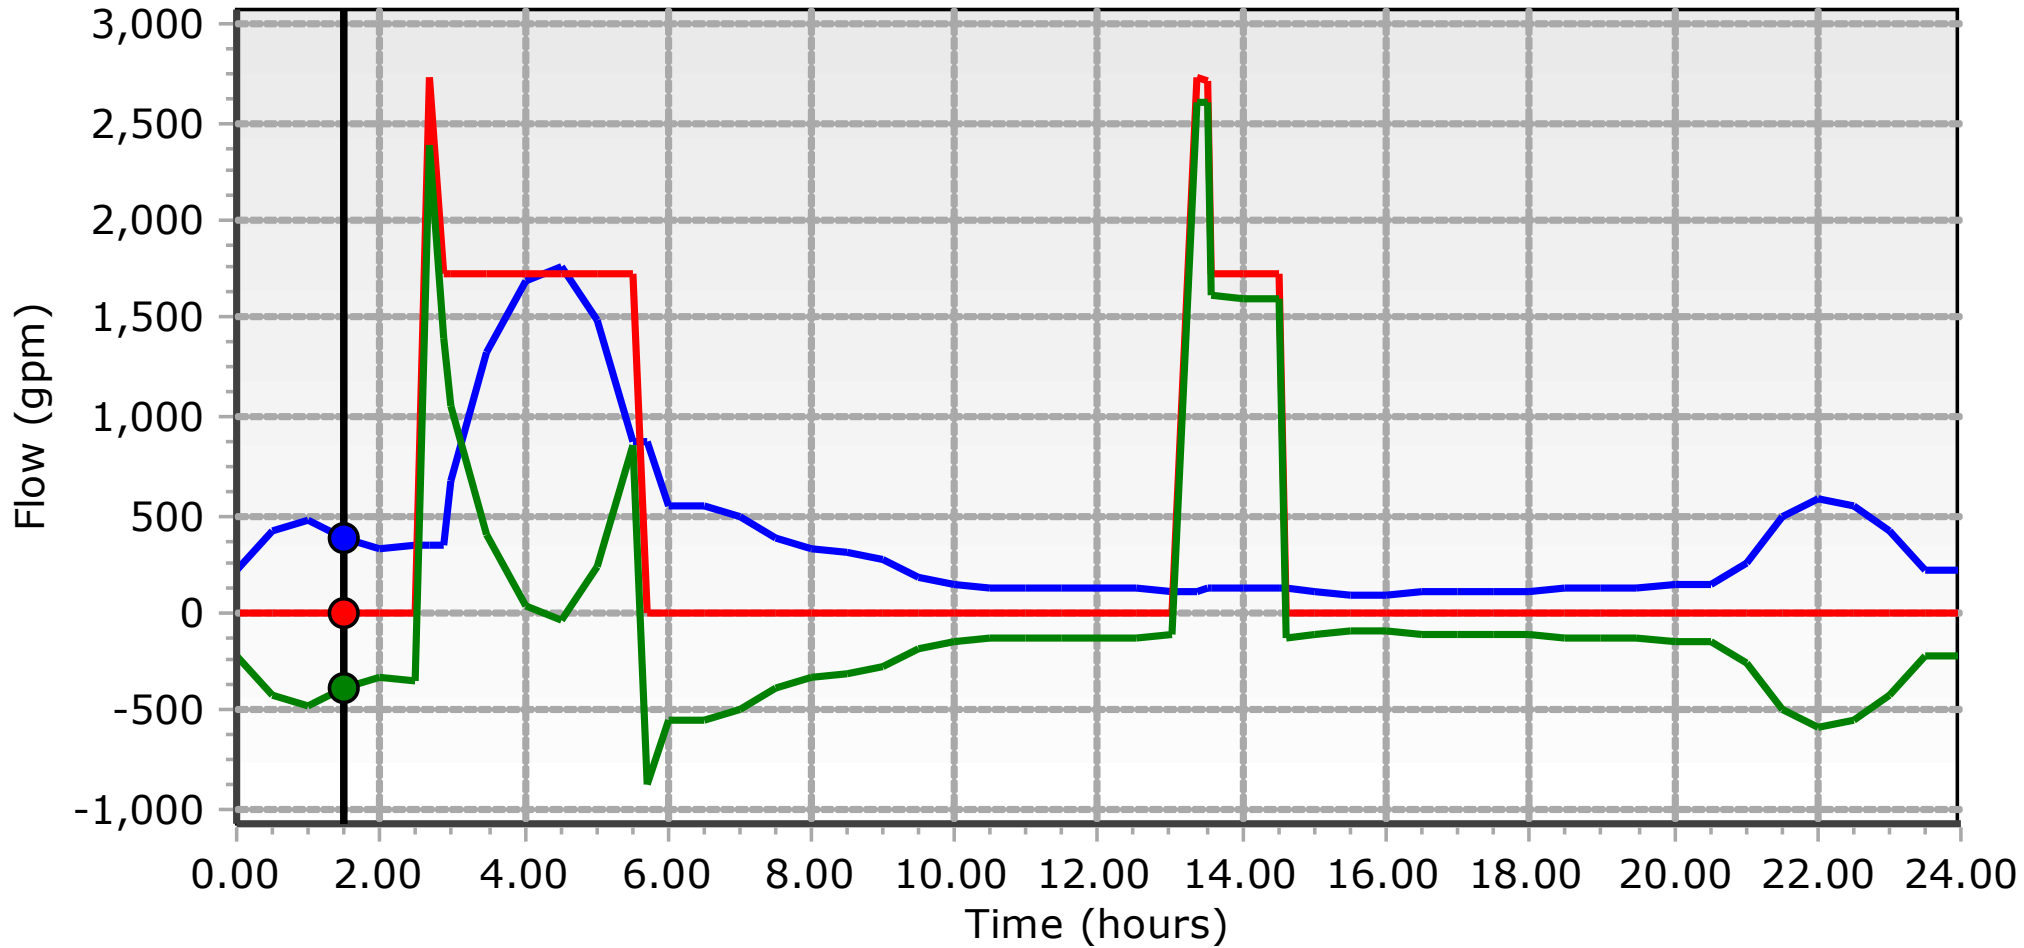


WP 1 Tank Level

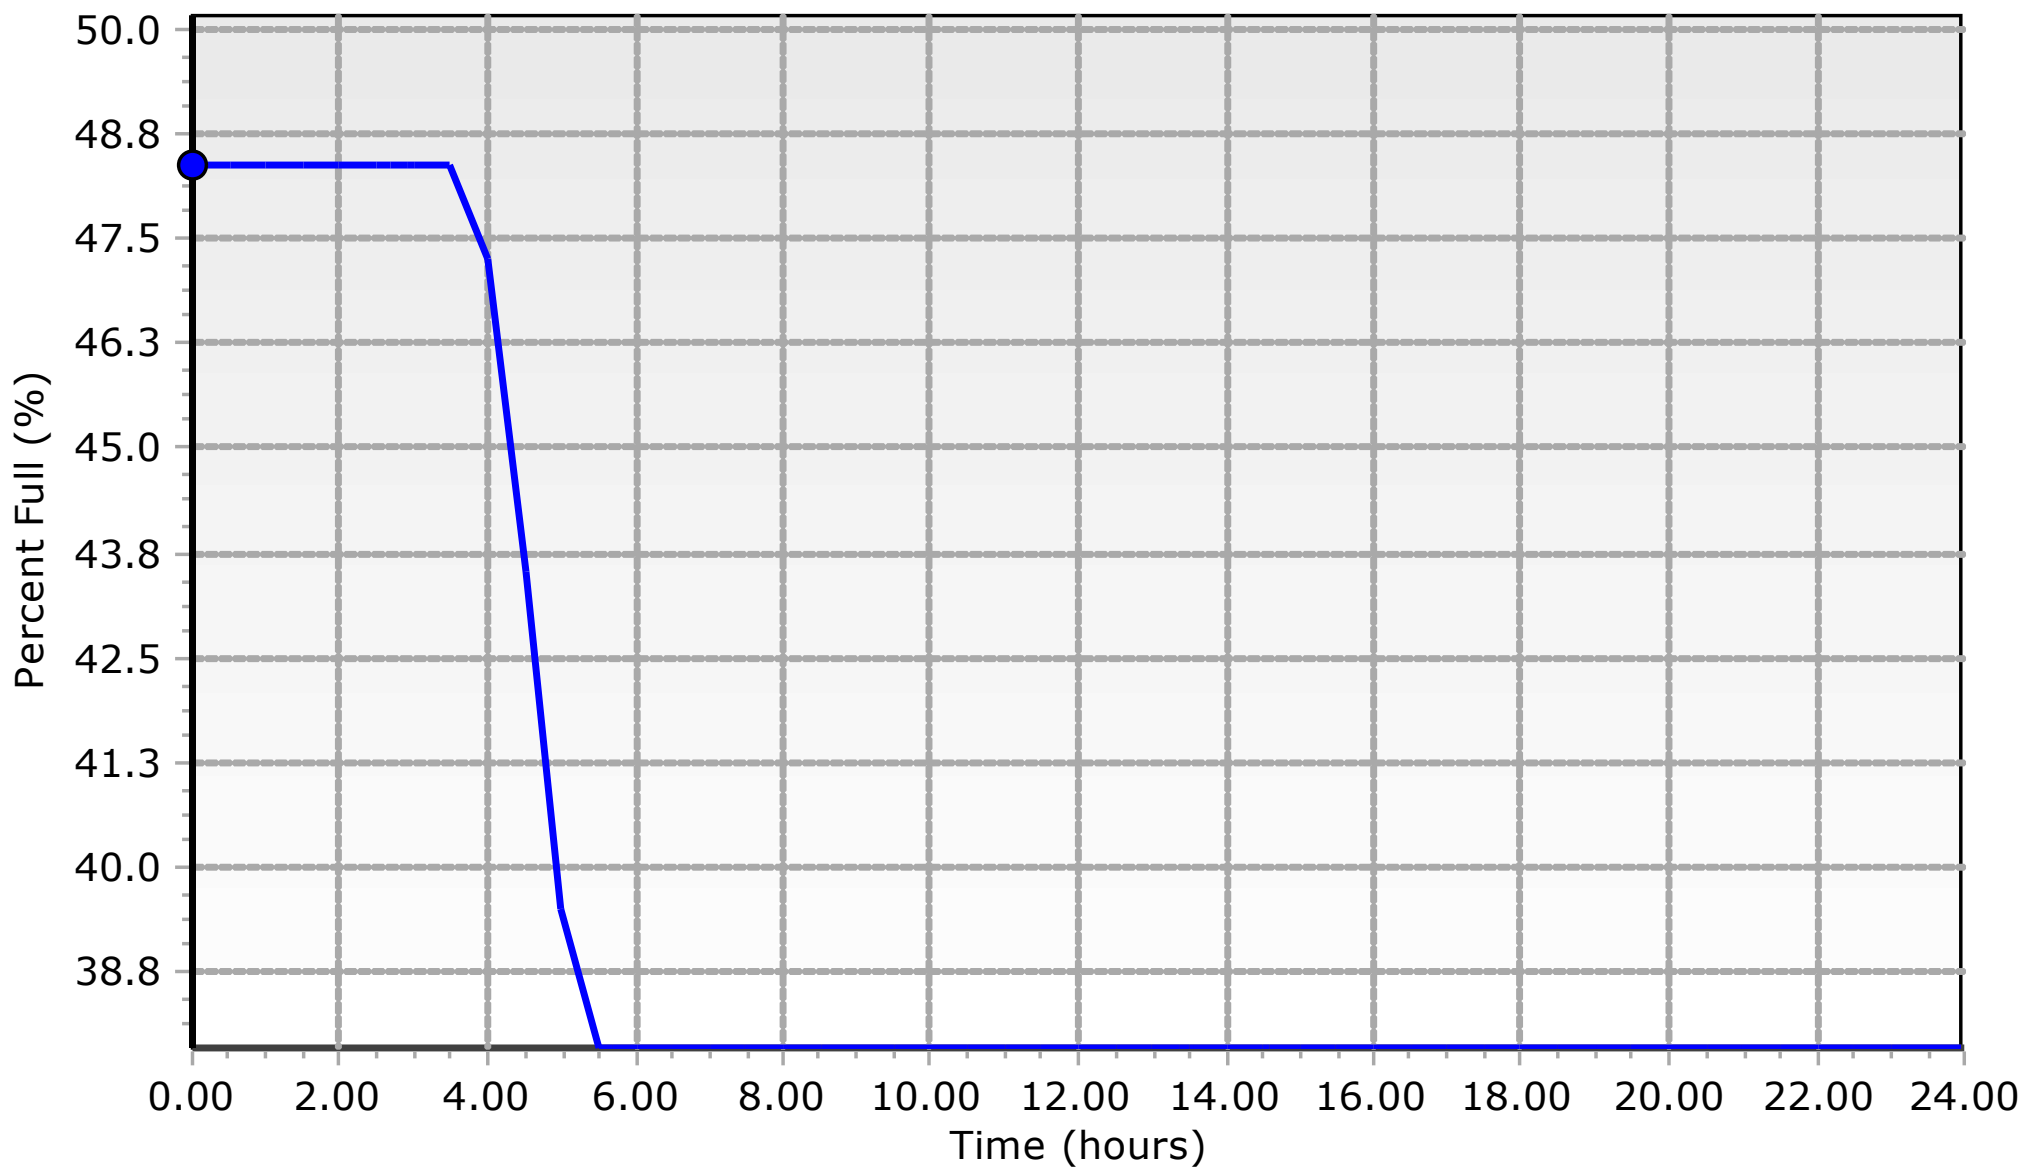


WP 1 GST 2 - Average Demand EPS - Winter - Percent Full

# WP 1 Water Sources

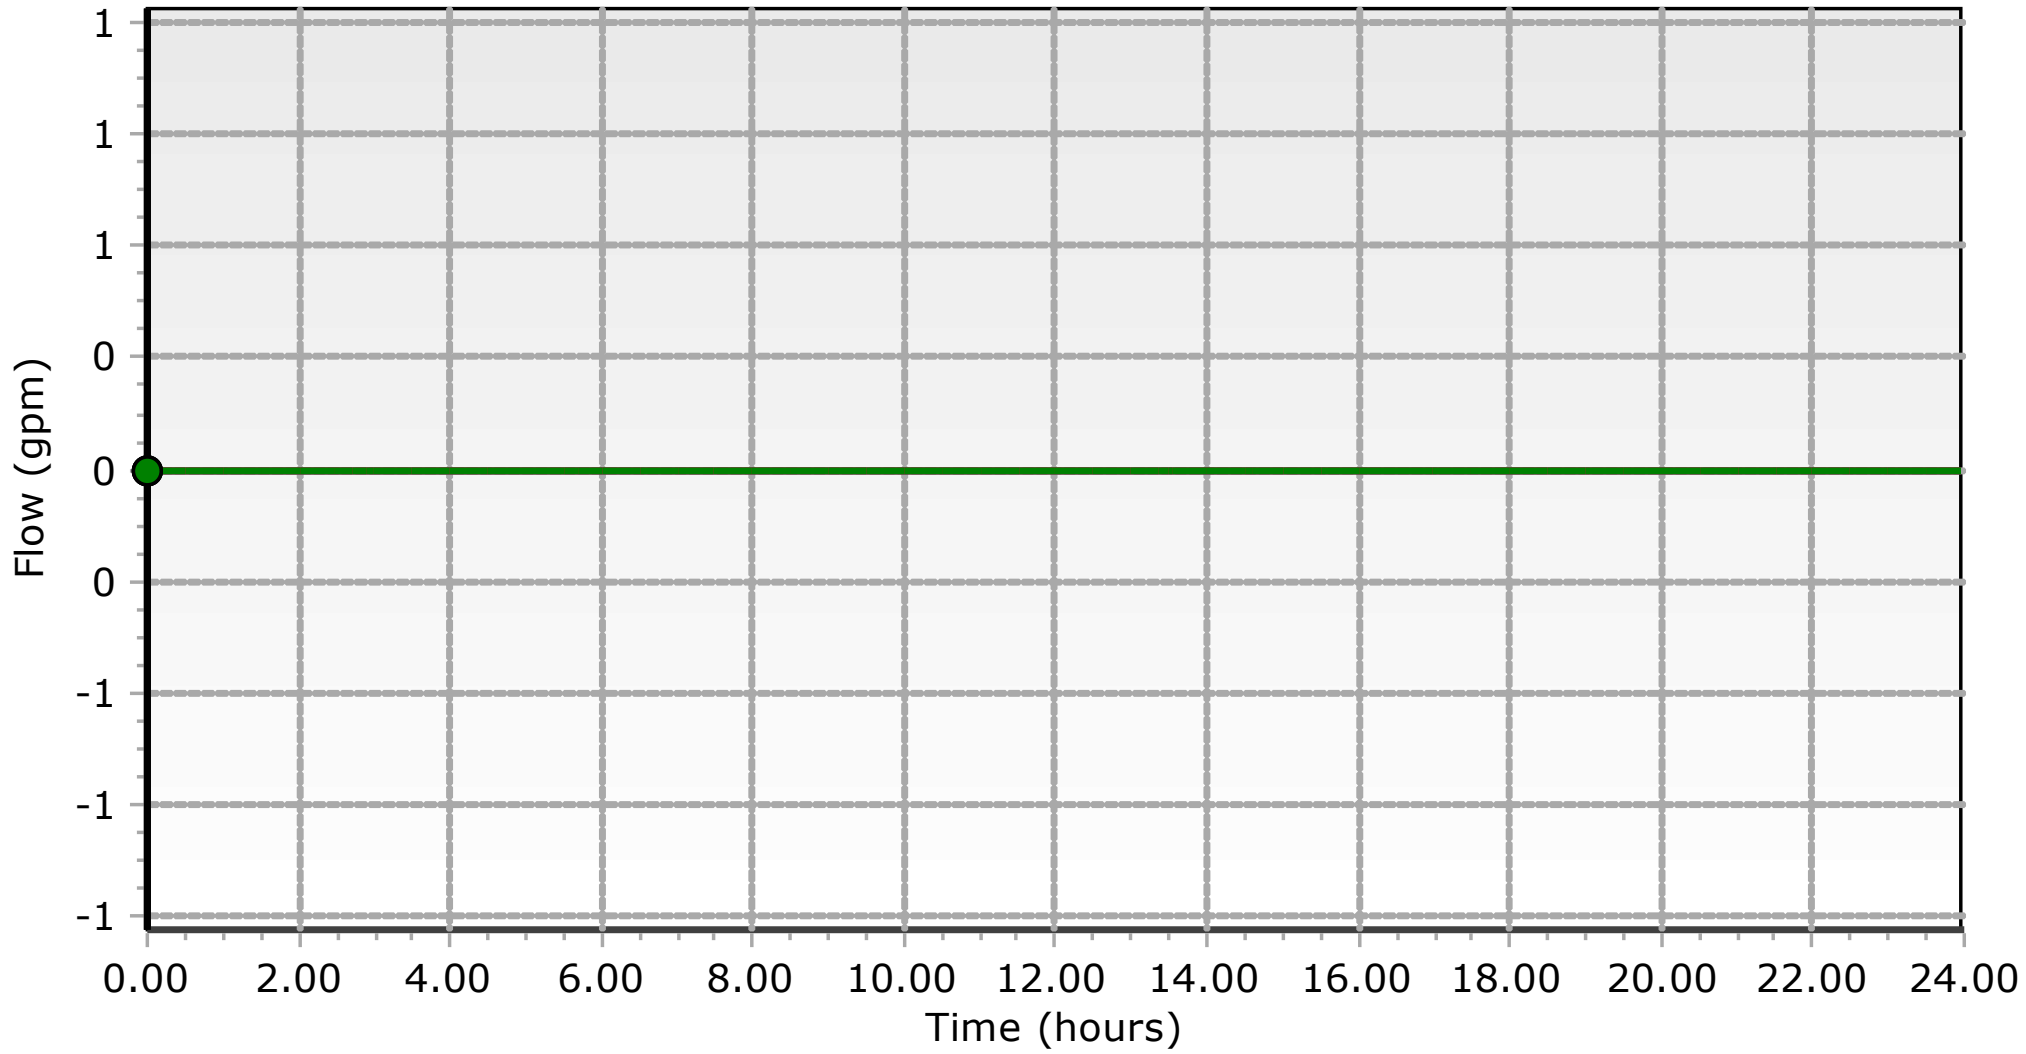


- COH SW 1 - Average Demand EPS - Winter - Flow (Total)
- WW 5 - Average Demand EPS - Winter - Flow (Total)
- WW 1 - Average Demand EPS - Winter - Flow (Total)

WP 2 Tank Level

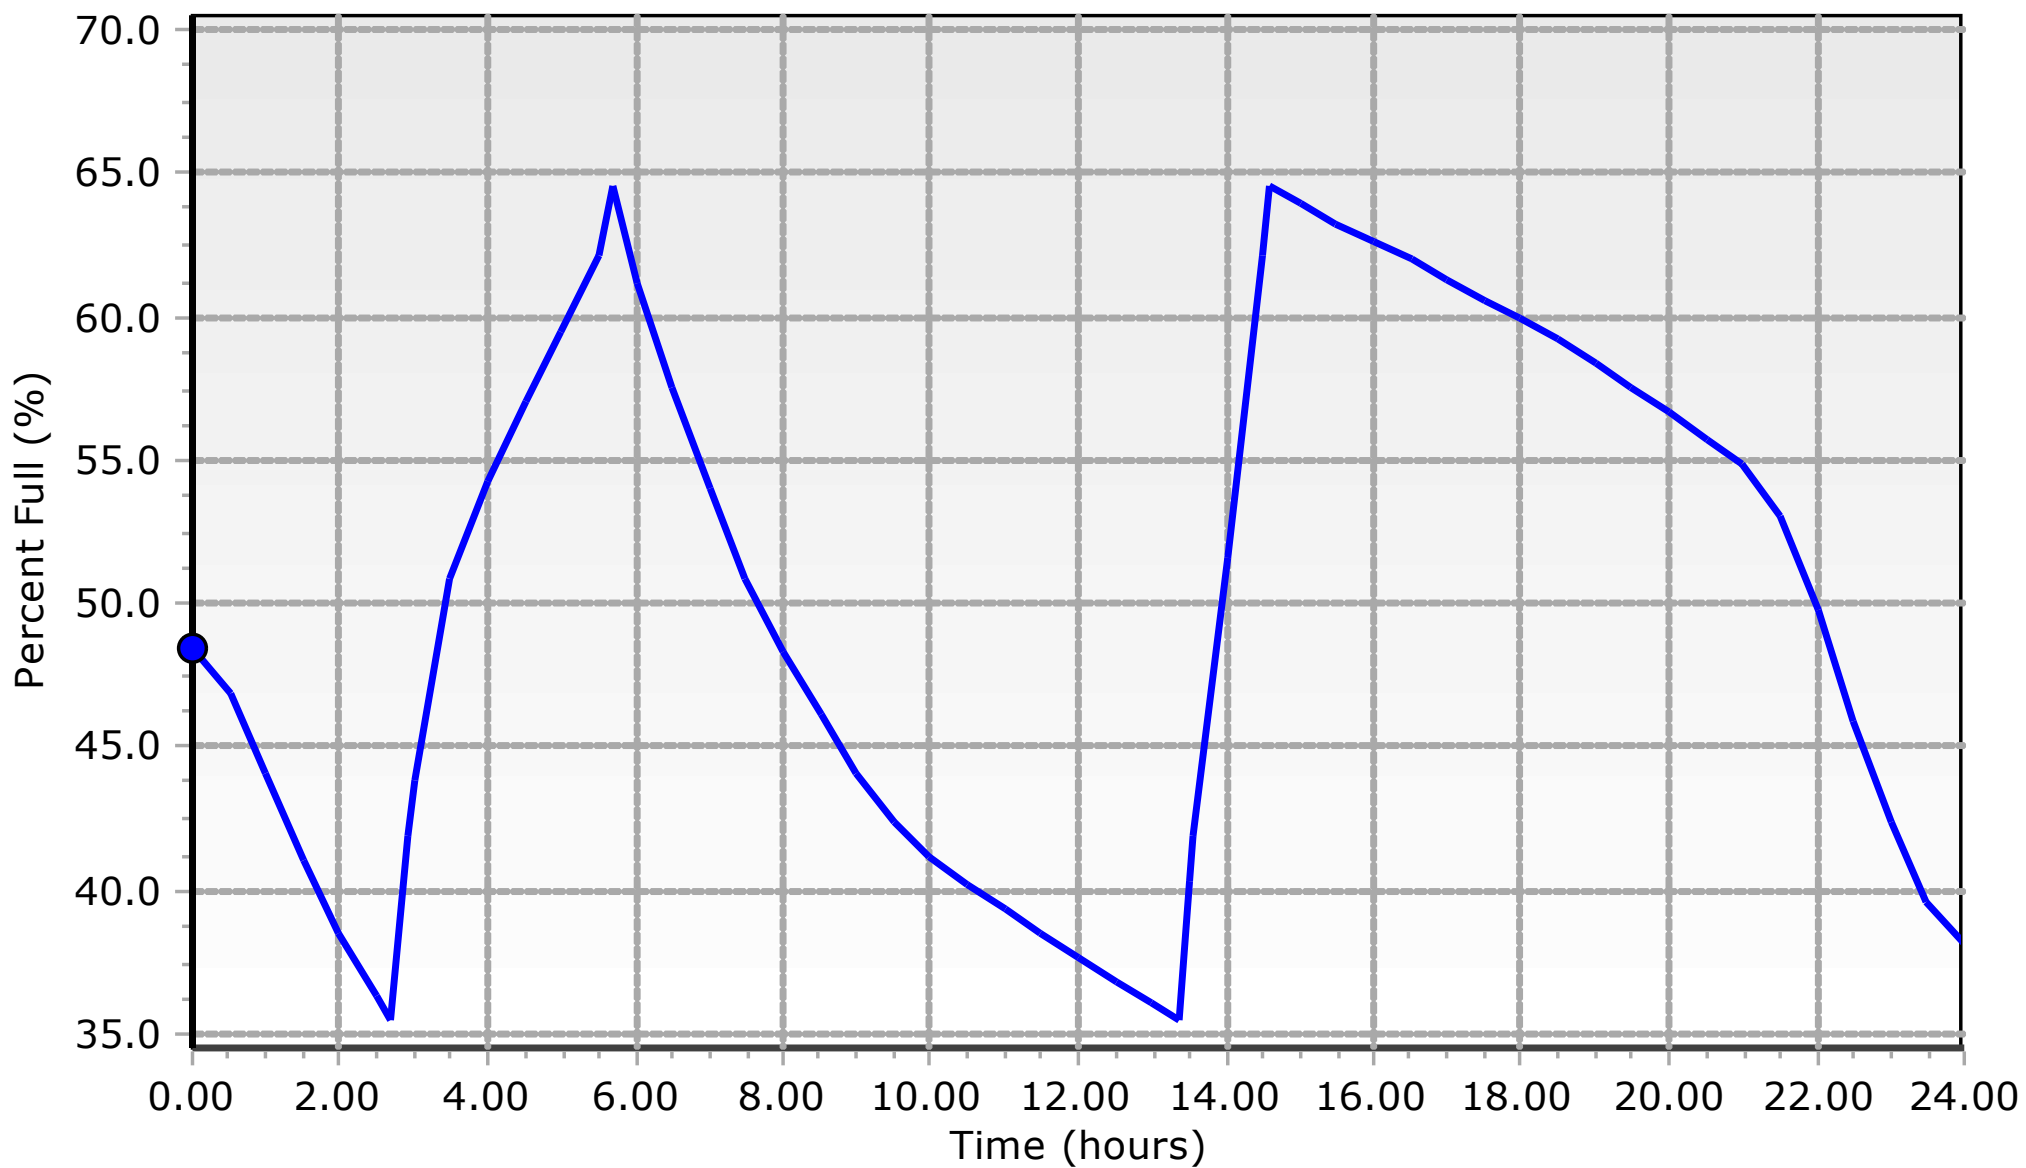

WP 2 GST 1 - Average Demand EPS - Winter - Percent Full


WP 2 Water Sources

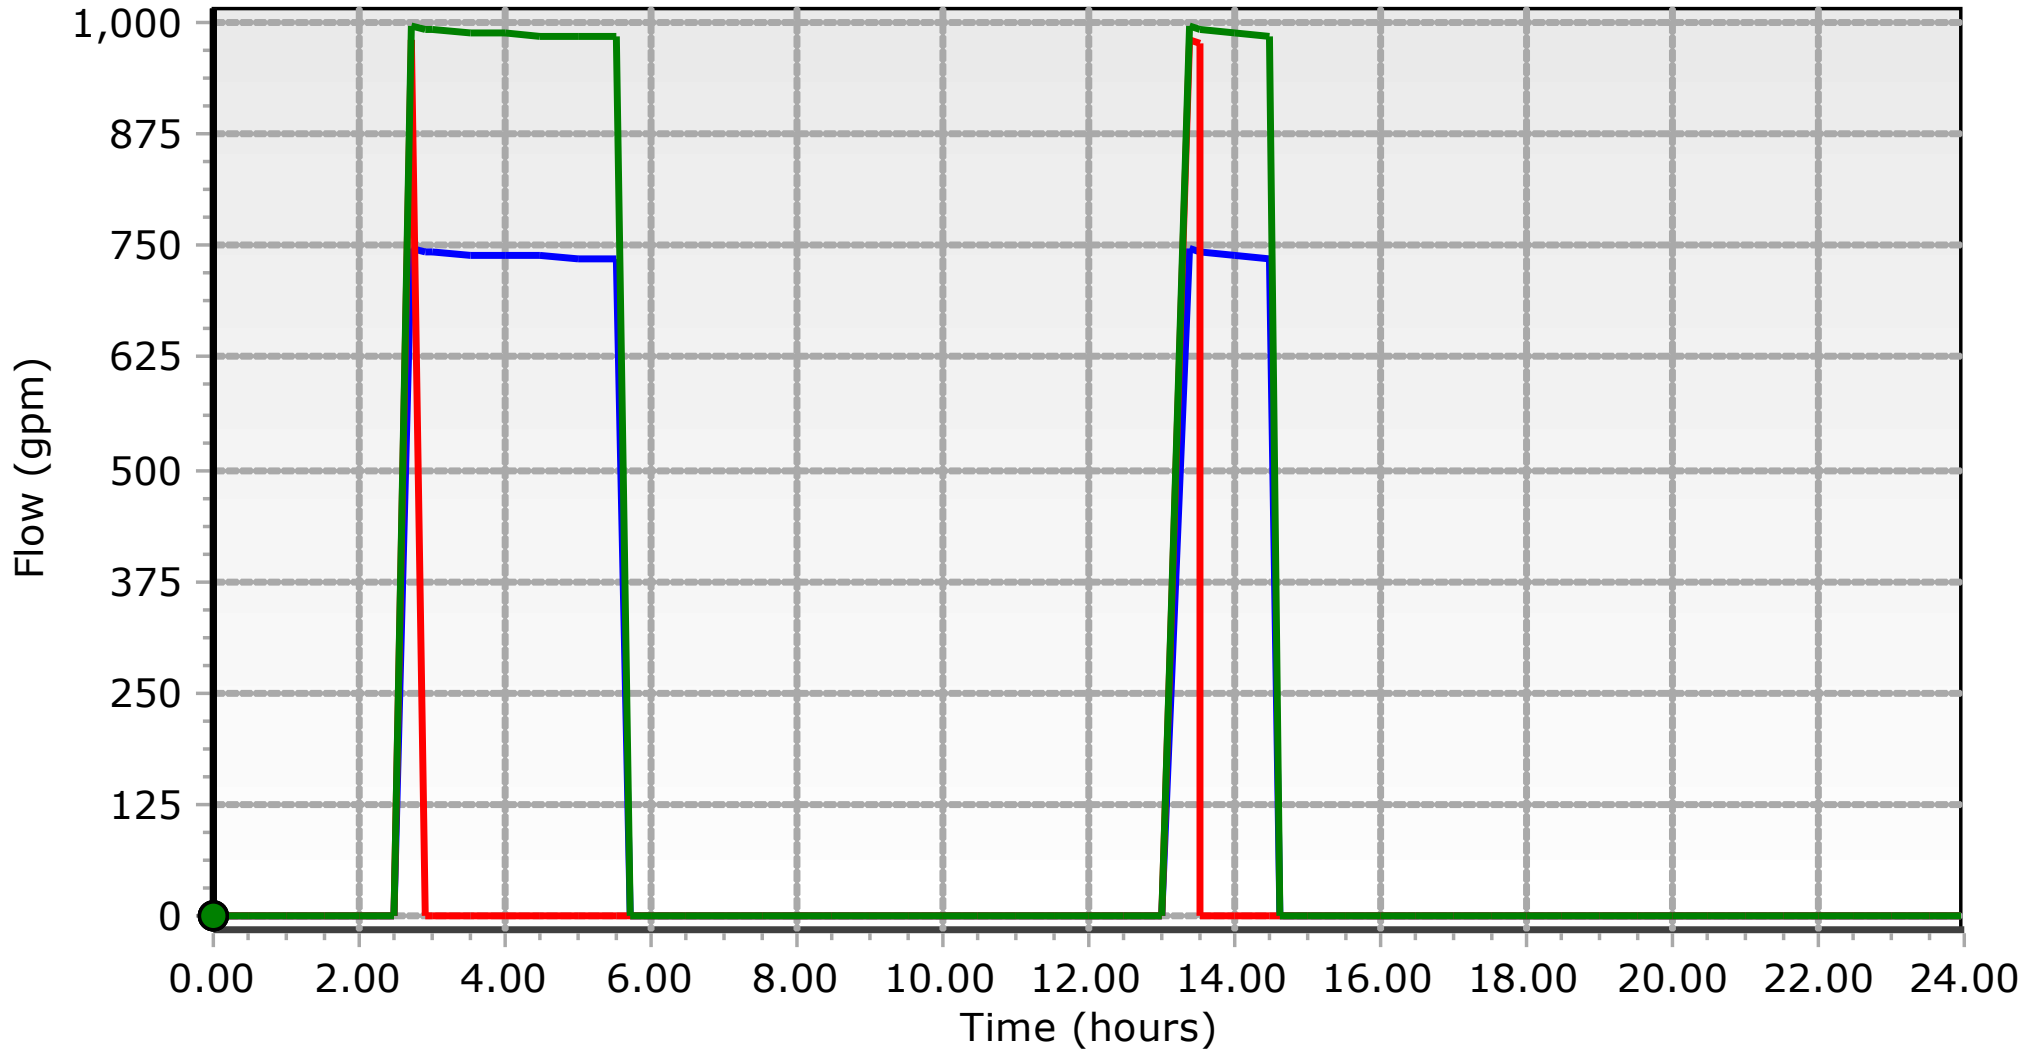

- WW 3 - Average Demand EPS - Winter - Flow (Total)
- COH SW 2 - Average Demand EPS - Winter - Flow (Total)
- WW 4 - Average Demand EPS - Winter - Flow (Total)


# **24-Hour Average Summer Day Simulation**

Calculation Summary Graph

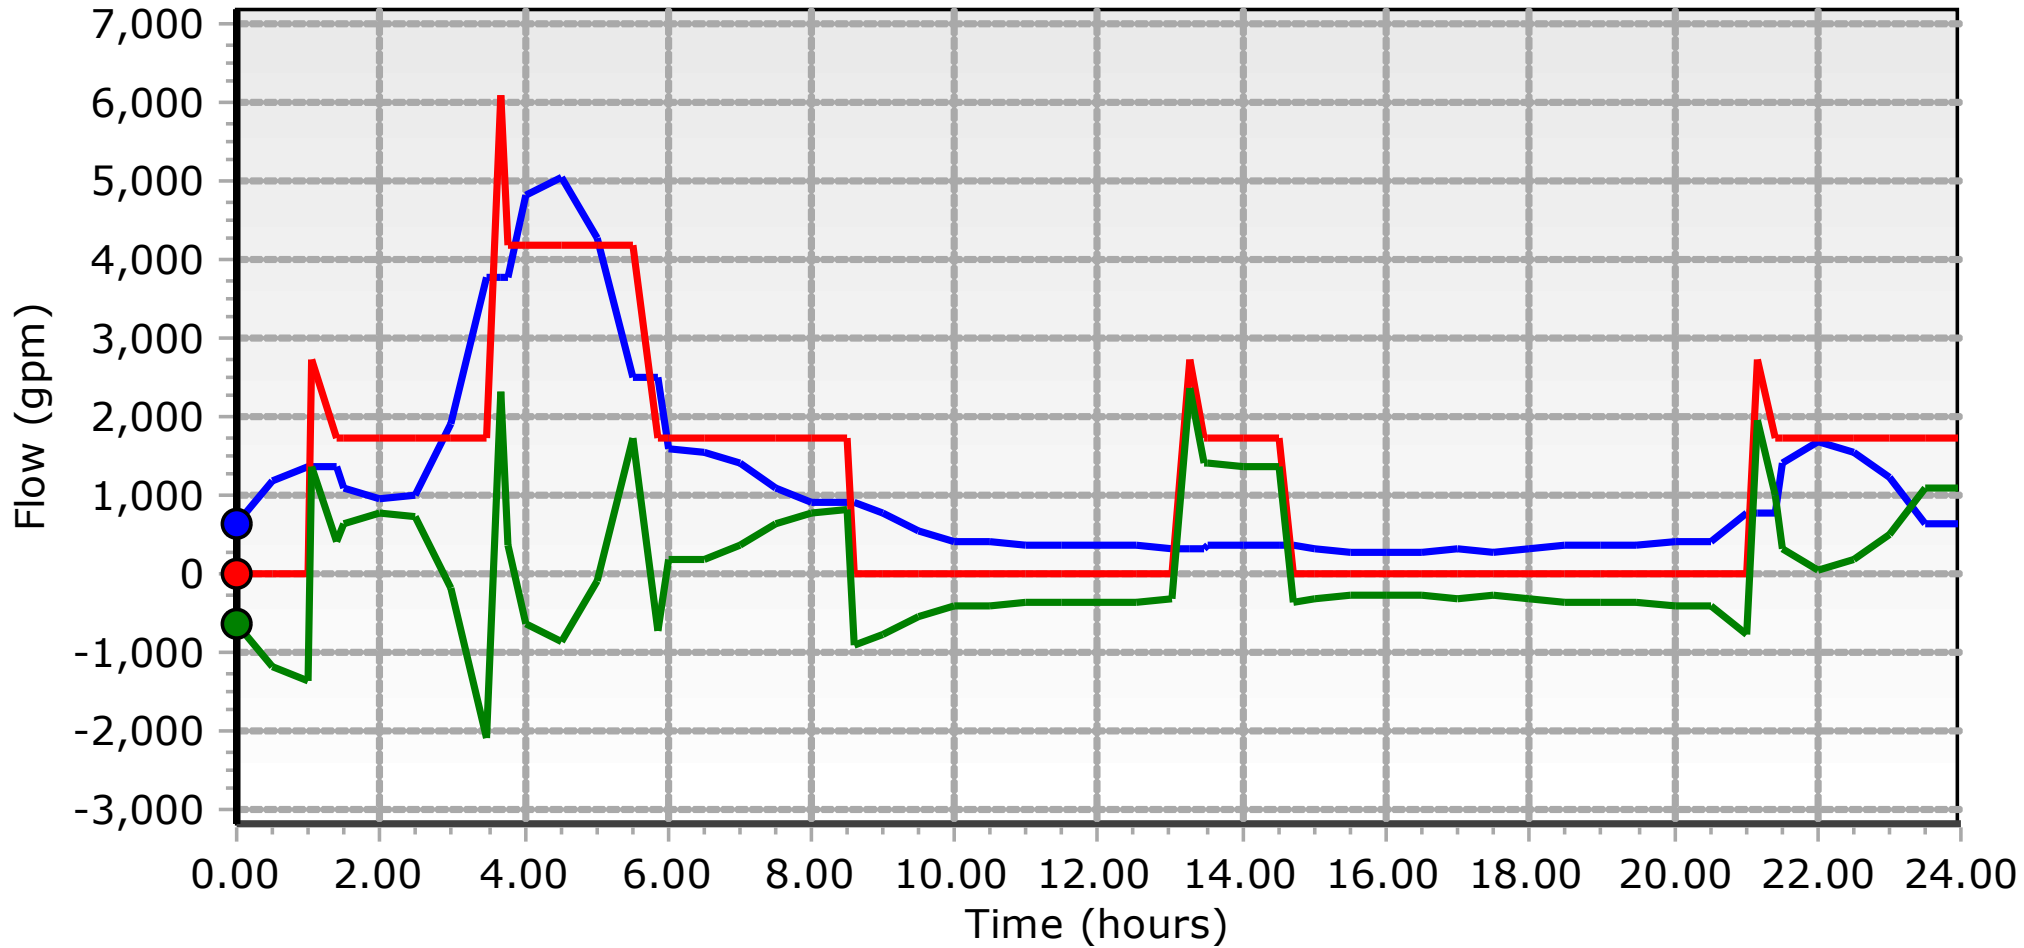


- Average Demand EPS - Summer - Flow Demanded
- Average Demand EPS - Summer - Flow Supplied
- Average Demand EPS - Summer - Flow Stored

WP 1 Tank Levels

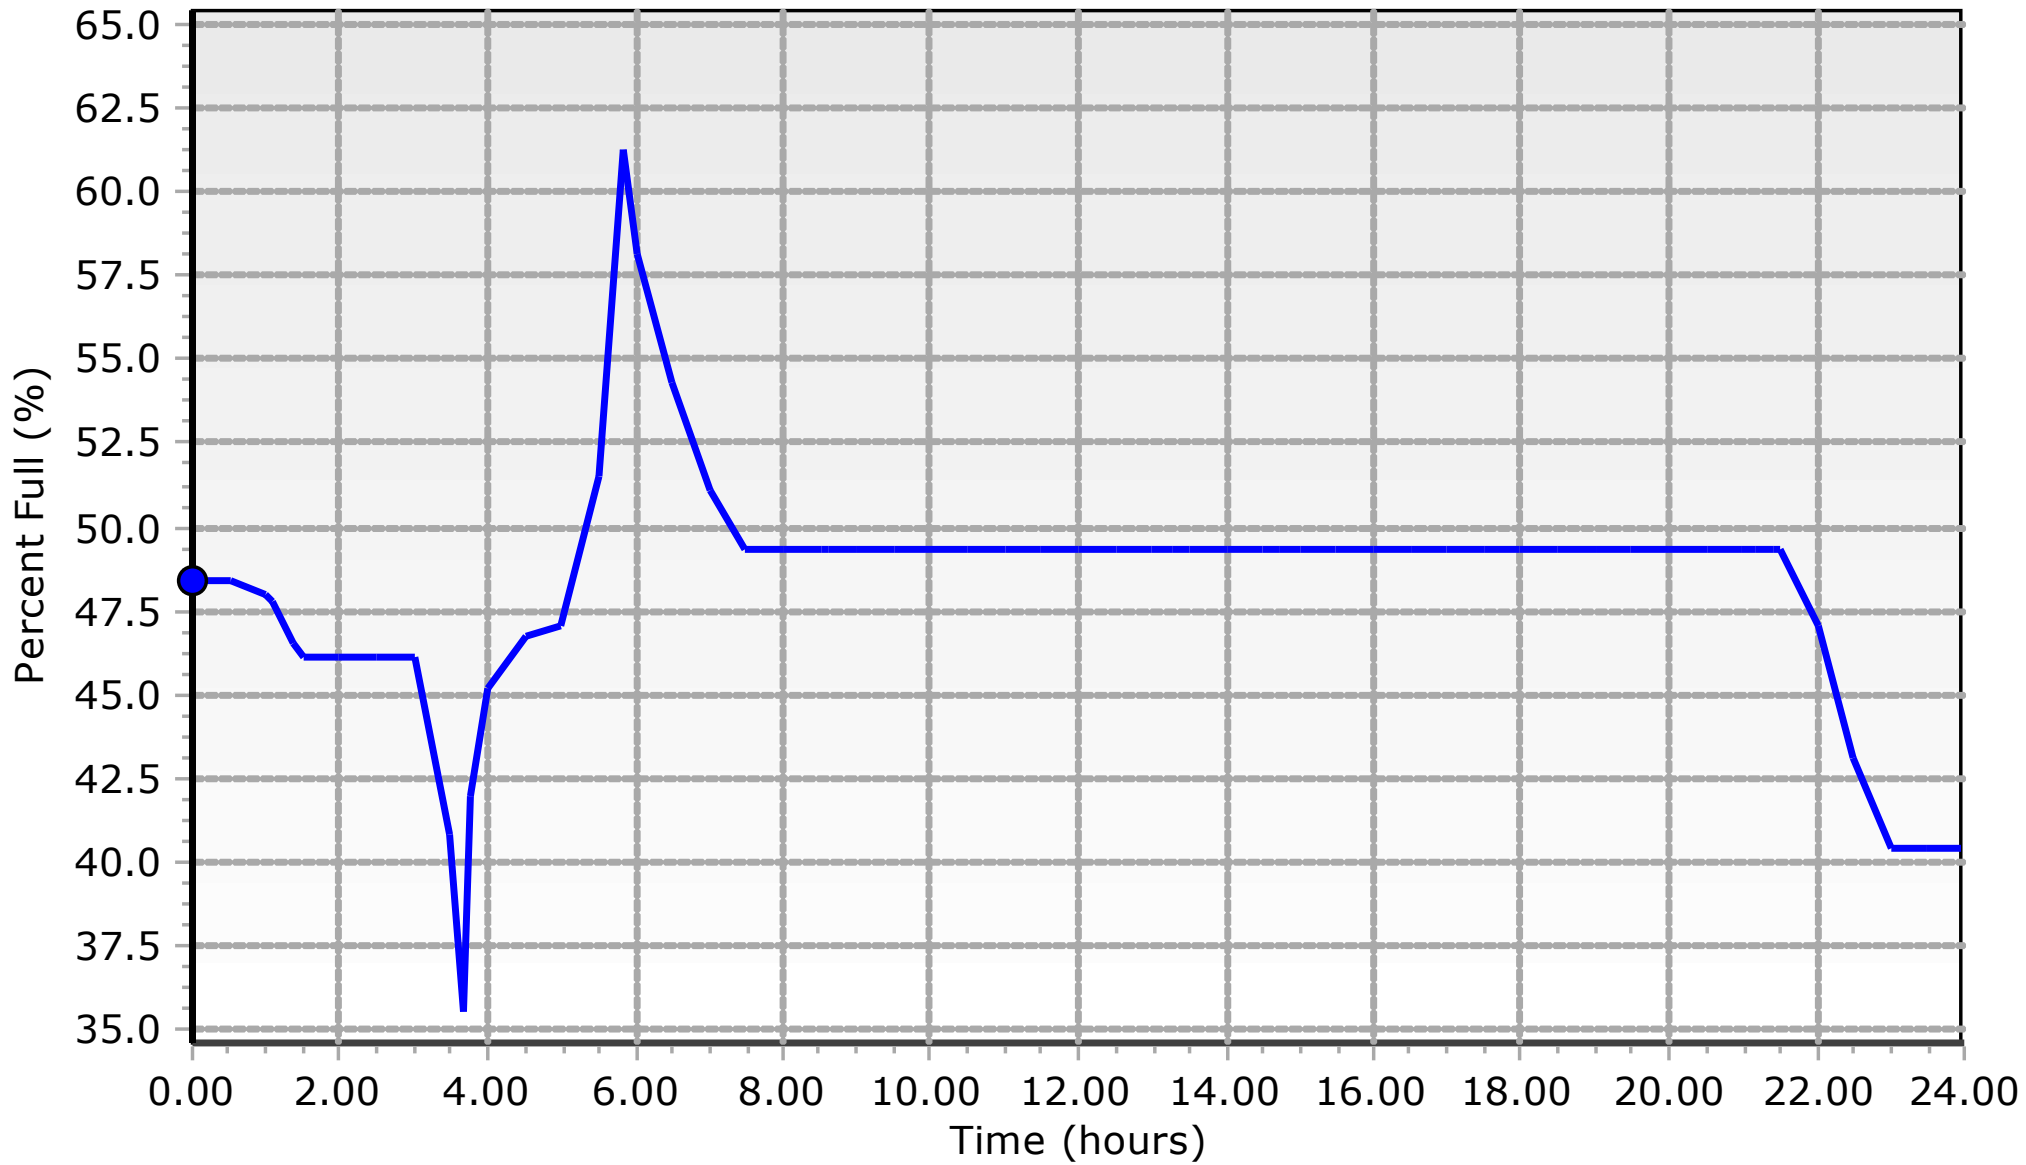


WP 1 GST 2 - Average Demand EPS - Summer - Percent Full

# WP 1 Water Sources

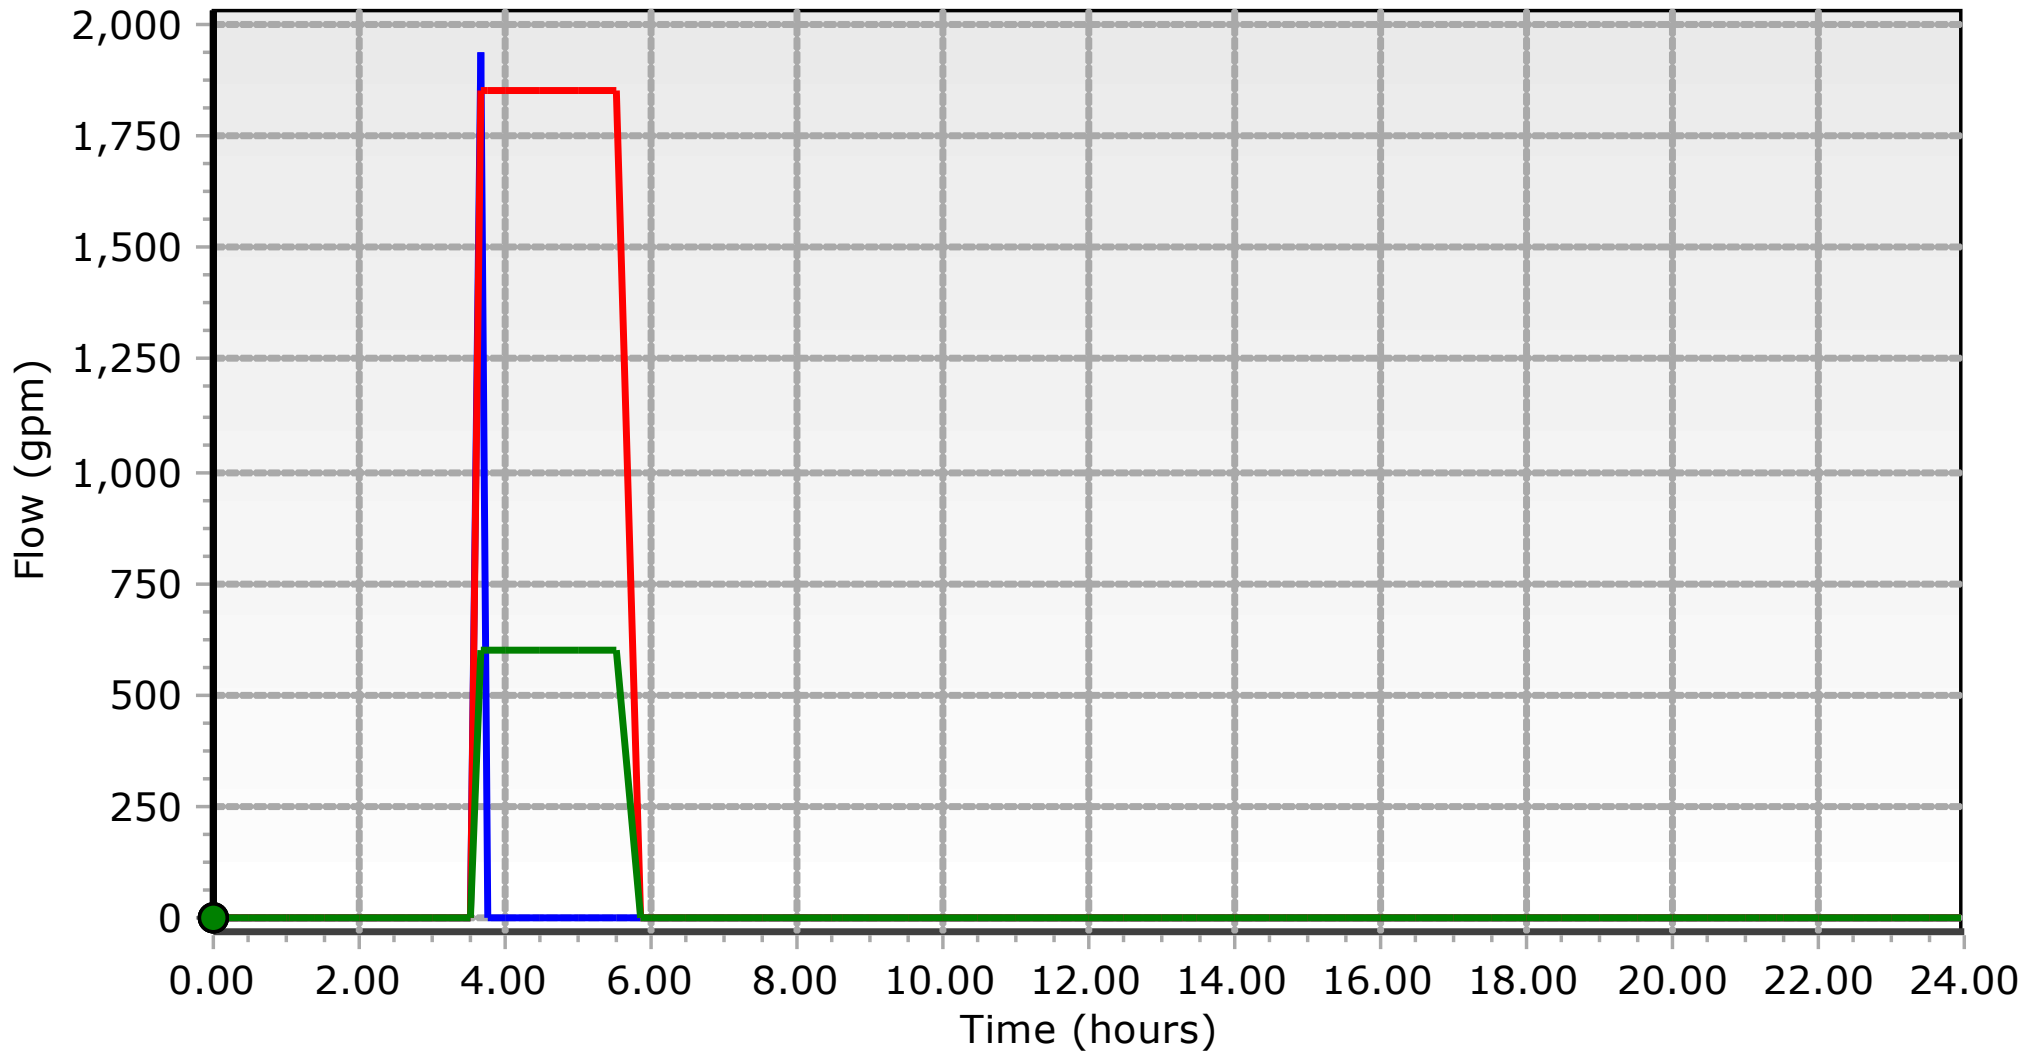


- COH SW 1 - Average Demand EPS - Summer - Flow (Total)
- WW 5 - Average Demand EPS - Summer - Flow (Total)
- WW 1 - Average Demand EPS - Summer - Flow (Total)

WP 2 Tank Level

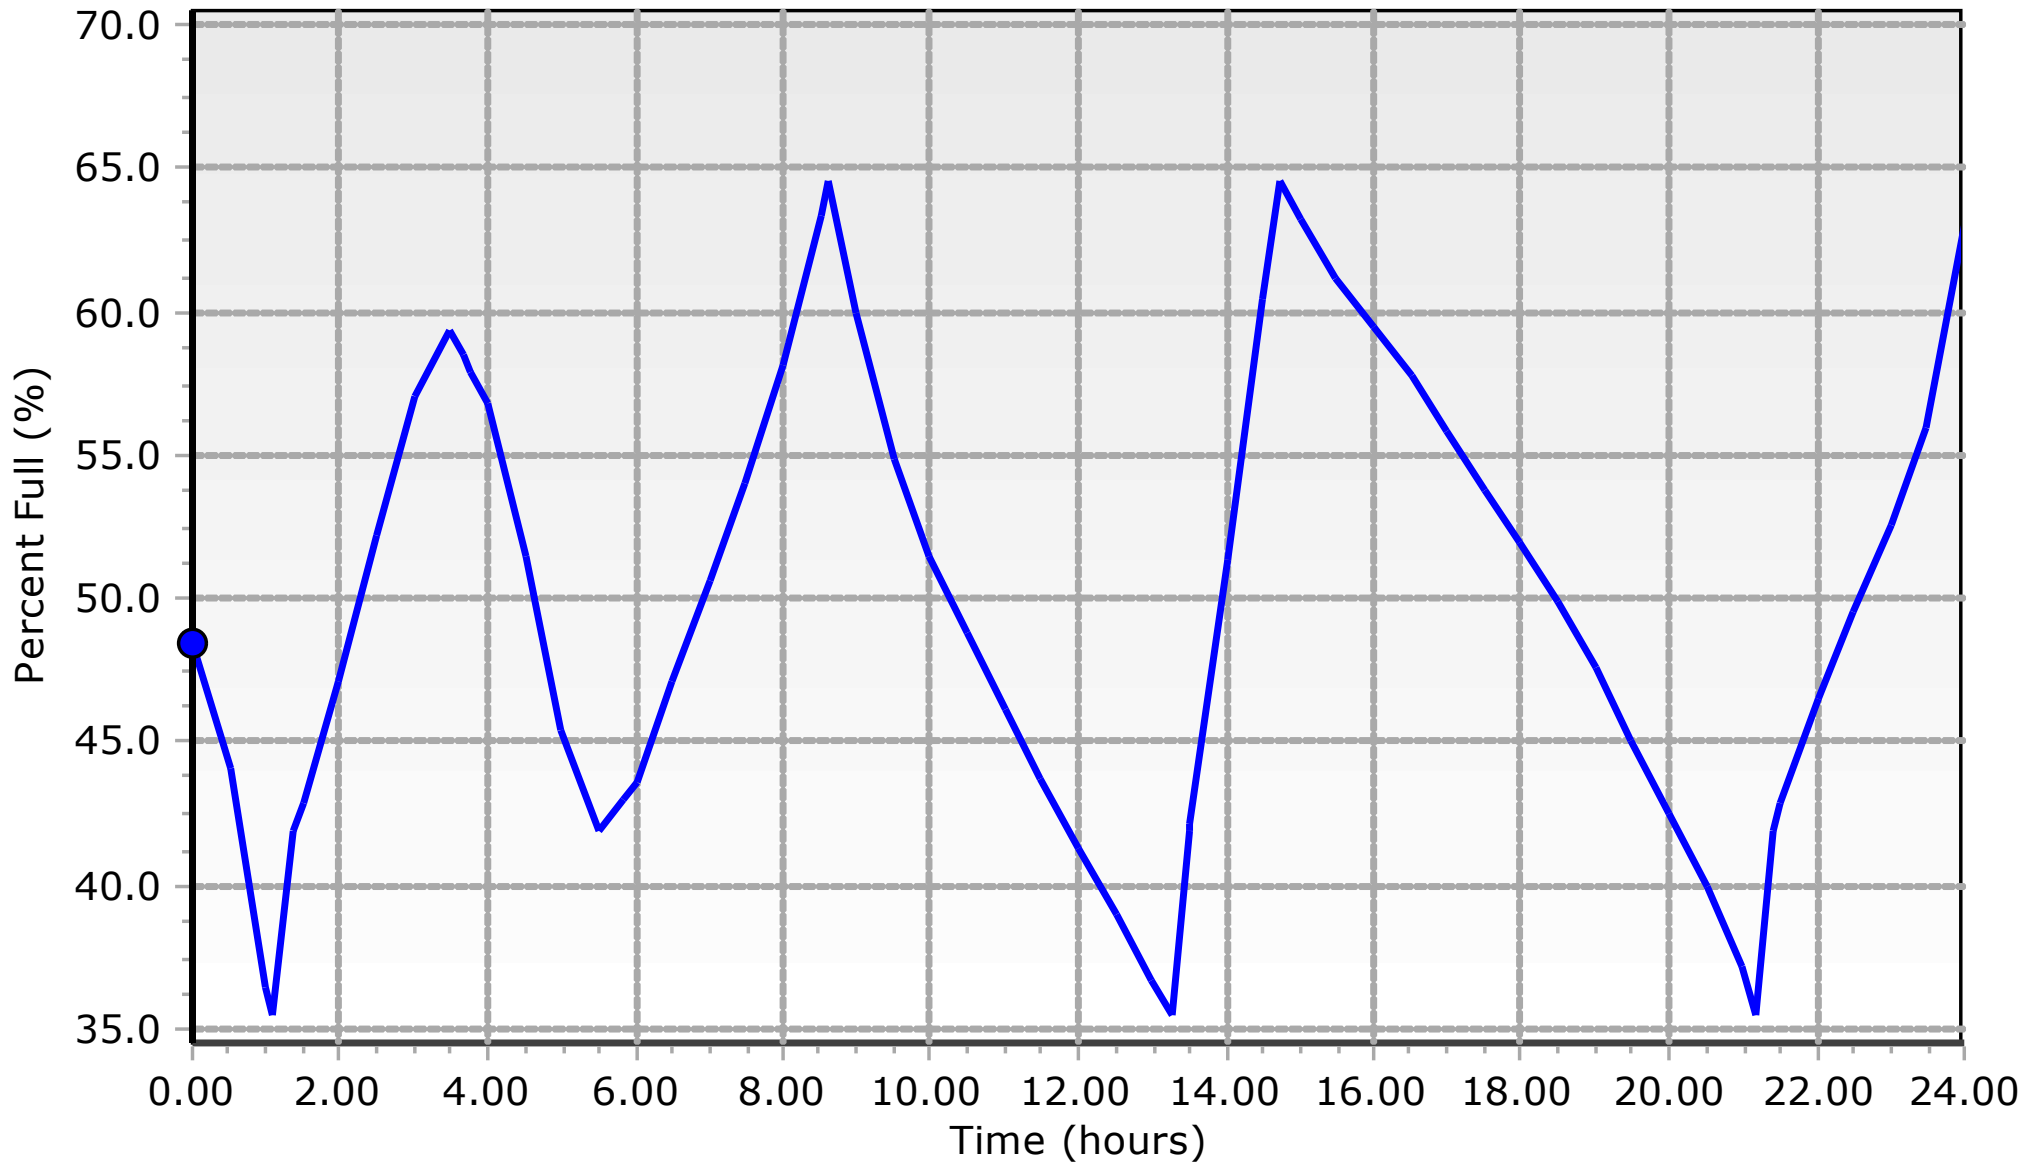

WP 2 GST 1 - Average Demand EPS - Summer - Percent Full


WP 2 Water Sources

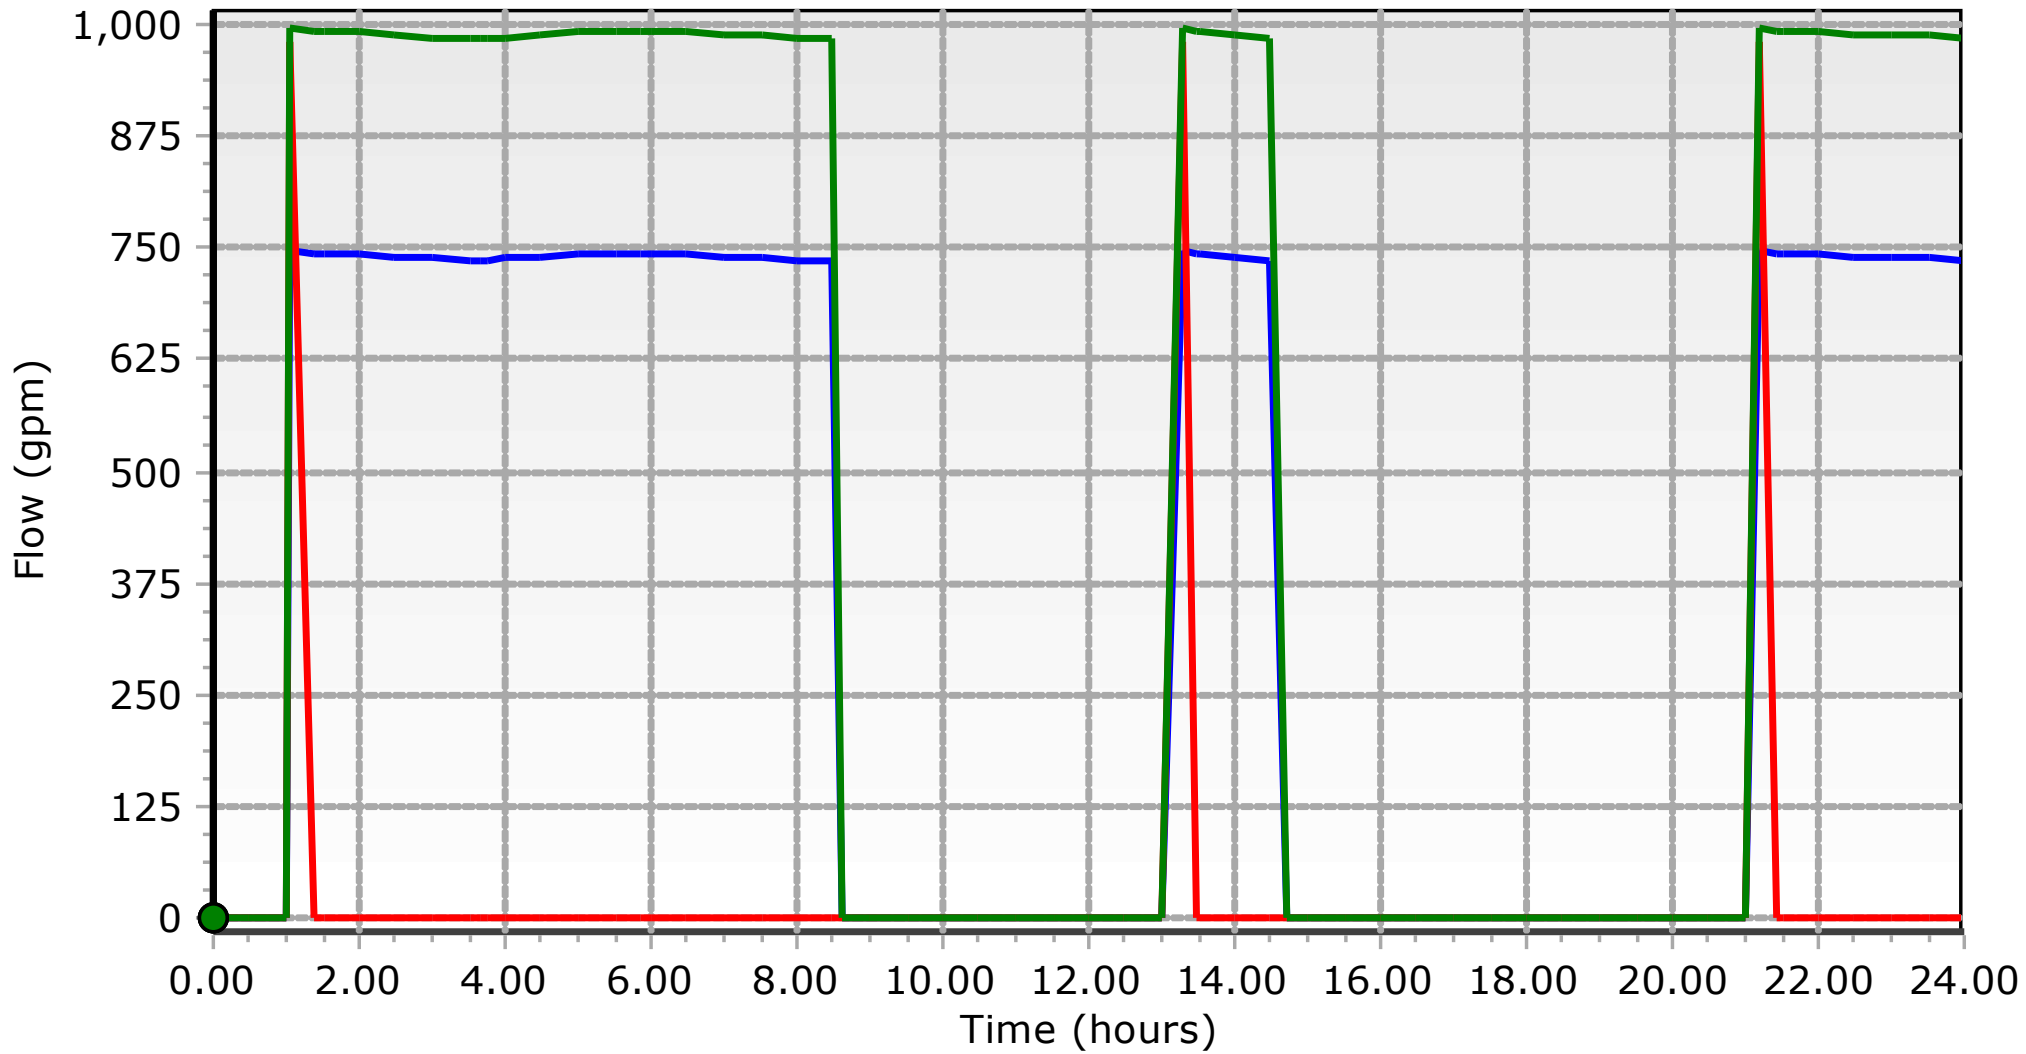

- WW 3 - Average Demand EPS - Summer - Flow (Total)
- COH SW 2 - Average Demand EPS - Summer - Flow (Total)
- WW 4 - Average Demand EPS - Summer - Flow (Total)


# **24-Hour Maximum Day Simulation**

Calculation Summary Graph

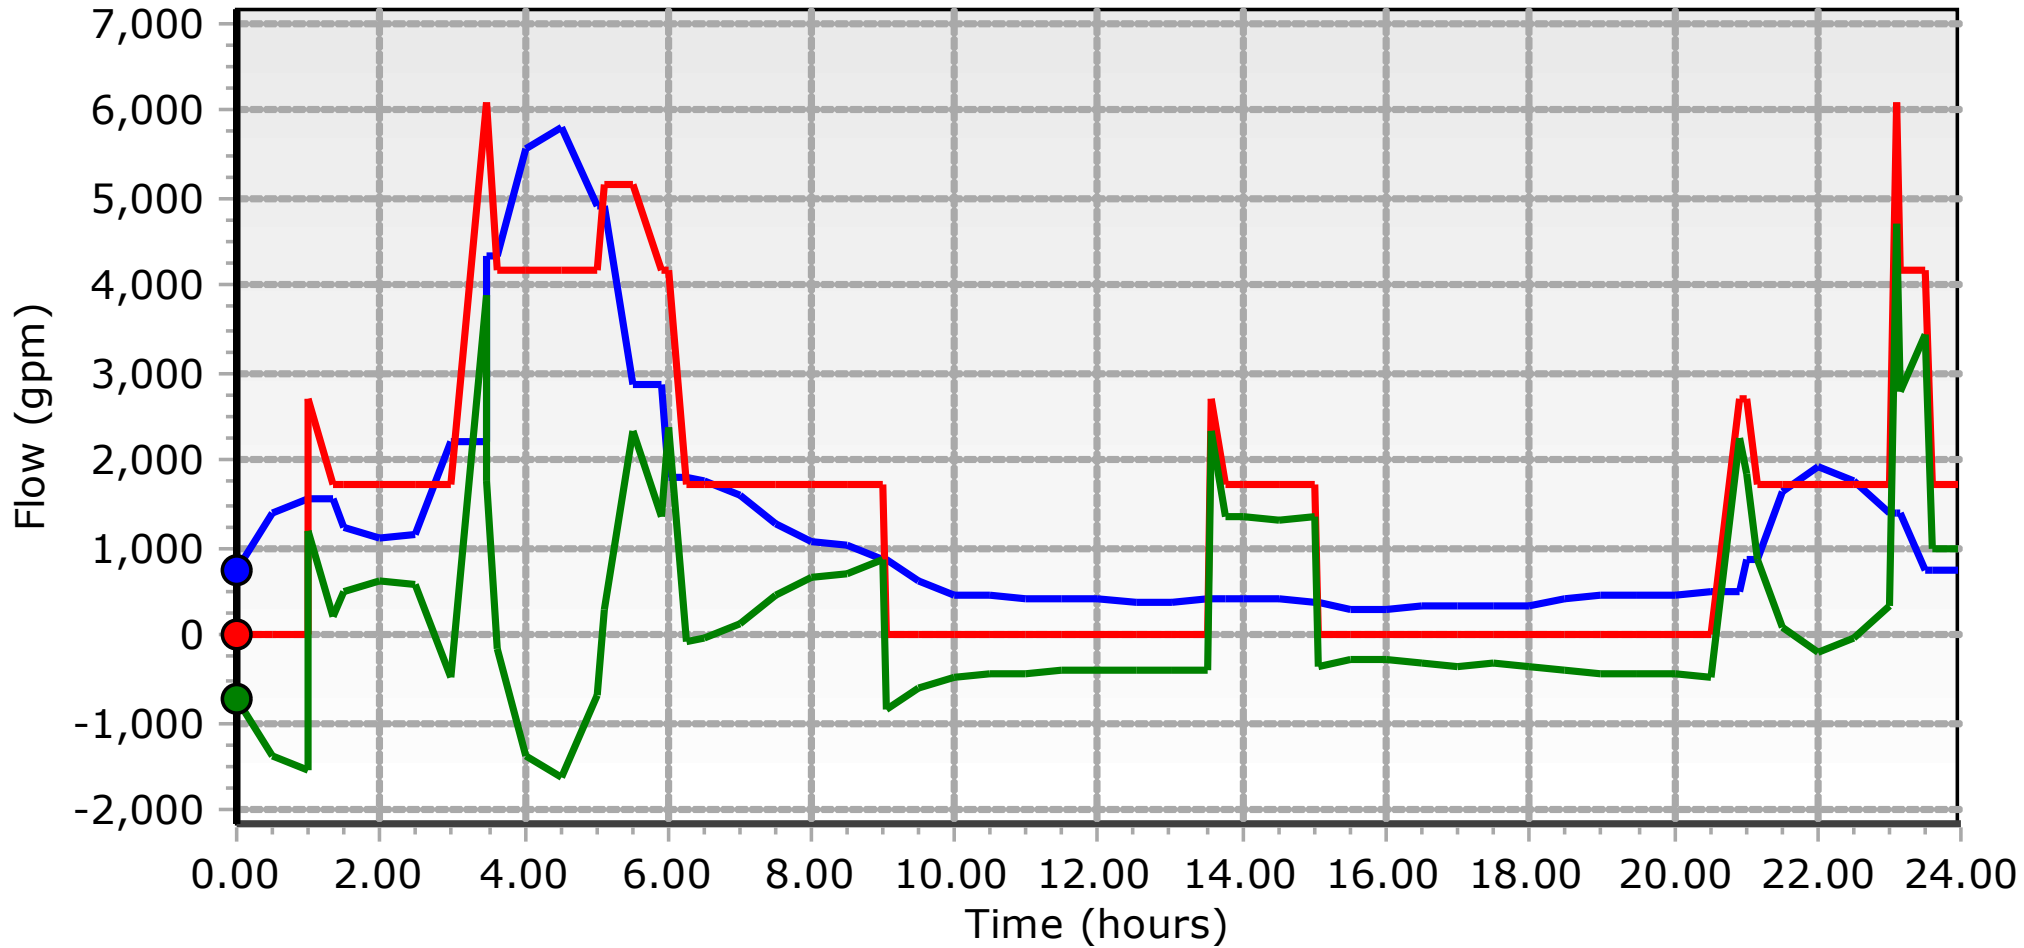


- Maximum Day EPS - Flow Demanded
- Maximum Day EPS - Flow Supplied
- Maximum Day EPS - Flow Stored

WP 1 Tank Levels

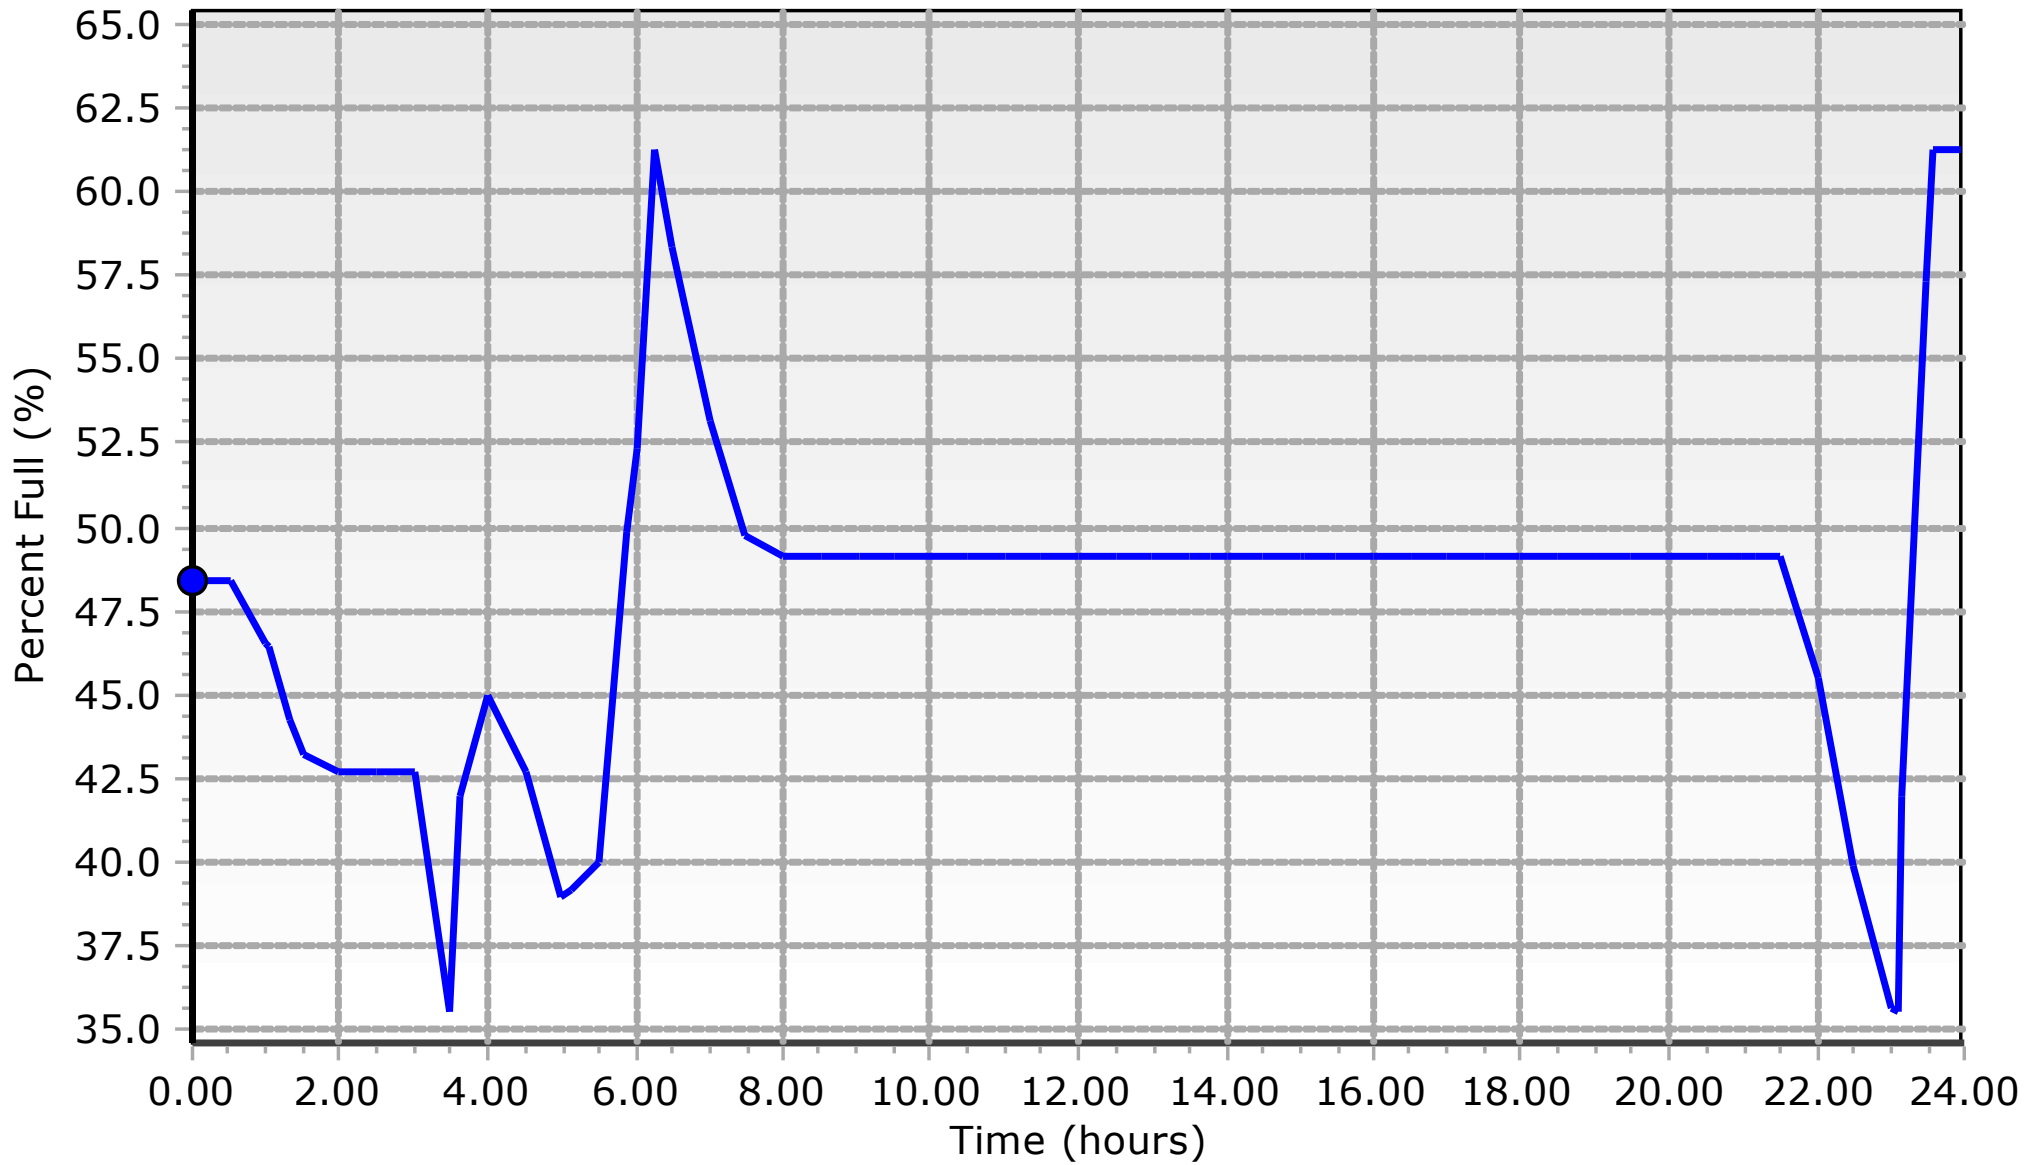


WP 1 GST 2 - Maximum Day EPS - Percent Full

# WP 1 Water Sources

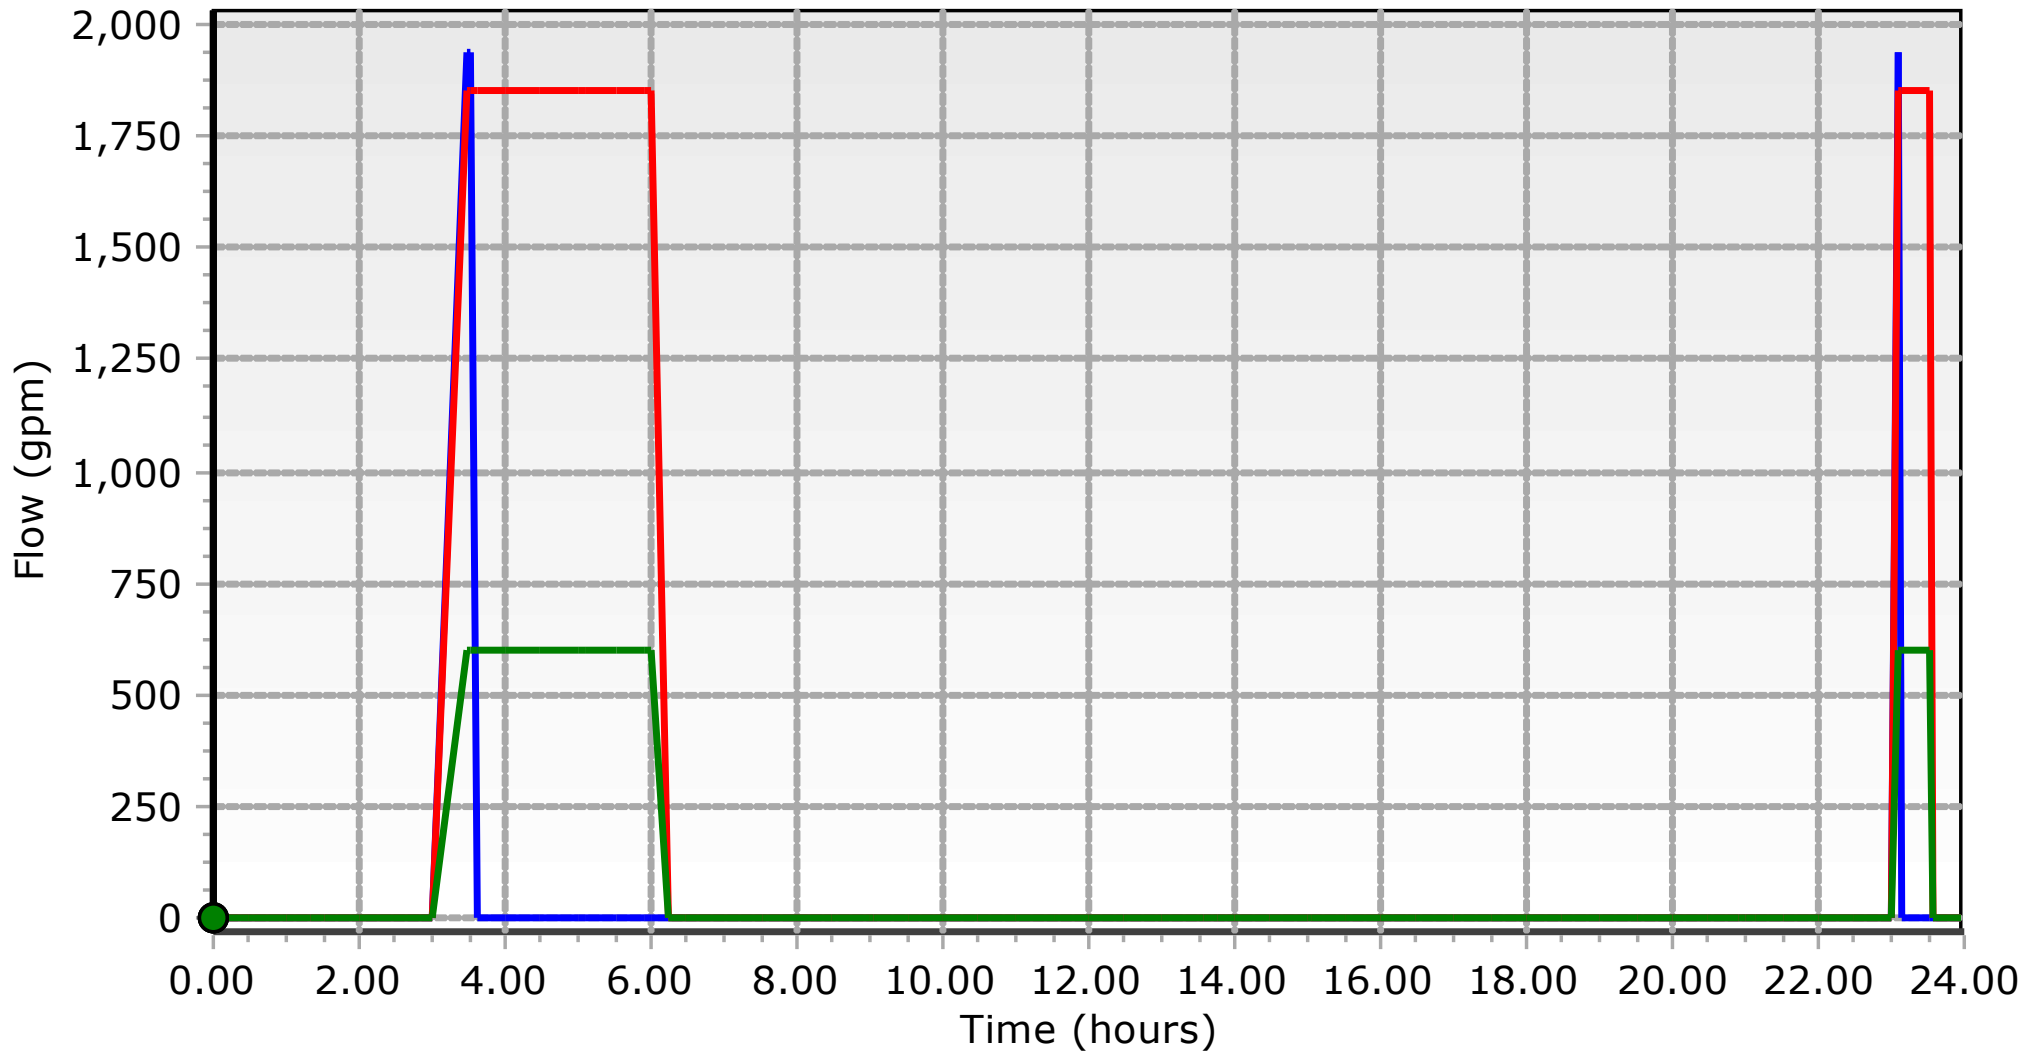



- COH SW 1 - Maximum Day EPS - Flow (Total)
- WW 5 - Maximum Day EPS - Flow (Total)
- WW 1 - Maximum Day EPS - Flow (Total)

WP 2 Tank Level

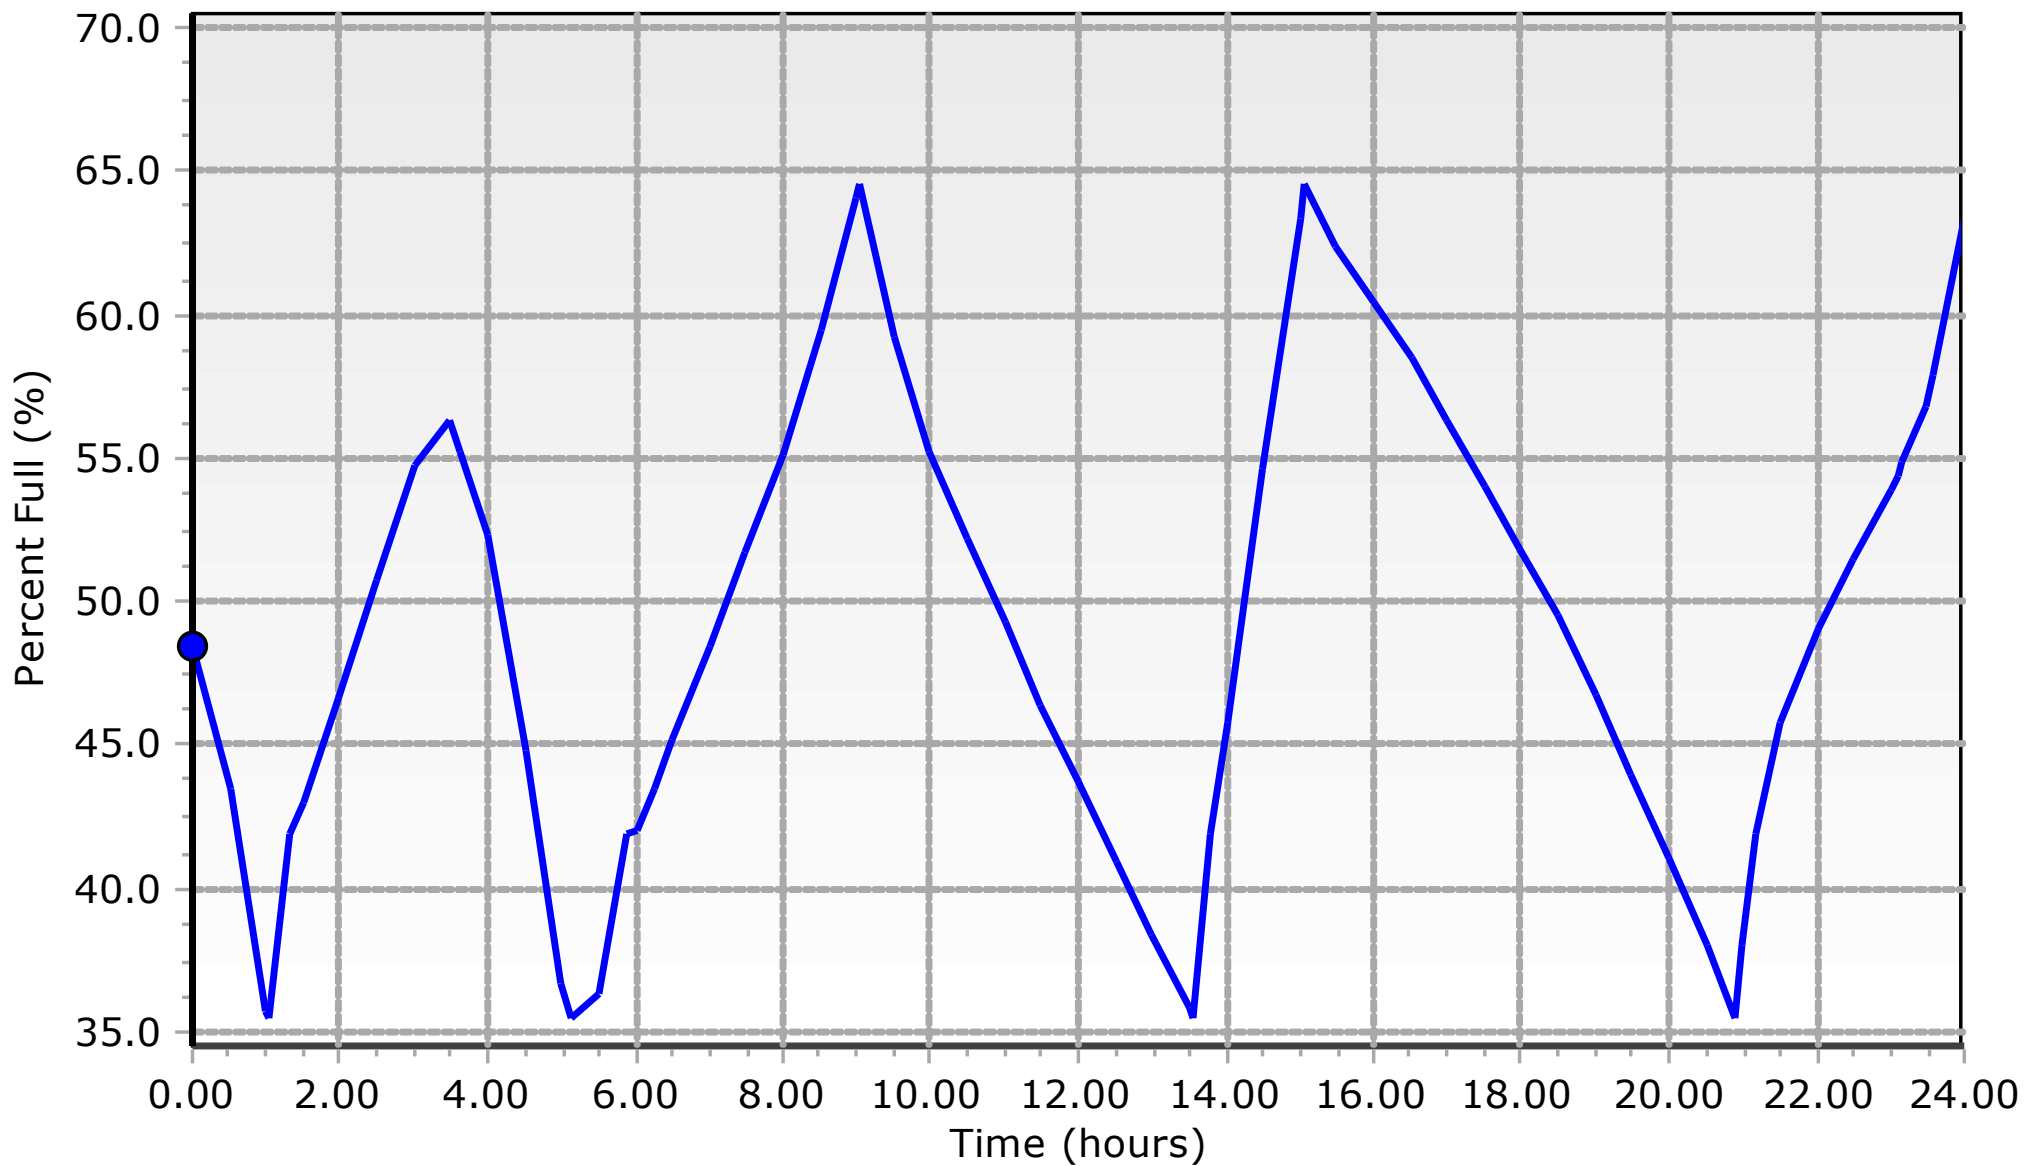

WP 2 GST 1 - Maximum Day EPS - Percent Full


### WP 2 Water Sources

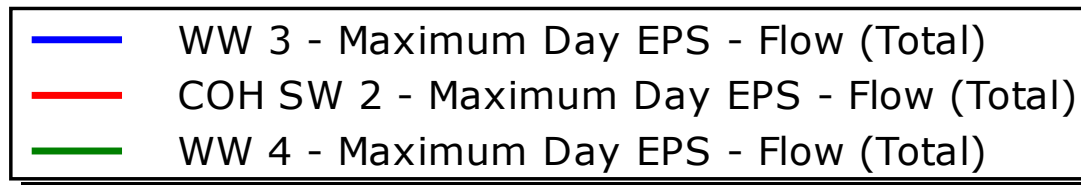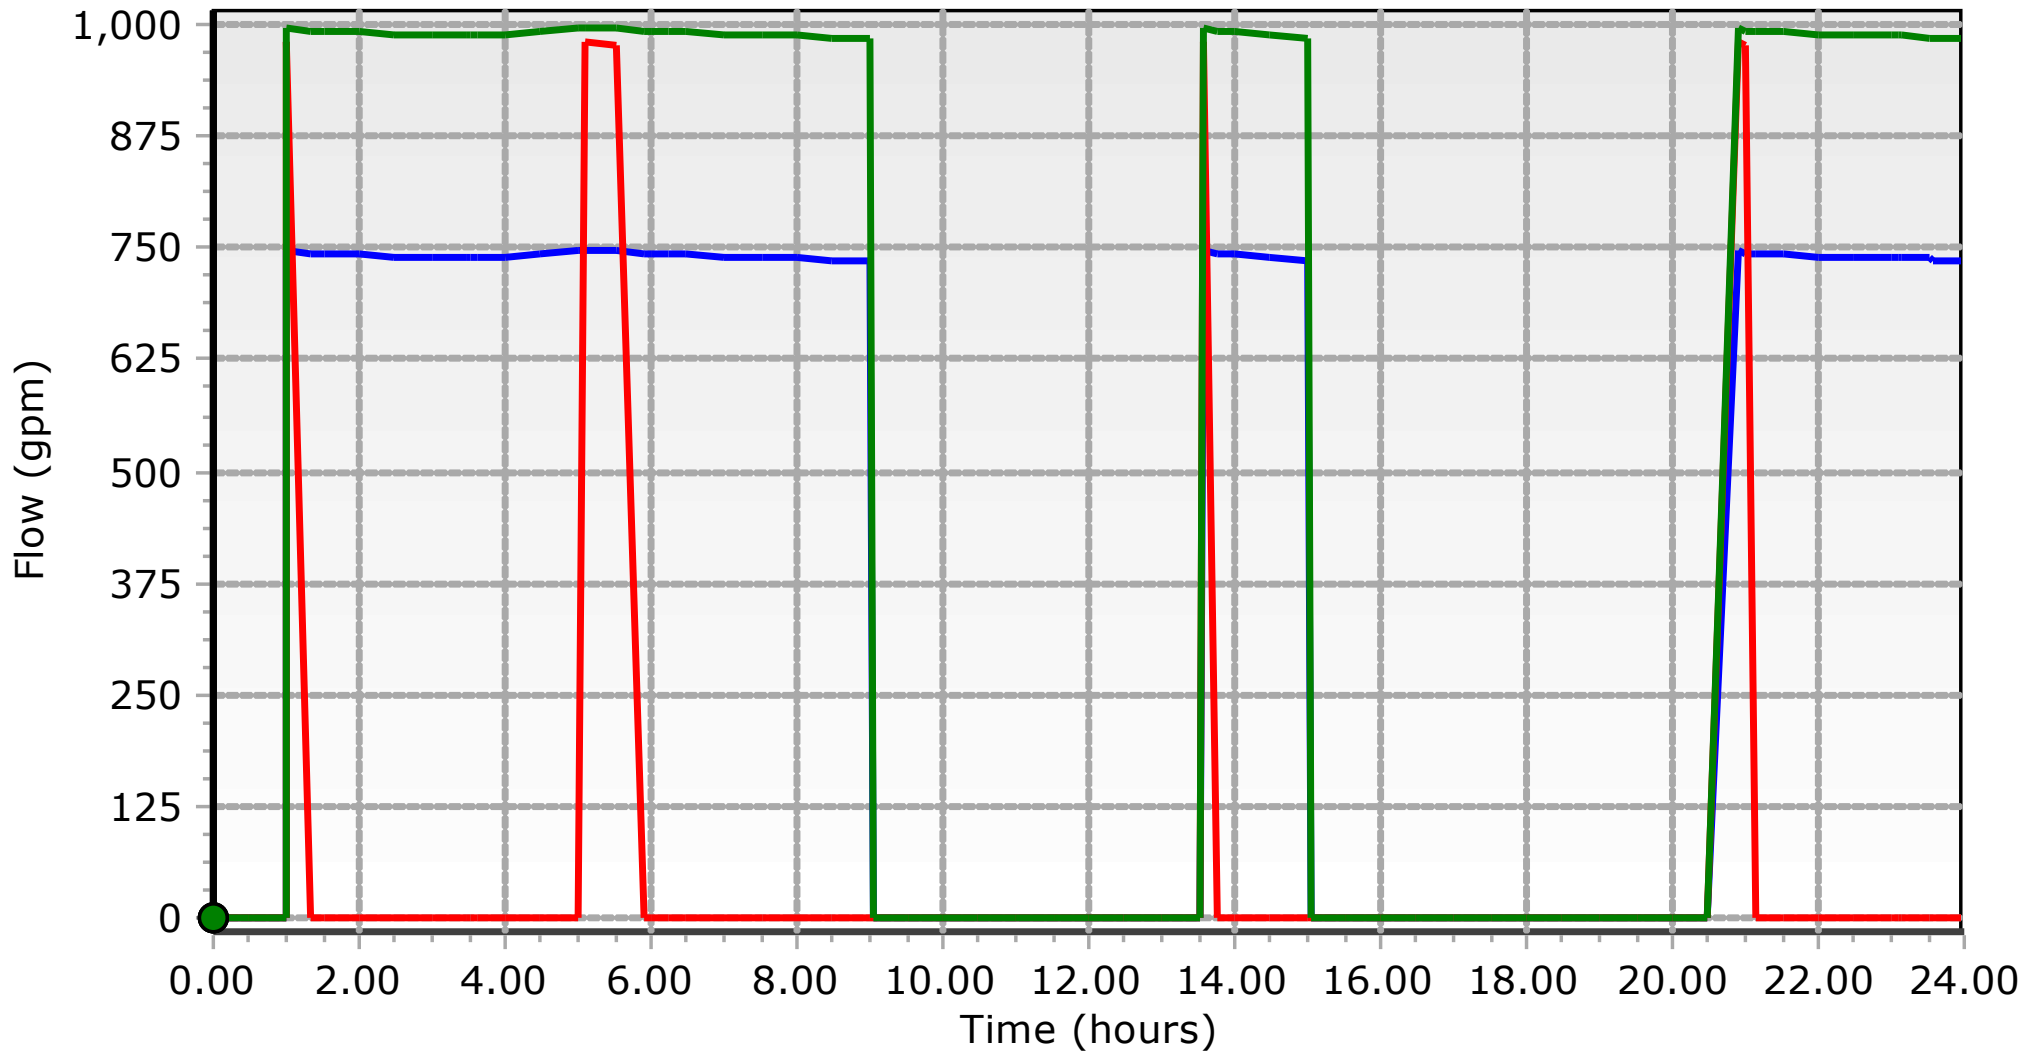

**City of Bunker Hill Village Removal of  
GST 2 at Taylorcrest WP - Extended  
Period Simulation**



# **24-Hour Average Winter Day Simulation**

WP 1 Tank Level

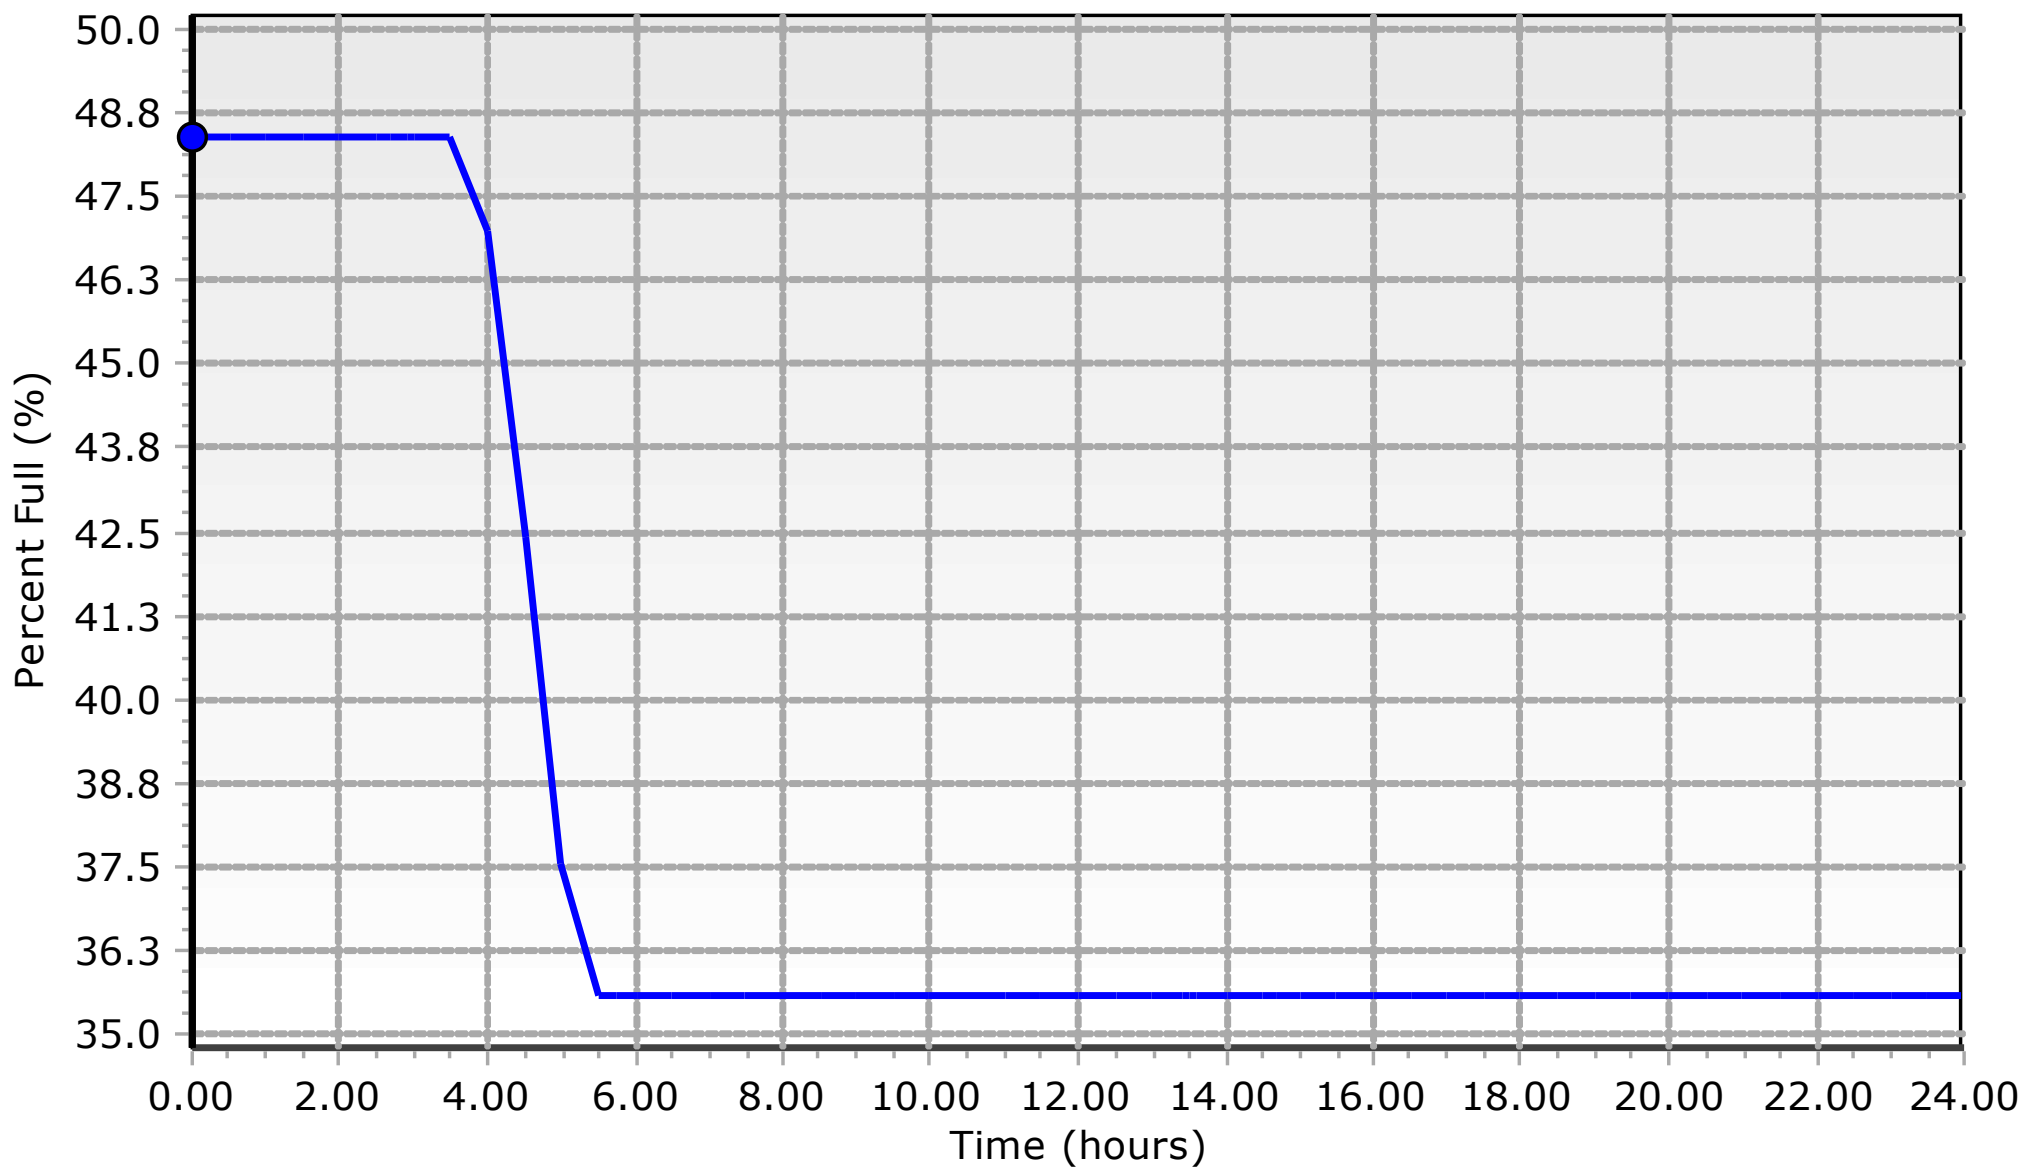


WP 1 GST 2 - Average Demand EPS - Winter - Percent Full

# WP 1 Water Sources

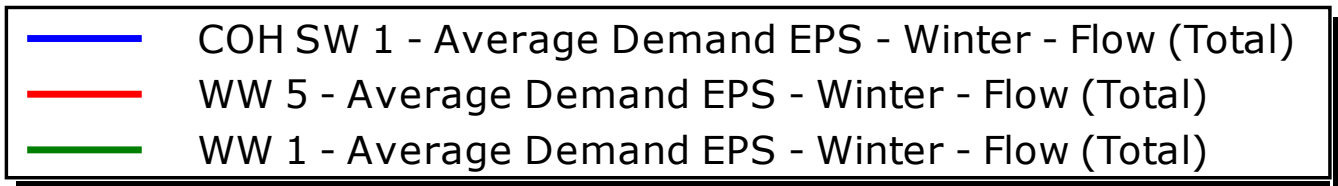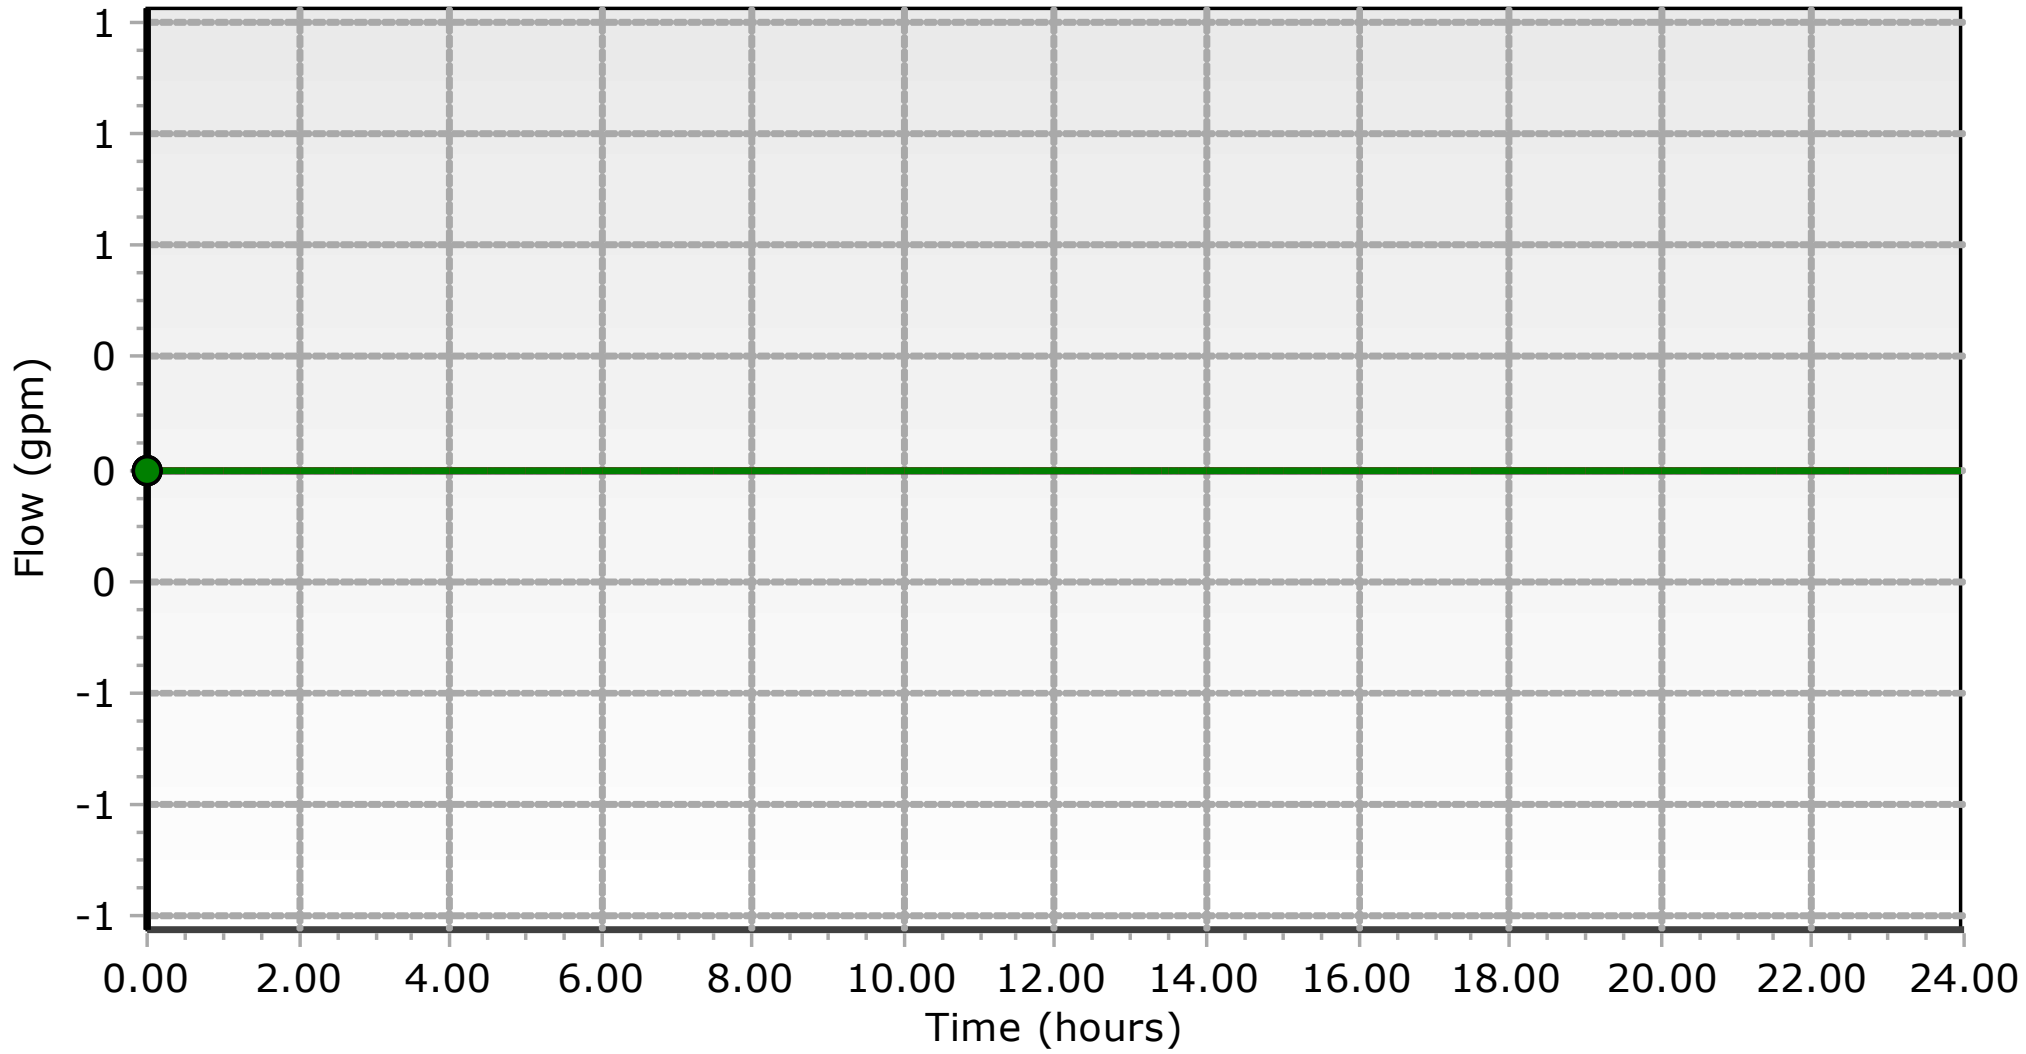


WP 2 Tank Level

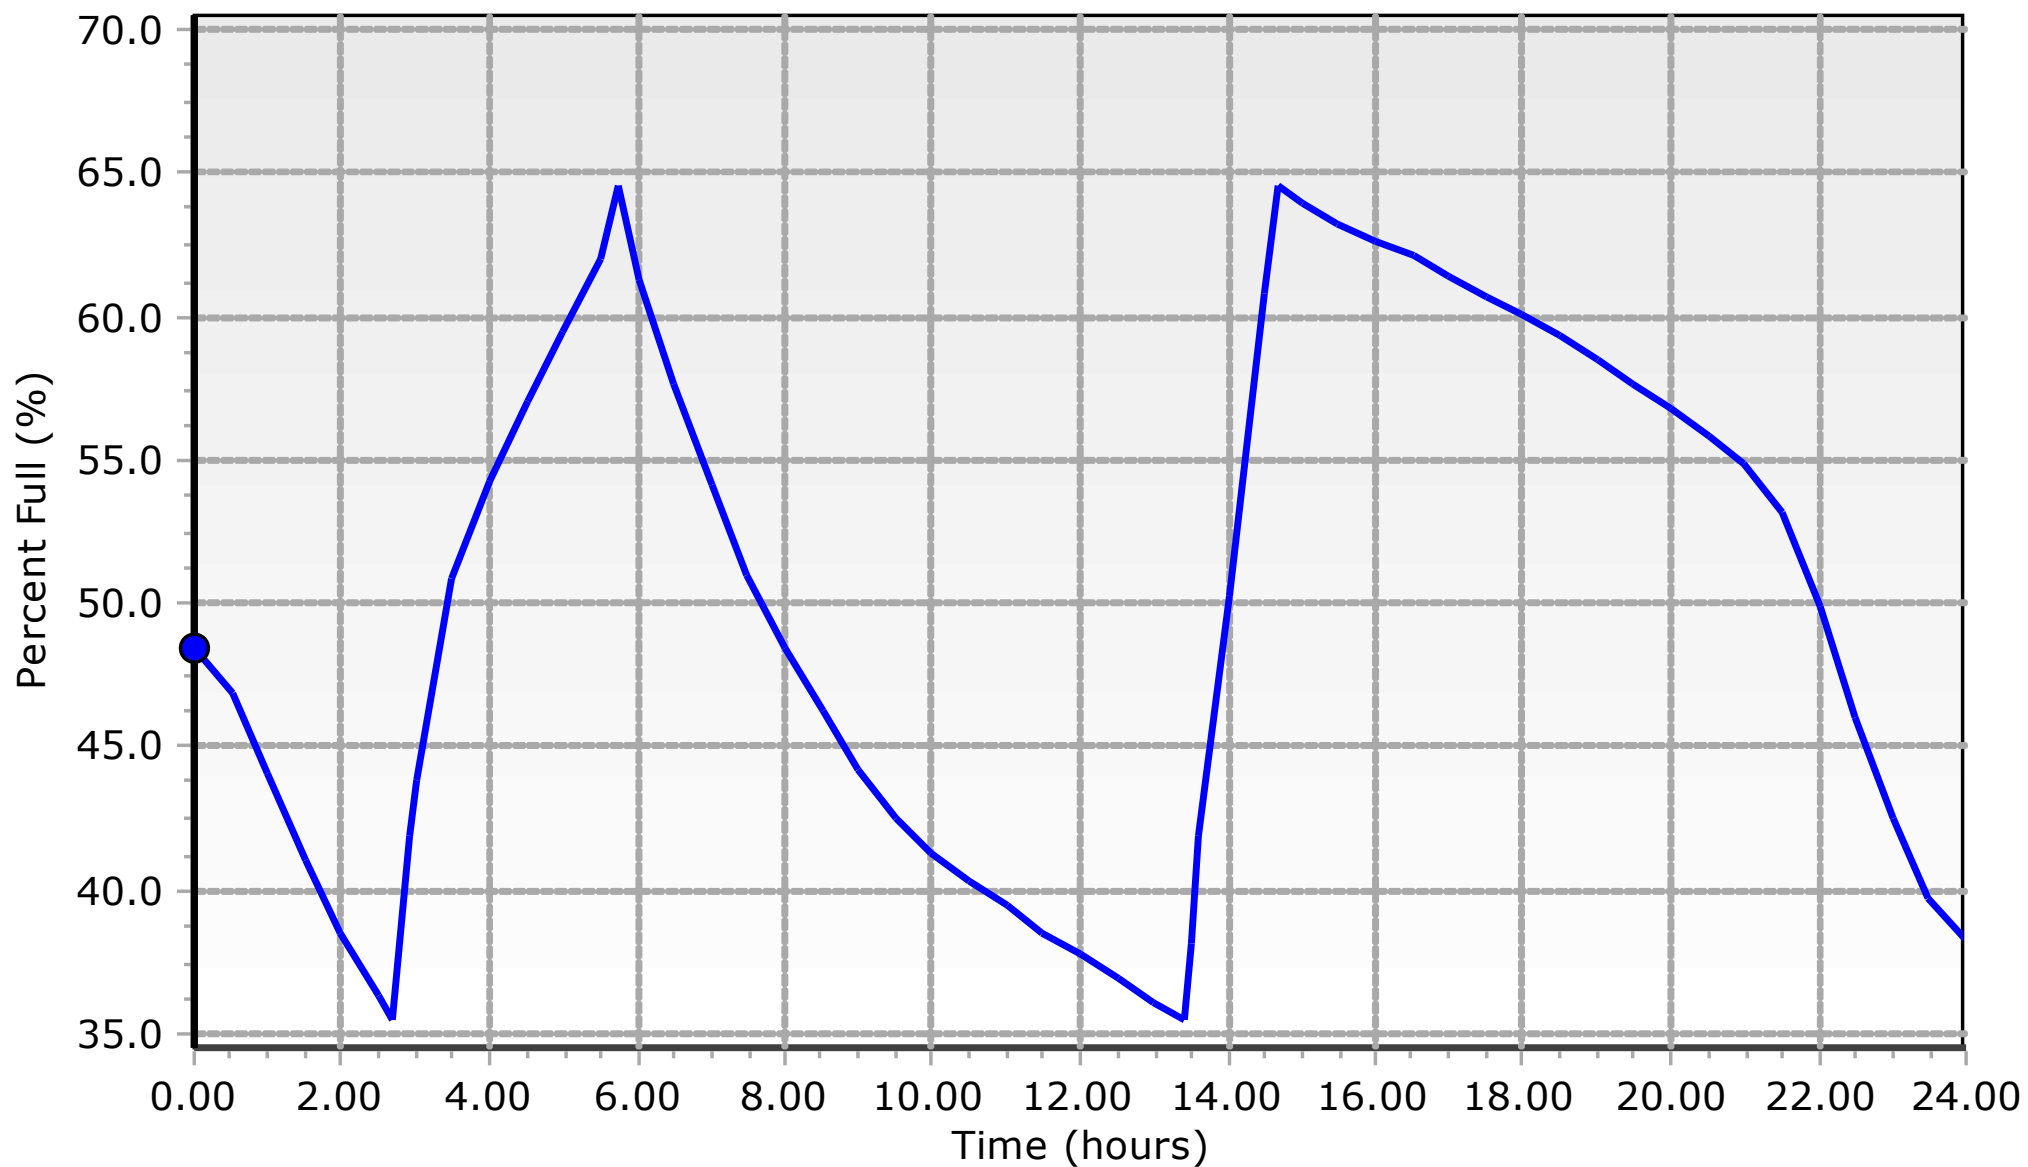

WP 2 GST 1 - Average Demand EPS - Winter - Percent Full


WP 2 Water Sources

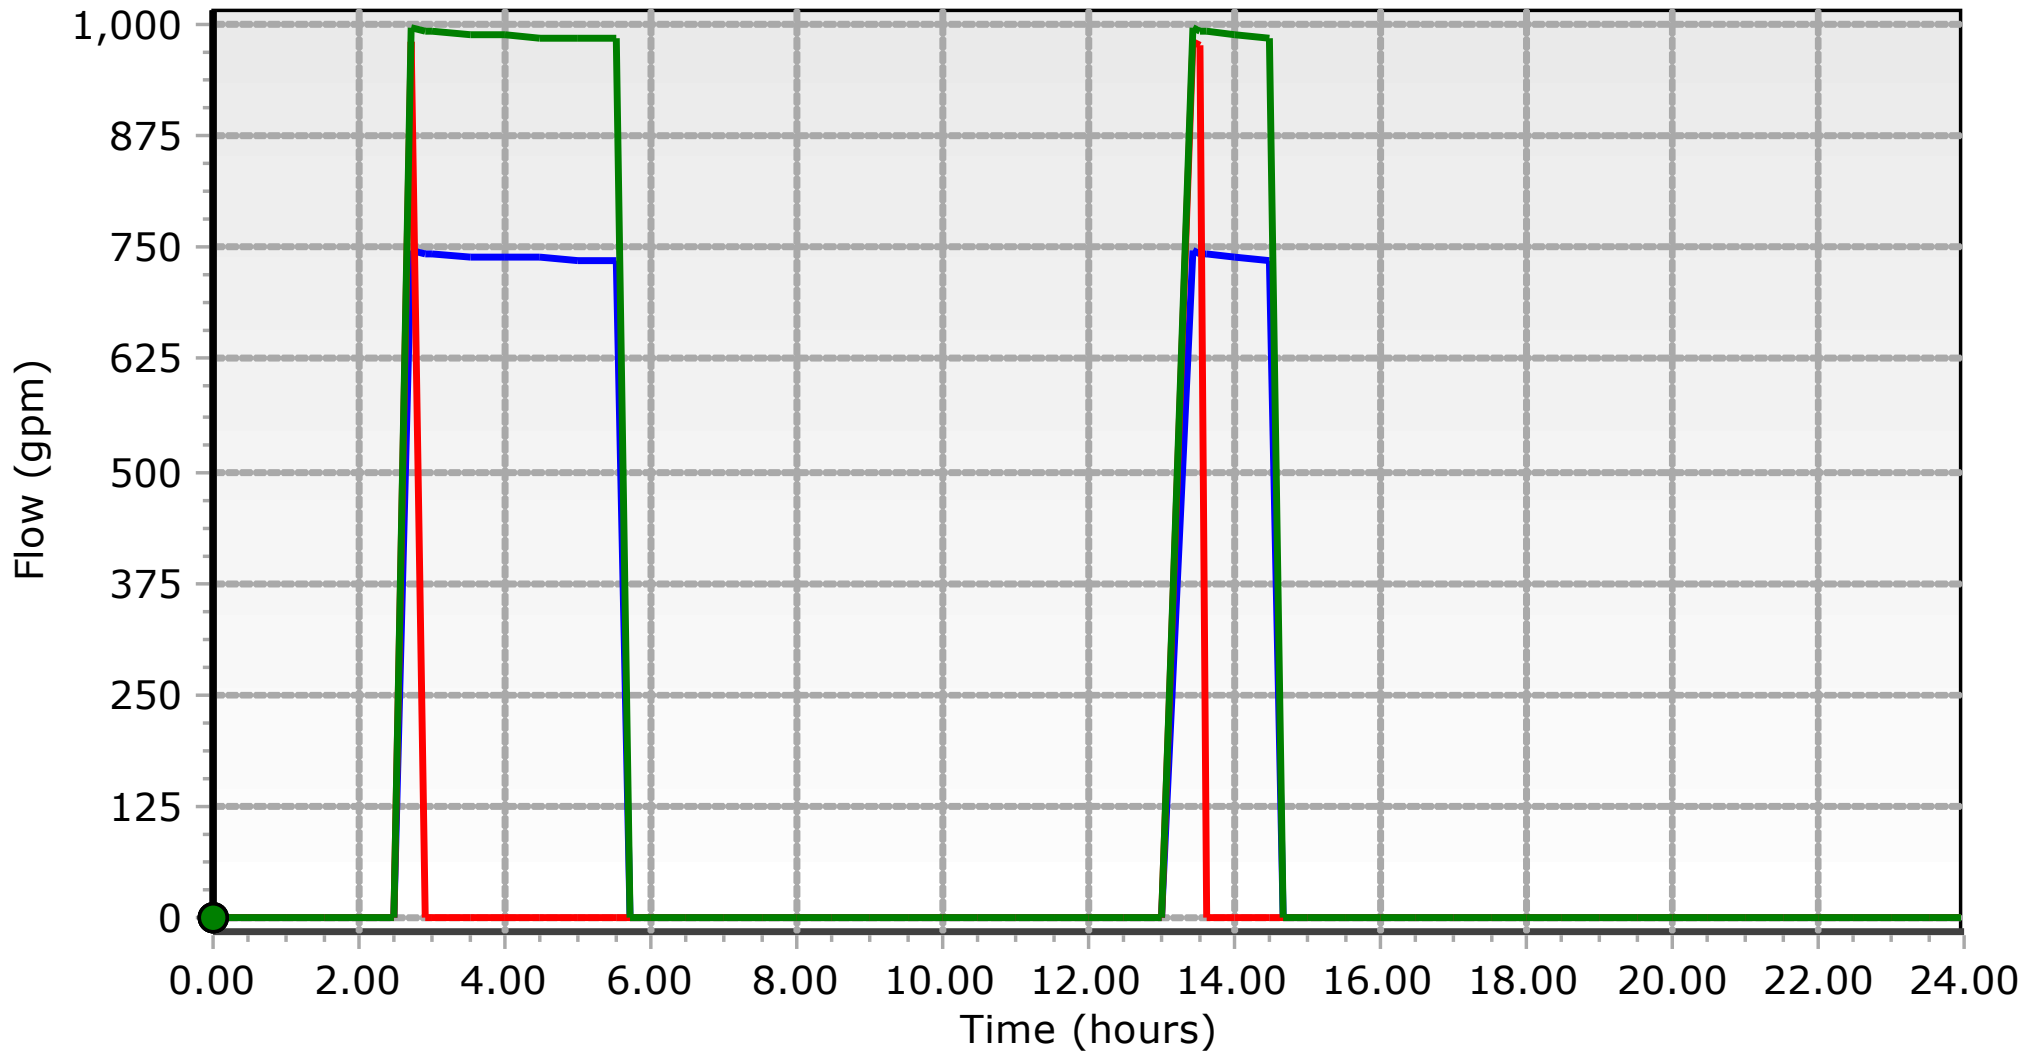

- WW 3 - Average Demand EPS - Winter - Flow (Total)
- COH SW 2 - Average Demand EPS - Winter - Flow (Total)
- WW 4 - Average Demand EPS - Winter - Flow (Total)


# **24-Hour Average Summer Day Simulation**

WP 1 Tank Levels

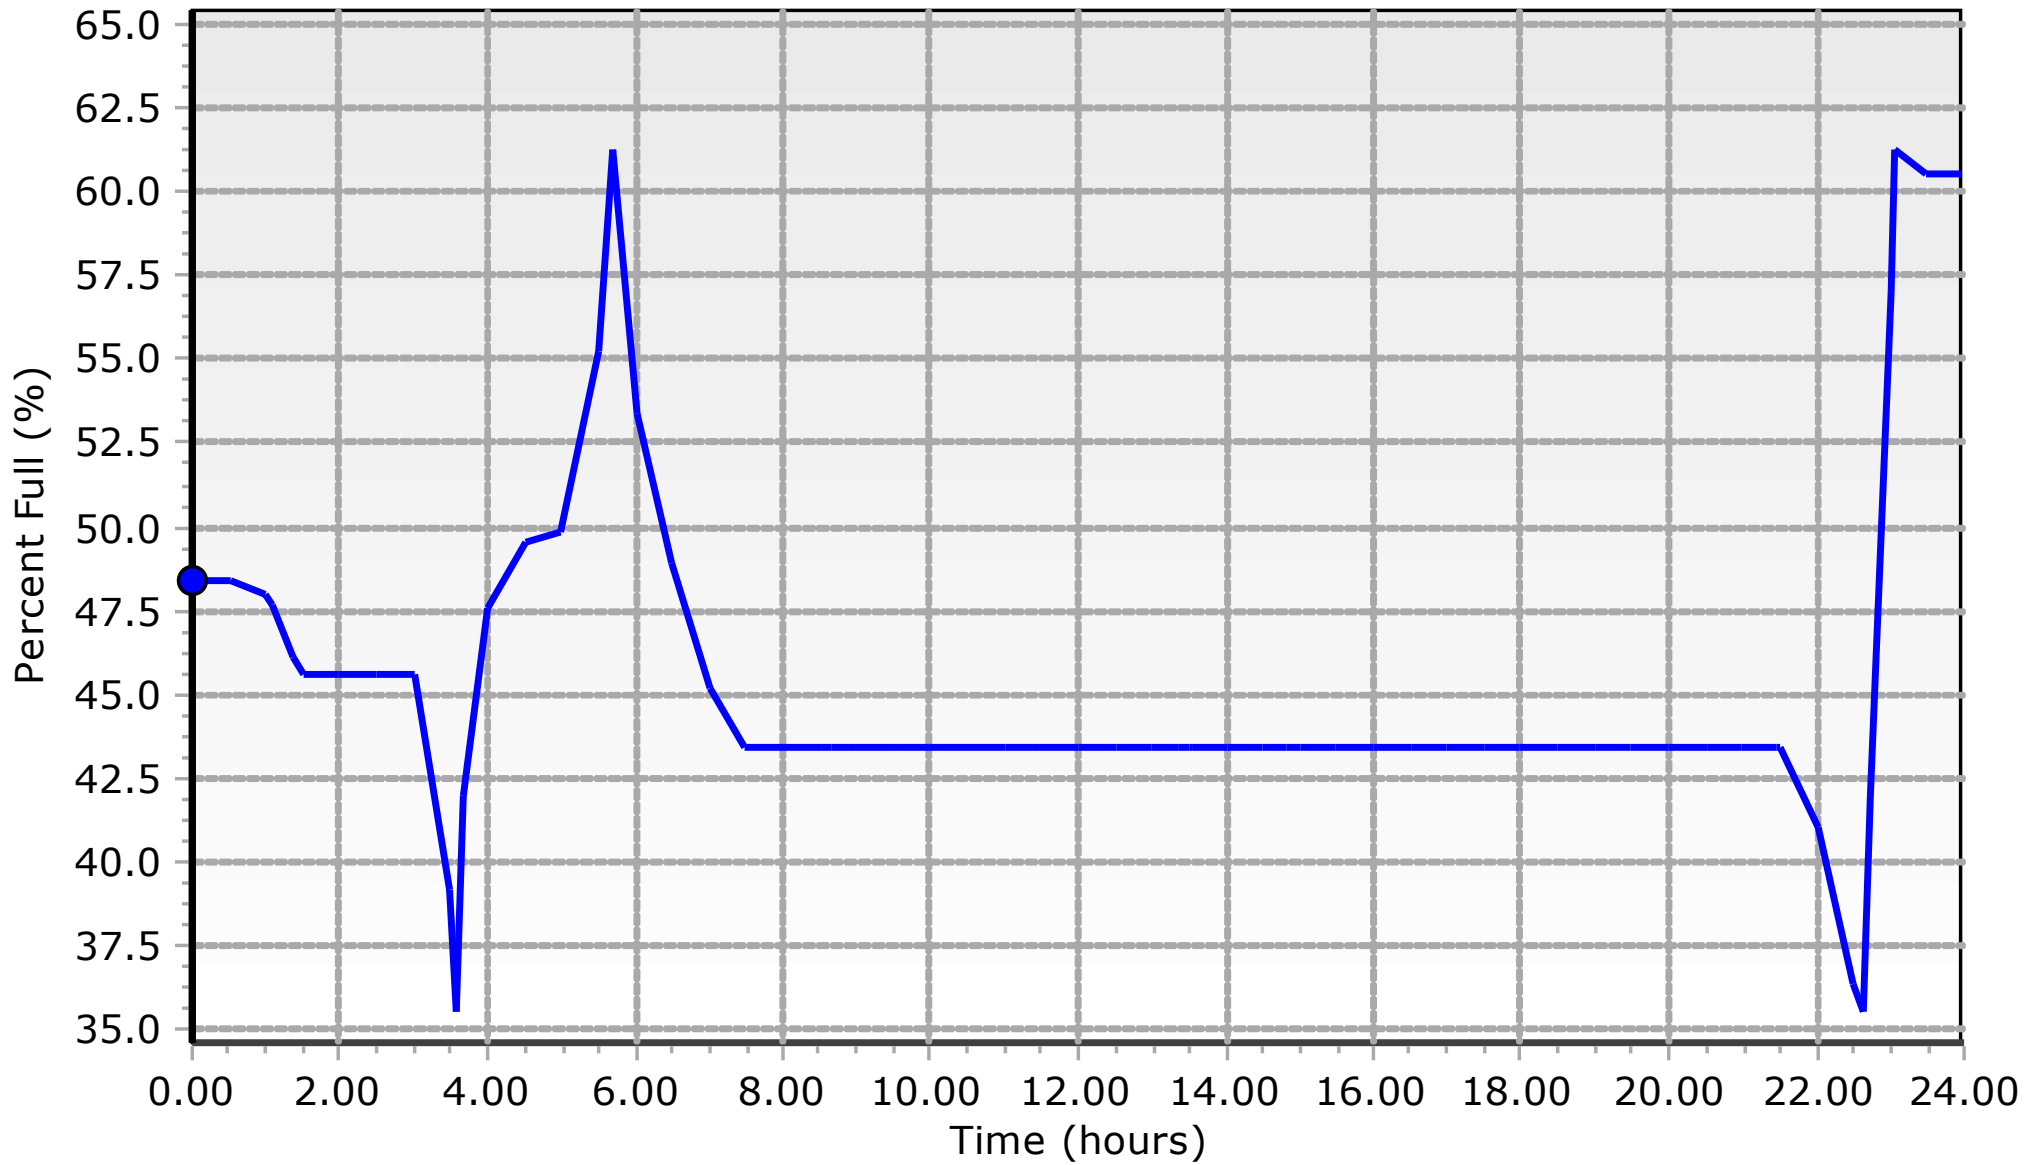


WP 1 GST 2 - Average Demand EPS - Summer - Percent Full

# WP 1 Water Sources

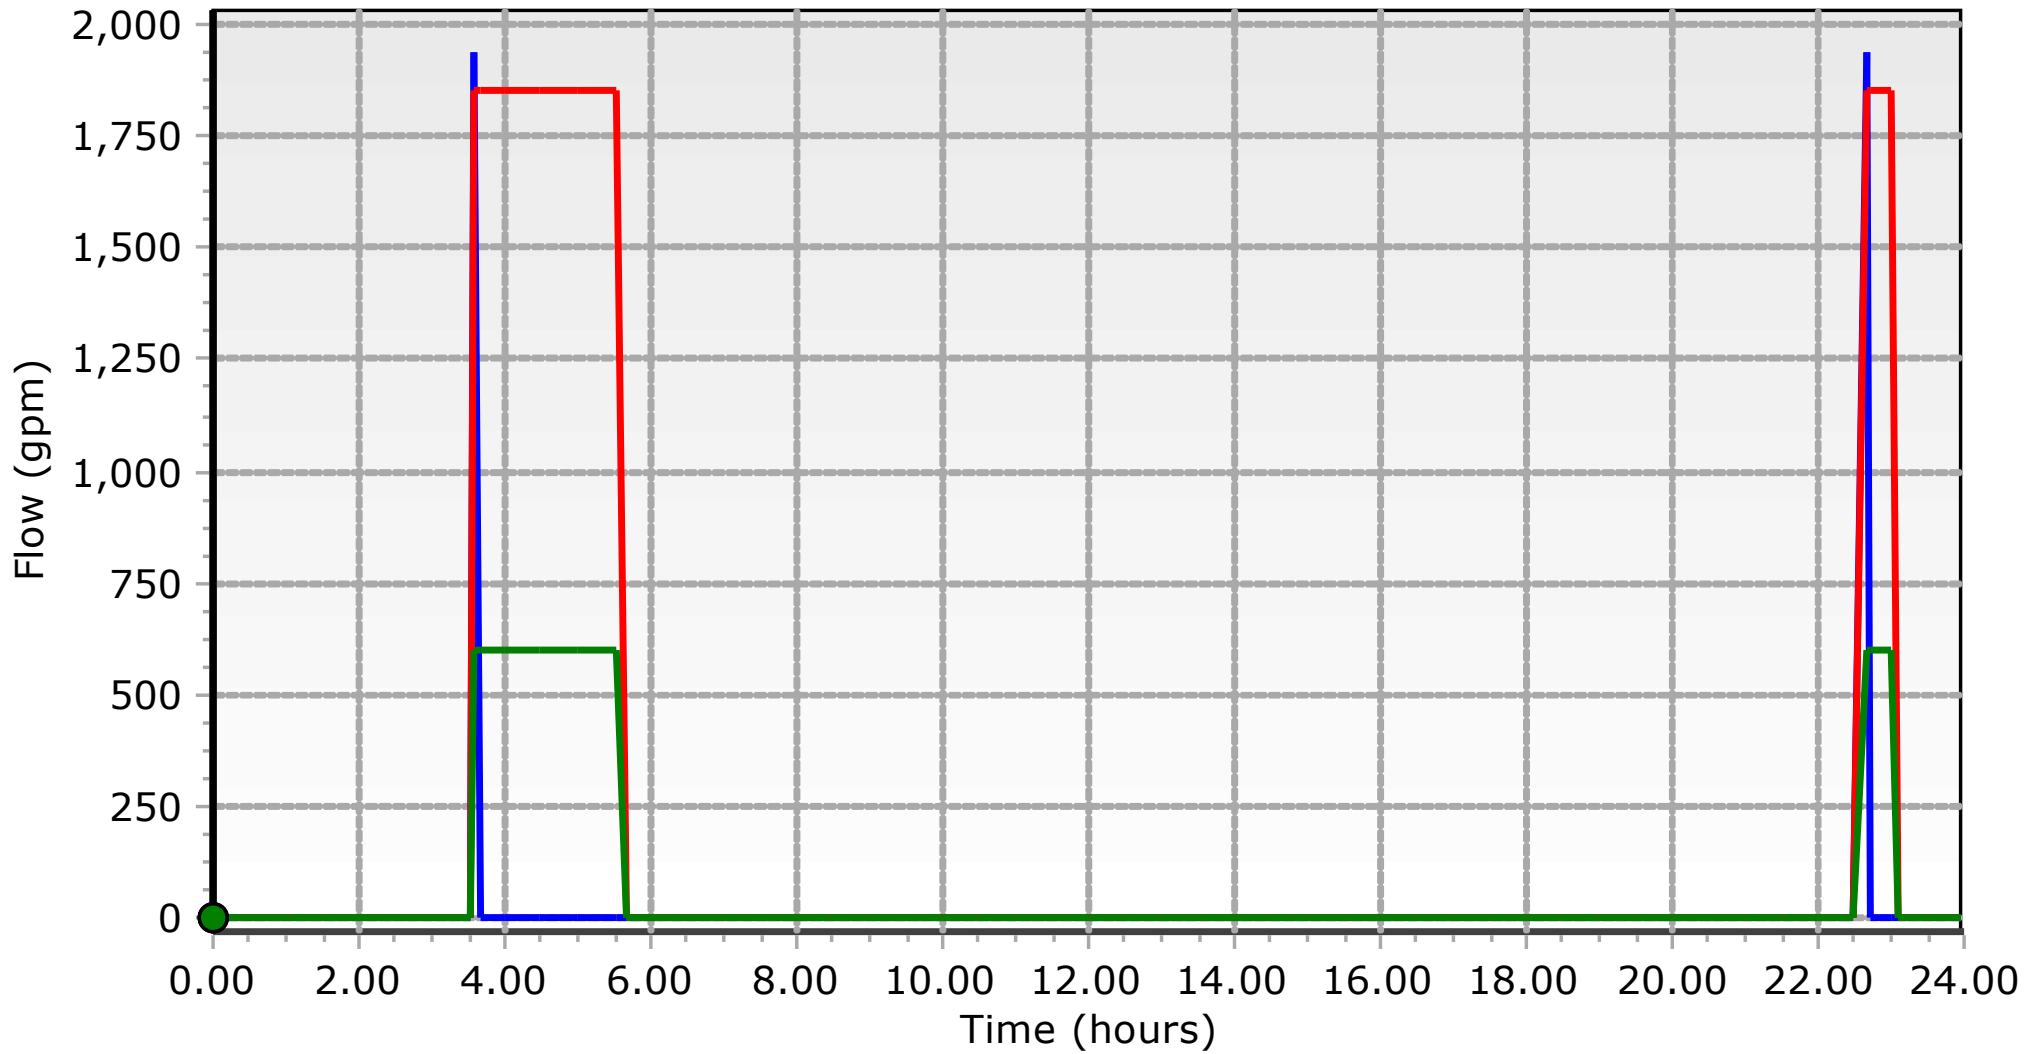


- COH SW 1 - Average Demand EPS - Summer - Flow (Total)
- WW 5 - Average Demand EPS - Summer - Flow (Total)
- WW 1 - Average Demand EPS - Summer - Flow (Total)

WP 2 Tank Level

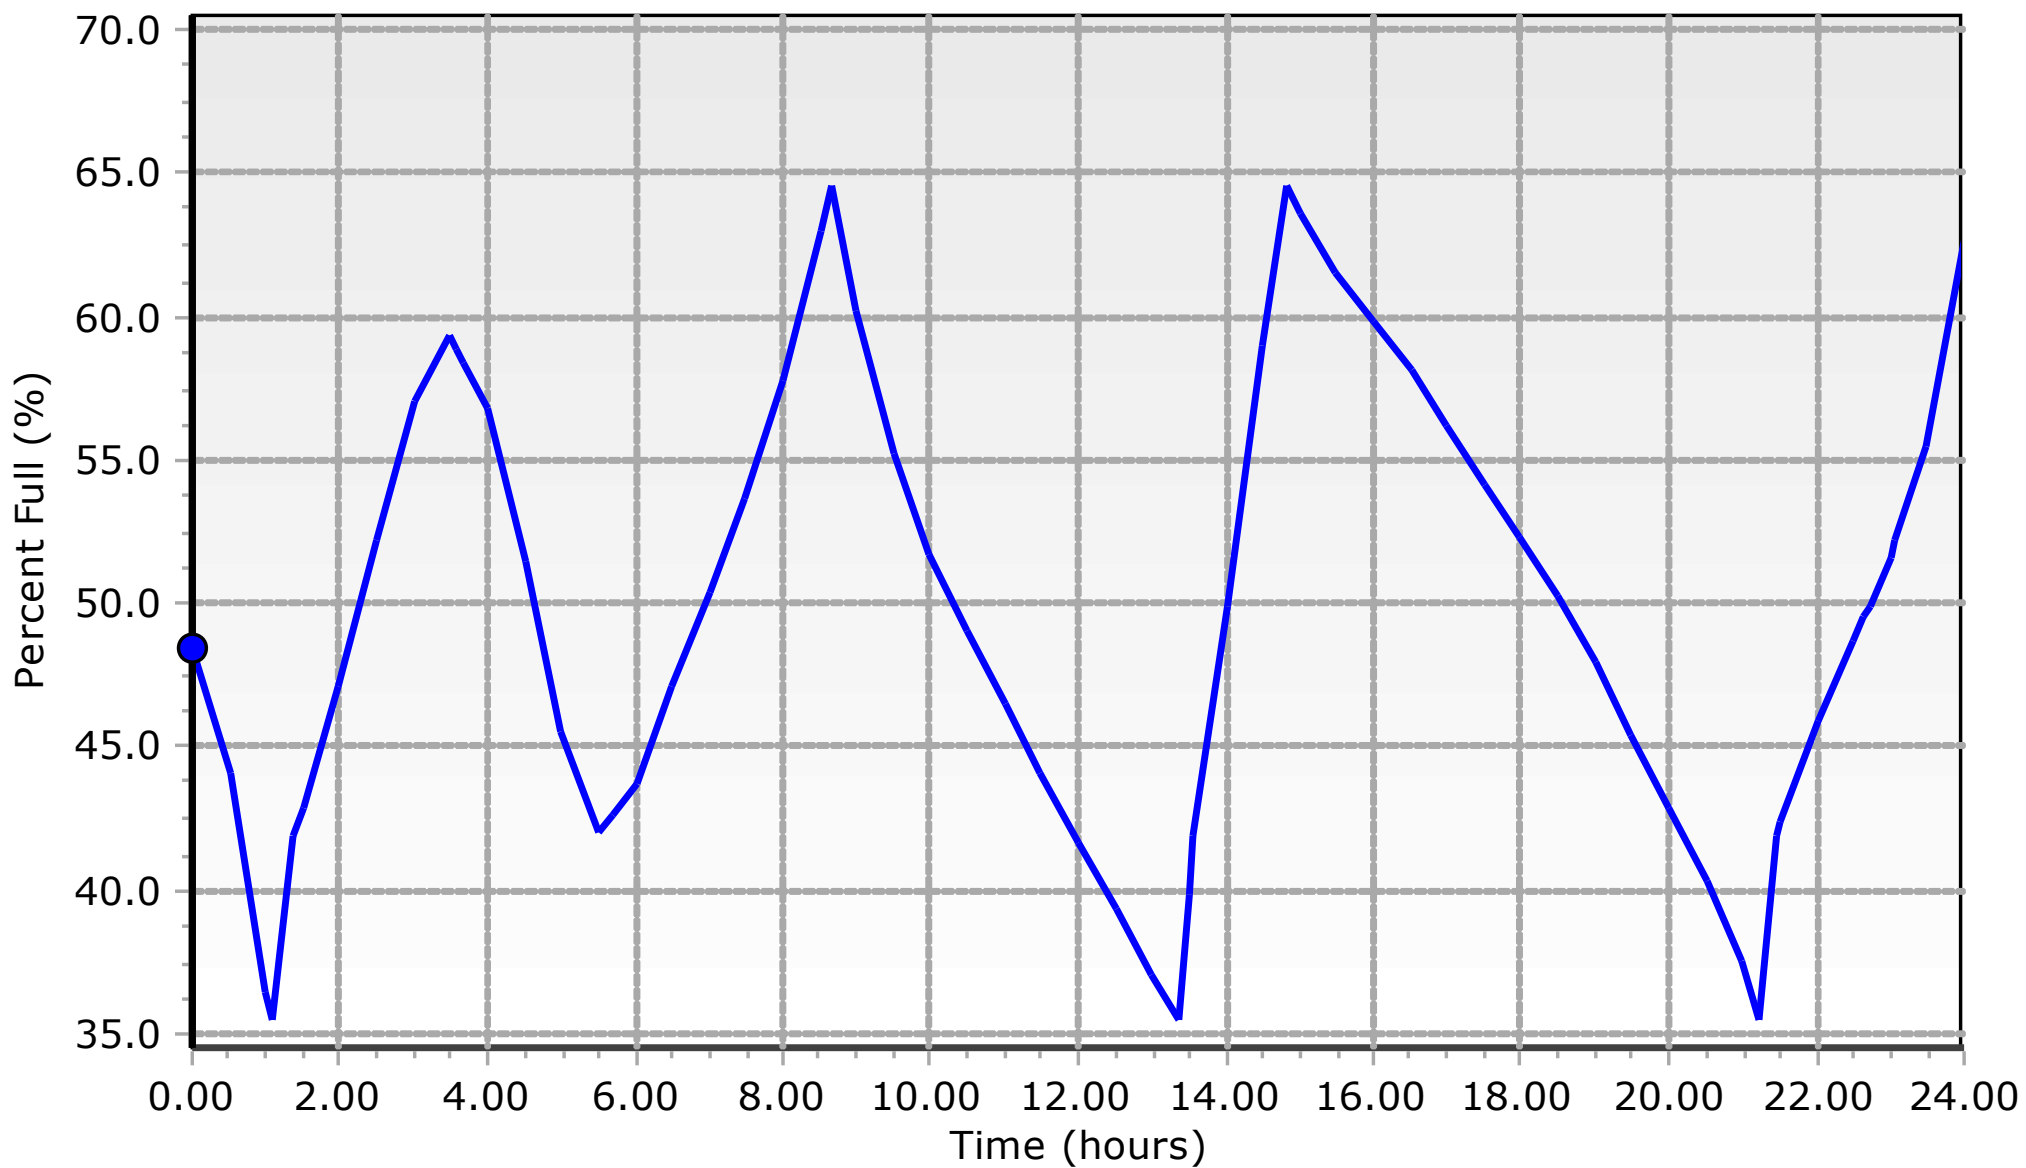

WP 2 GST 1 - Average Demand EPS - Summer - Percent Full


WP 2 Water Sources

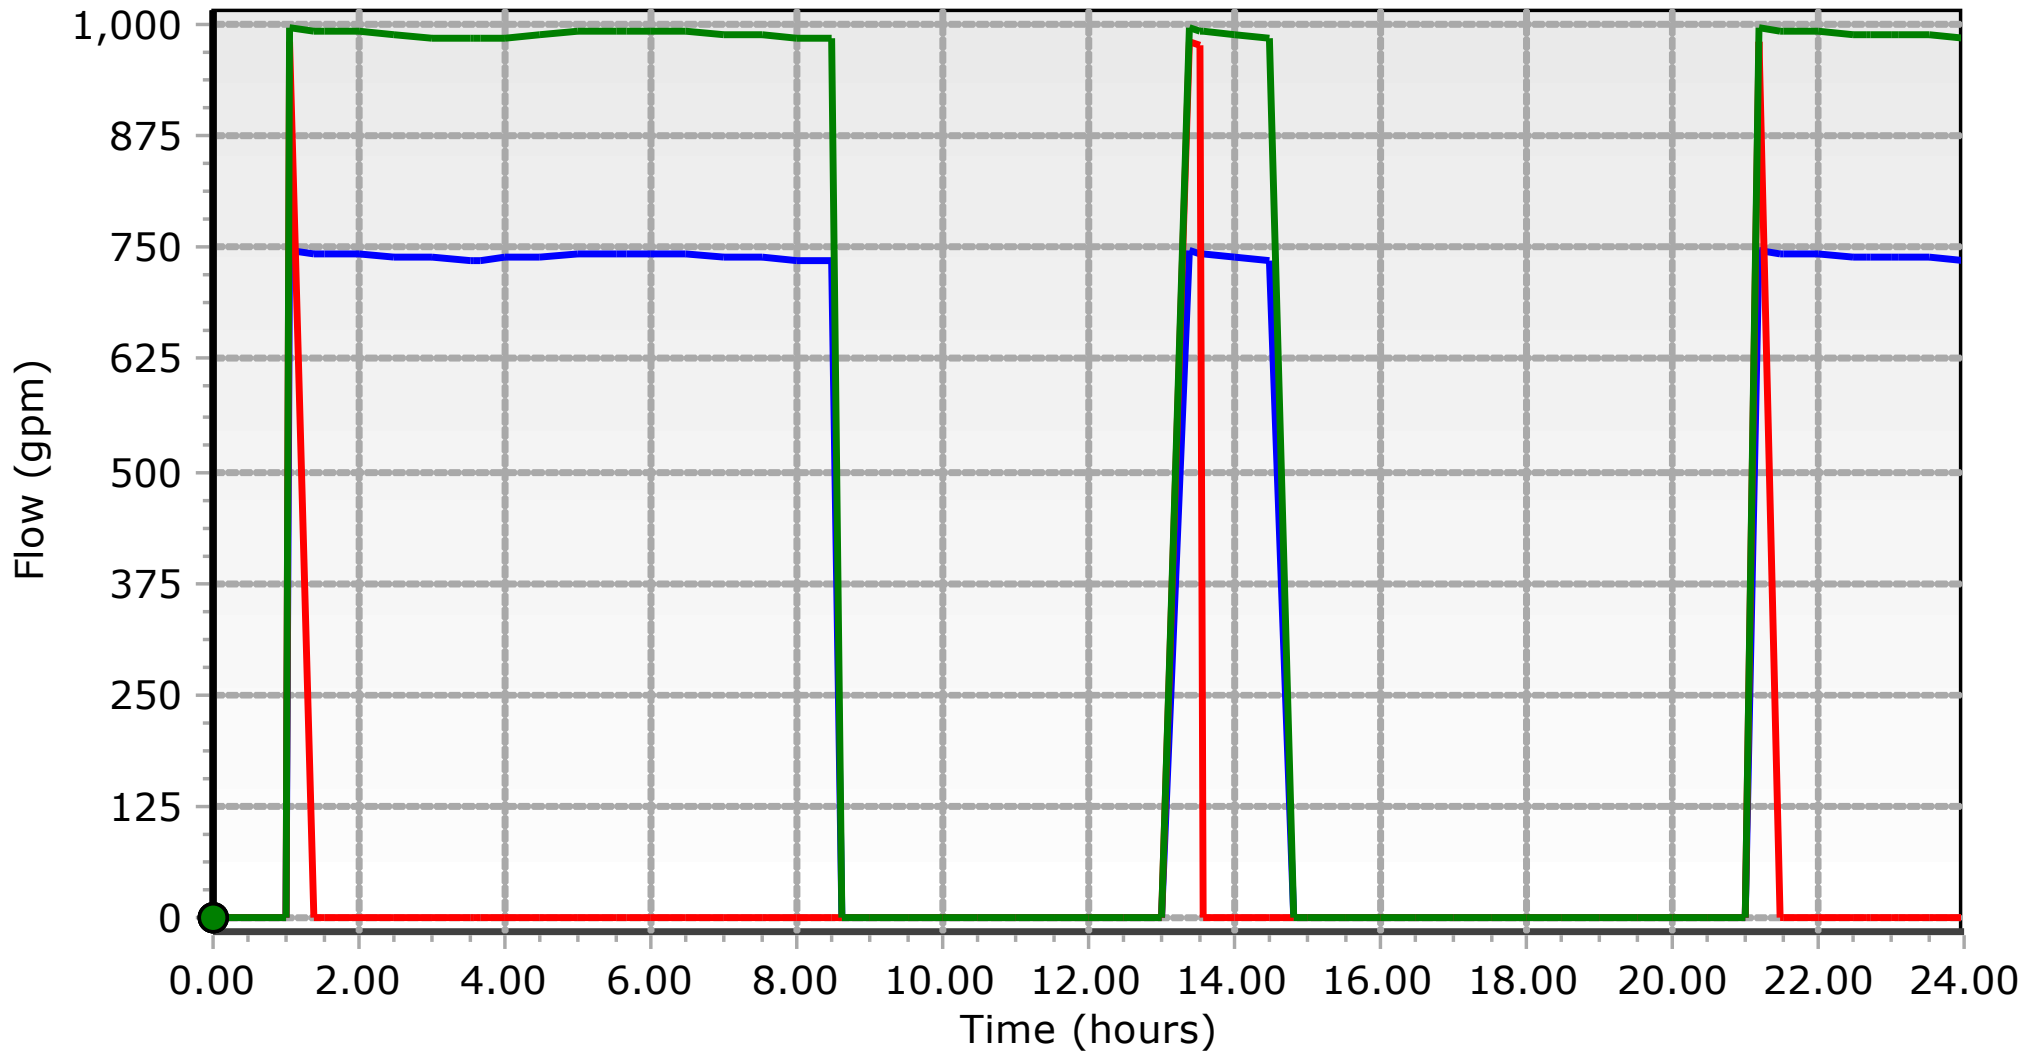

- WW 3 - Average Demand EPS - Summer - Flow (Total)
- COH SW 2 - Average Demand EPS - Summer - Flow (Total)
- WW 4 - Average Demand EPS - Summer - Flow (Total)


# **24-Hour Maximum Day Simulation**

WP 1 Tank Levels

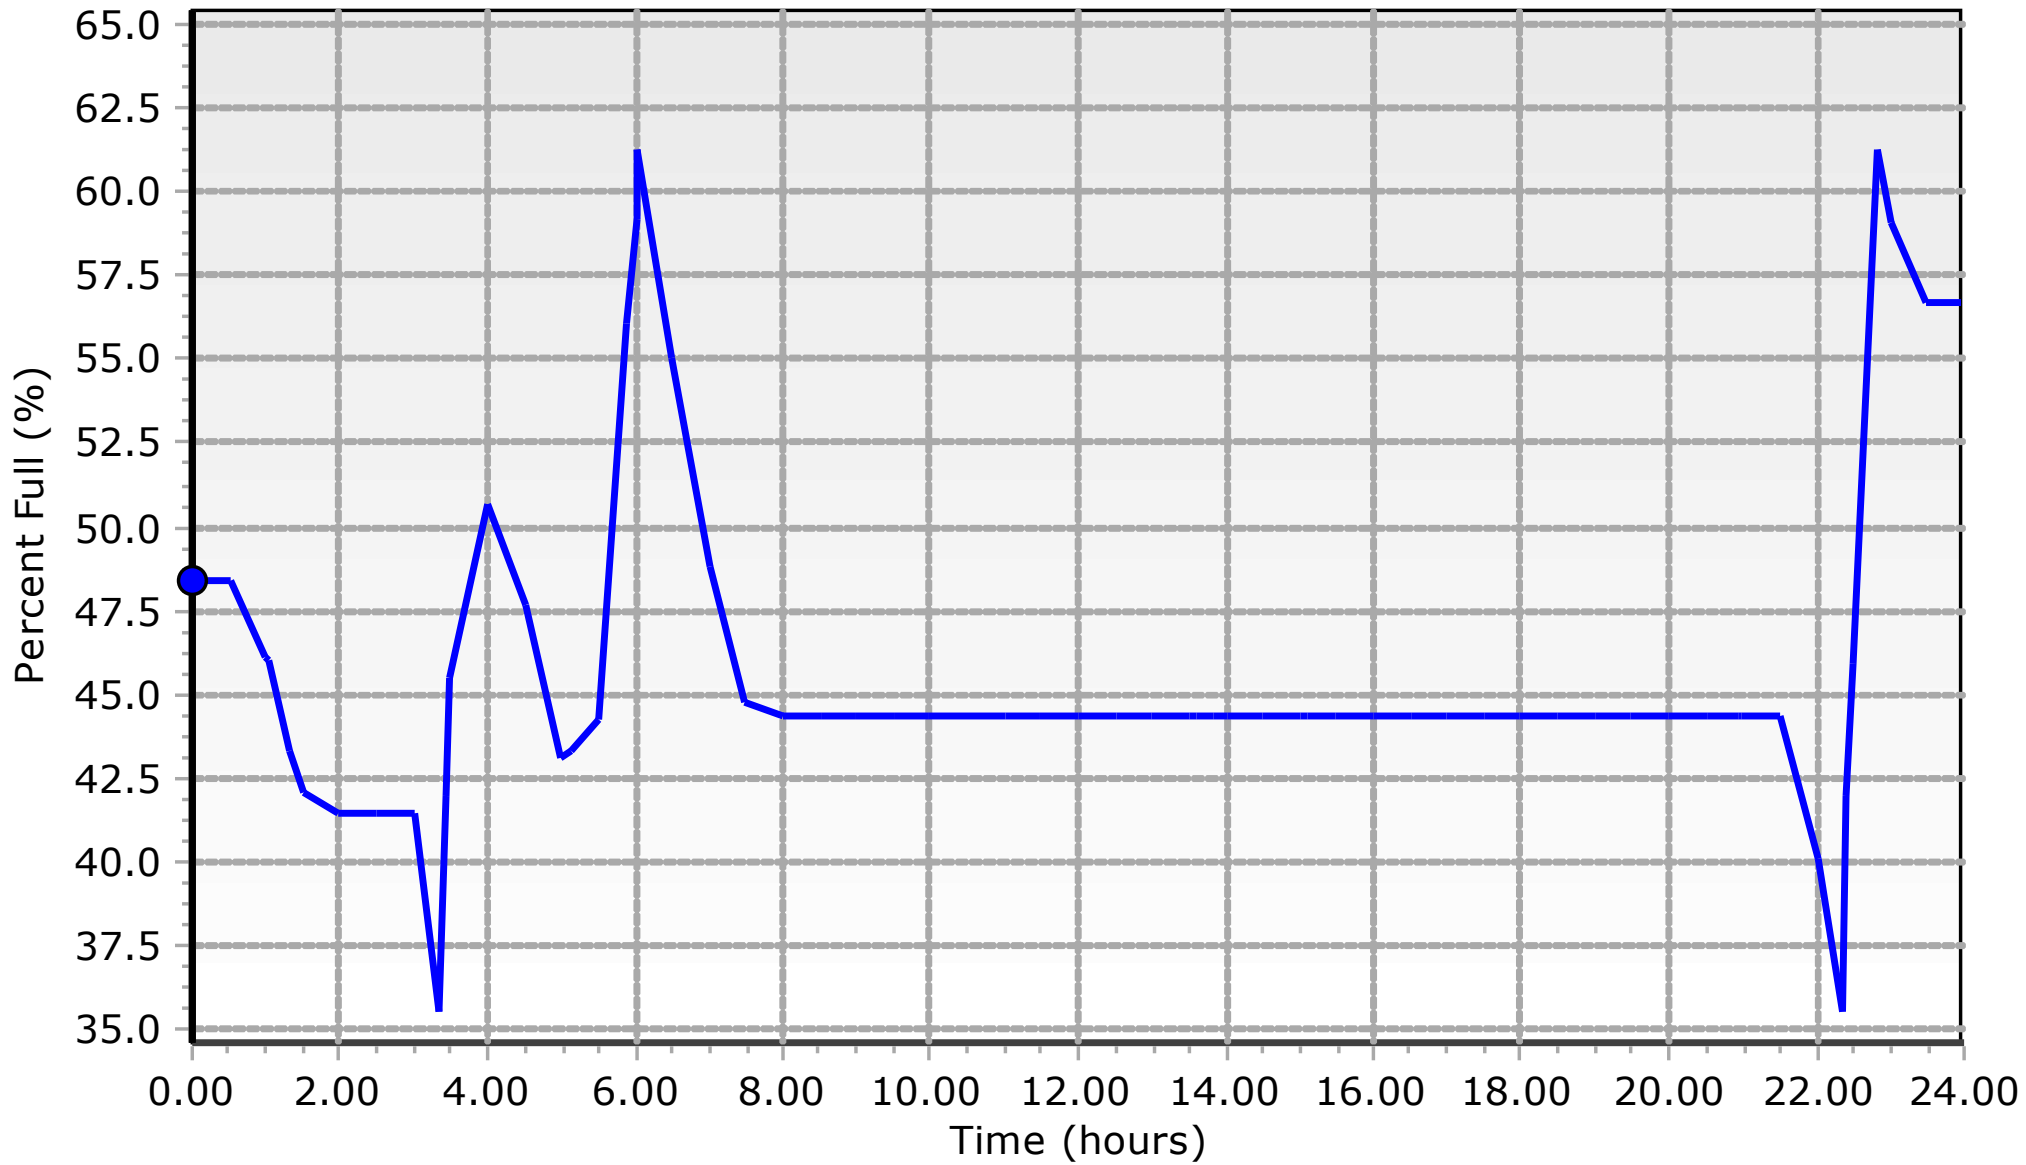


WP 1 GST 2 - Maximum Day EPS - Percent Full

# WP 1 Water Sources

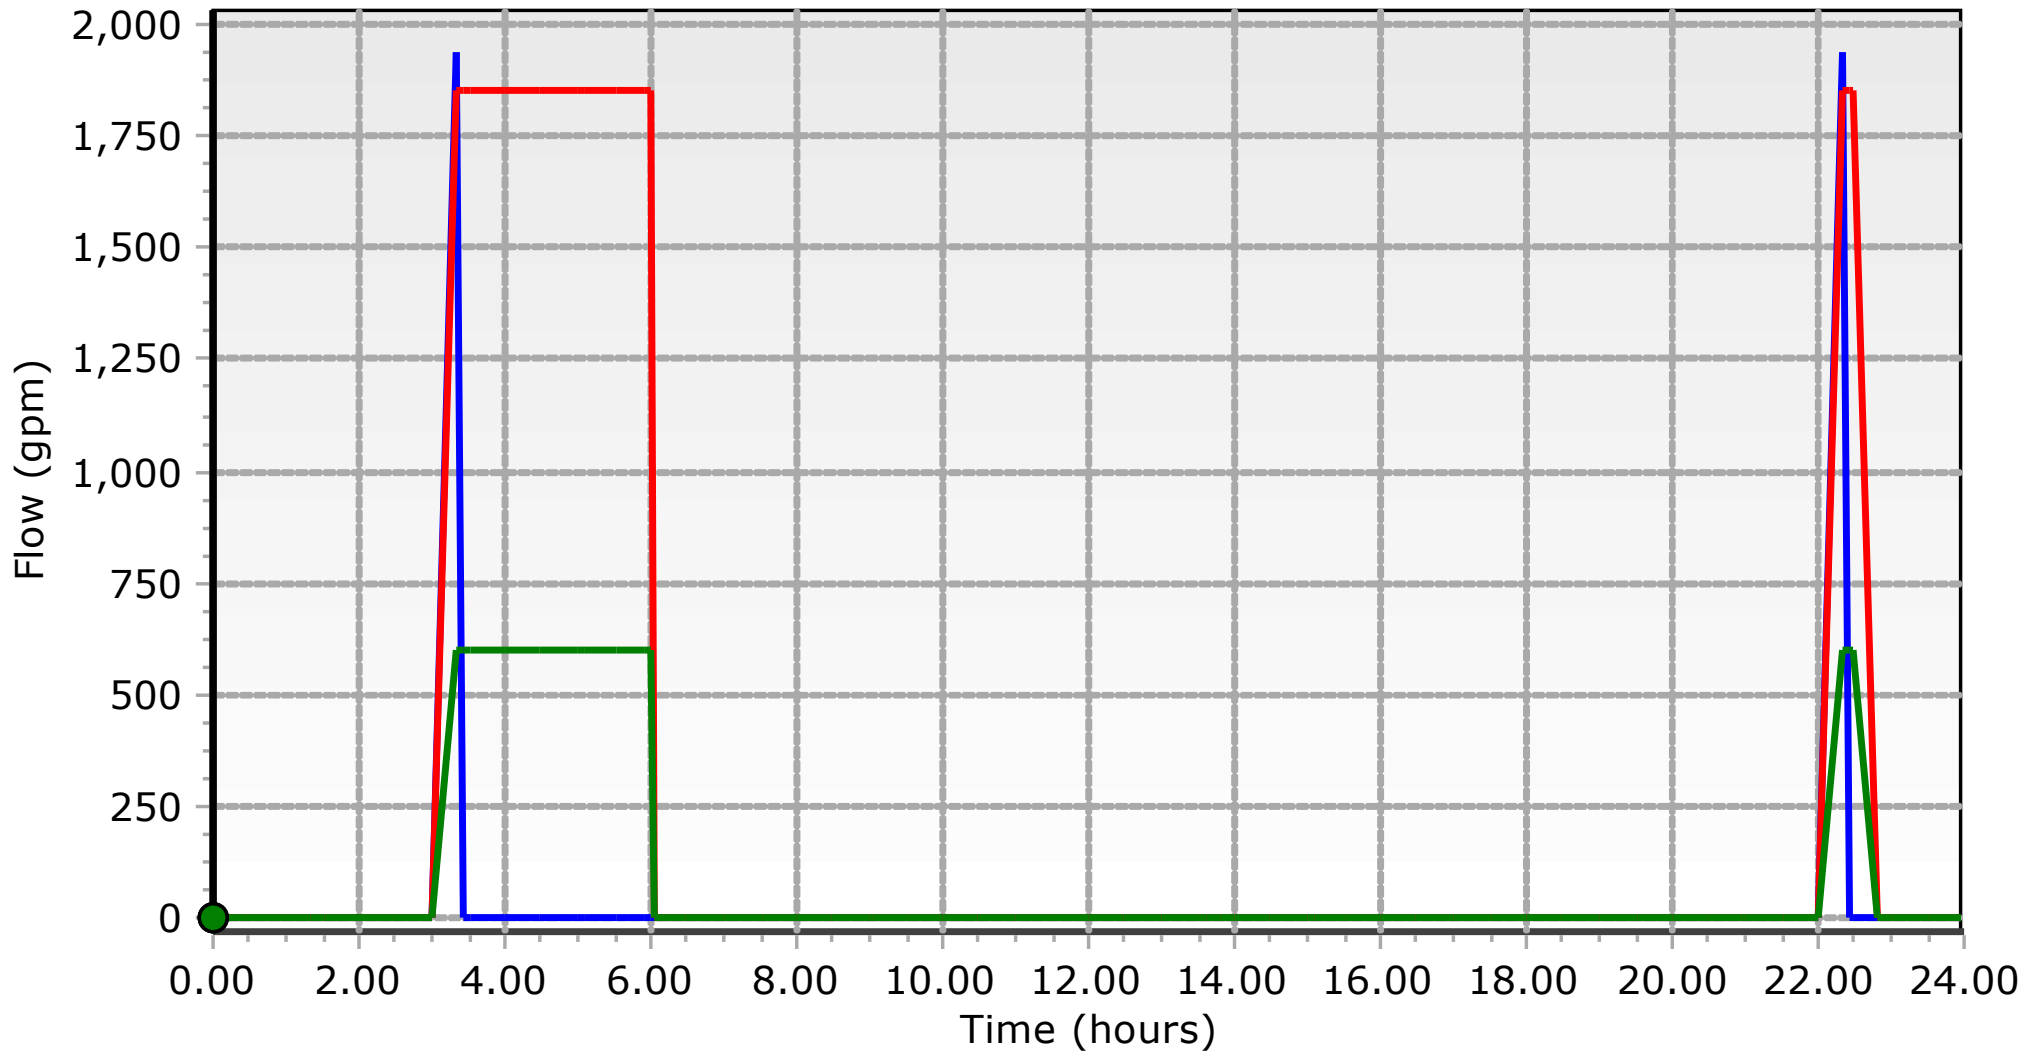



- COH SW 1 - Maximum Day EPS - Flow (Total)
- WW 5 - Maximum Day EPS - Flow (Total)
- WW 1 - Maximum Day EPS - Flow (Total)

WP 2 Tank Level

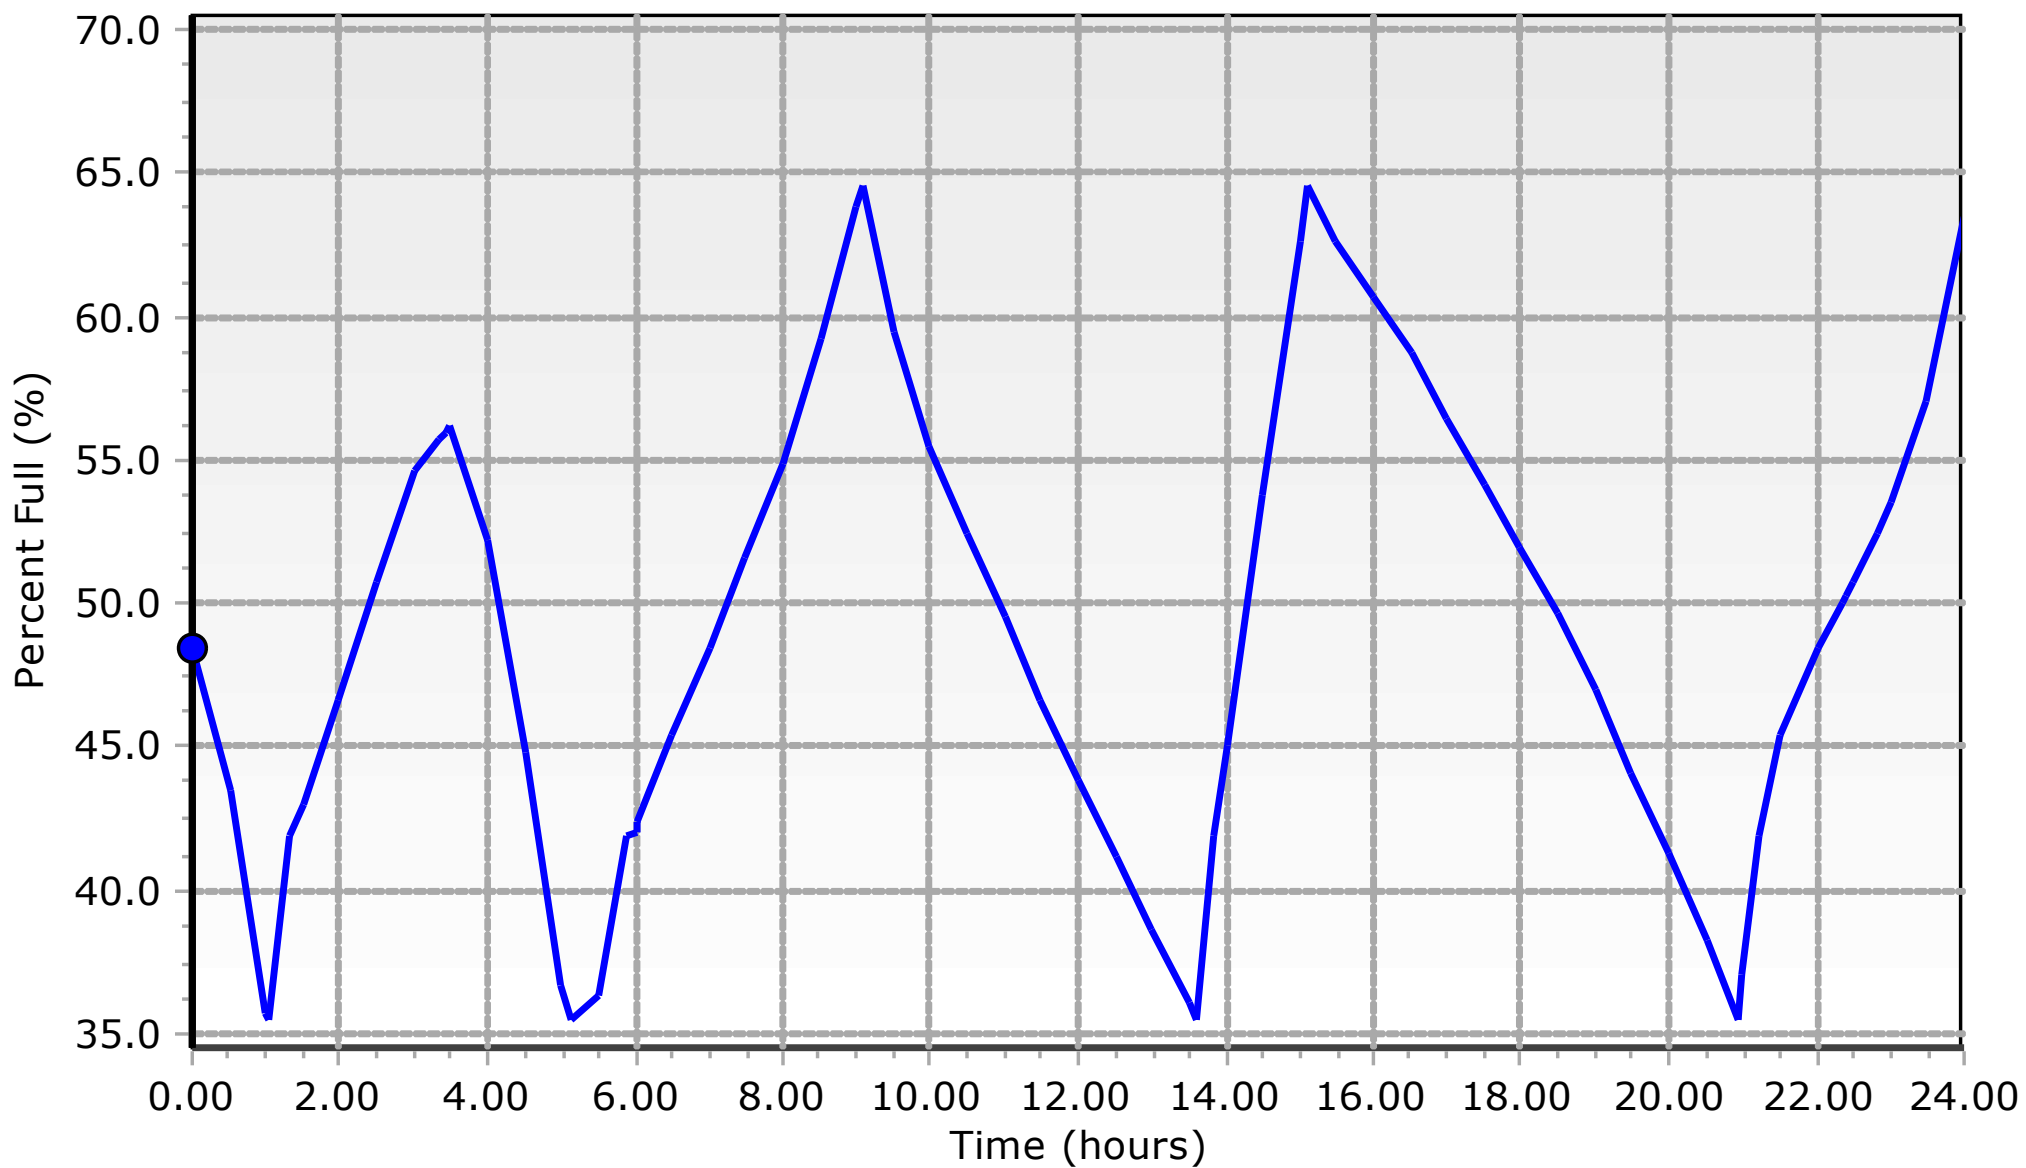

WP 2 GST 1 - Maximum Day EPS - Percent Full


### WP 2 Water Sources

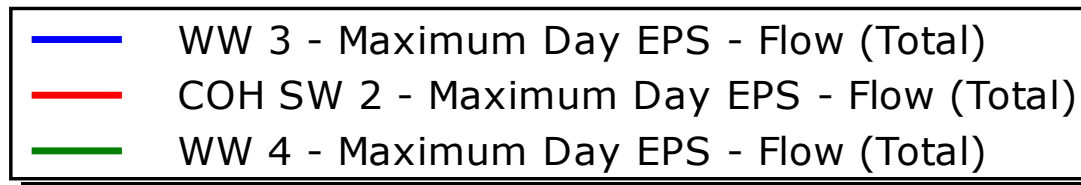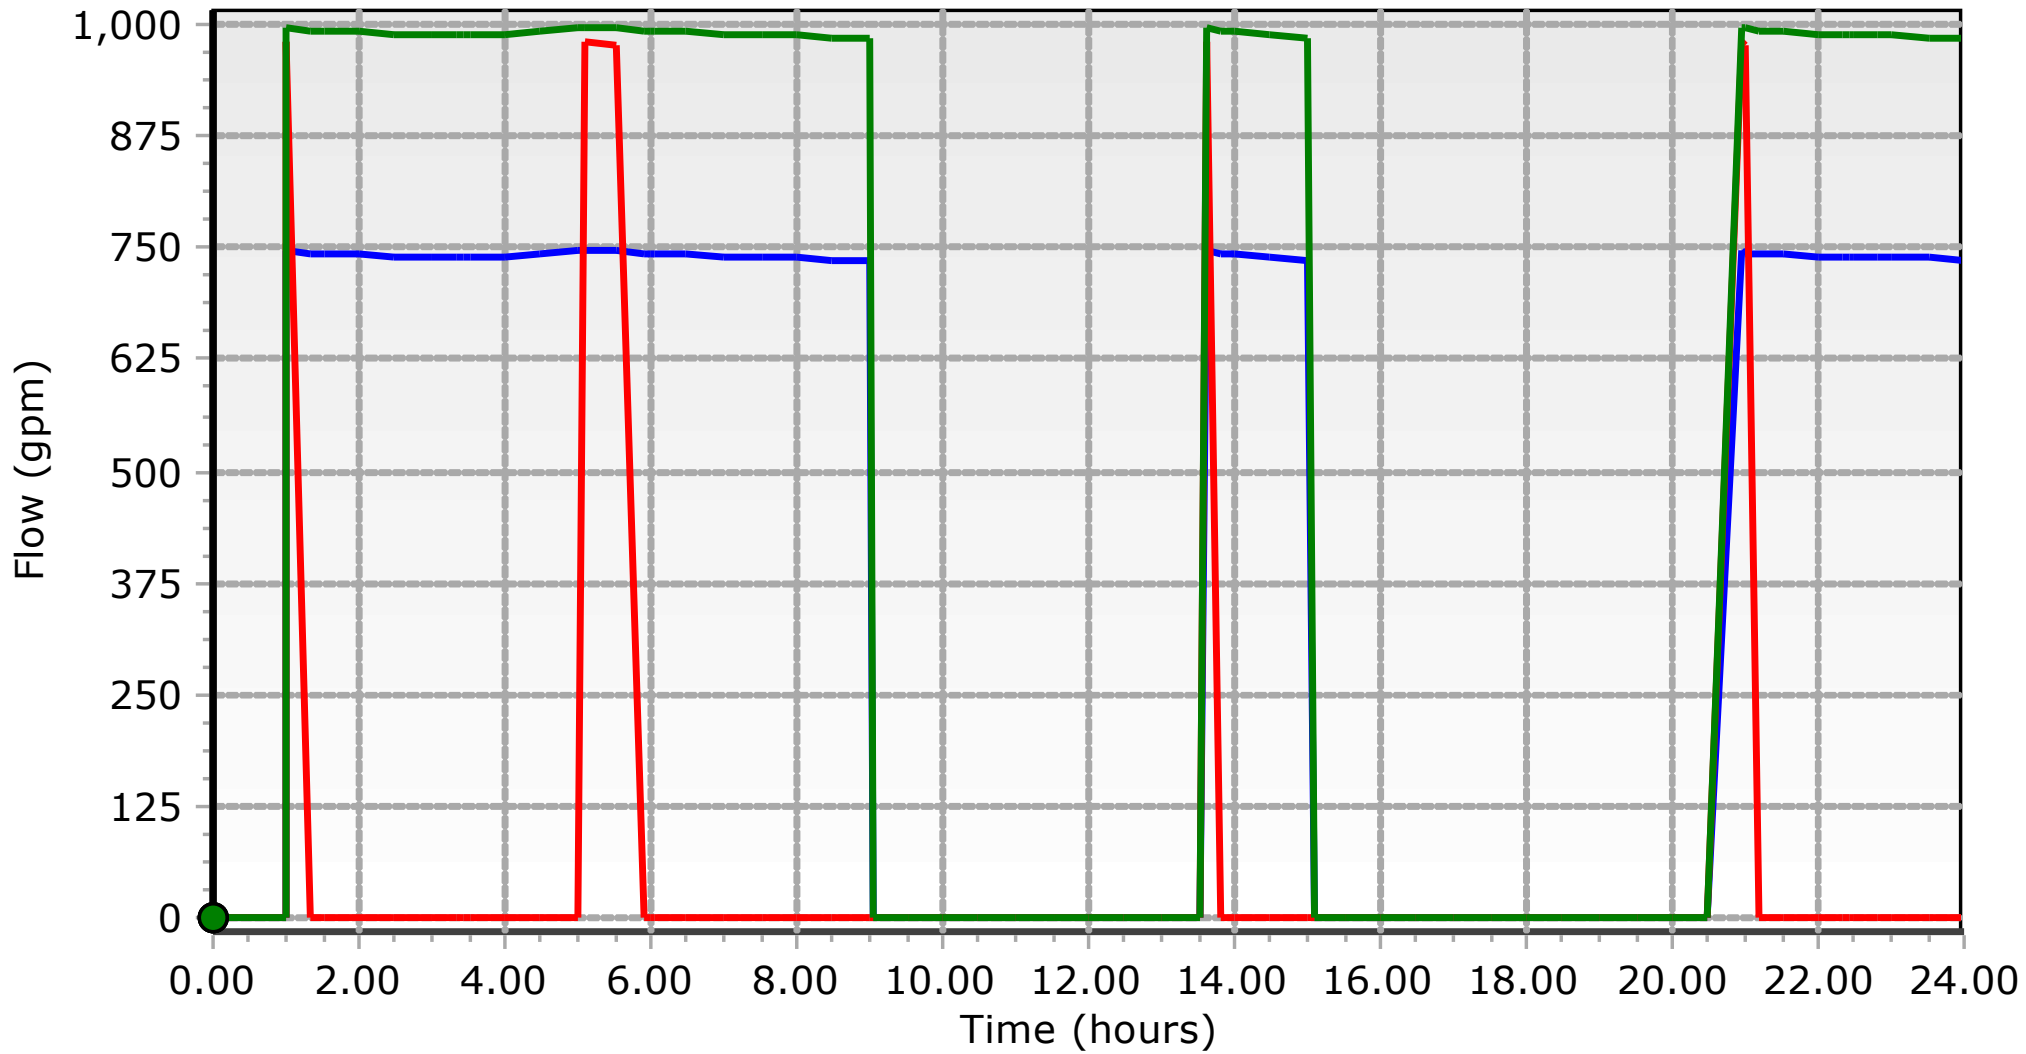

**City of Bunker Hill Village Removal of  
GST 1 at City Hall Water Plant -  
Extended Period Simulation**


# **24-Hour Average Winter Day Simulation**

WP 1 Tank Level

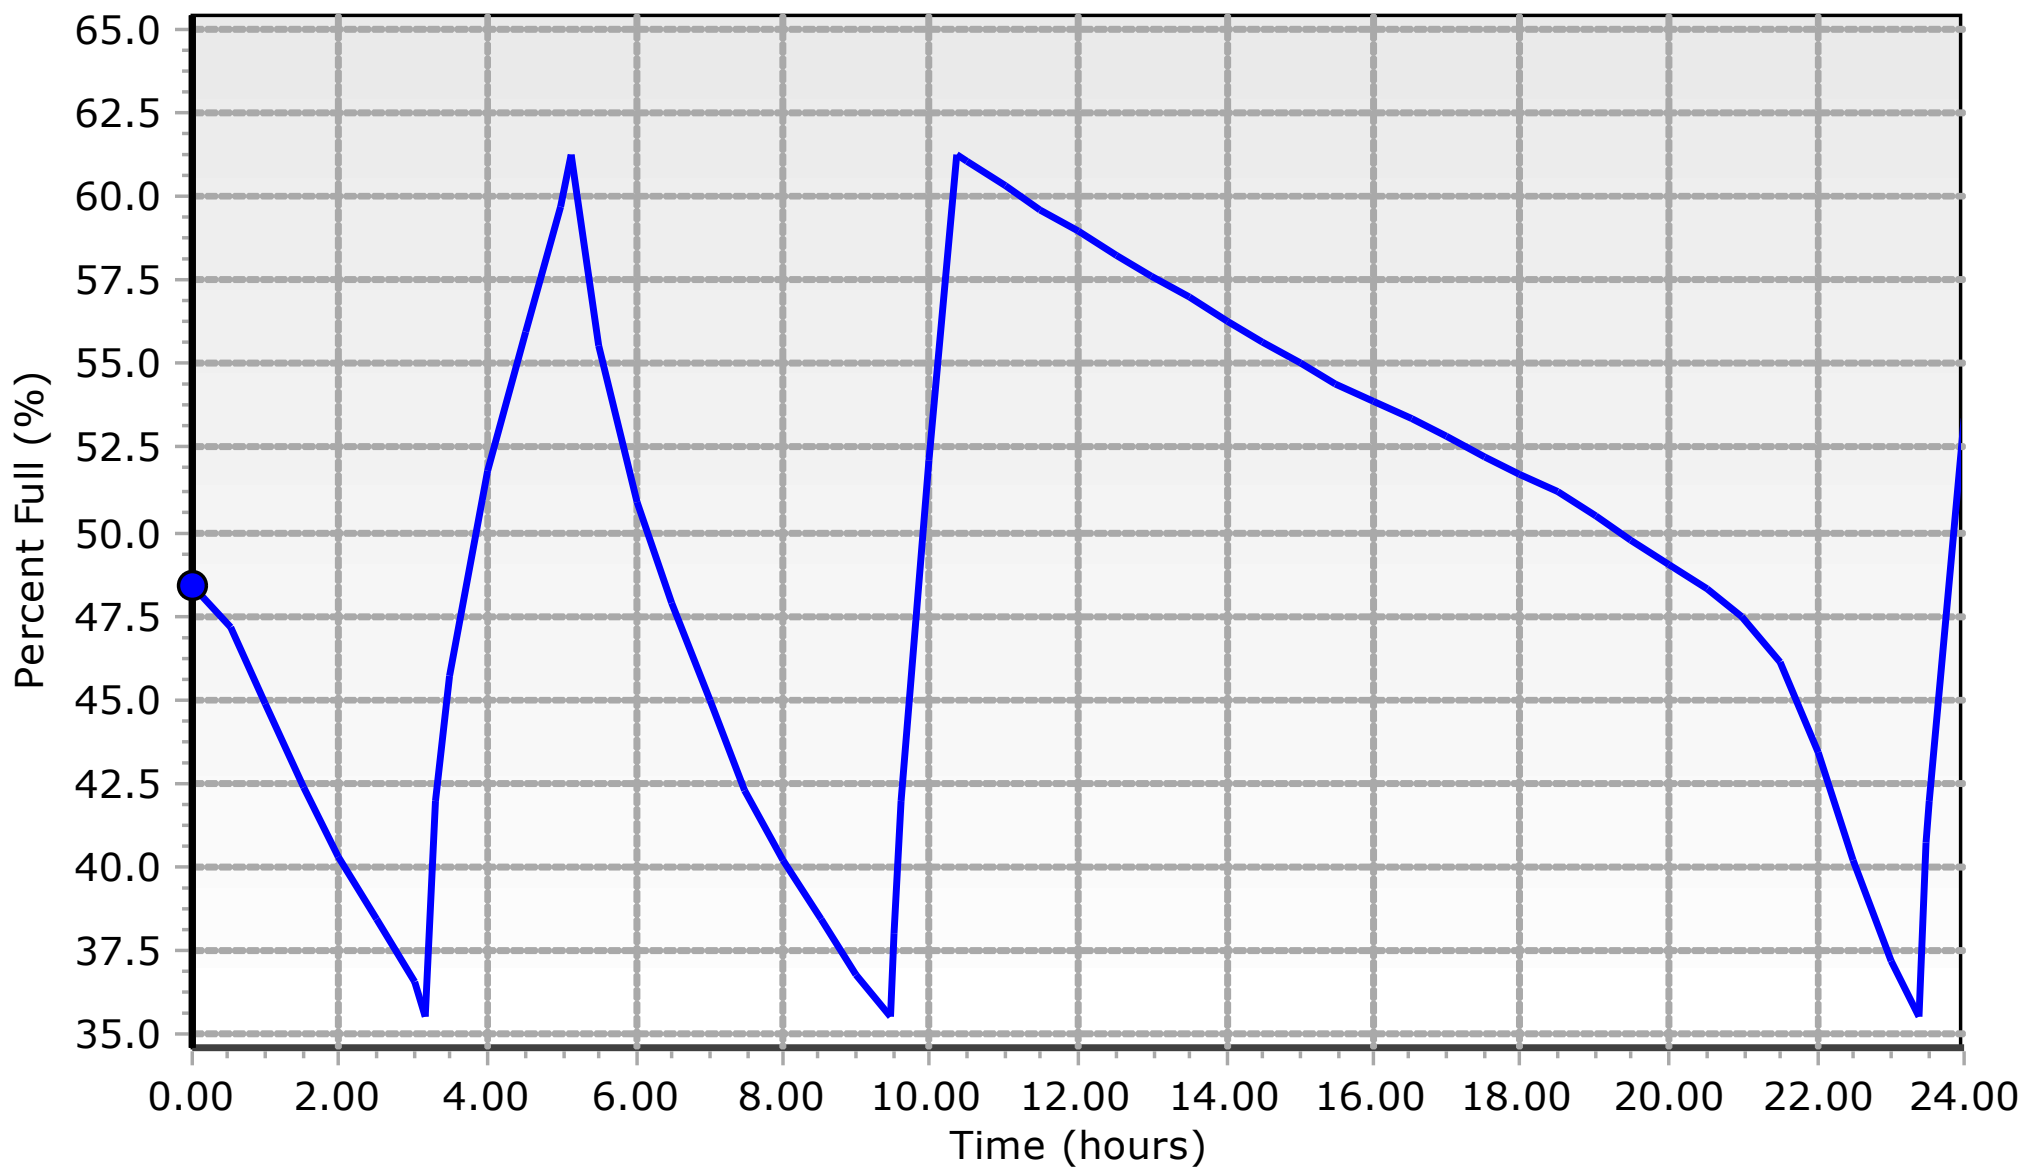


WP 1 GST 2 - Average Demand EPS - Winter - Percent Full

WP 1 Water Sources

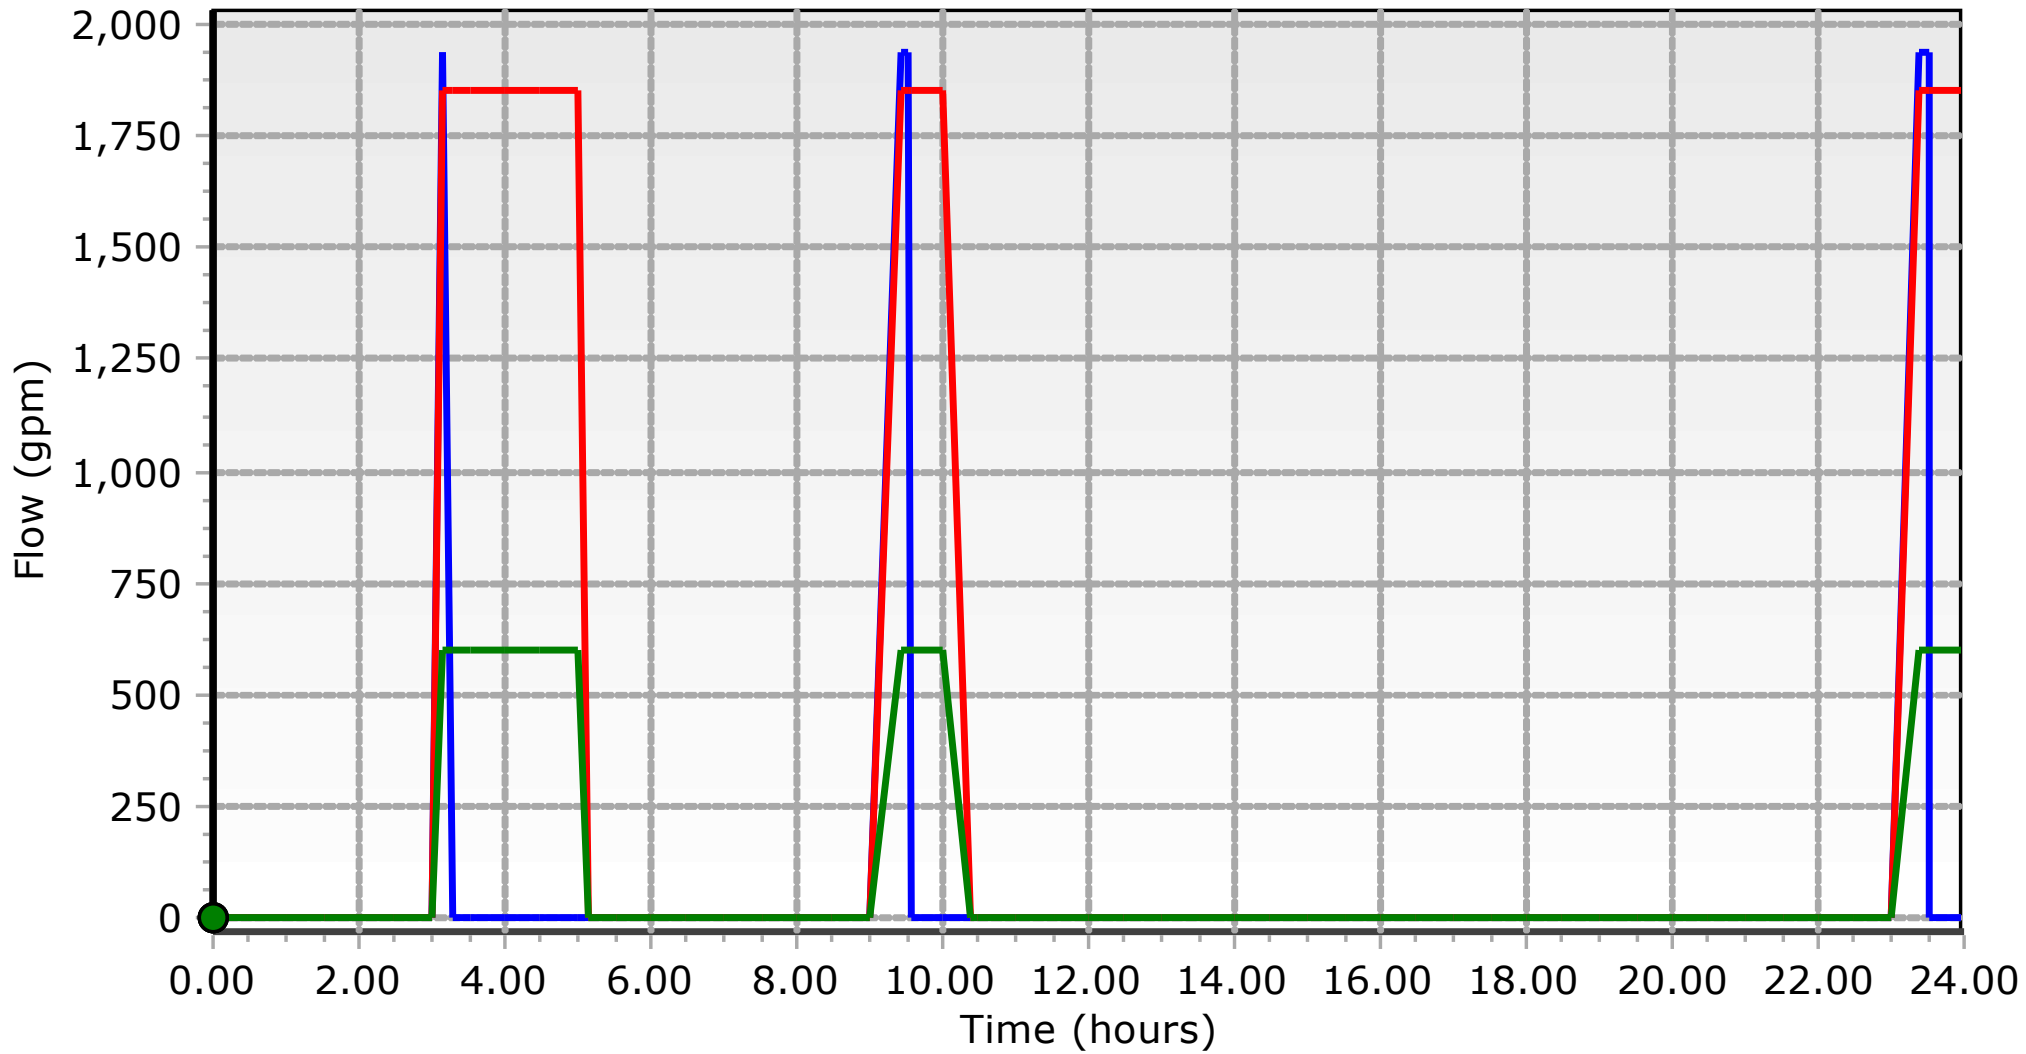


# **24-Hour Average Summer Day Simulation**

WP 1 Tank Levels

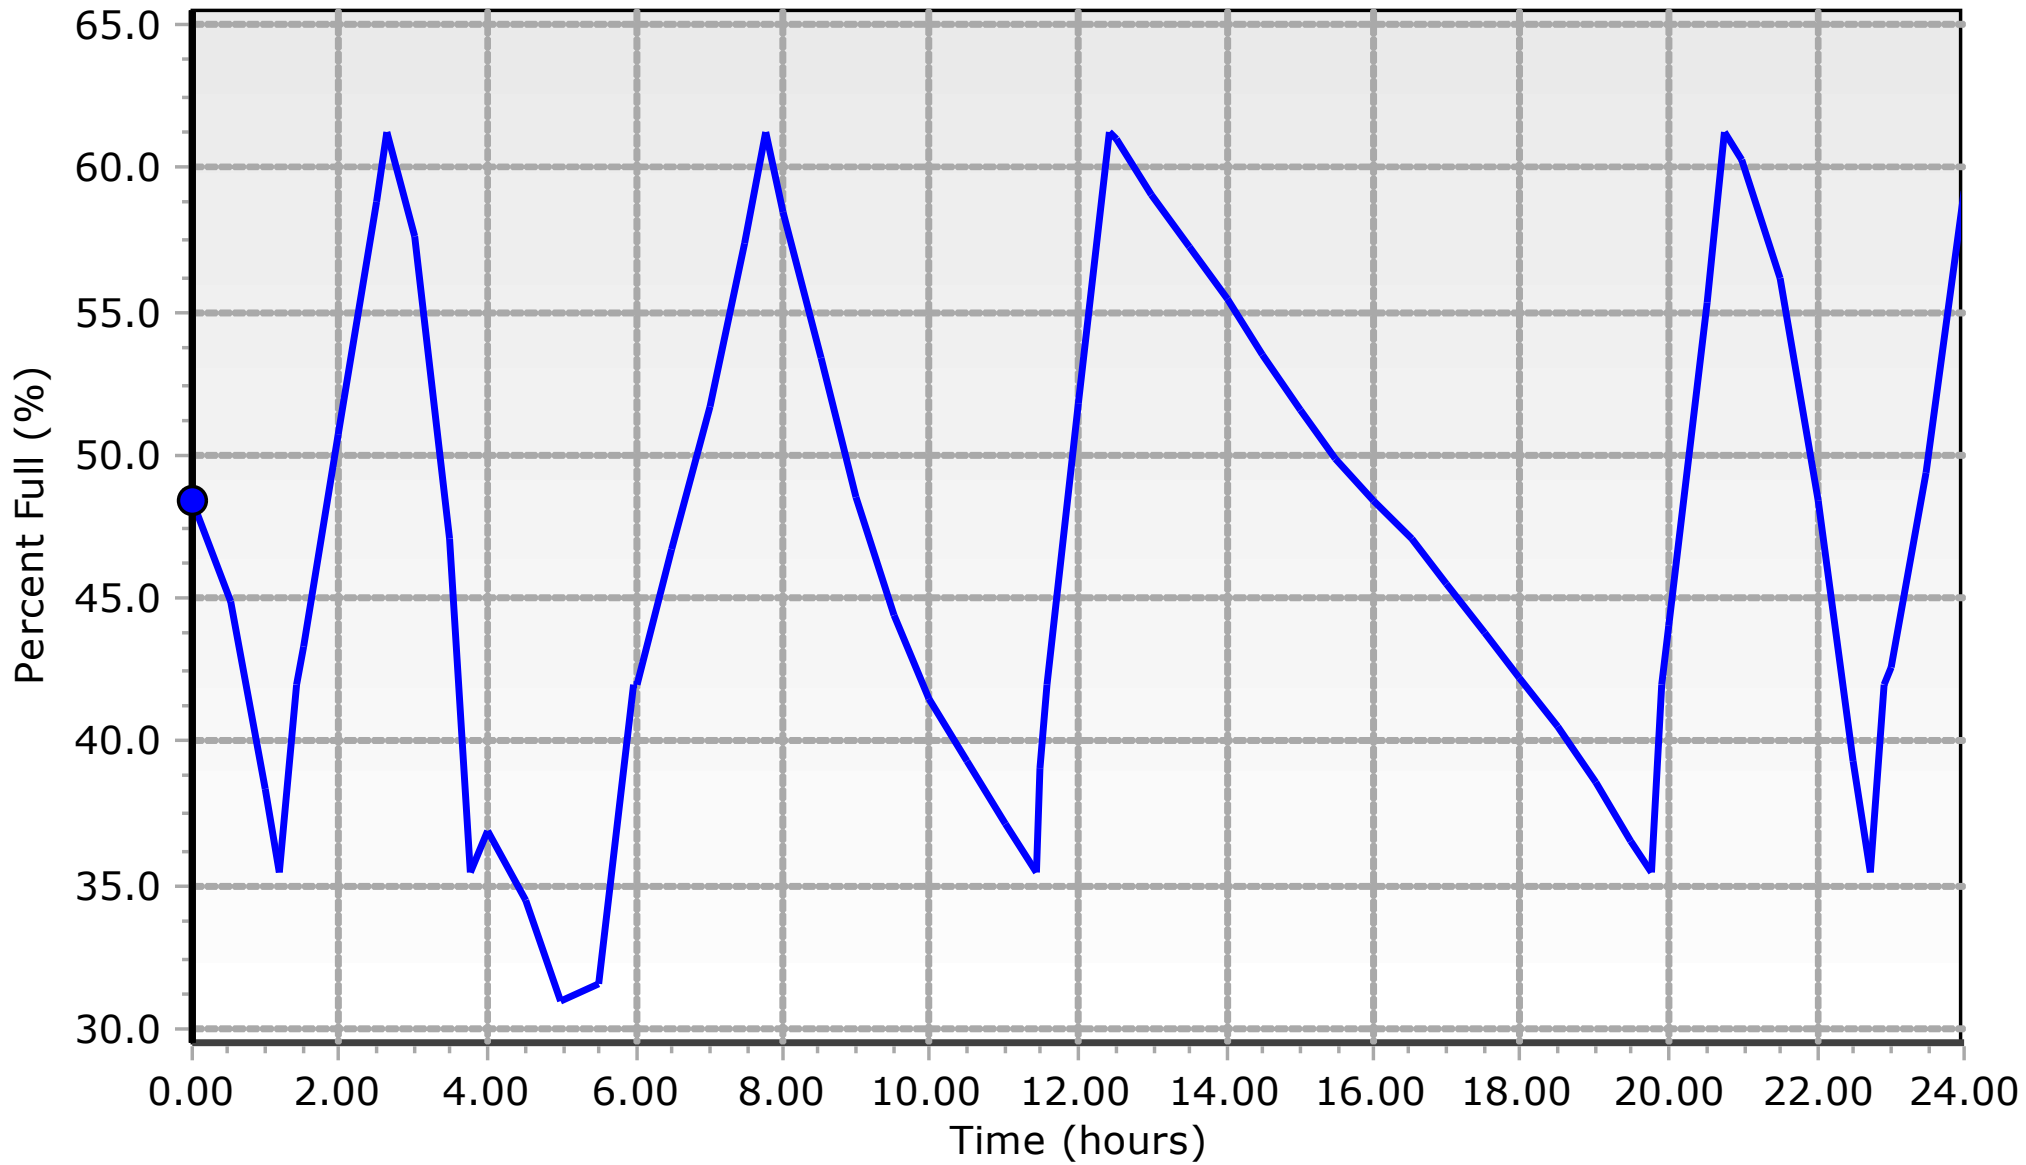

WP 1 GST 2 - Average Demand EPS - Summer - Percent Full


WP 1 Water Sources

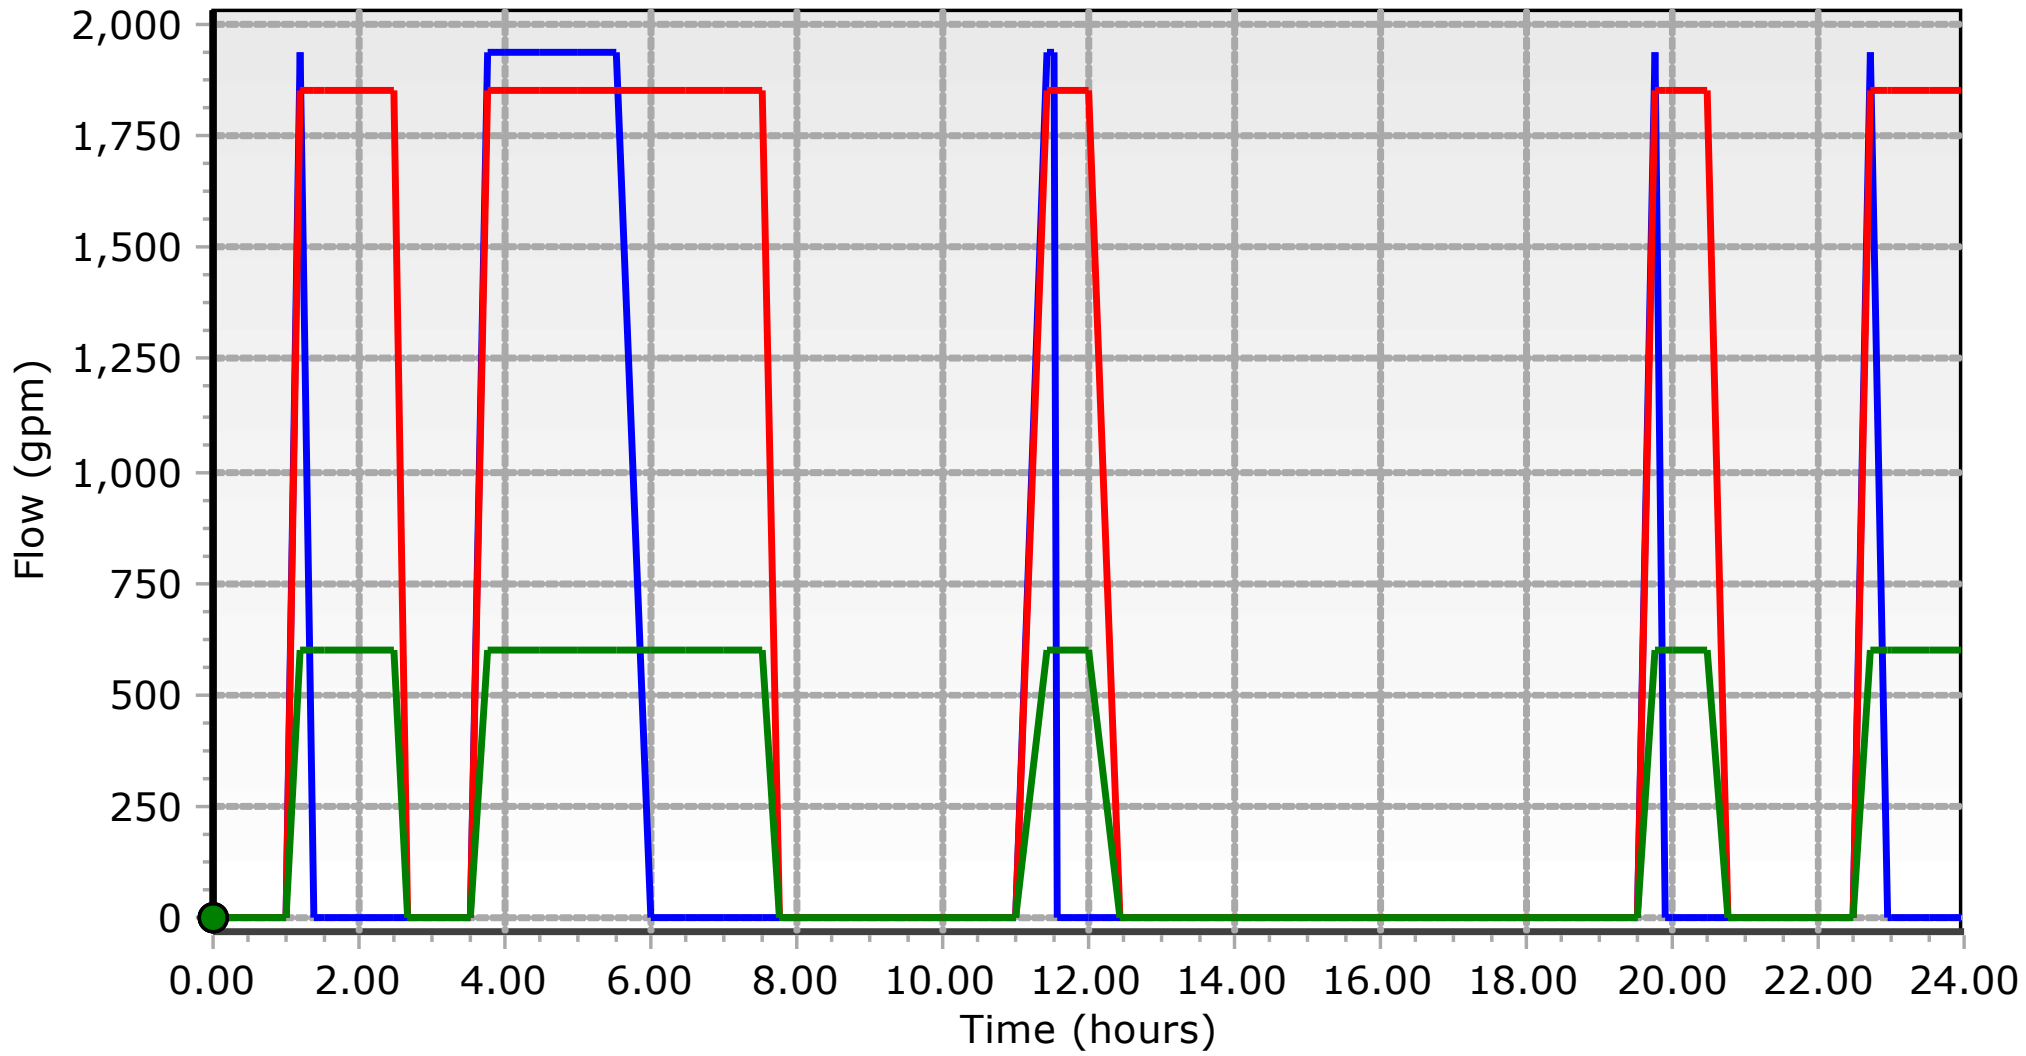

- COH SW 1 - Average Demand EPS - Summer - Flow (Total)
- WW 5 - Average Demand EPS - Summer - Flow (Total)
- WW 1 - Average Demand EPS - Summer - Flow (Total)



# **24-Hour Maximum Day Simulation**

WP 1 Tank Levels

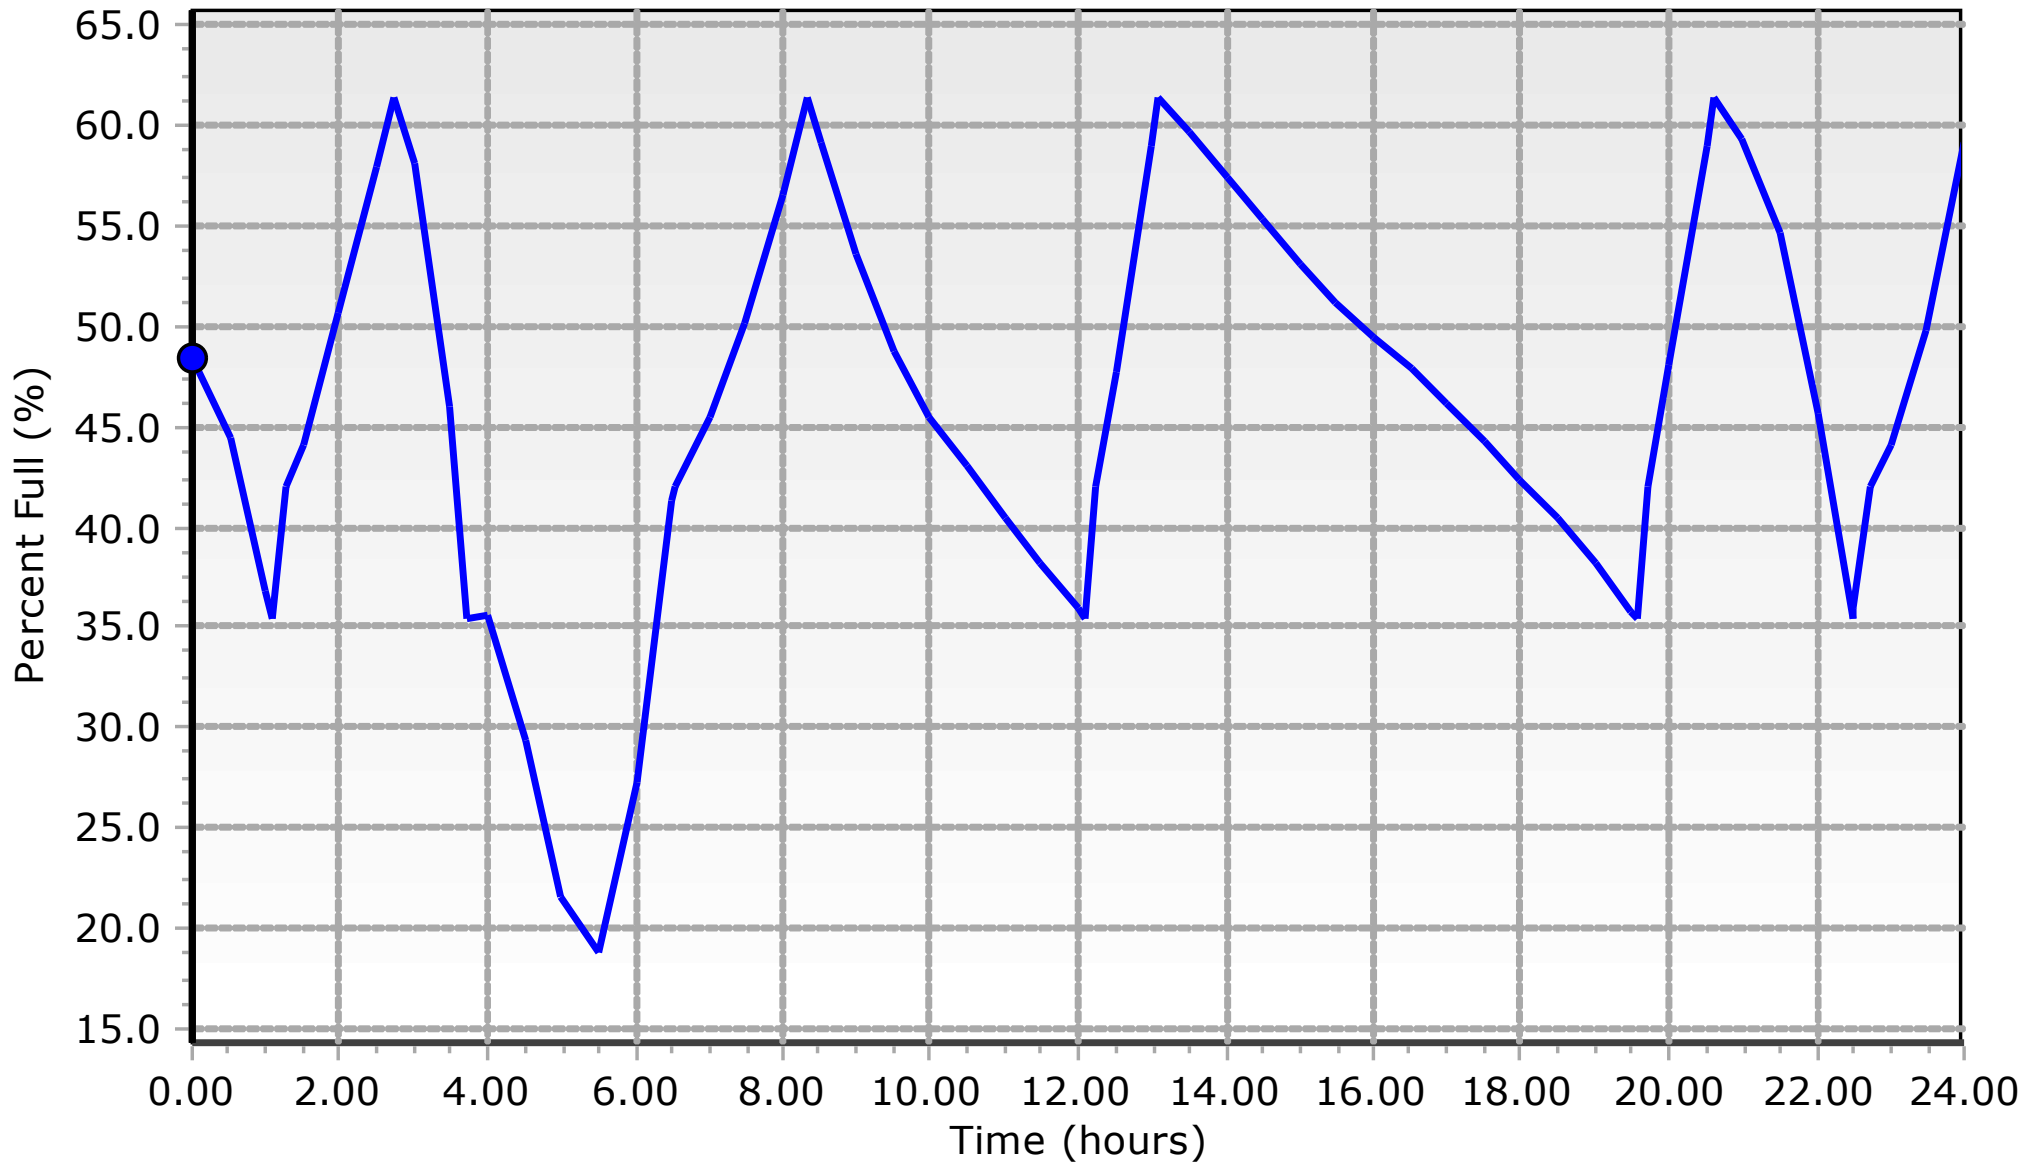

WP 1 GST 2 - Maximum Day EPS - Percent Full


WP 1 Water Sources

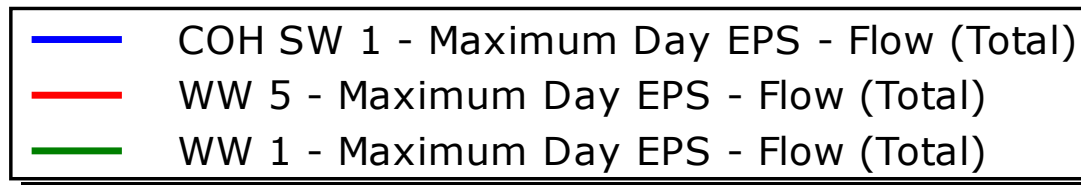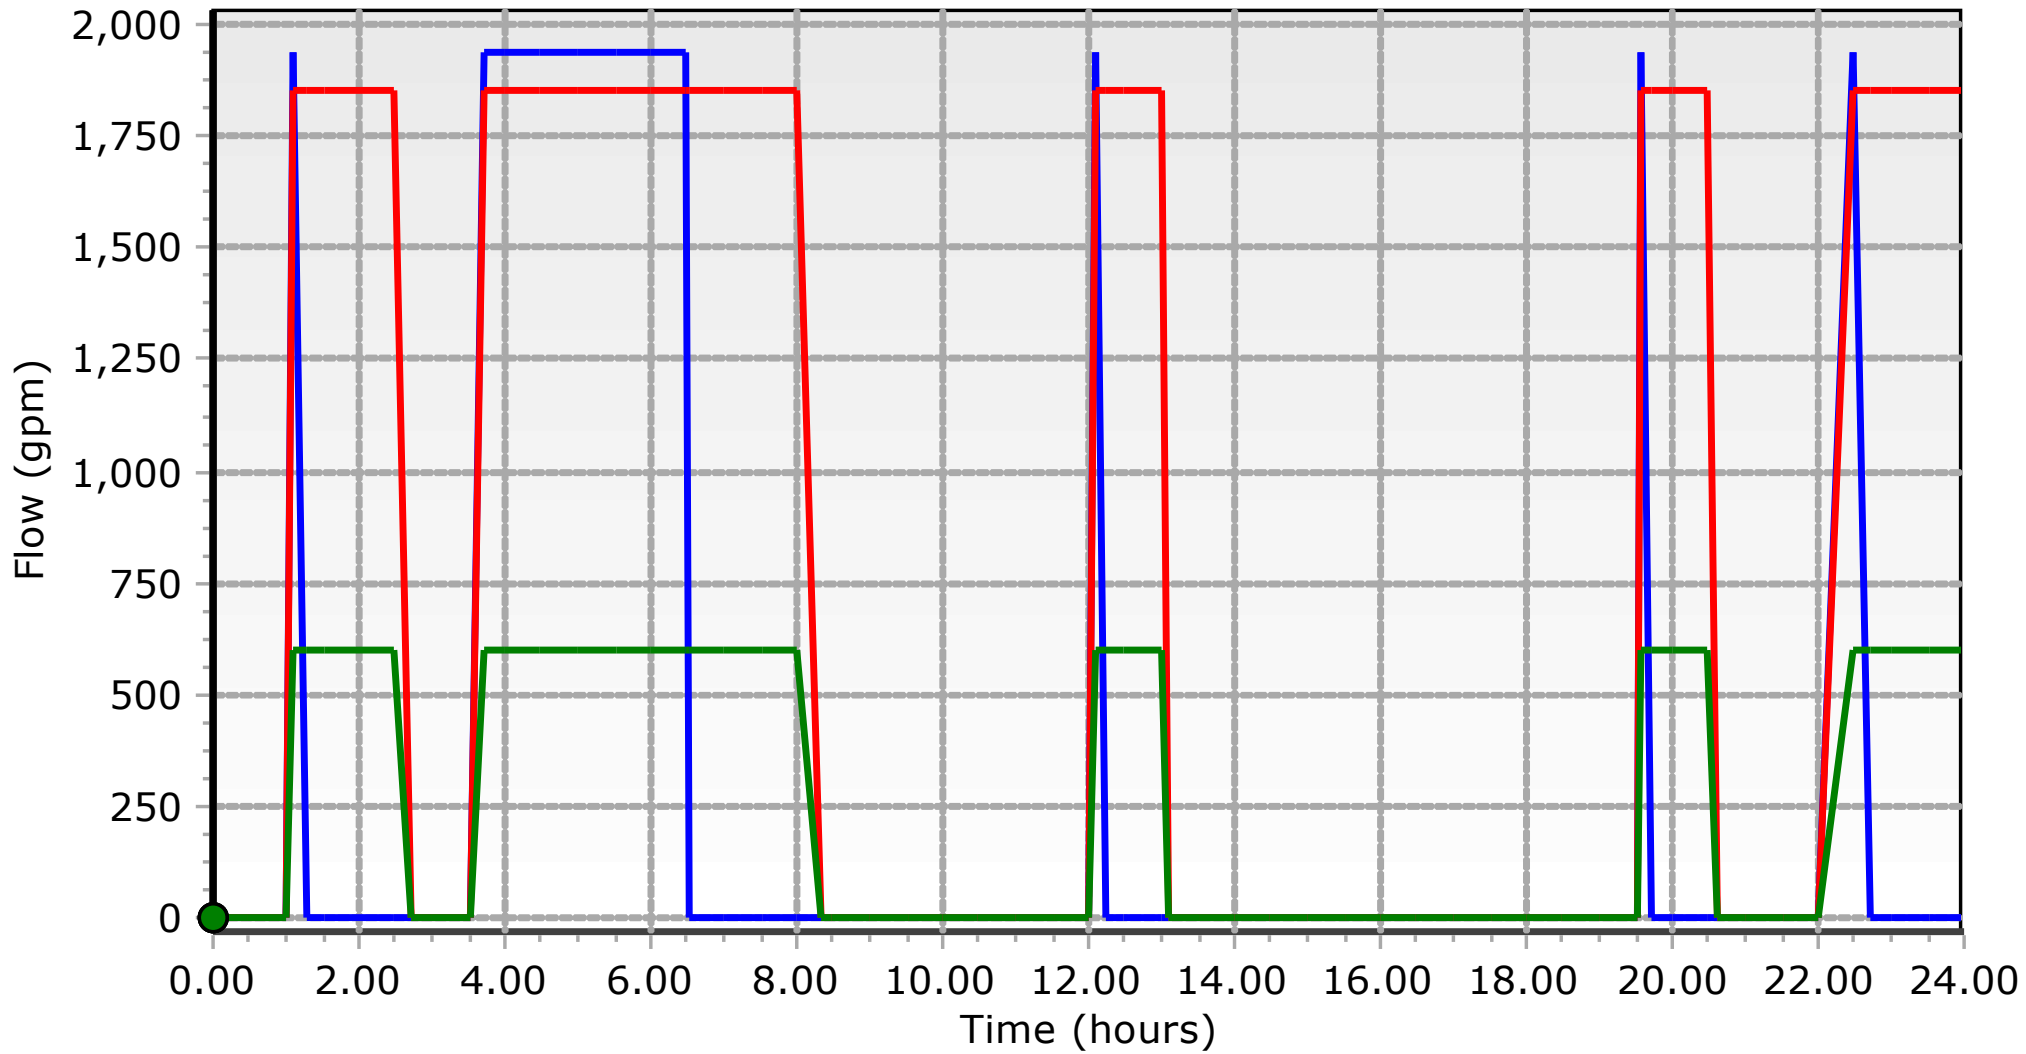

**City of Bunker Hill Village Emergency  
Operating Scenario No. 1 - Extended  
Period Simulation**


# **24-Hour Average Winter Day Simulation**

Calculation Summary Graph

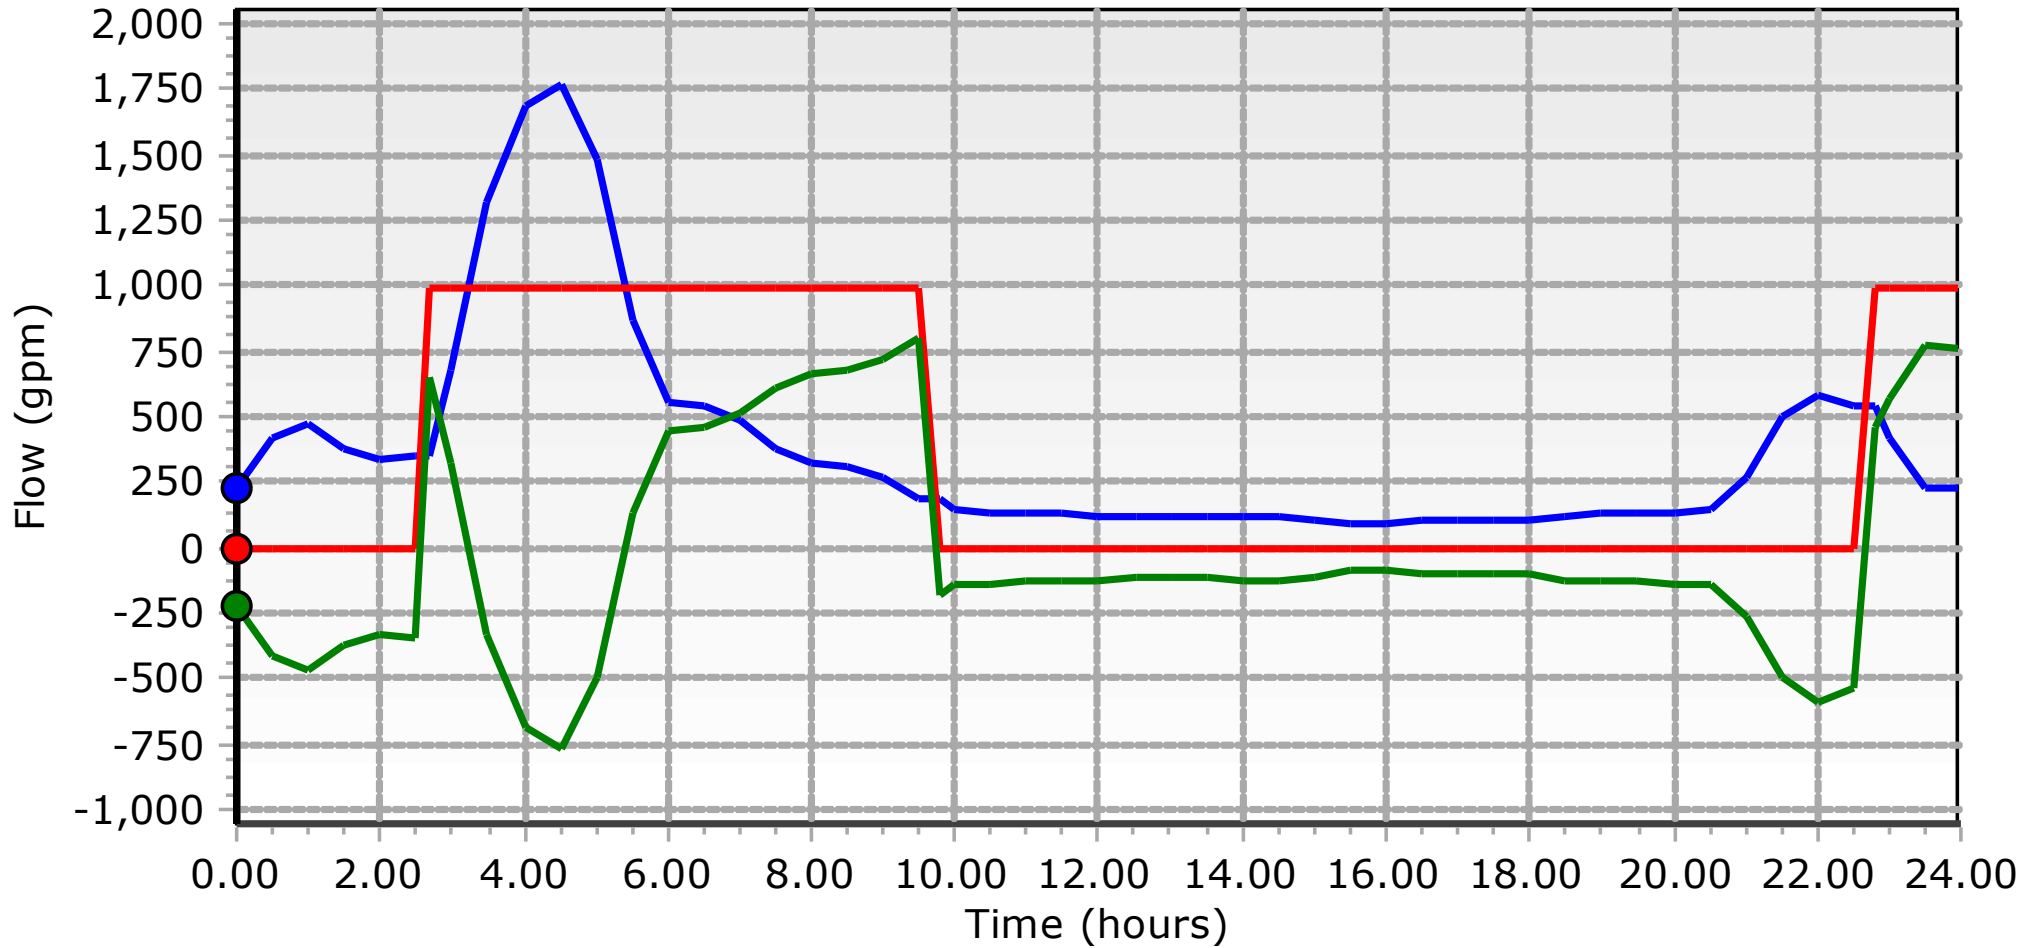



- Average Demand EPS - Winter - Flow Demanded
- Average Demand EPS - Winter - Flow Supplied
- Average Demand EPS - Winter - Flow Stored

WP 1 Tank Levels

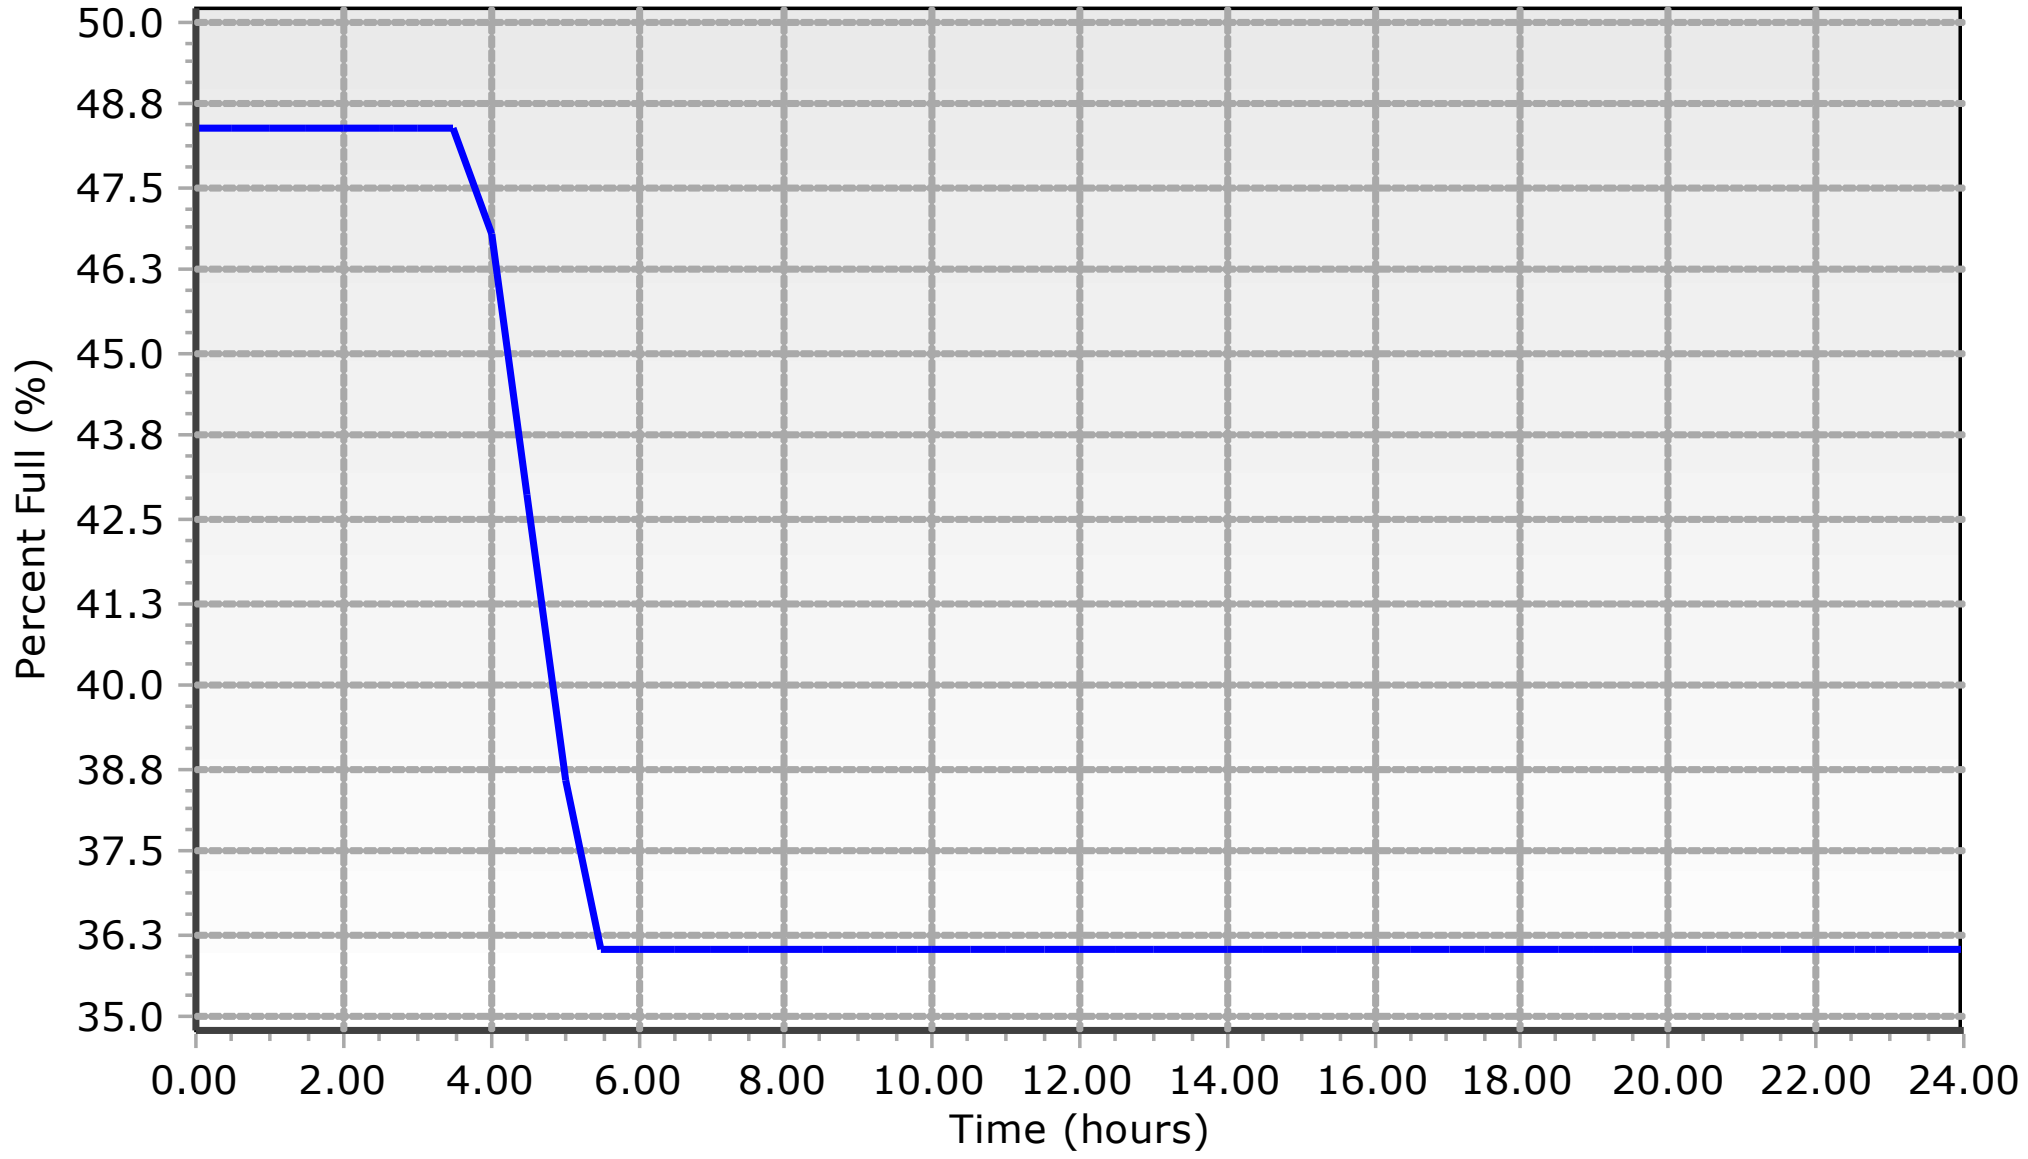


WP 1 GST 2 - Average Demand EPS - Winter - Percent Full

### WP 1 Water Sources

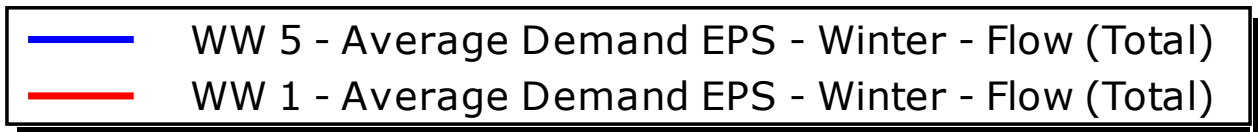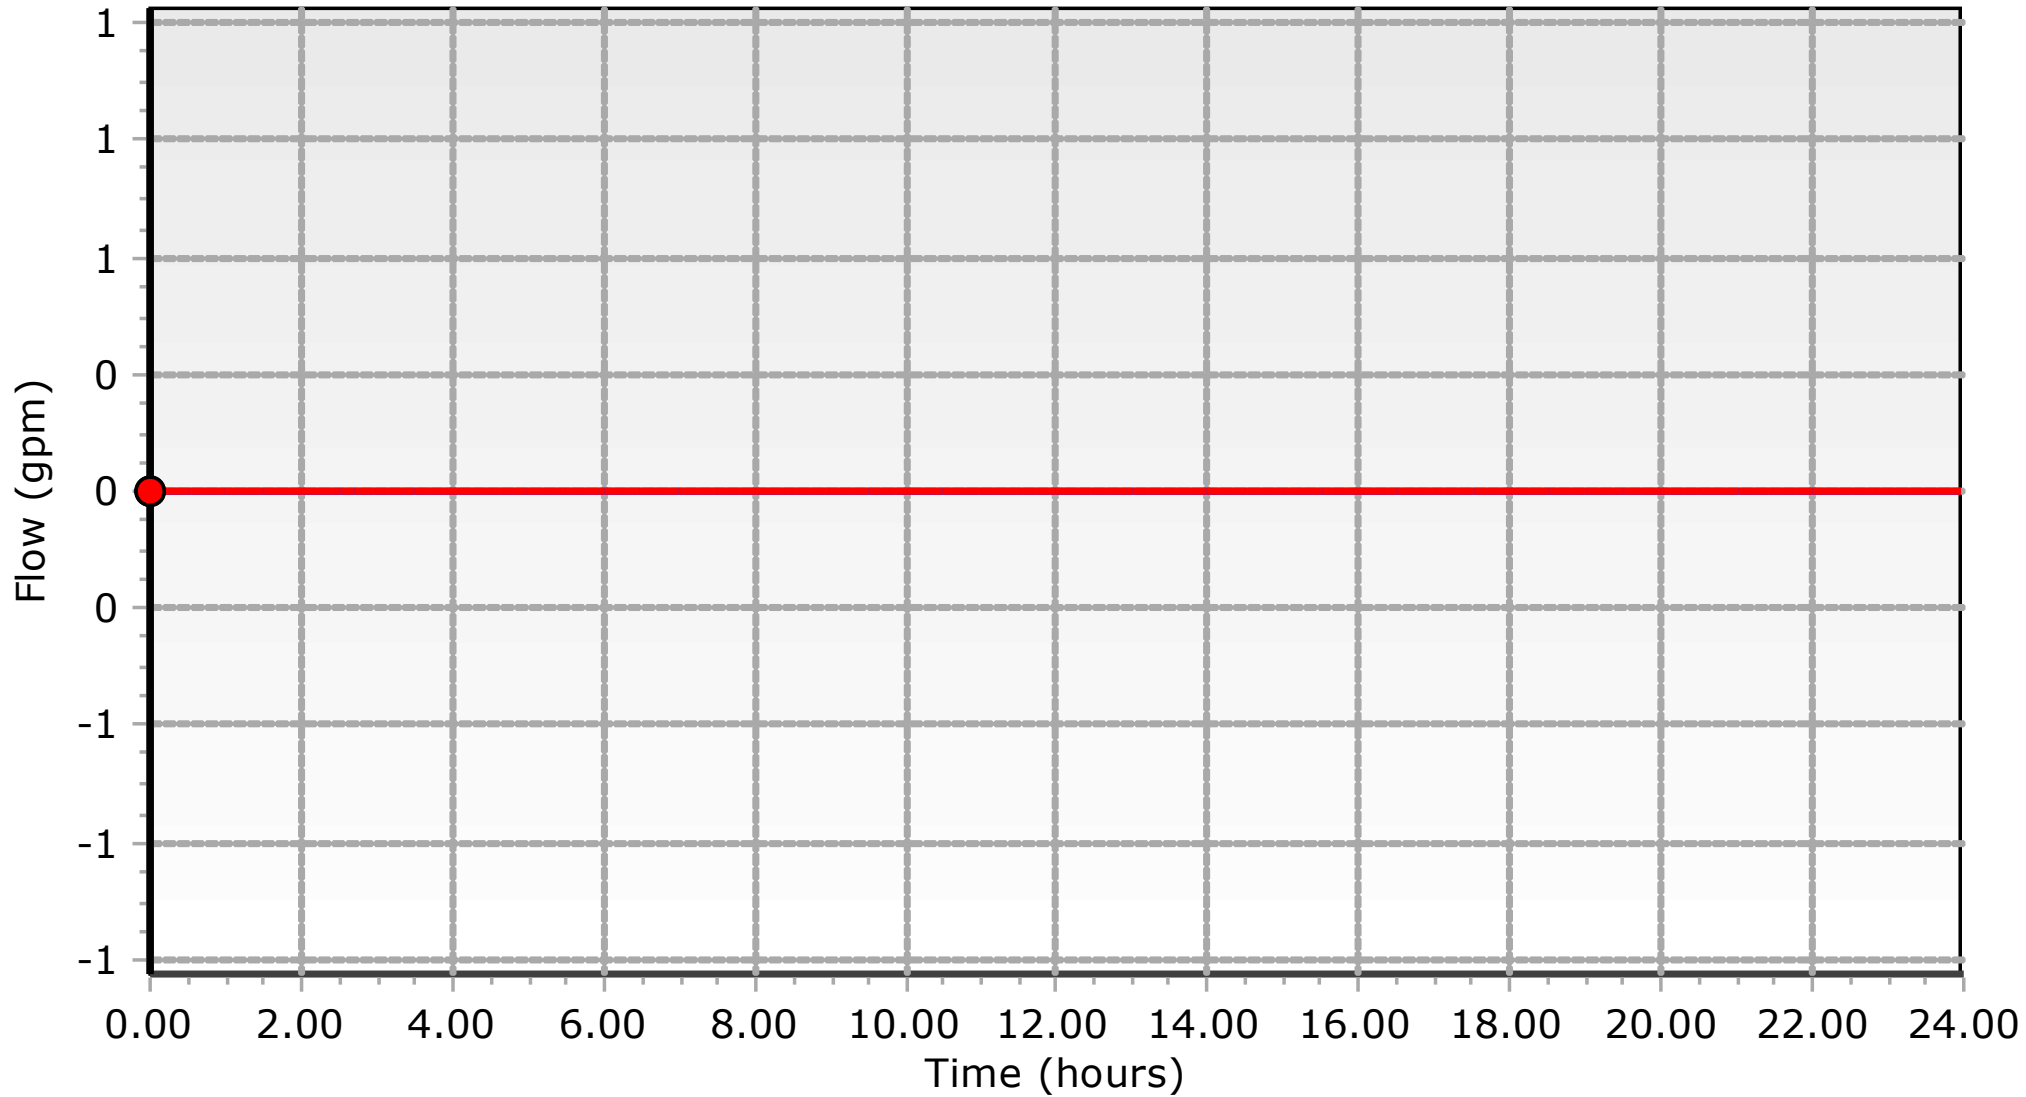


WP 2 Tank Level

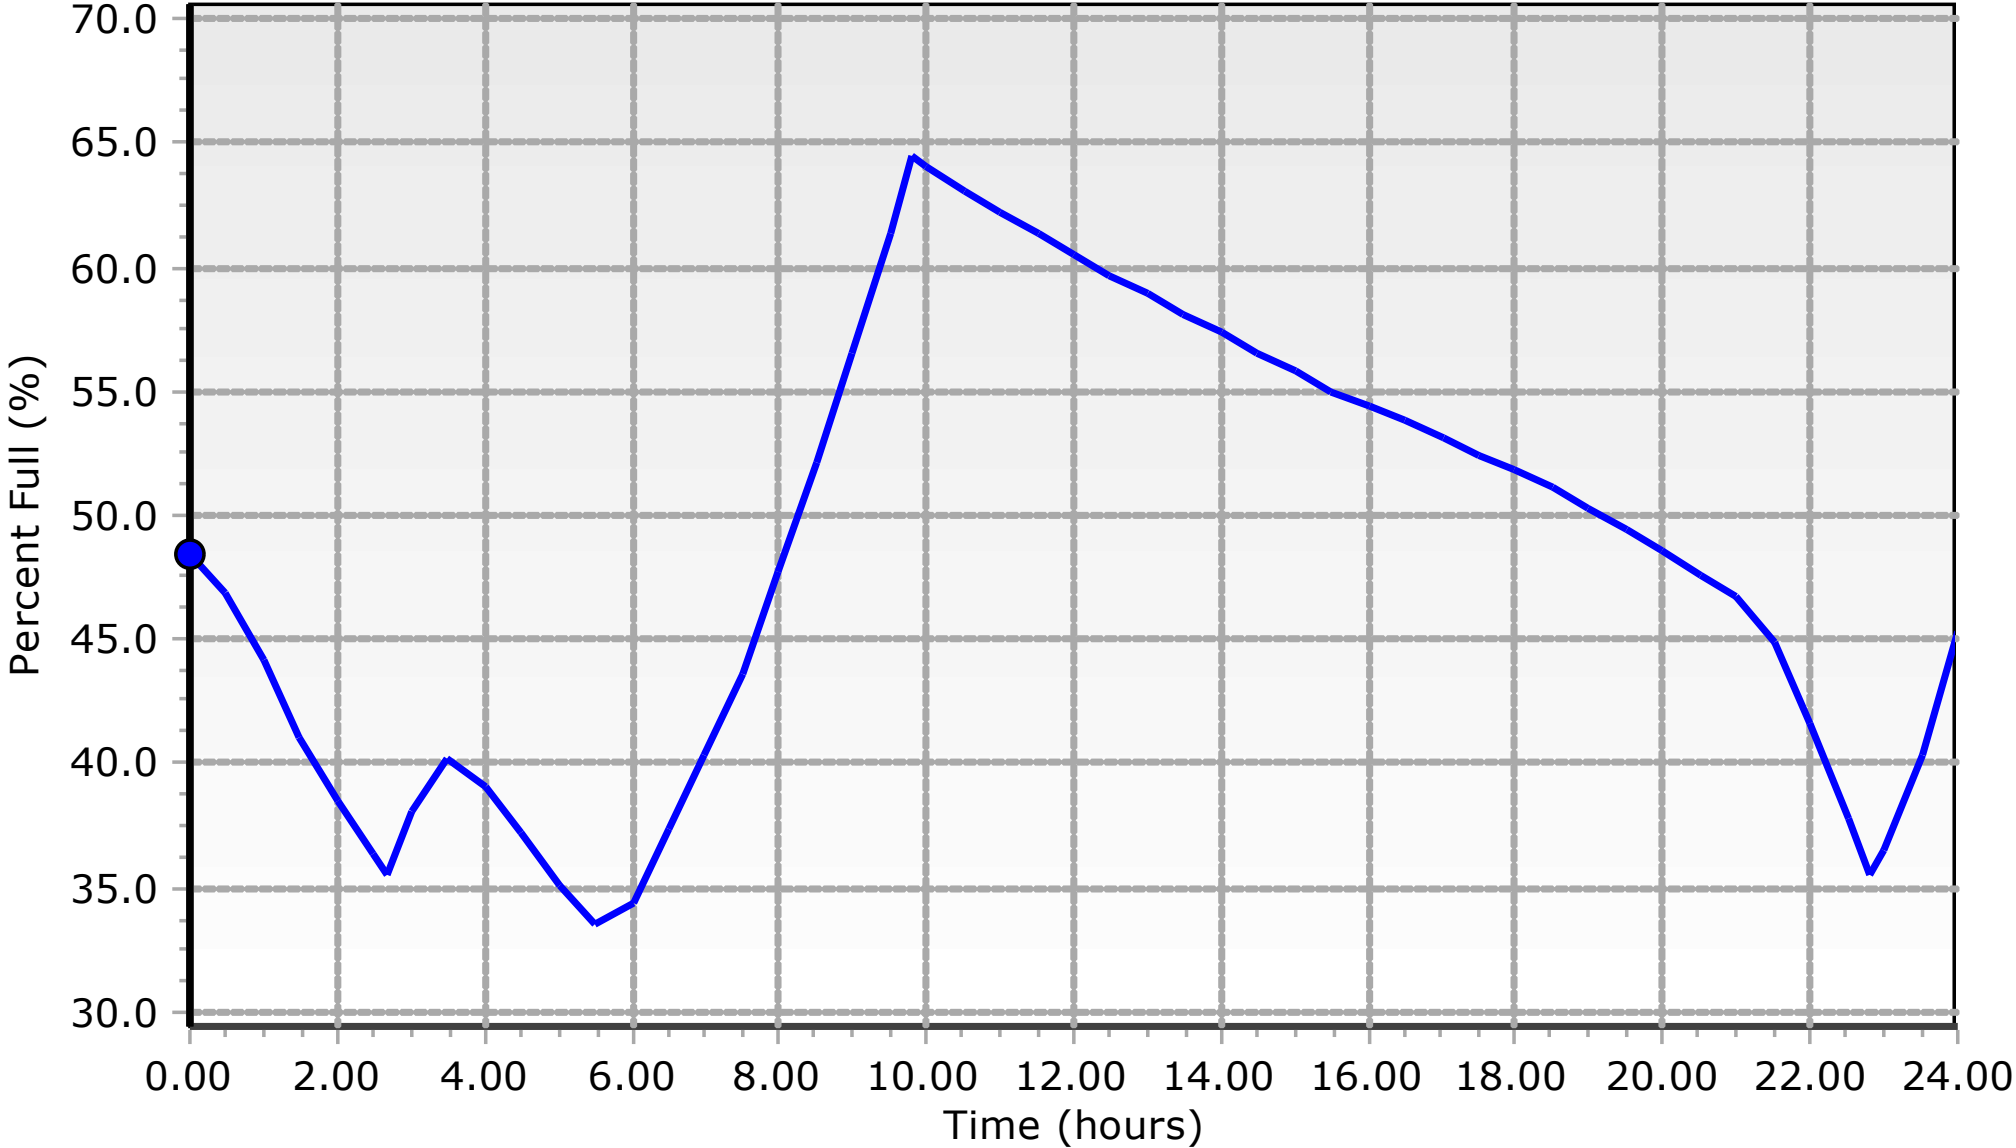

WP 2 GST 1 - Average Demand EPS - Winter - Percent Full


WP 2 Water Sources

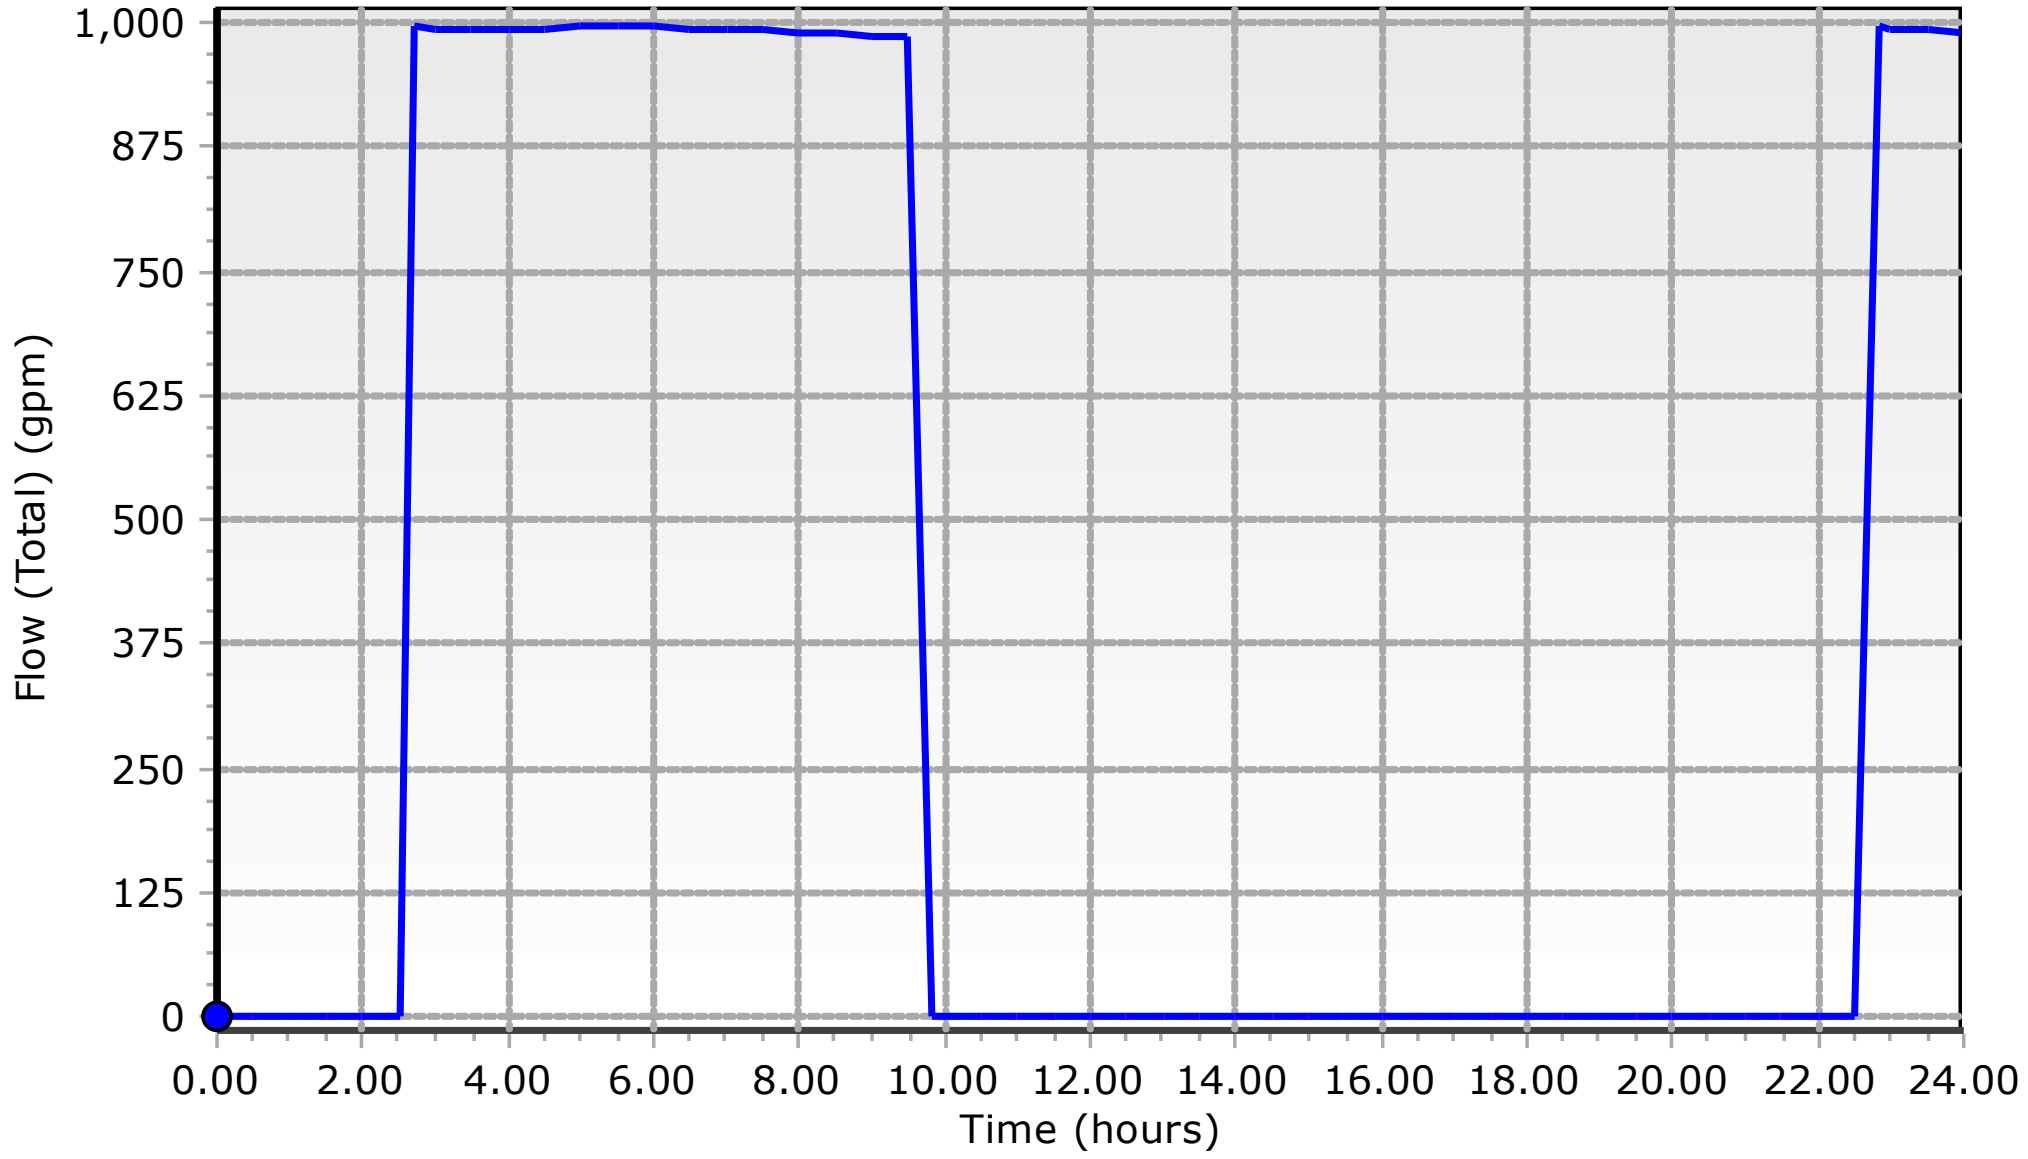

— WW 4 - Average Demand EPS - Winter - Flow (Total)


# **24-Hour Average Summer Day Simulation**

Calculation Summary Graph

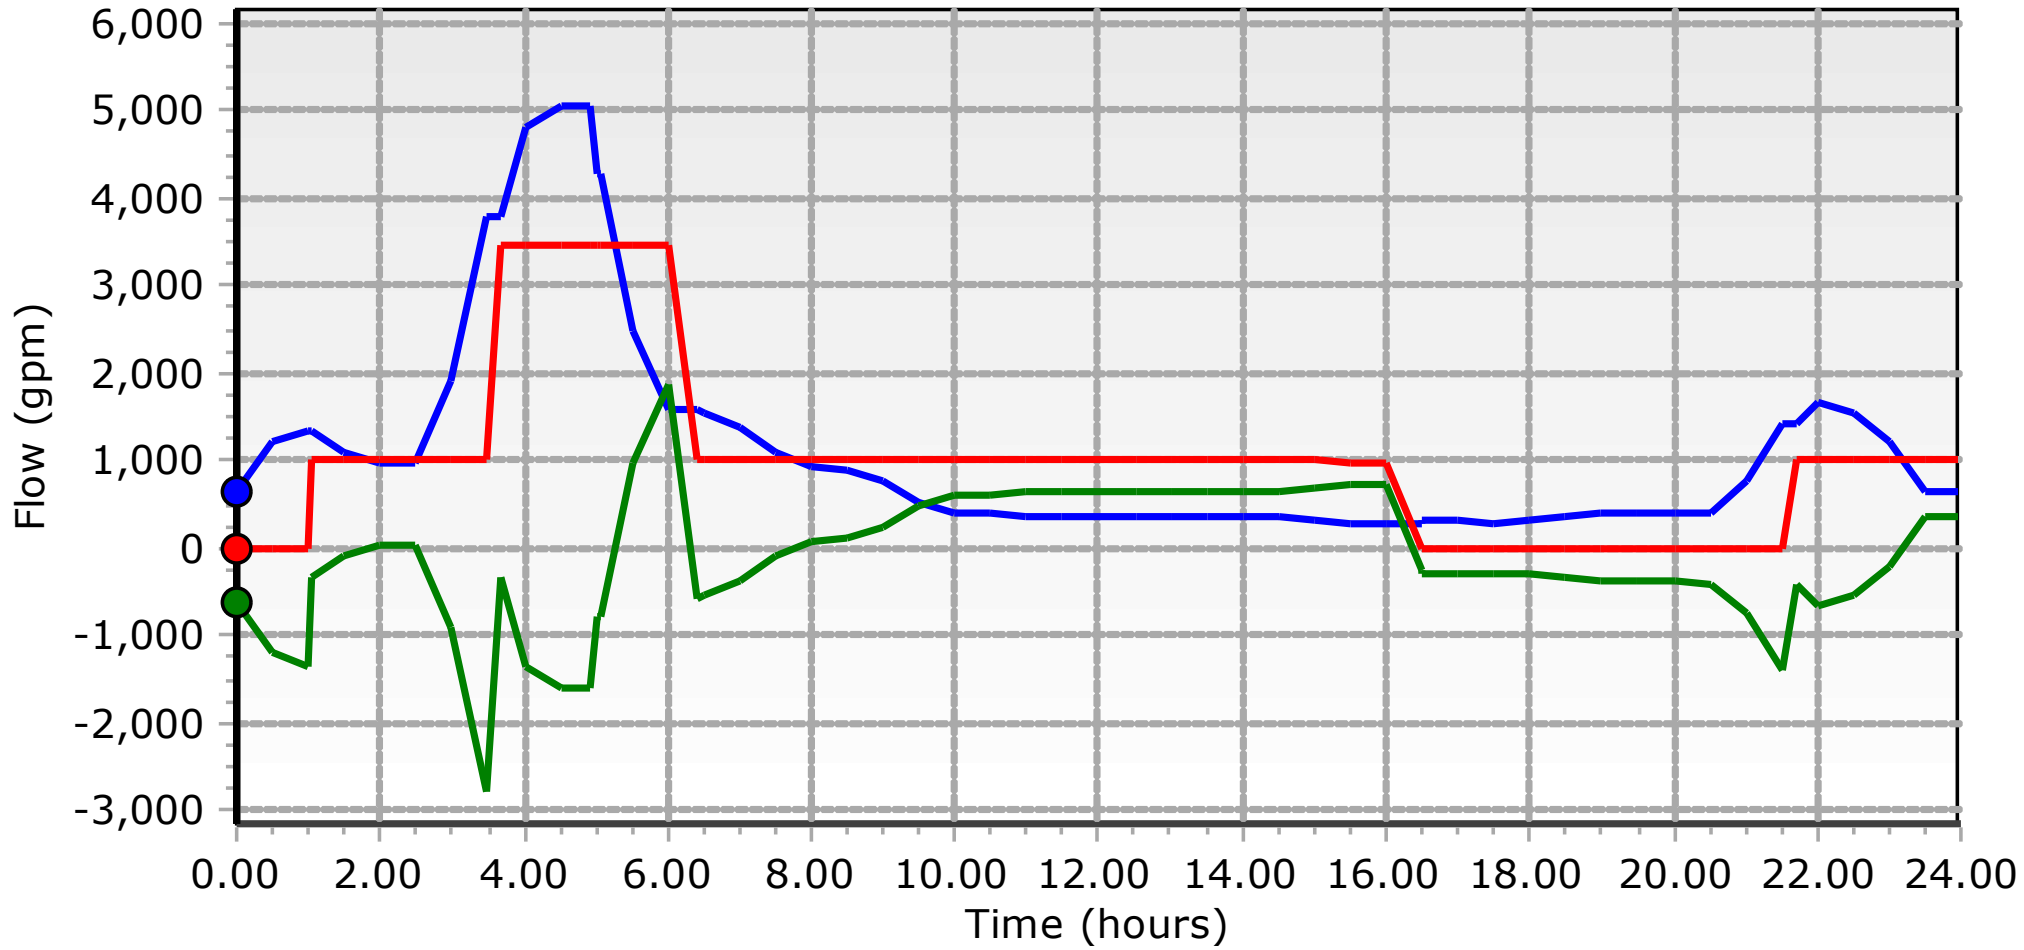



- Average Demand EPS - Summer - Flow Demanded
- Average Demand EPS - Summer - Flow Supplied
- Average Demand EPS - Summer - Flow Stored

WP 1 Tank Levels

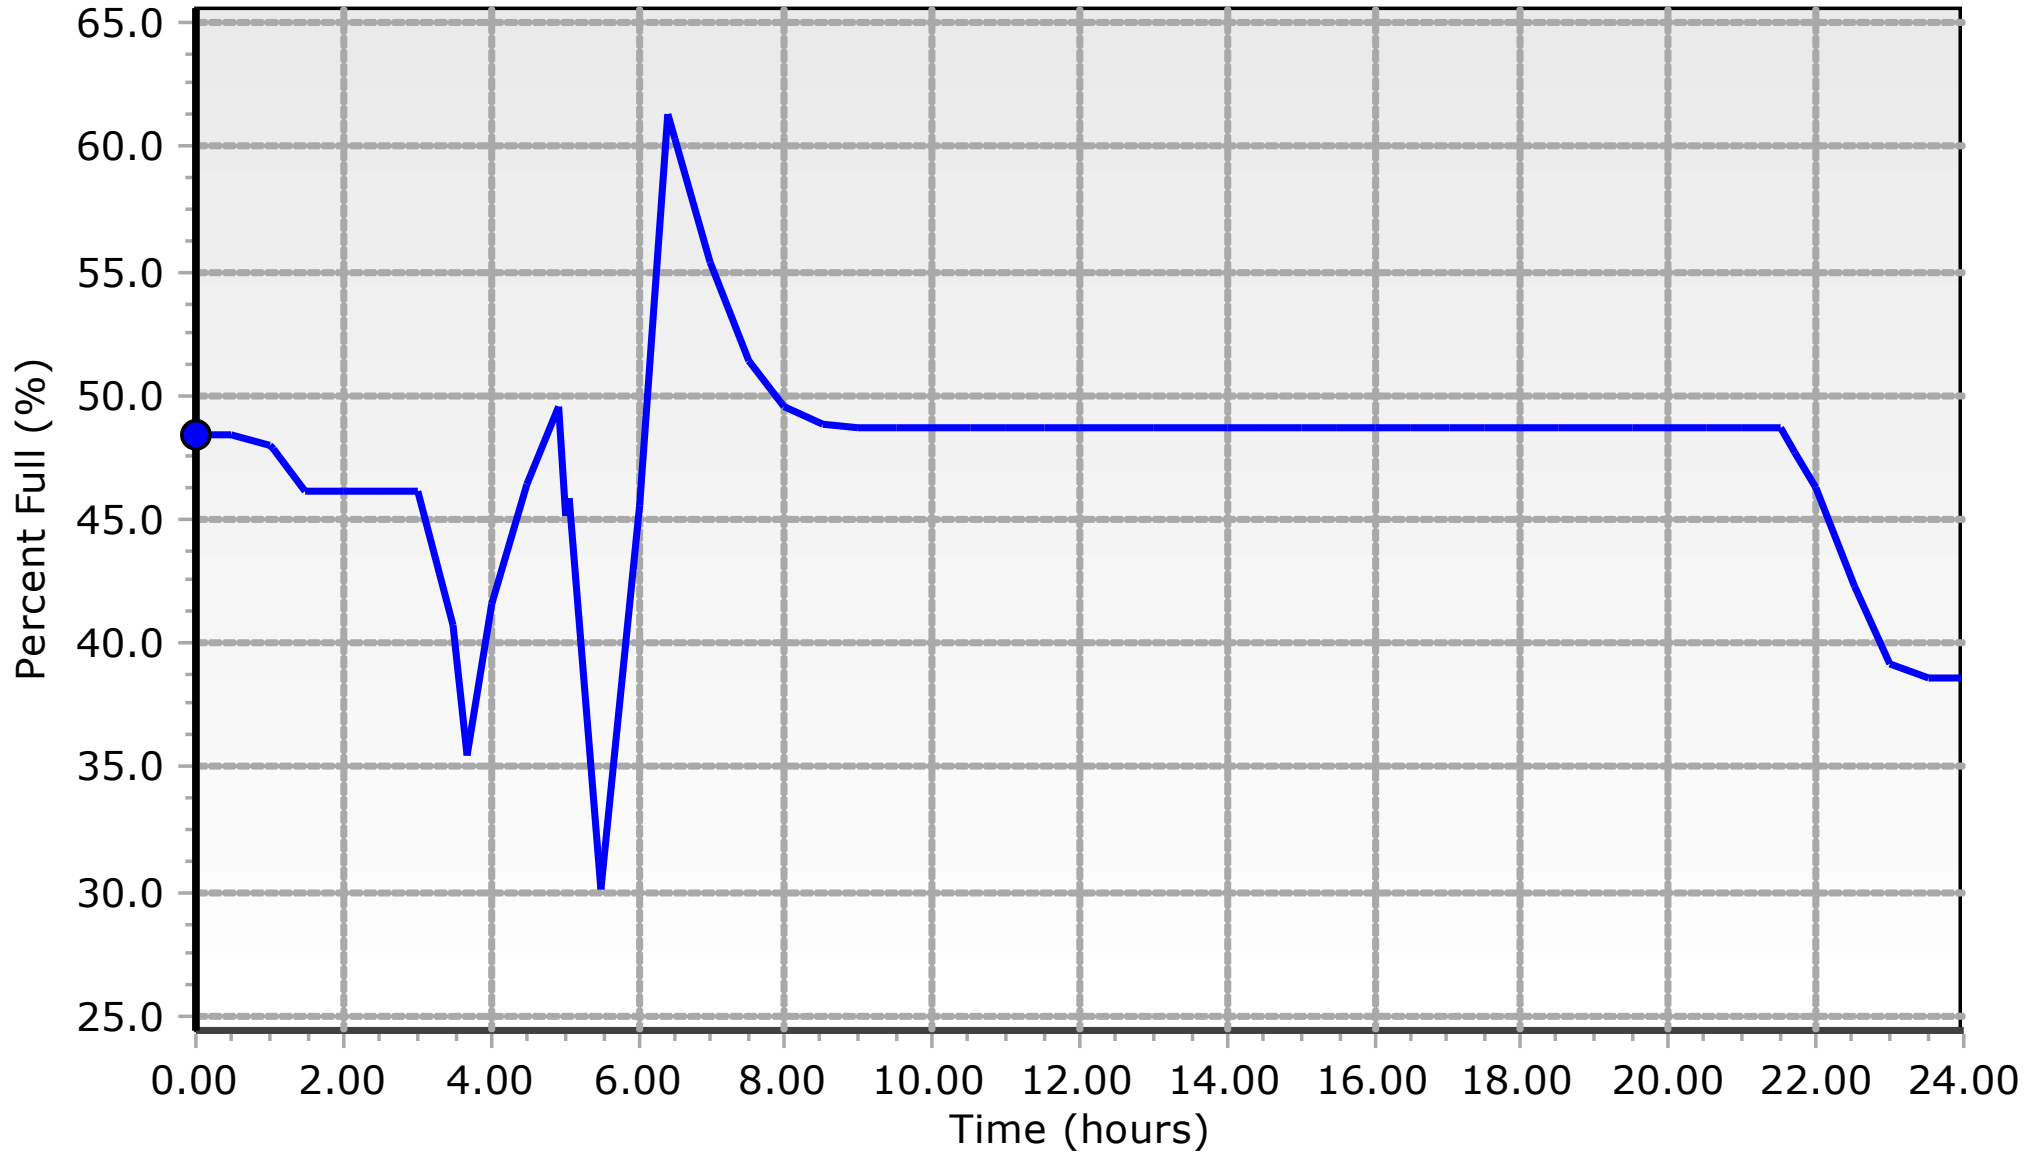


WP 1 GST 2 - Average Demand EPS - Summer - Percent Full

### WP 1 Water Sources

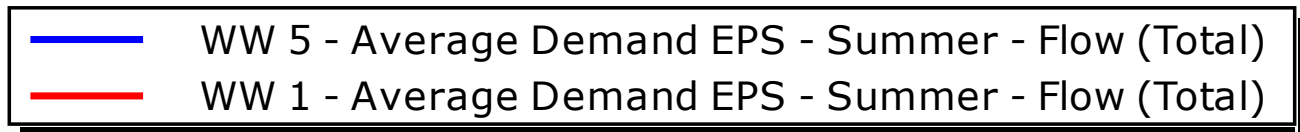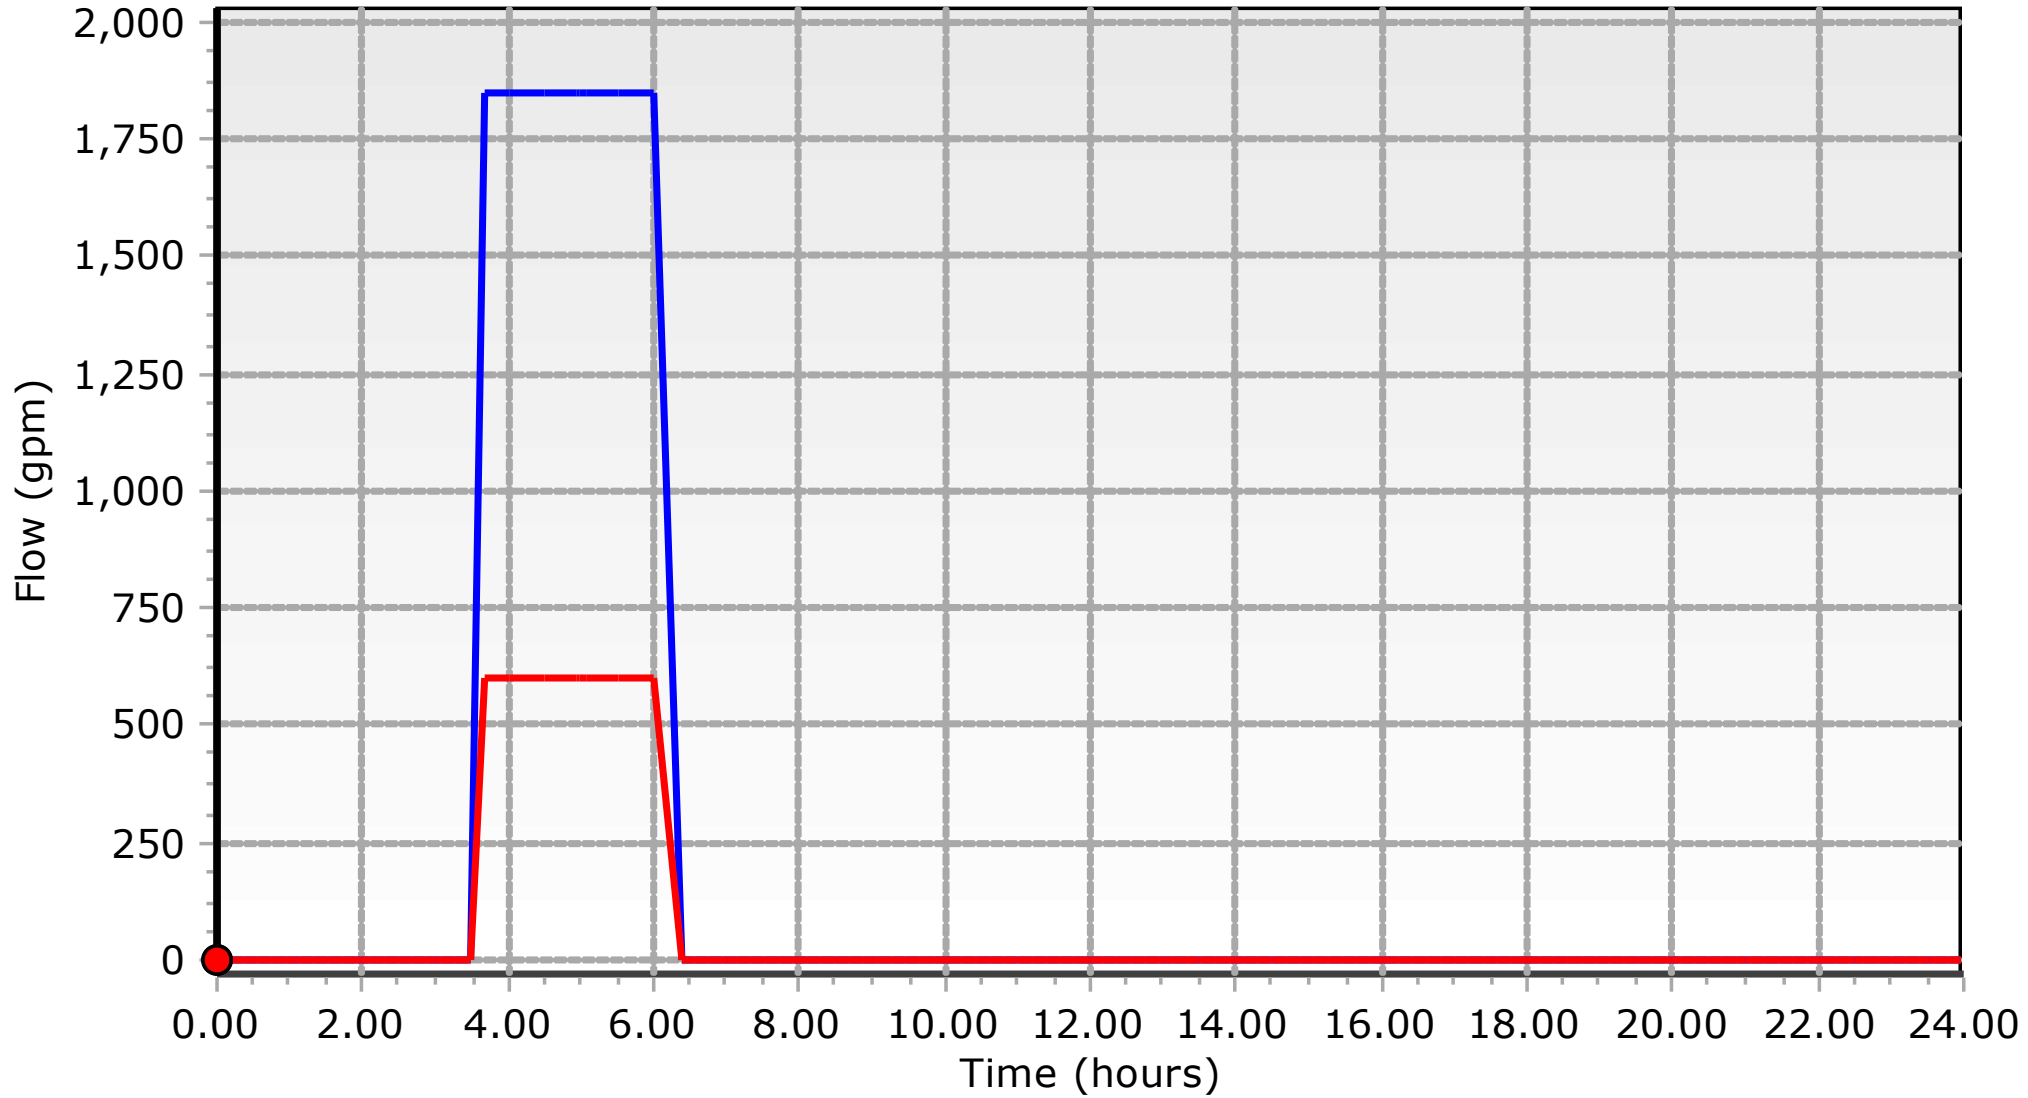

WP 2 Tank Level

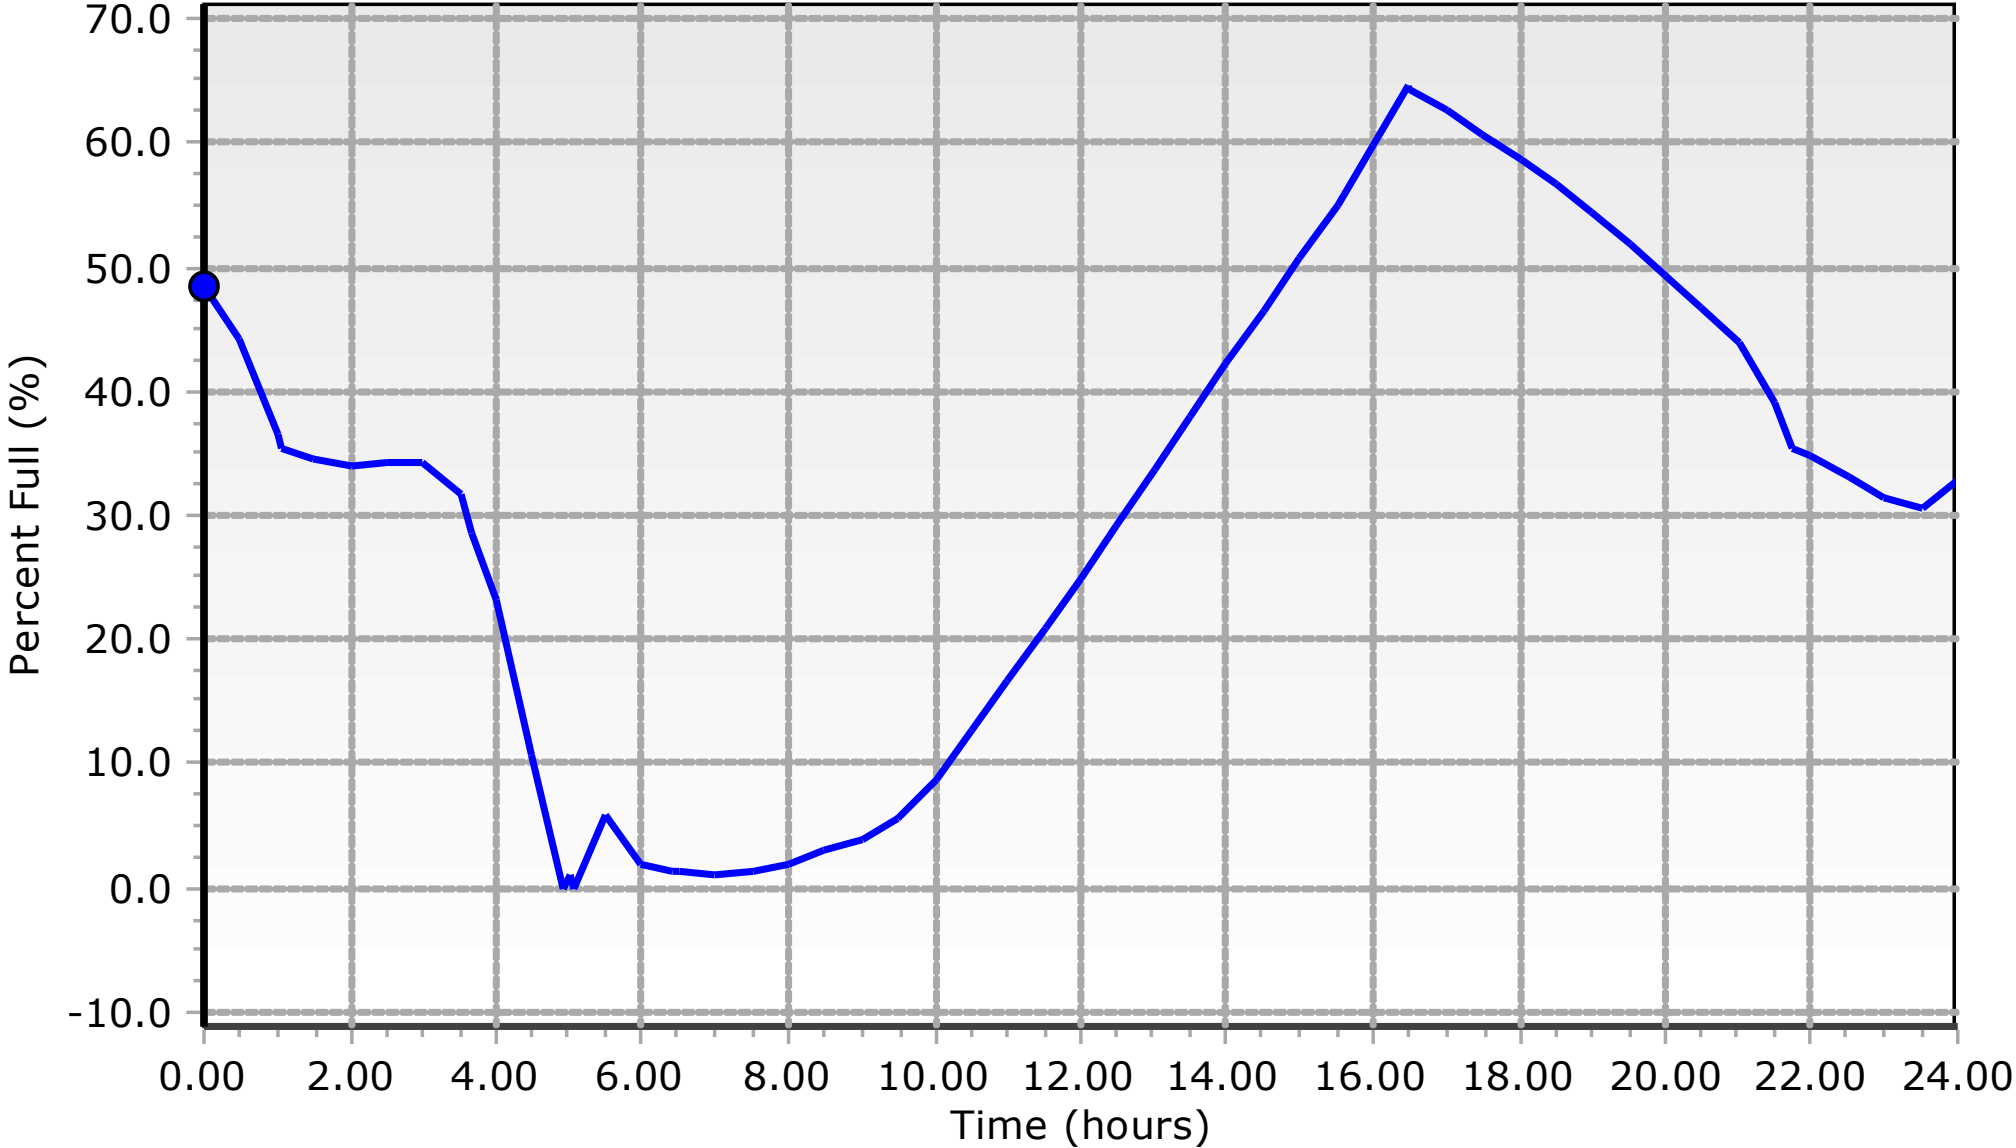

WP 2 GST 1 - Average Demand EPS - Summer - Percent Full


WP 2 Water Sources



— WW 4 - Average Demand EPS - Summer - Flow (Total)


# **24-Hour Maximum Day Simulation**

Calculation Summary Graph

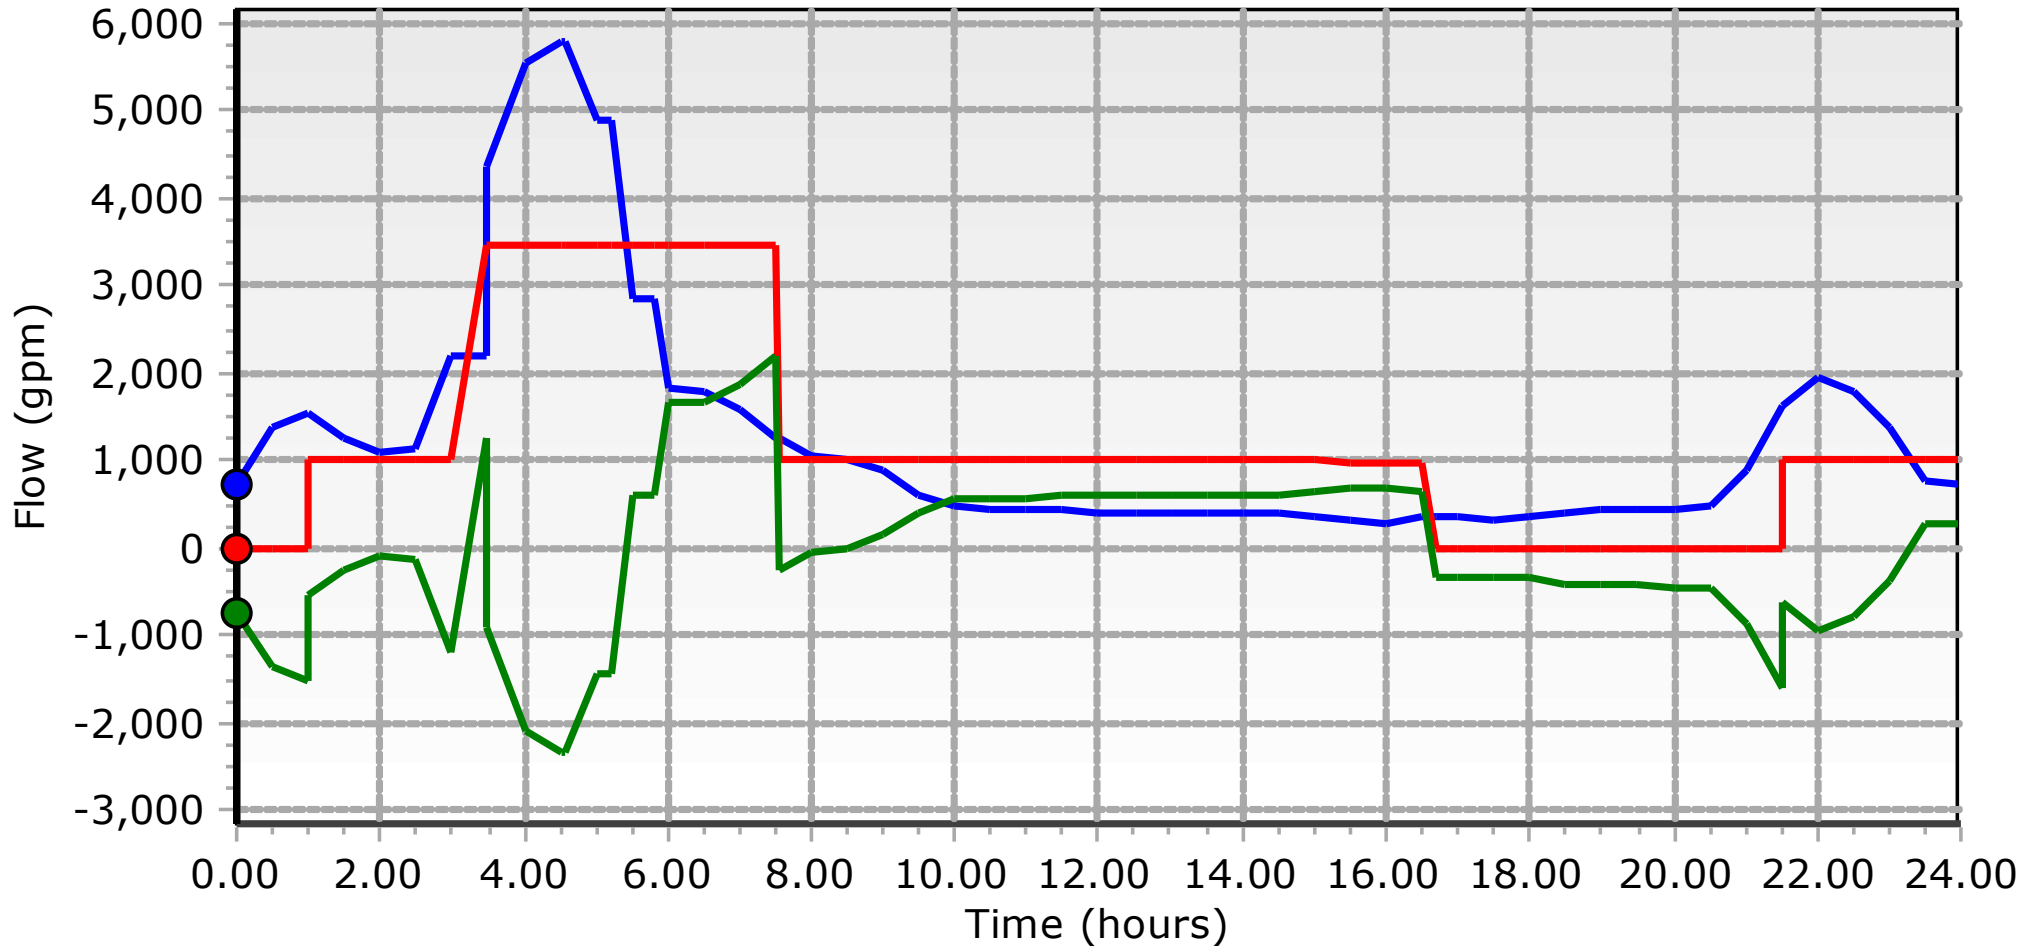


- Maximum Day EPS - Flow Demanded
- Maximum Day EPS - Flow Supplied
- Maximum Day EPS - Flow Stored

WP 1 Tank Levels

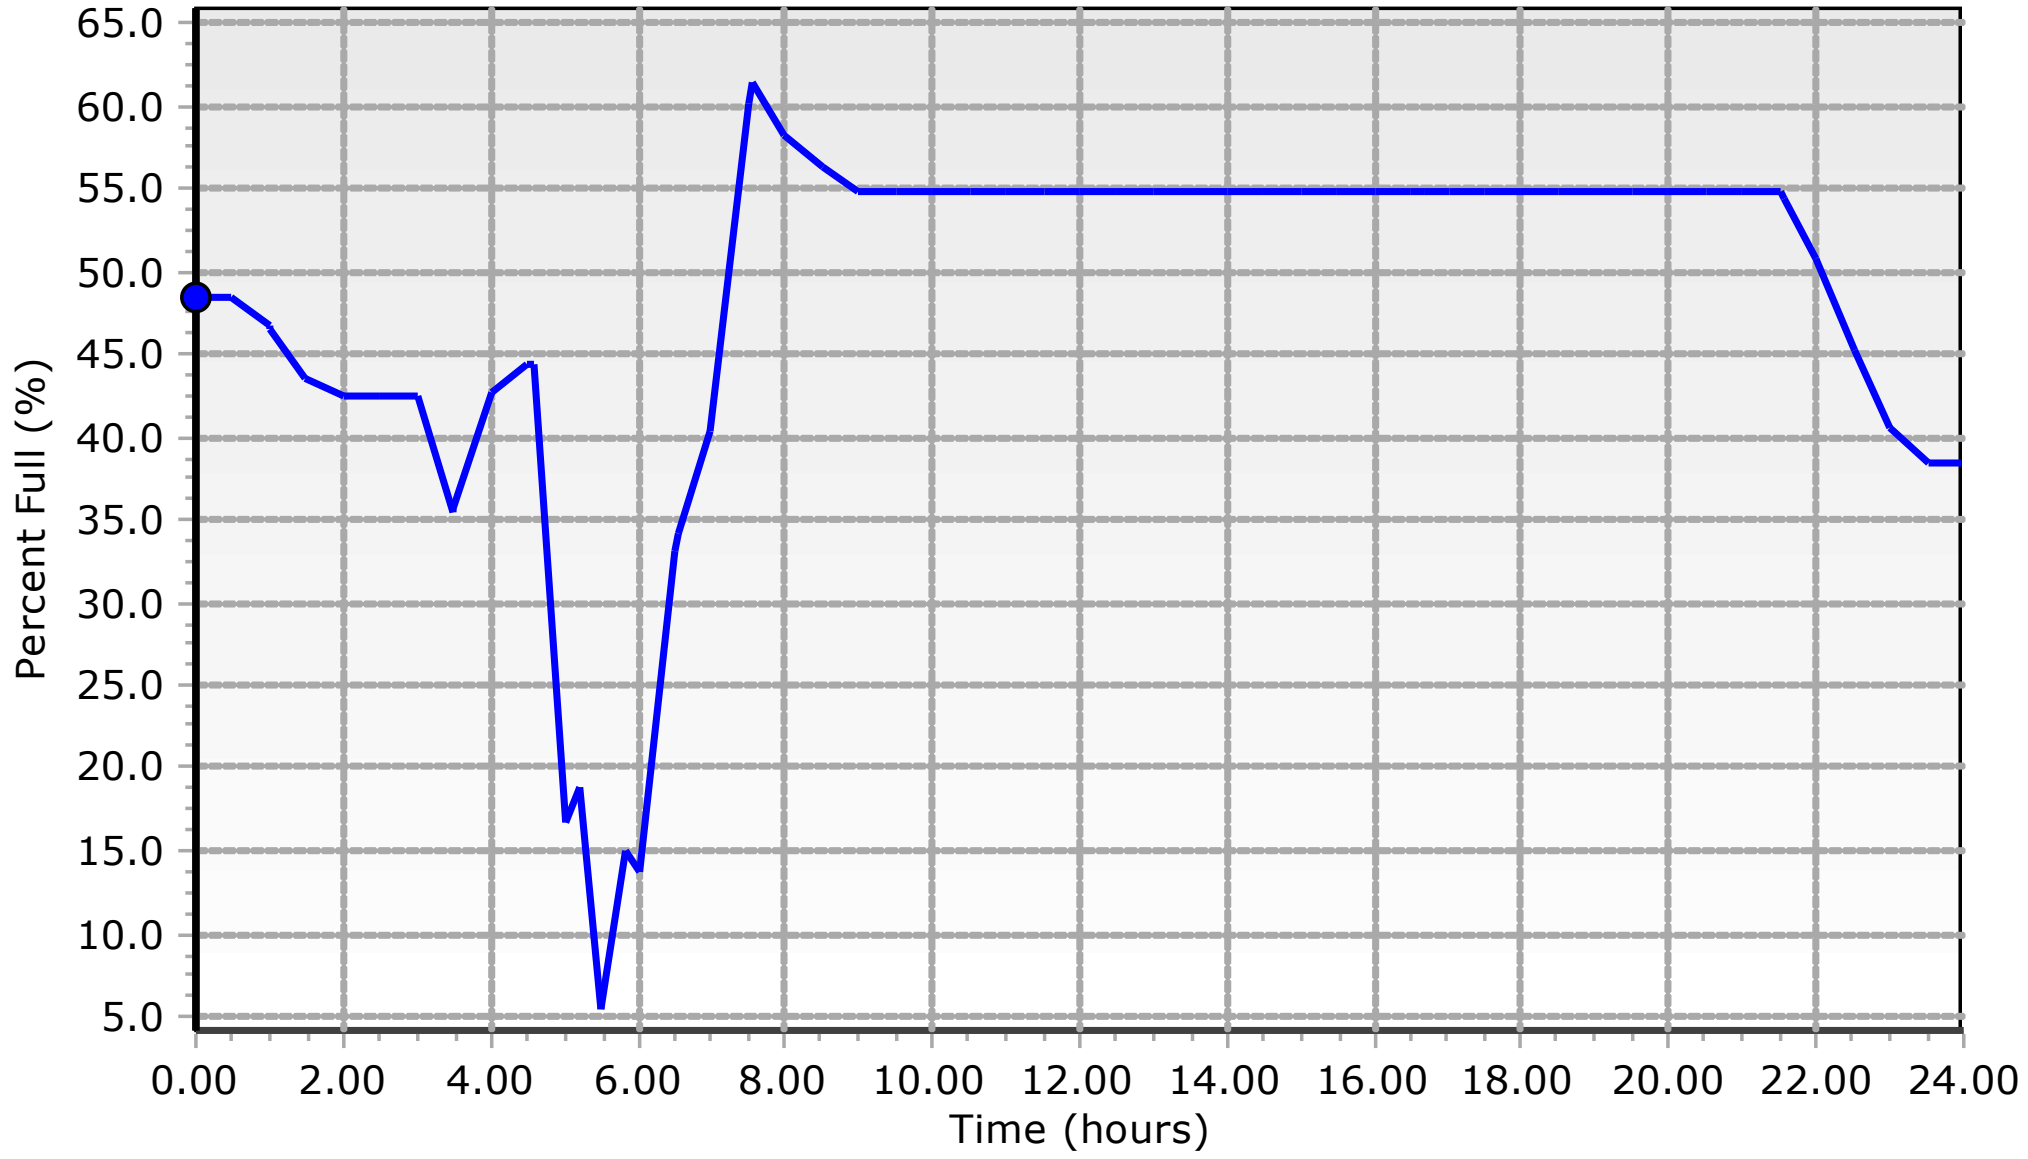


WP 1 GST 2 - Maximum Day EPS - Percent Full

### WP 1 Water Sources

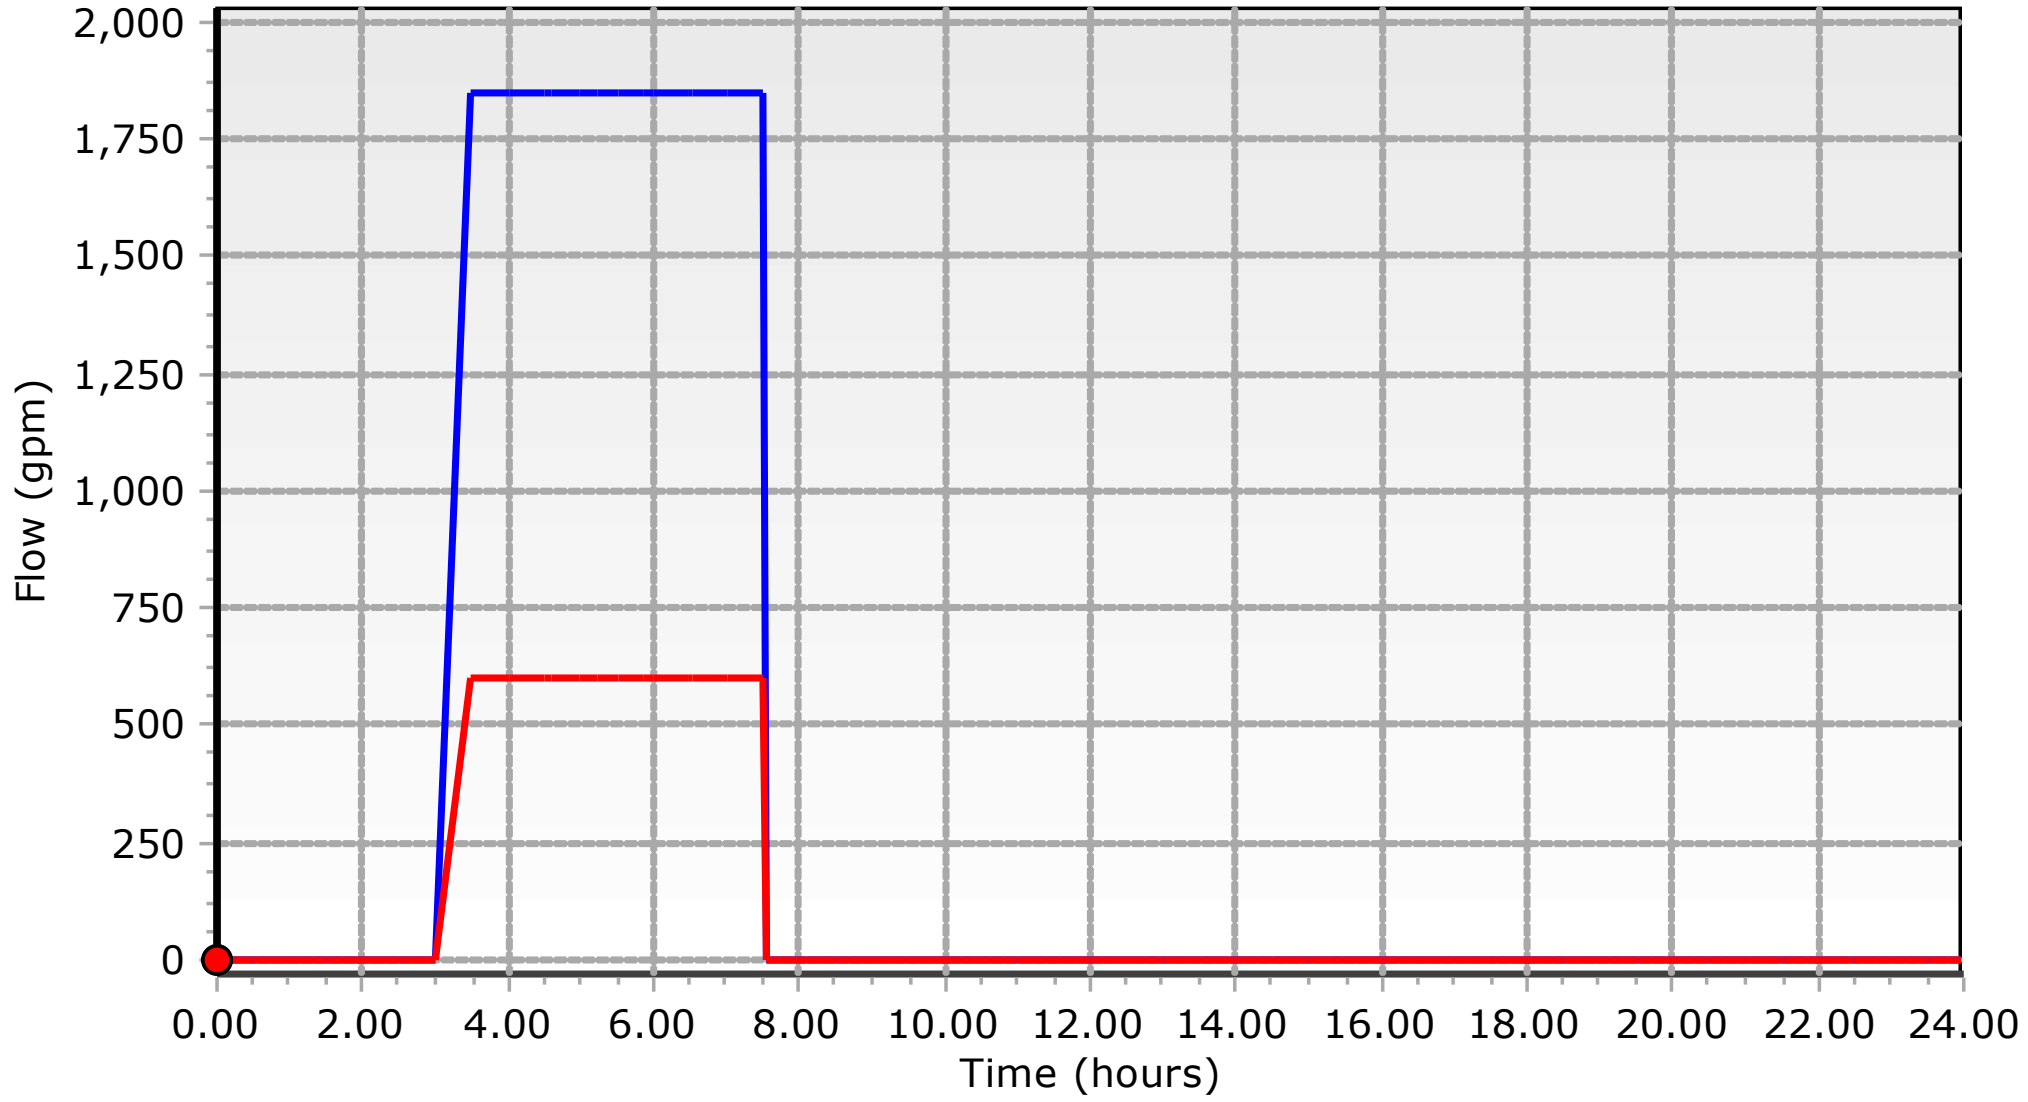


- WW 5 - Maximum Day EPS - Flow (Total)
- WW 1 - Maximum Day EPS - Flow (Total)

WP 2 Tank Level

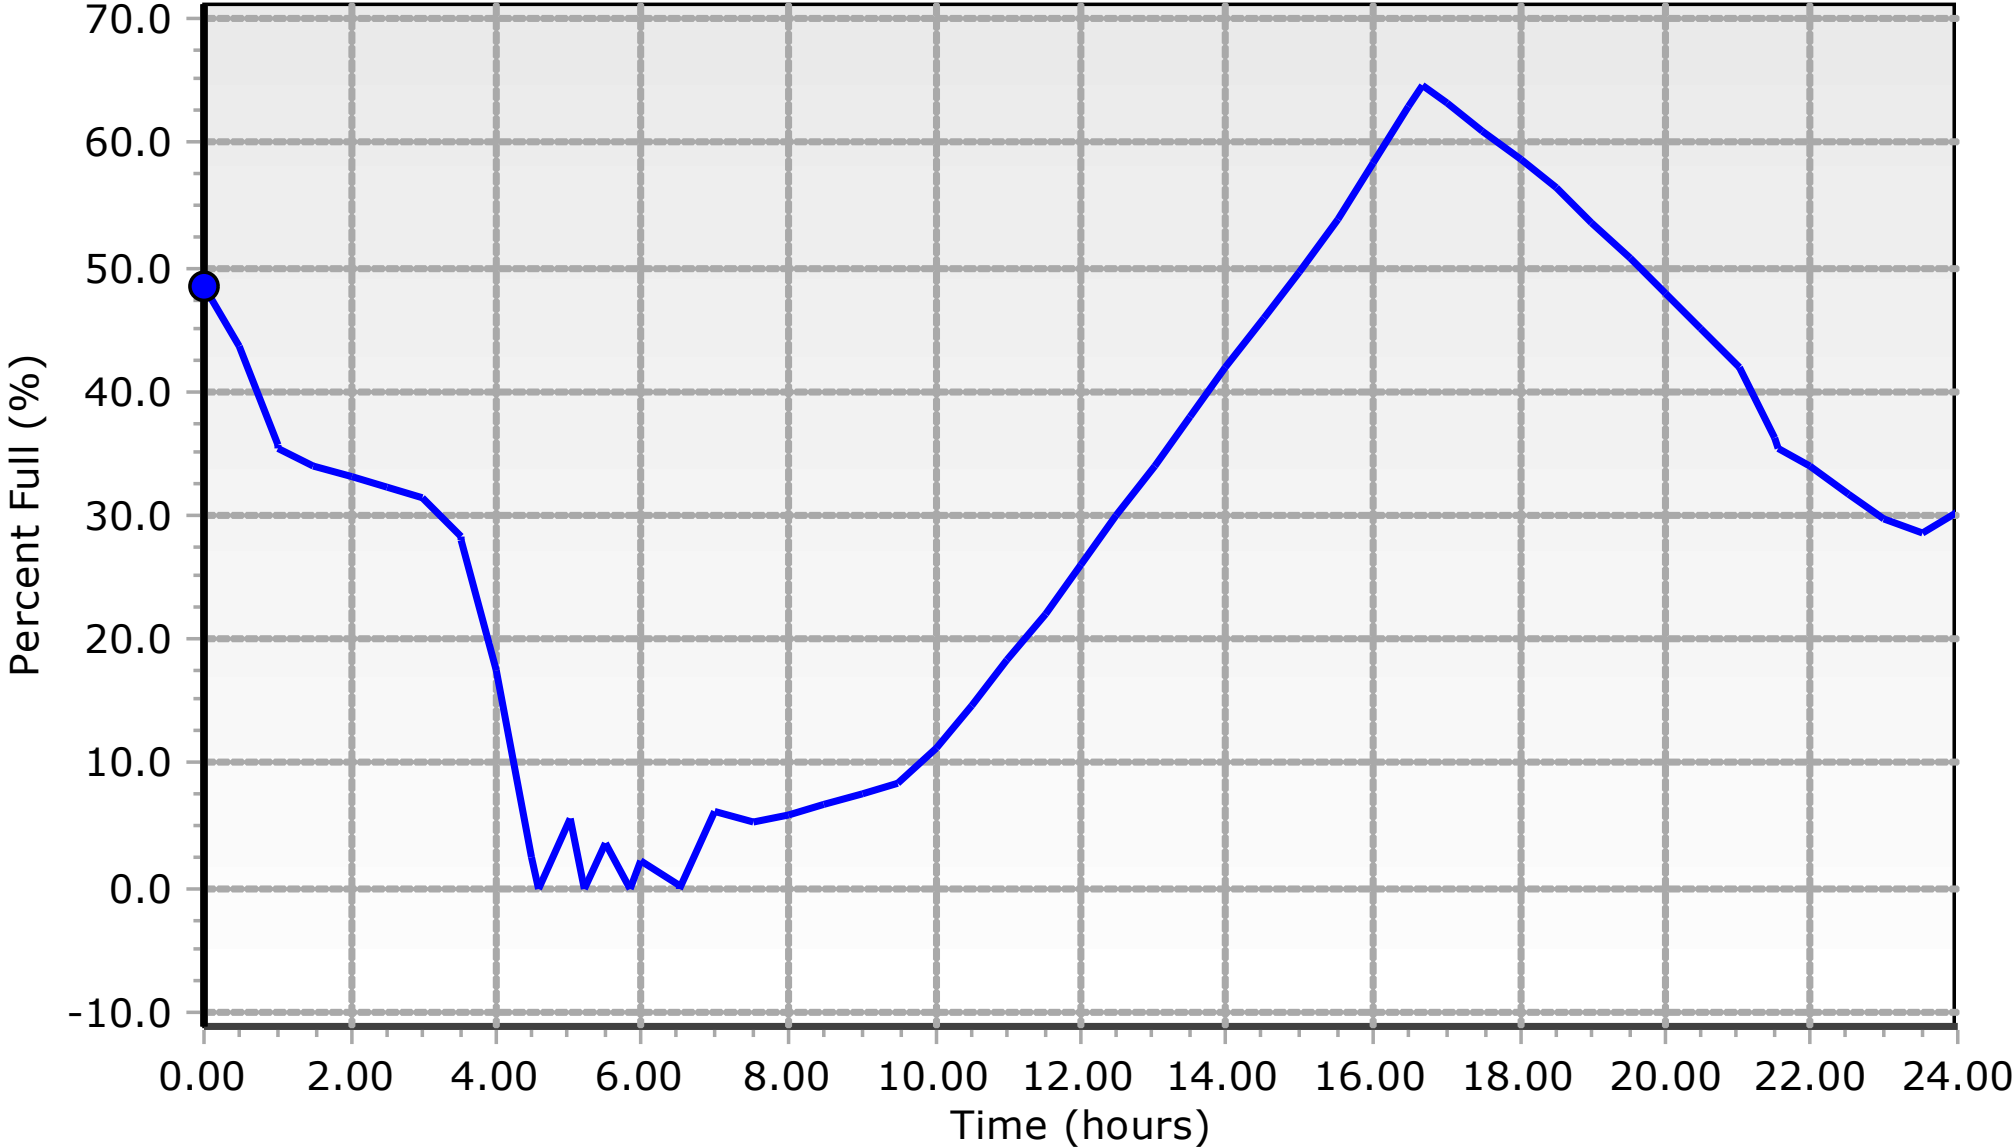

WP 2 GST 1 - Maximum Day EPS - Percent Full

### WP 2 Water Sources


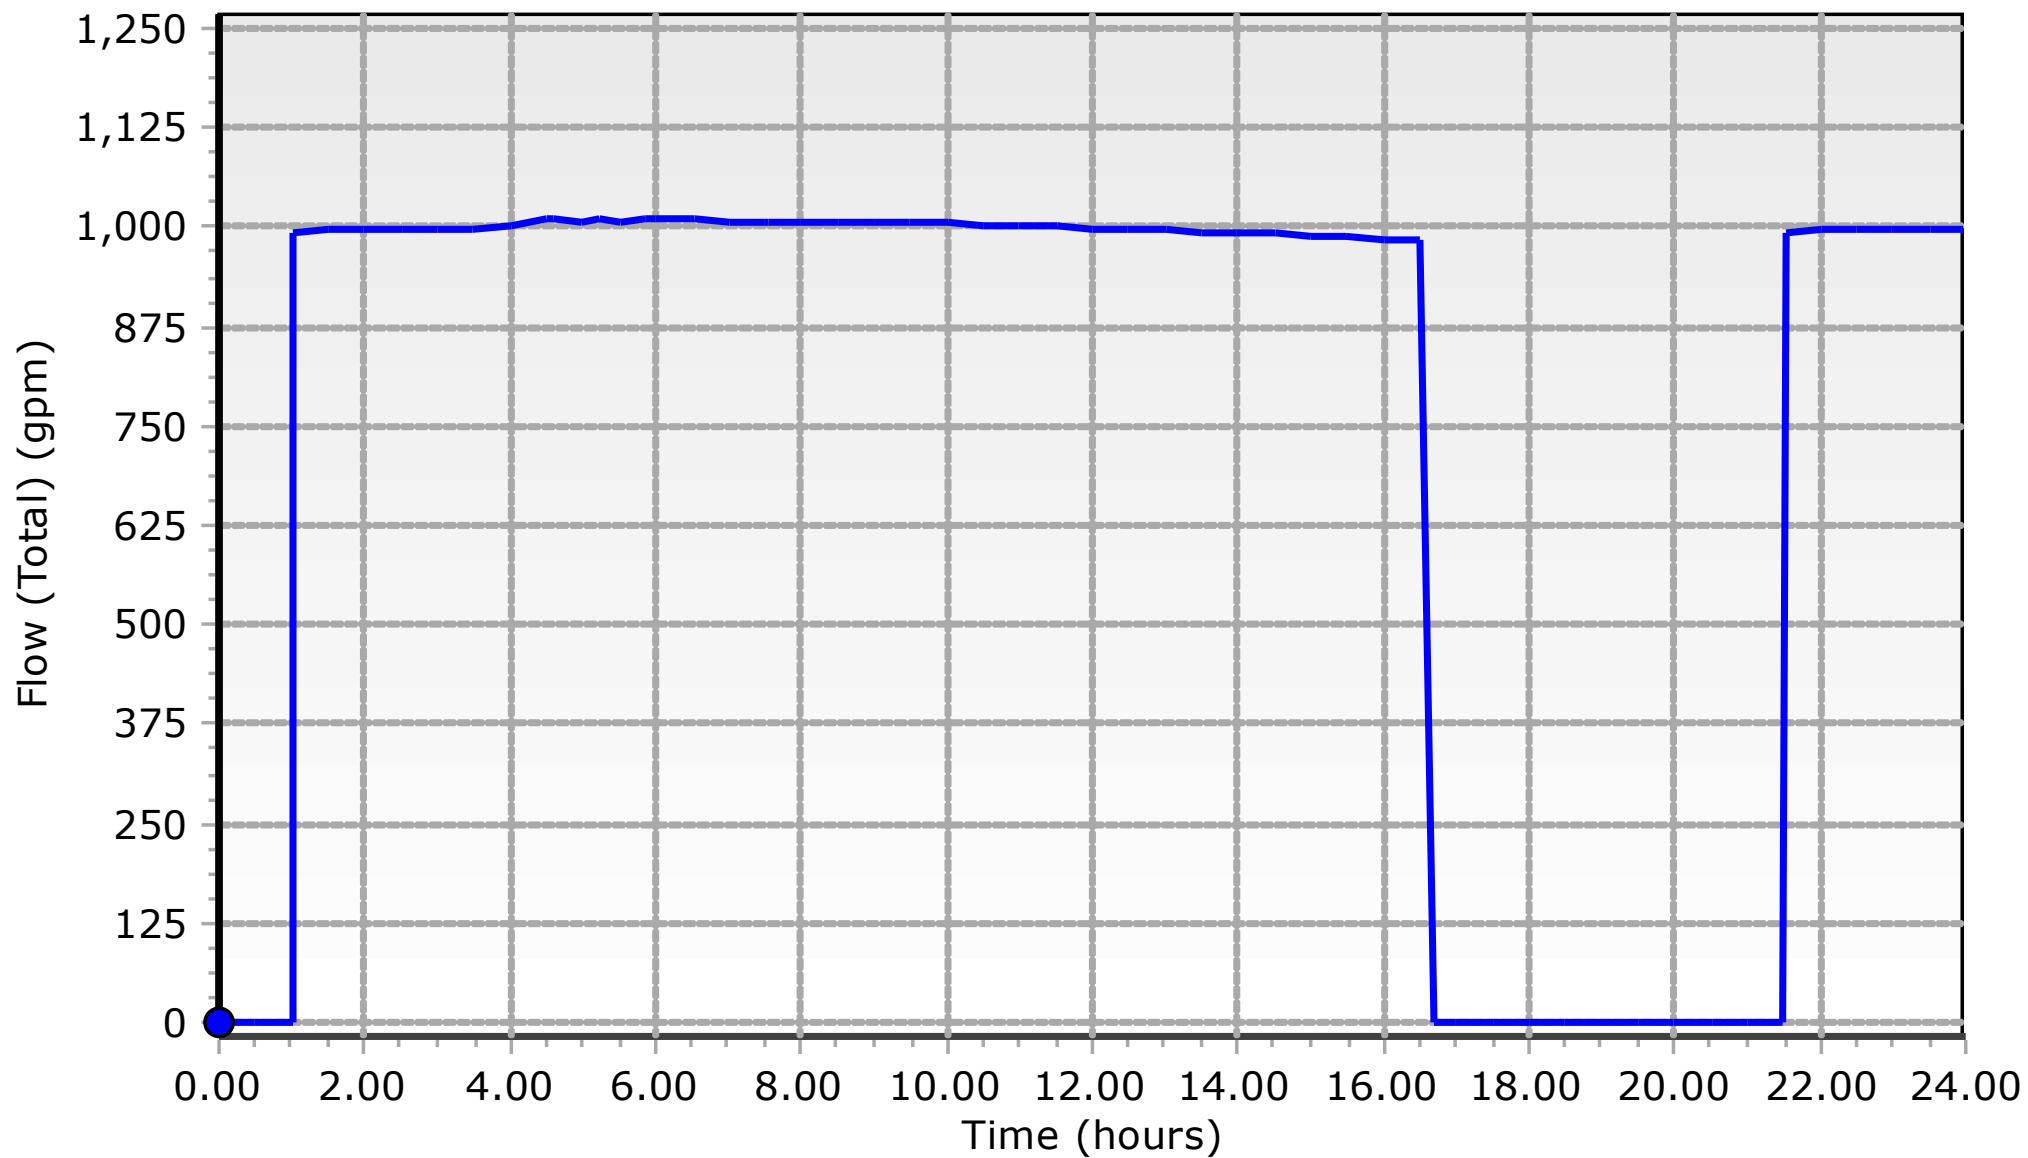


— WW 4 - Maximum Day EPS - Flow (Total)


**City of Bunker Hill Village Emergency  
Operating Scenario No. 2 - Extended  
Period Simulation**

# **24-Hour Average Winter Day Simulation**

Calculation Summary Graph

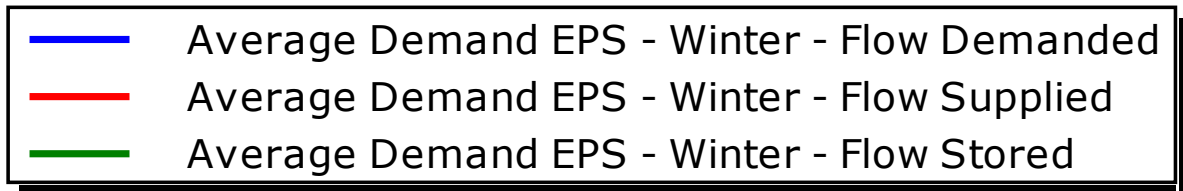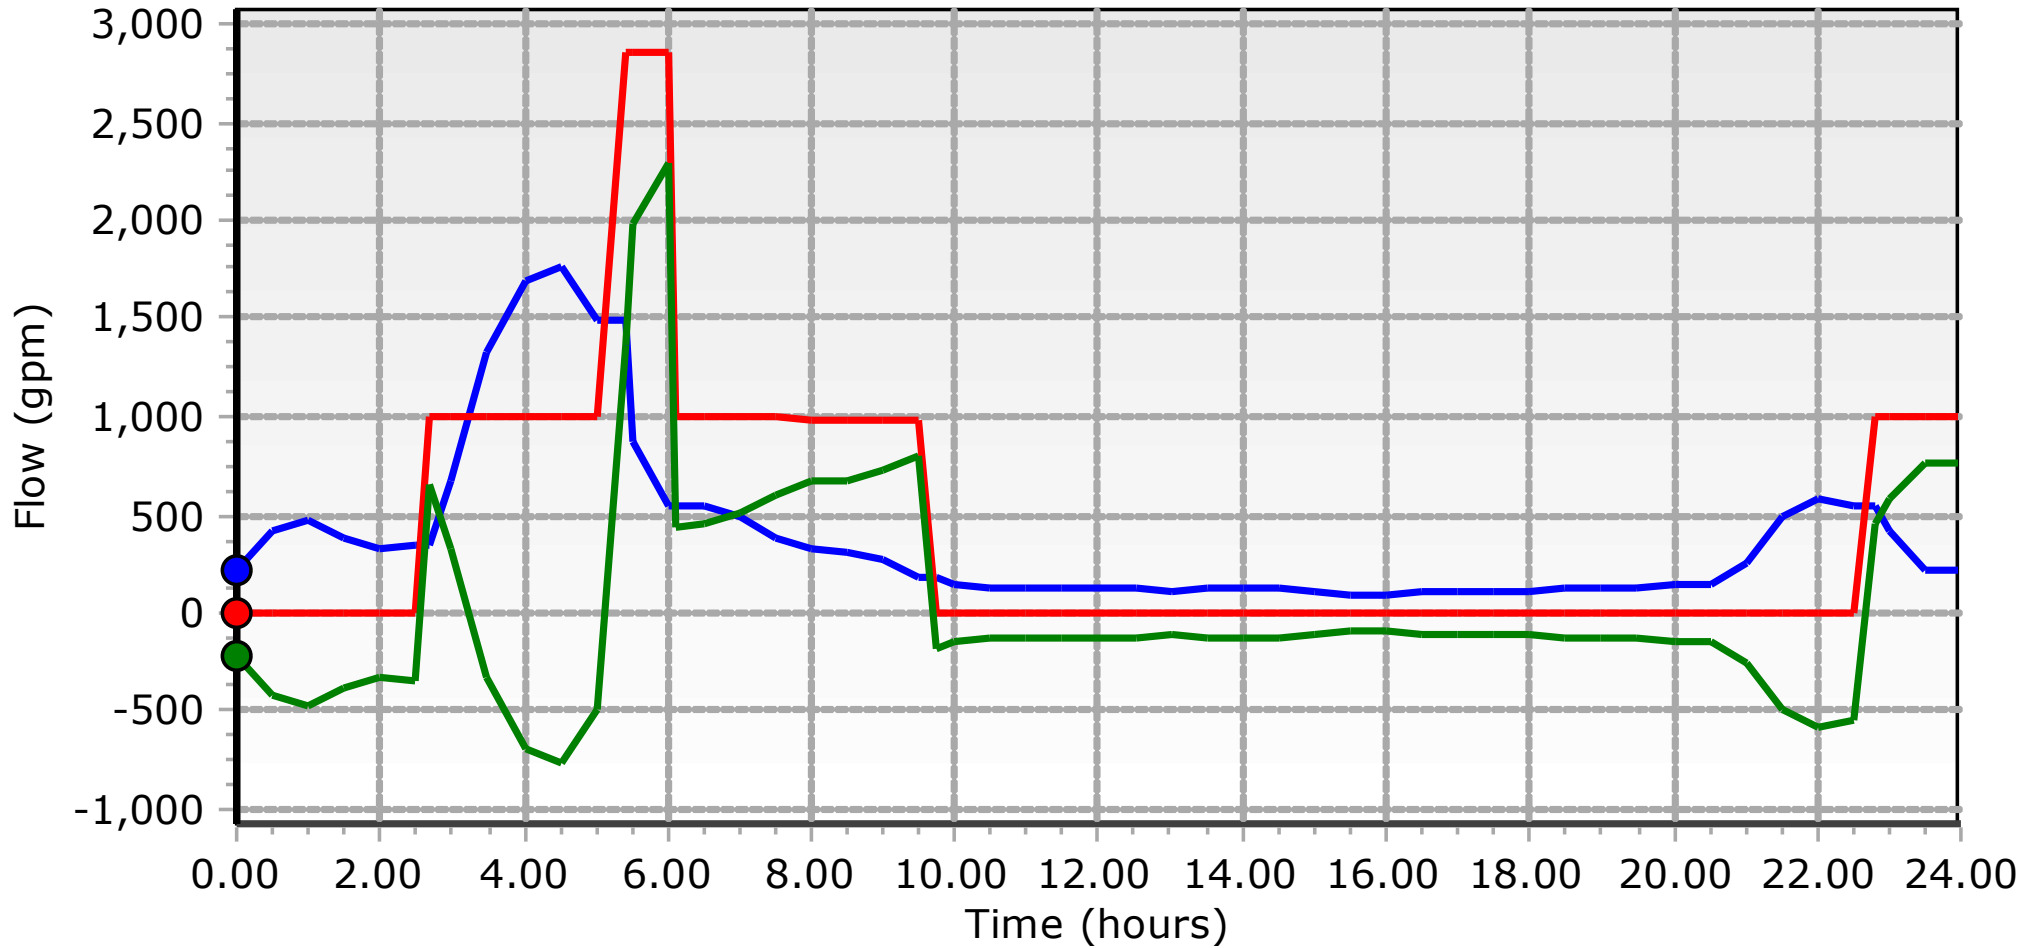


WP 1 Tank Levels

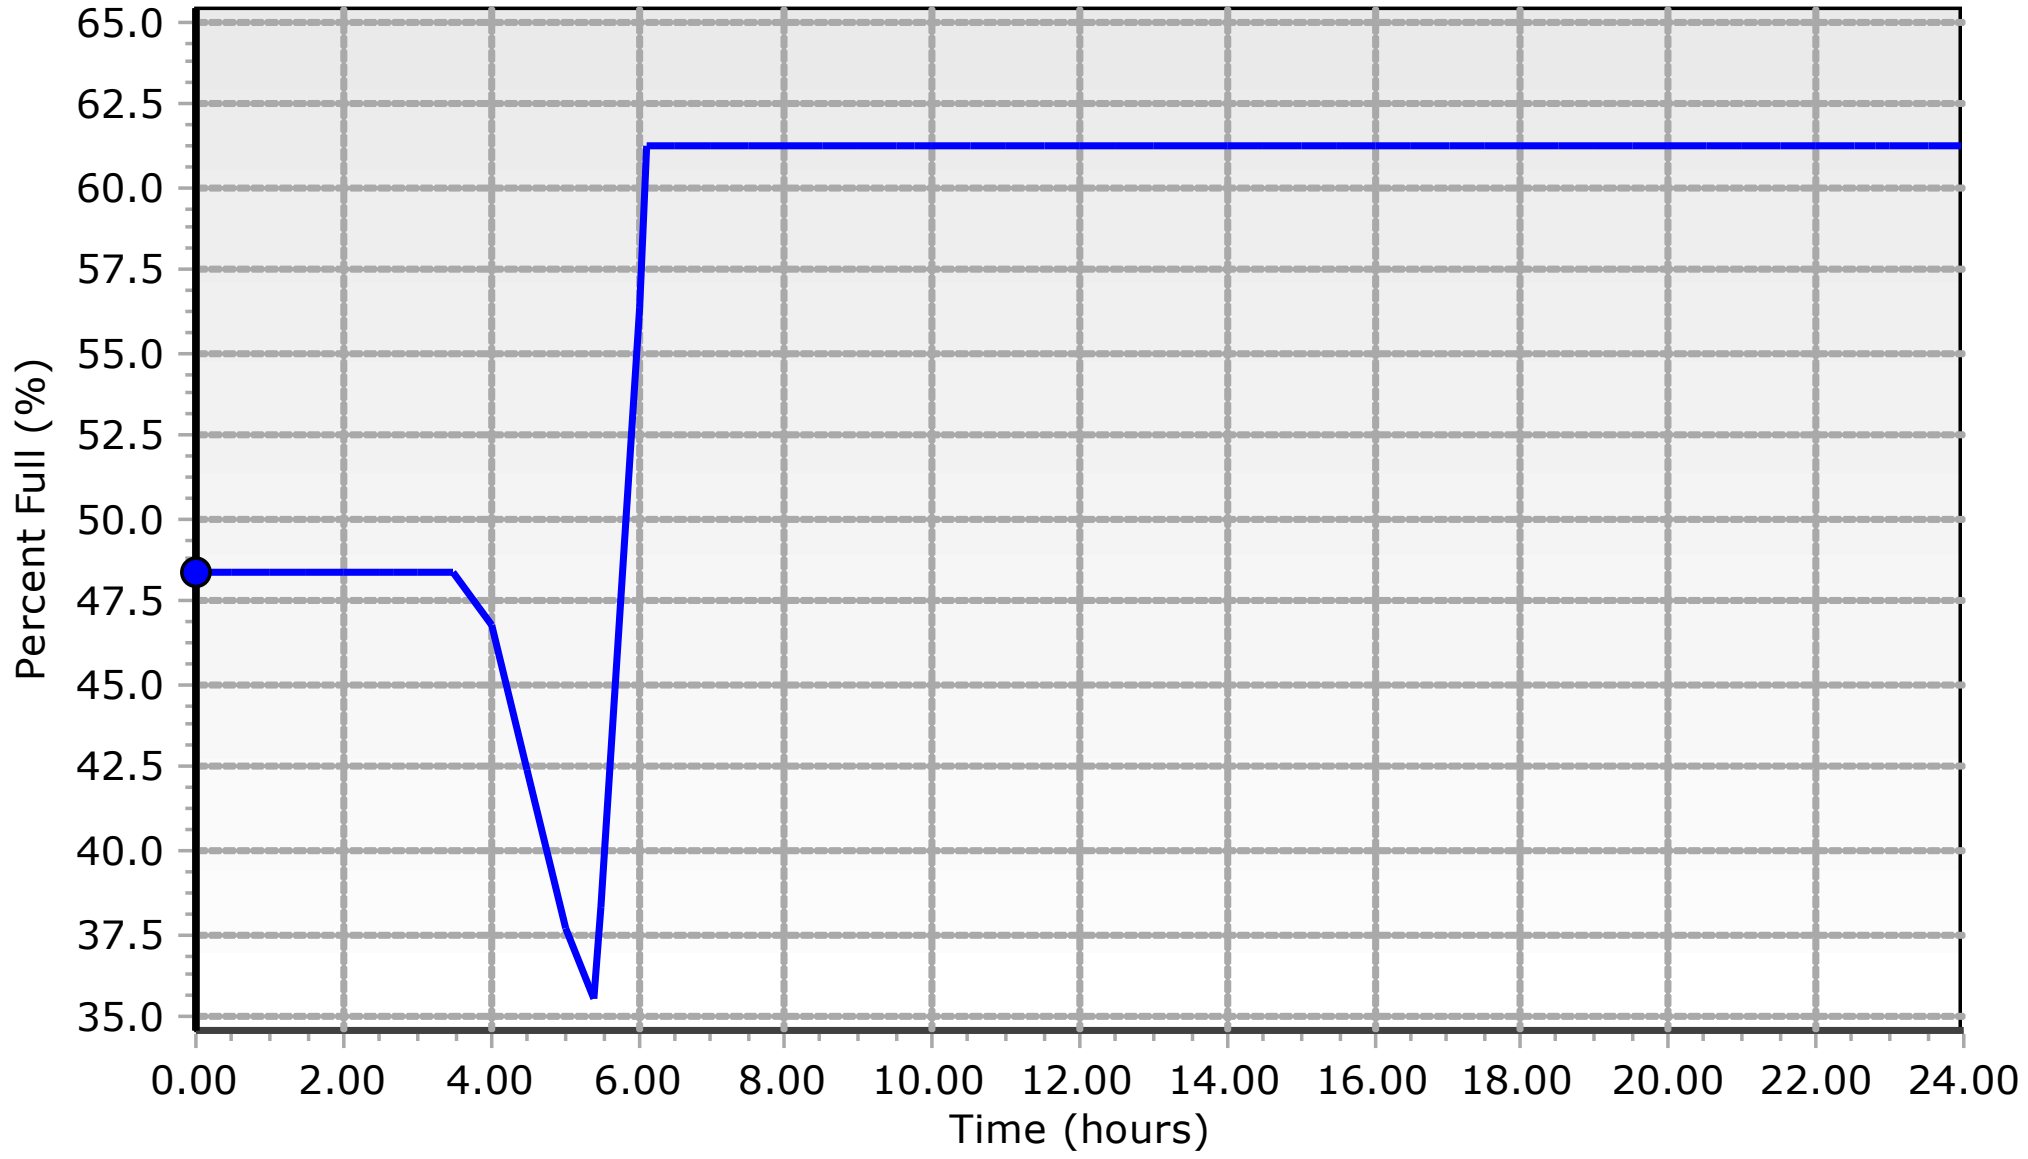


WP 1 GST 1 & 2 - Average Demand EPS - Winter - Percent Full

### WP 1 Water Sources

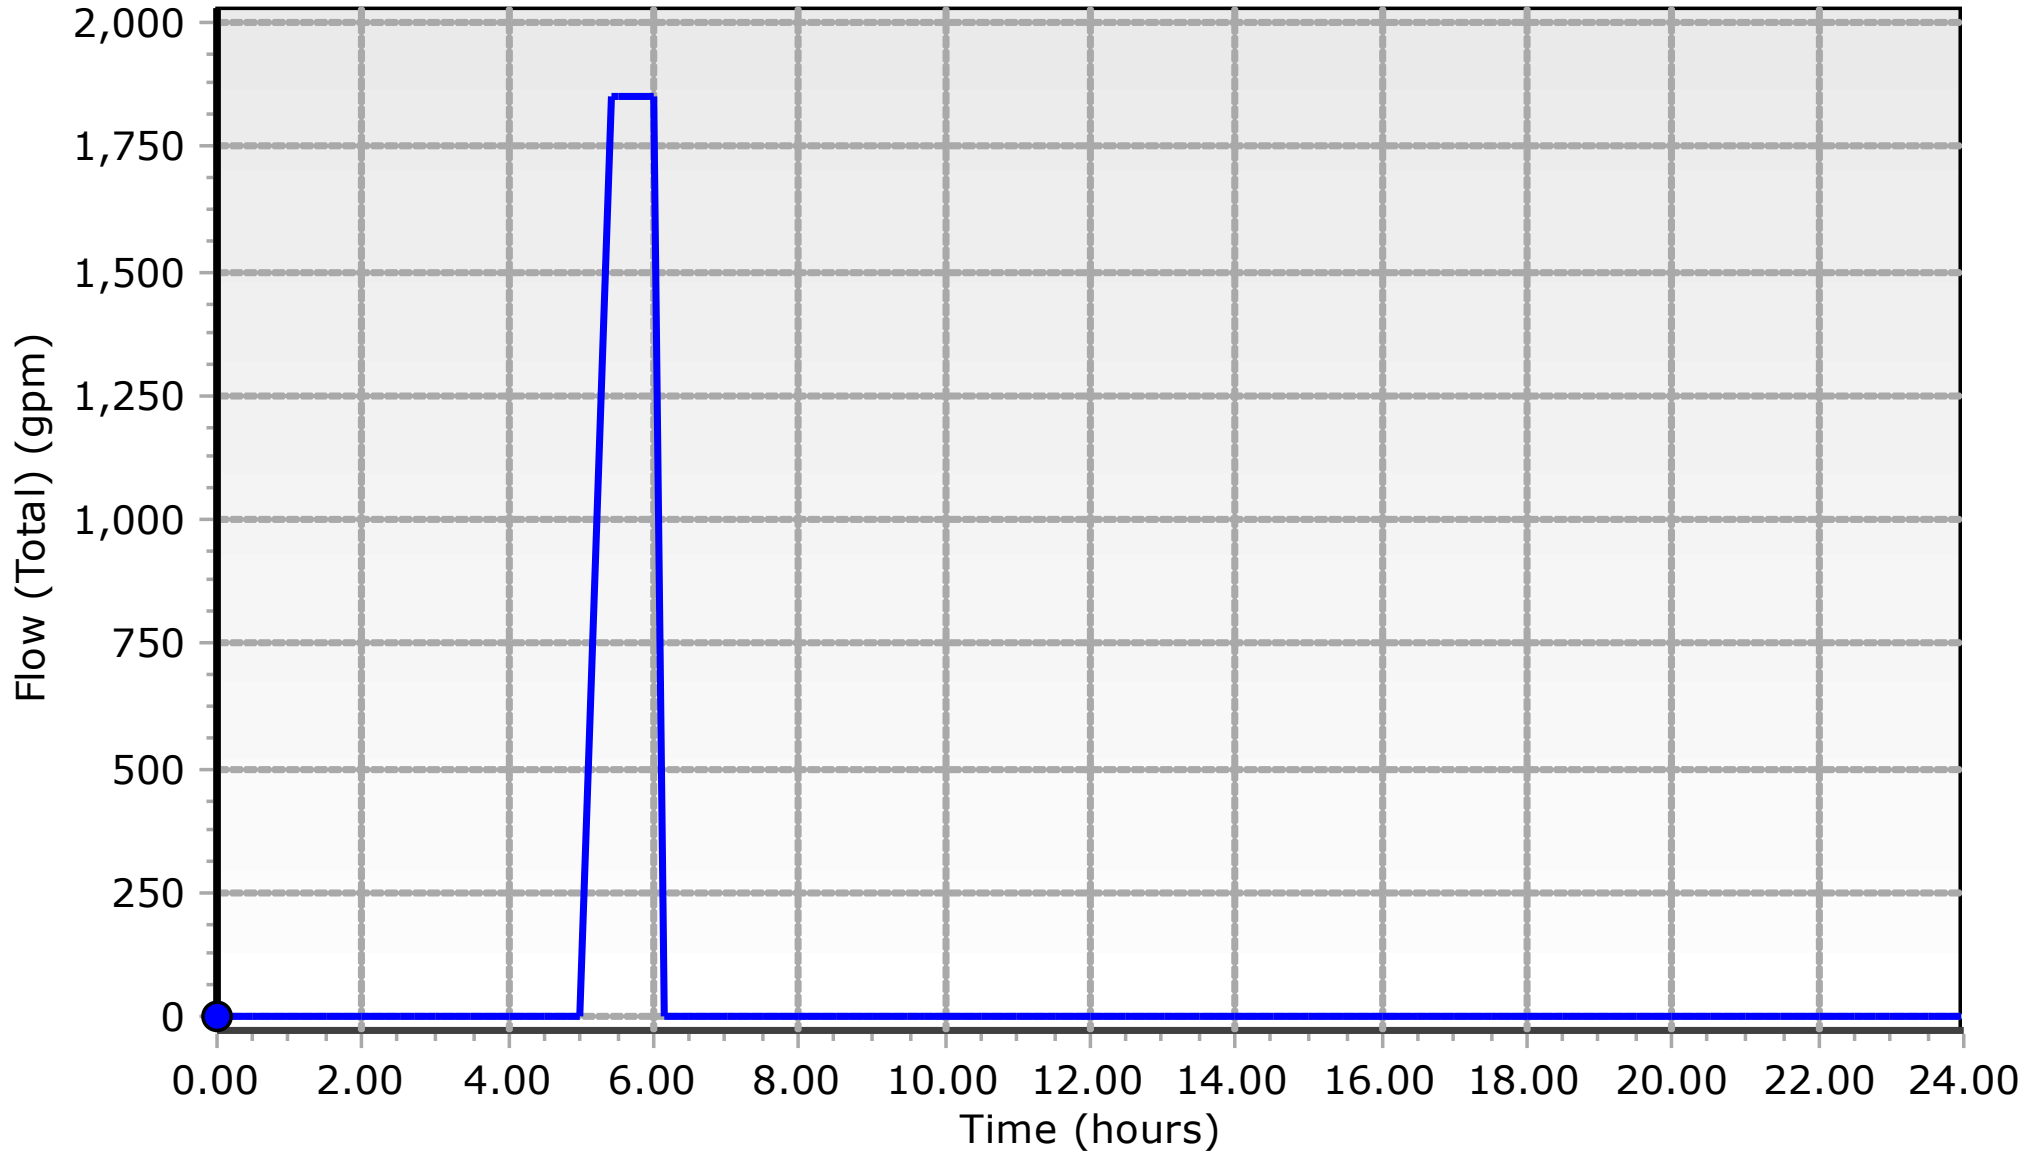

— WW 5 - Average Demand EPS - Winter - Flow (Total)

WP 2 Tank Level

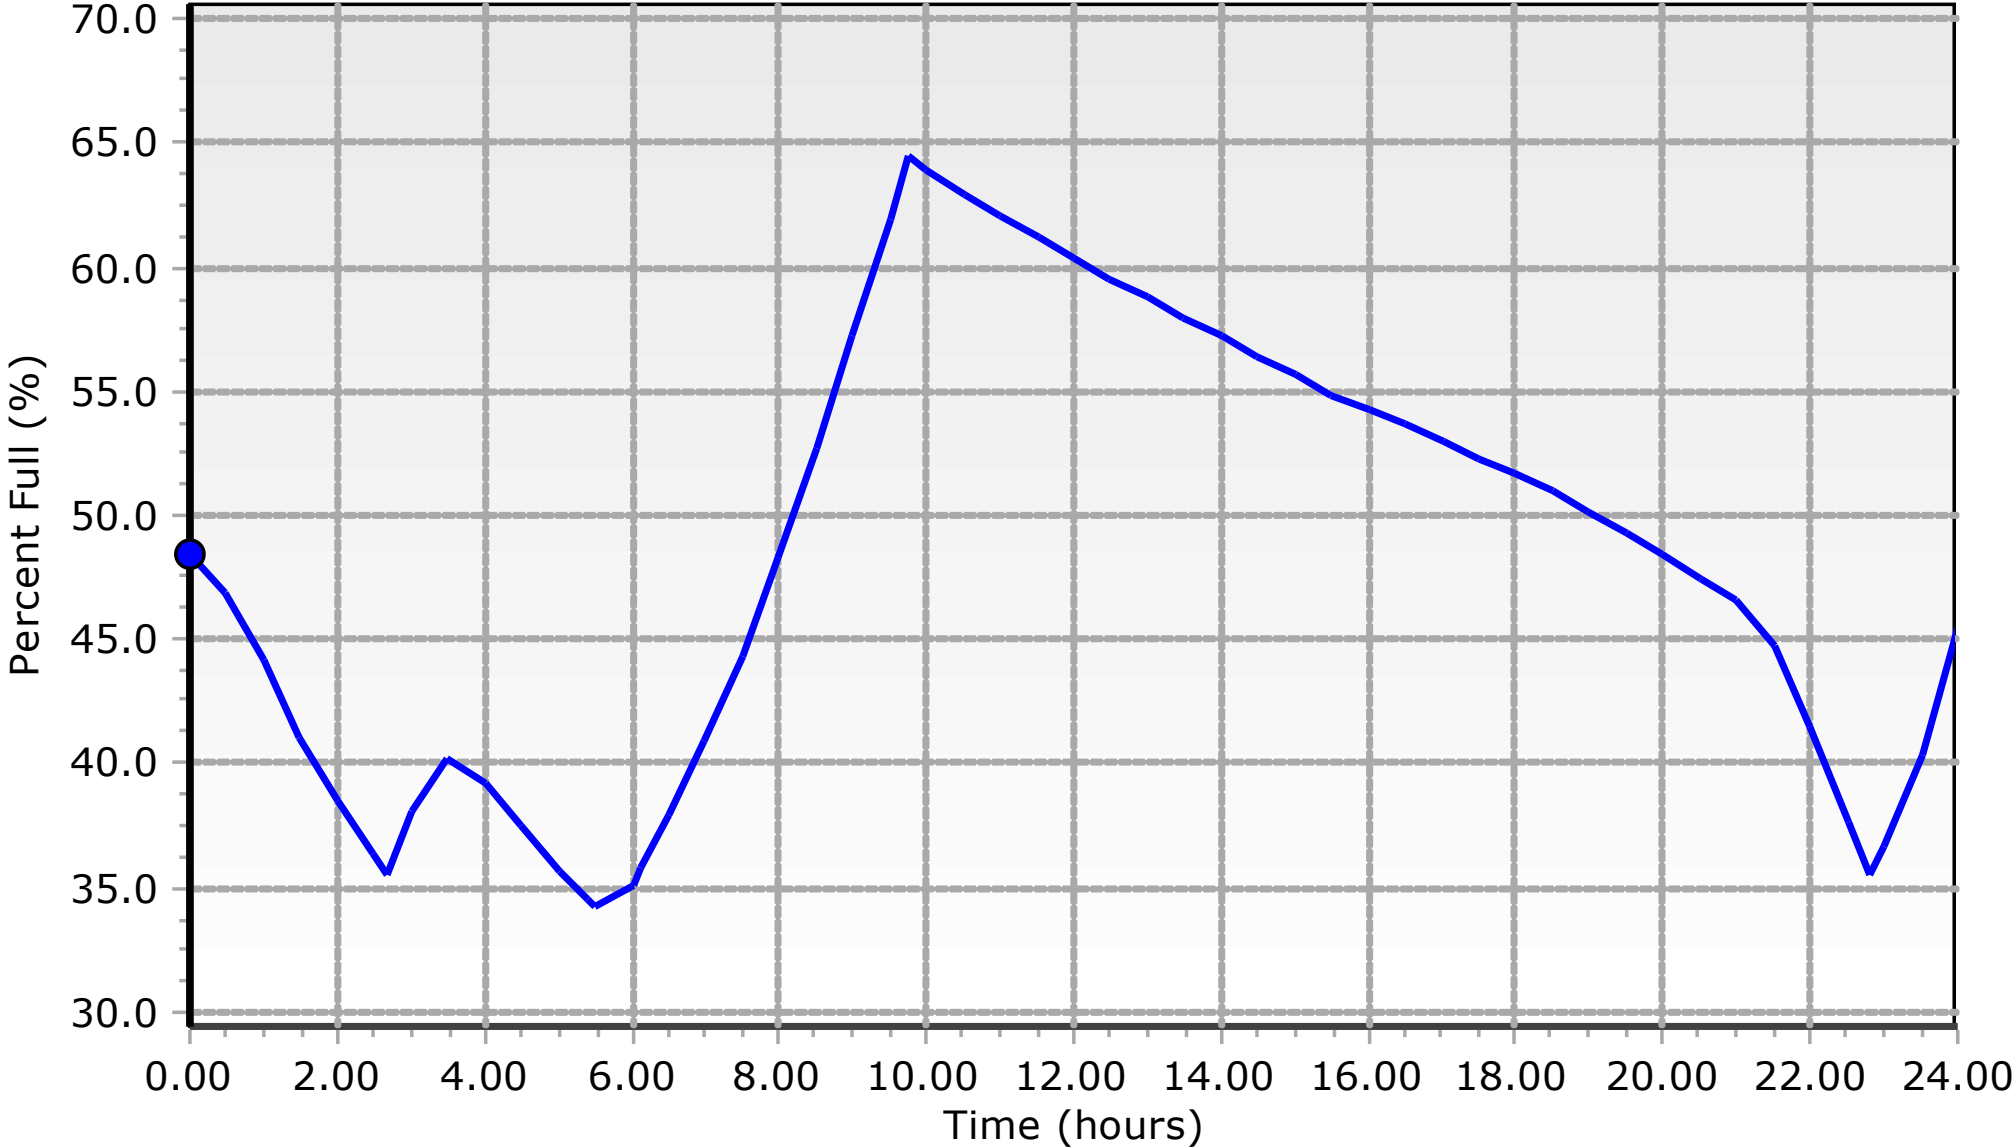

WP 2 GST 1 - Average Demand EPS - Winter - Percent Full



WP 2 Water Sources




— WW 4 - Average Demand EPS - Winter - Flow (Total)

# **24-Hour Average Summer Day Simulation**

Calculation Summary Graph

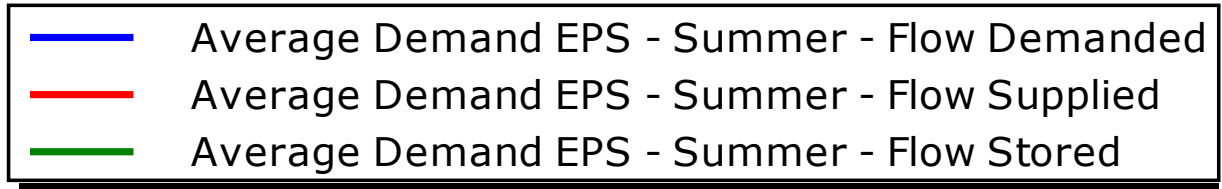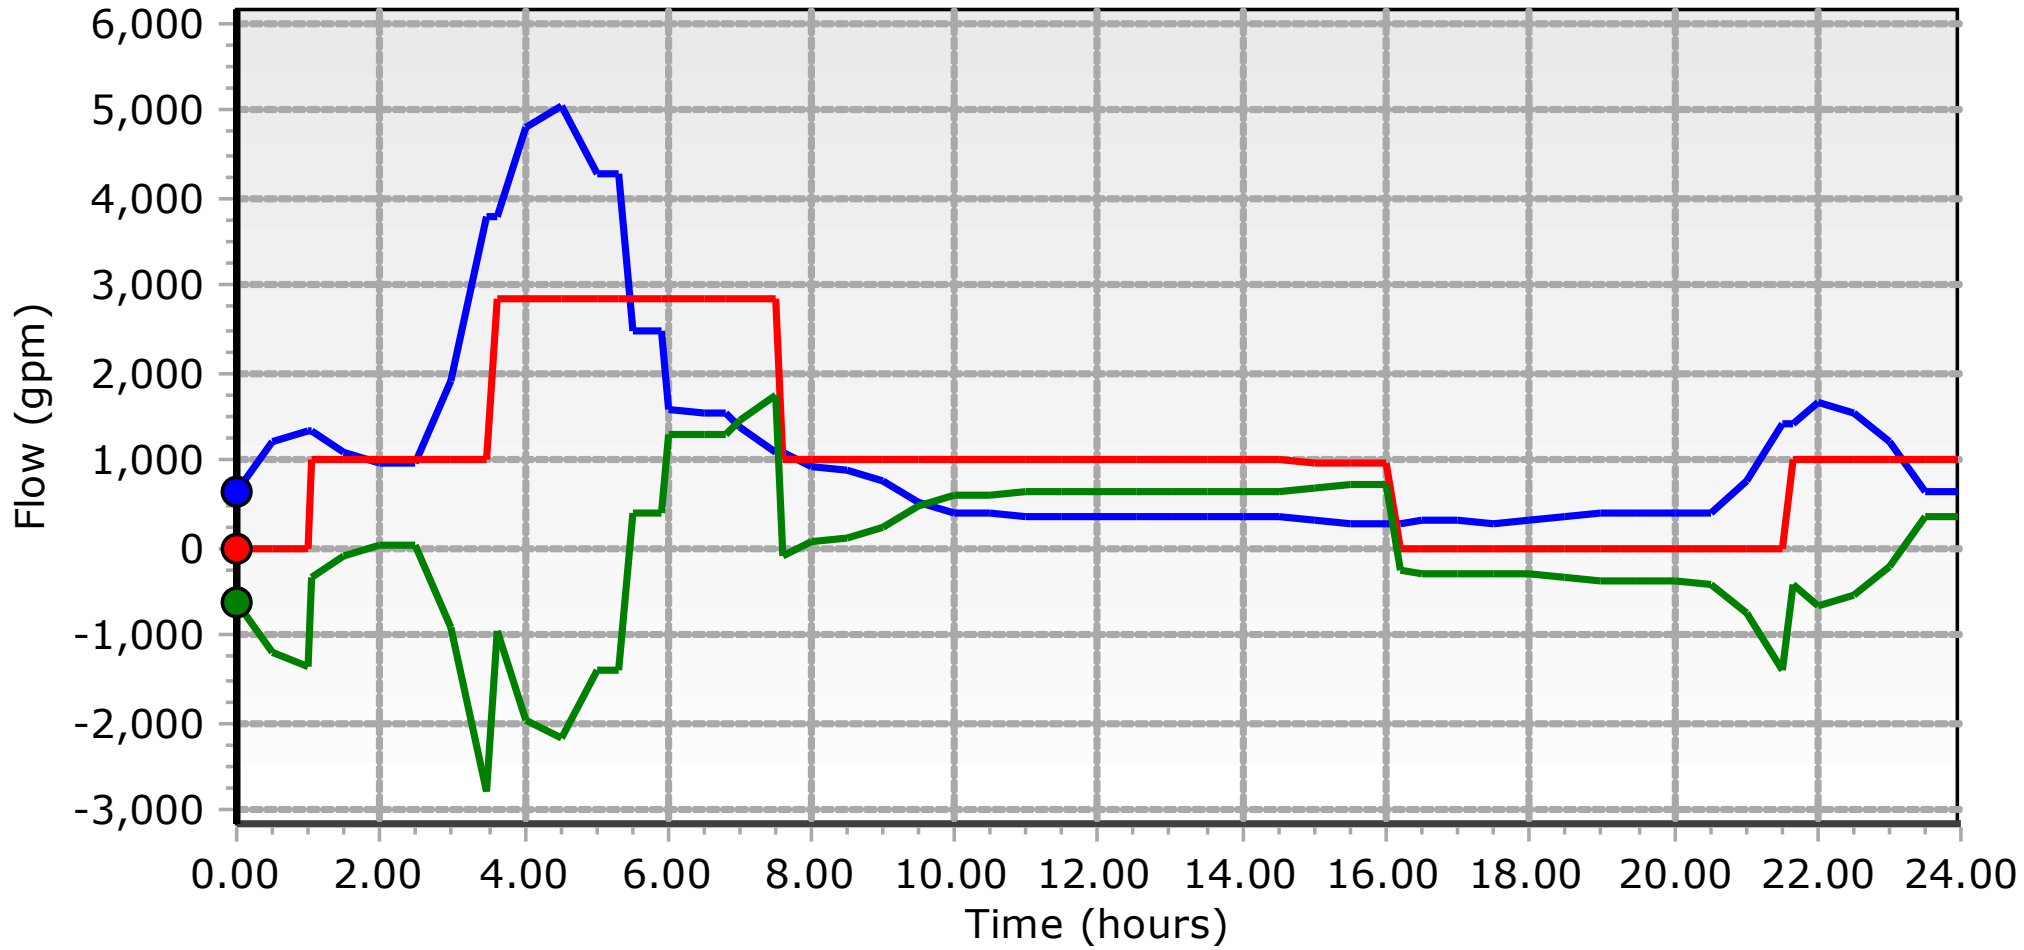


WP 1 Tank Levels

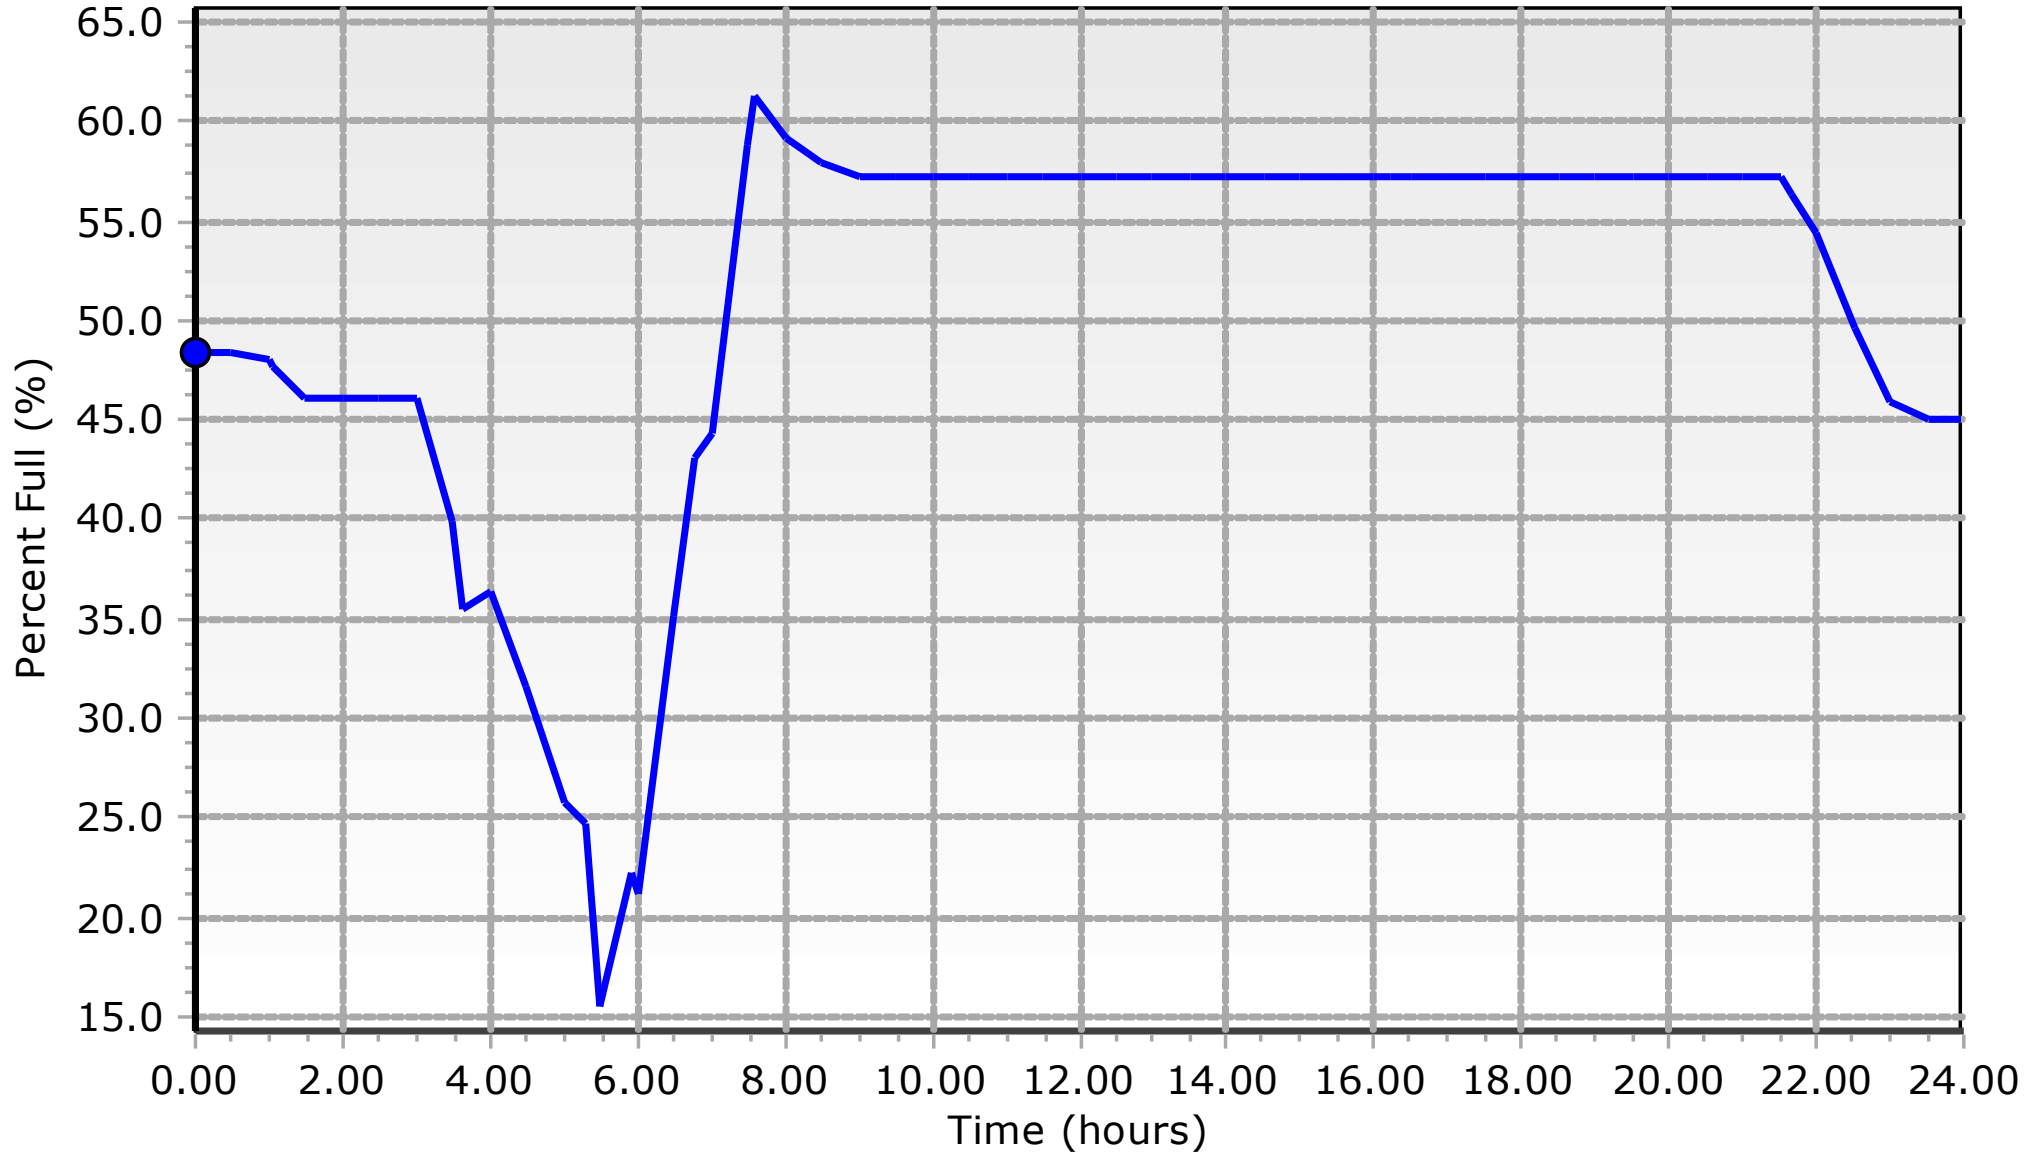


WP 1 GST 1 & 2 - Average Demand EPS - Summer - Percent Full

### WP 1 Water Sources

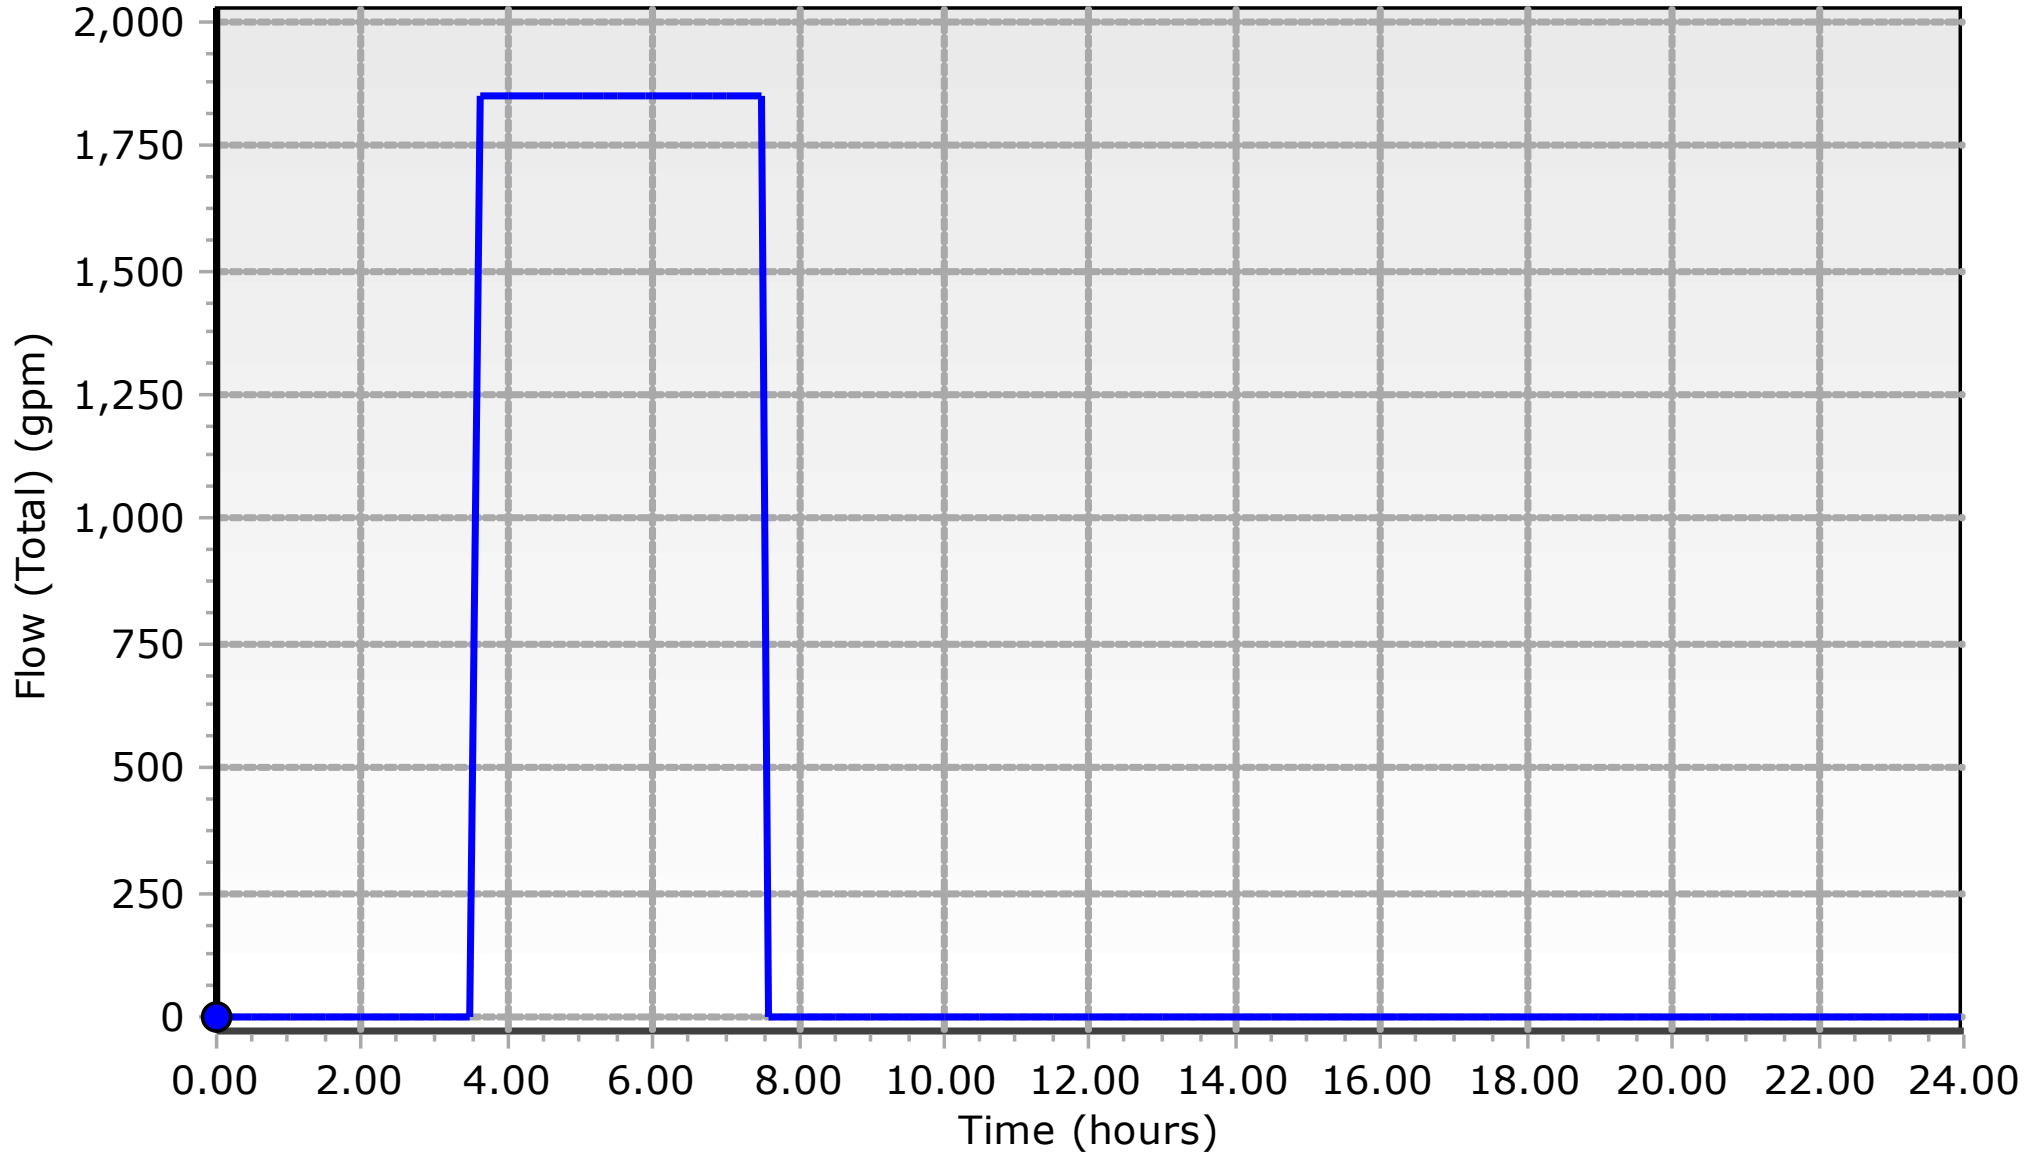


— WW 5 - Average Demand EPS - Summer - Flow (Total)

WP 2 Tank Level

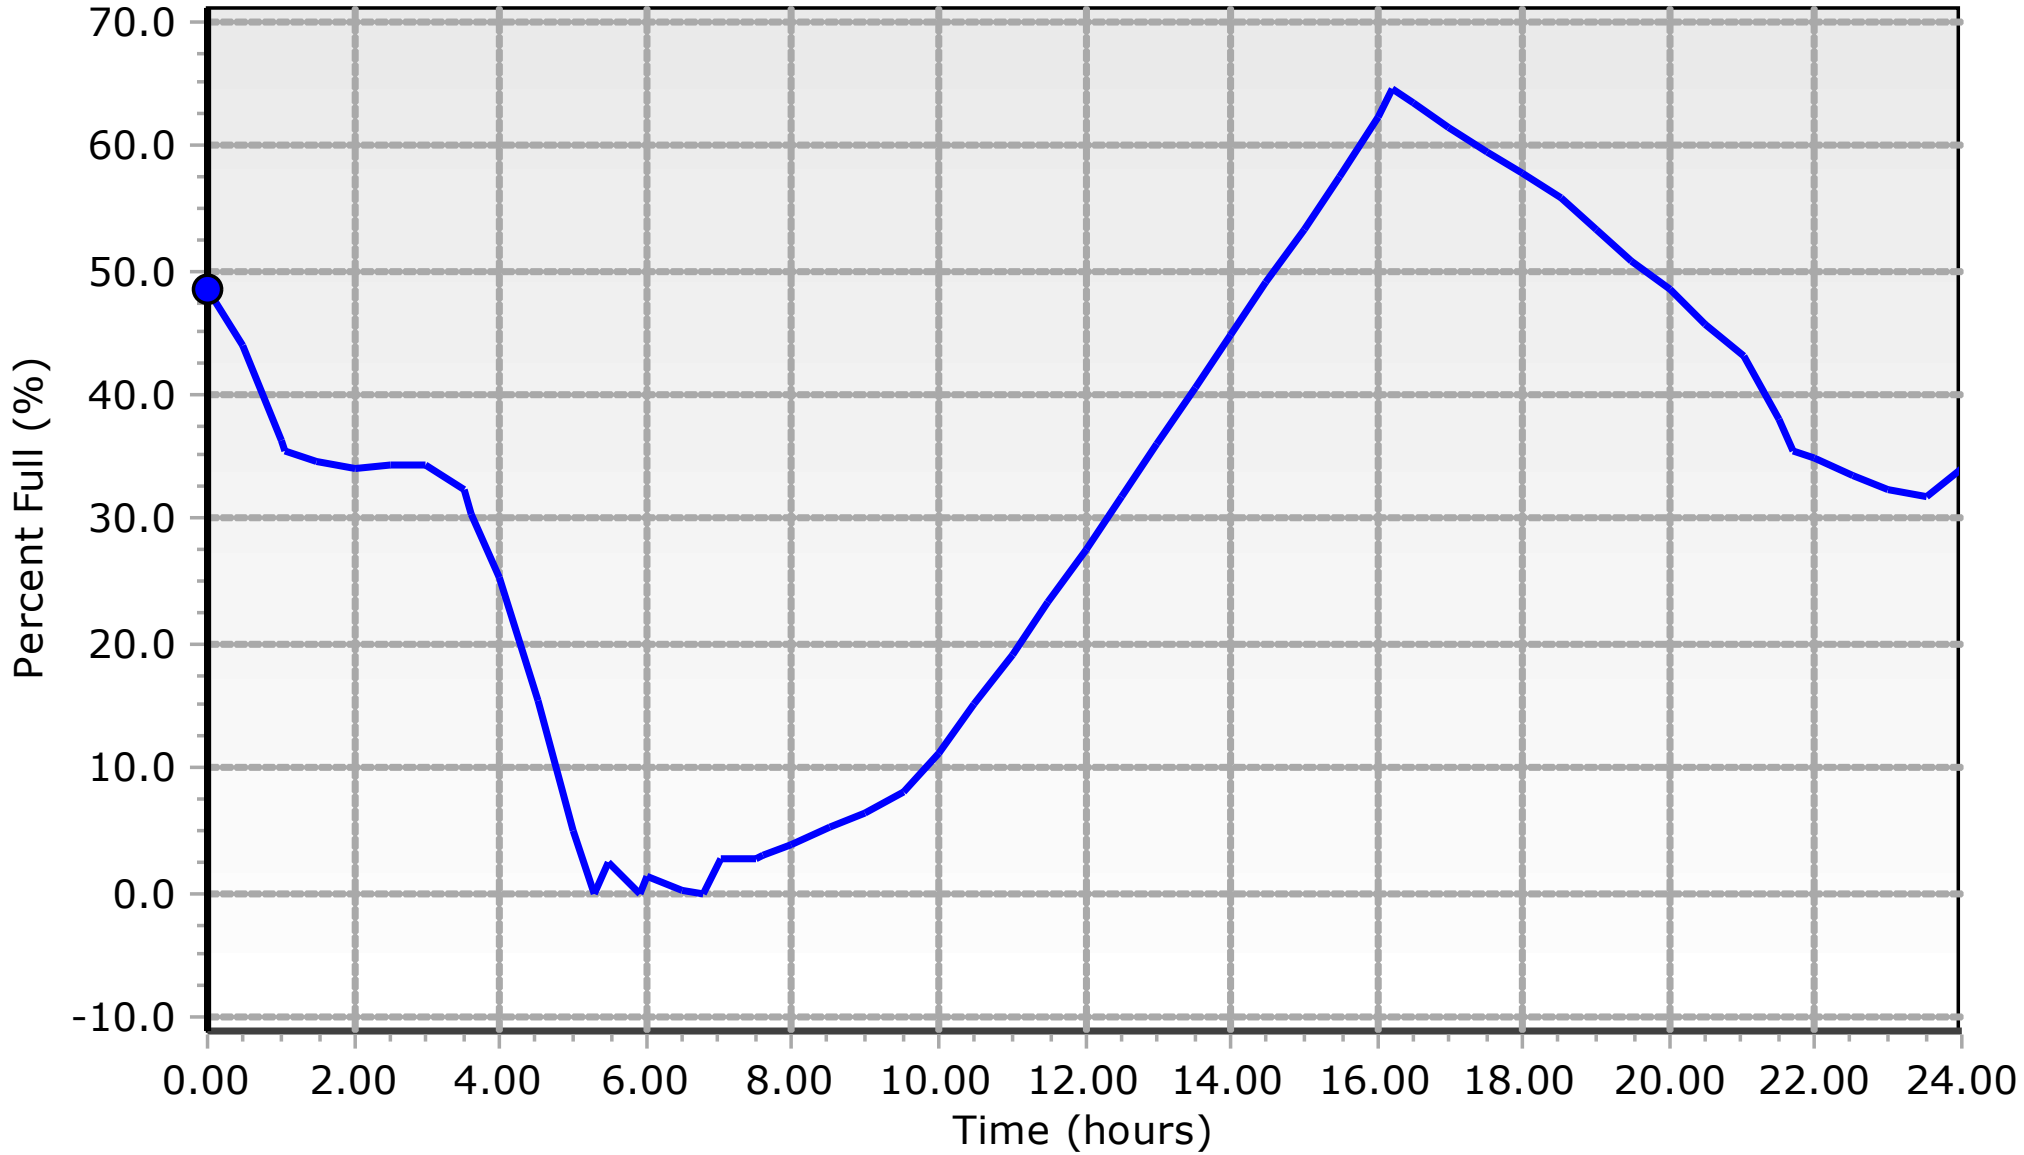

WP 2 GST 1 - Average Demand EPS - Summer - Percent Full


### WP 2 Water Sources

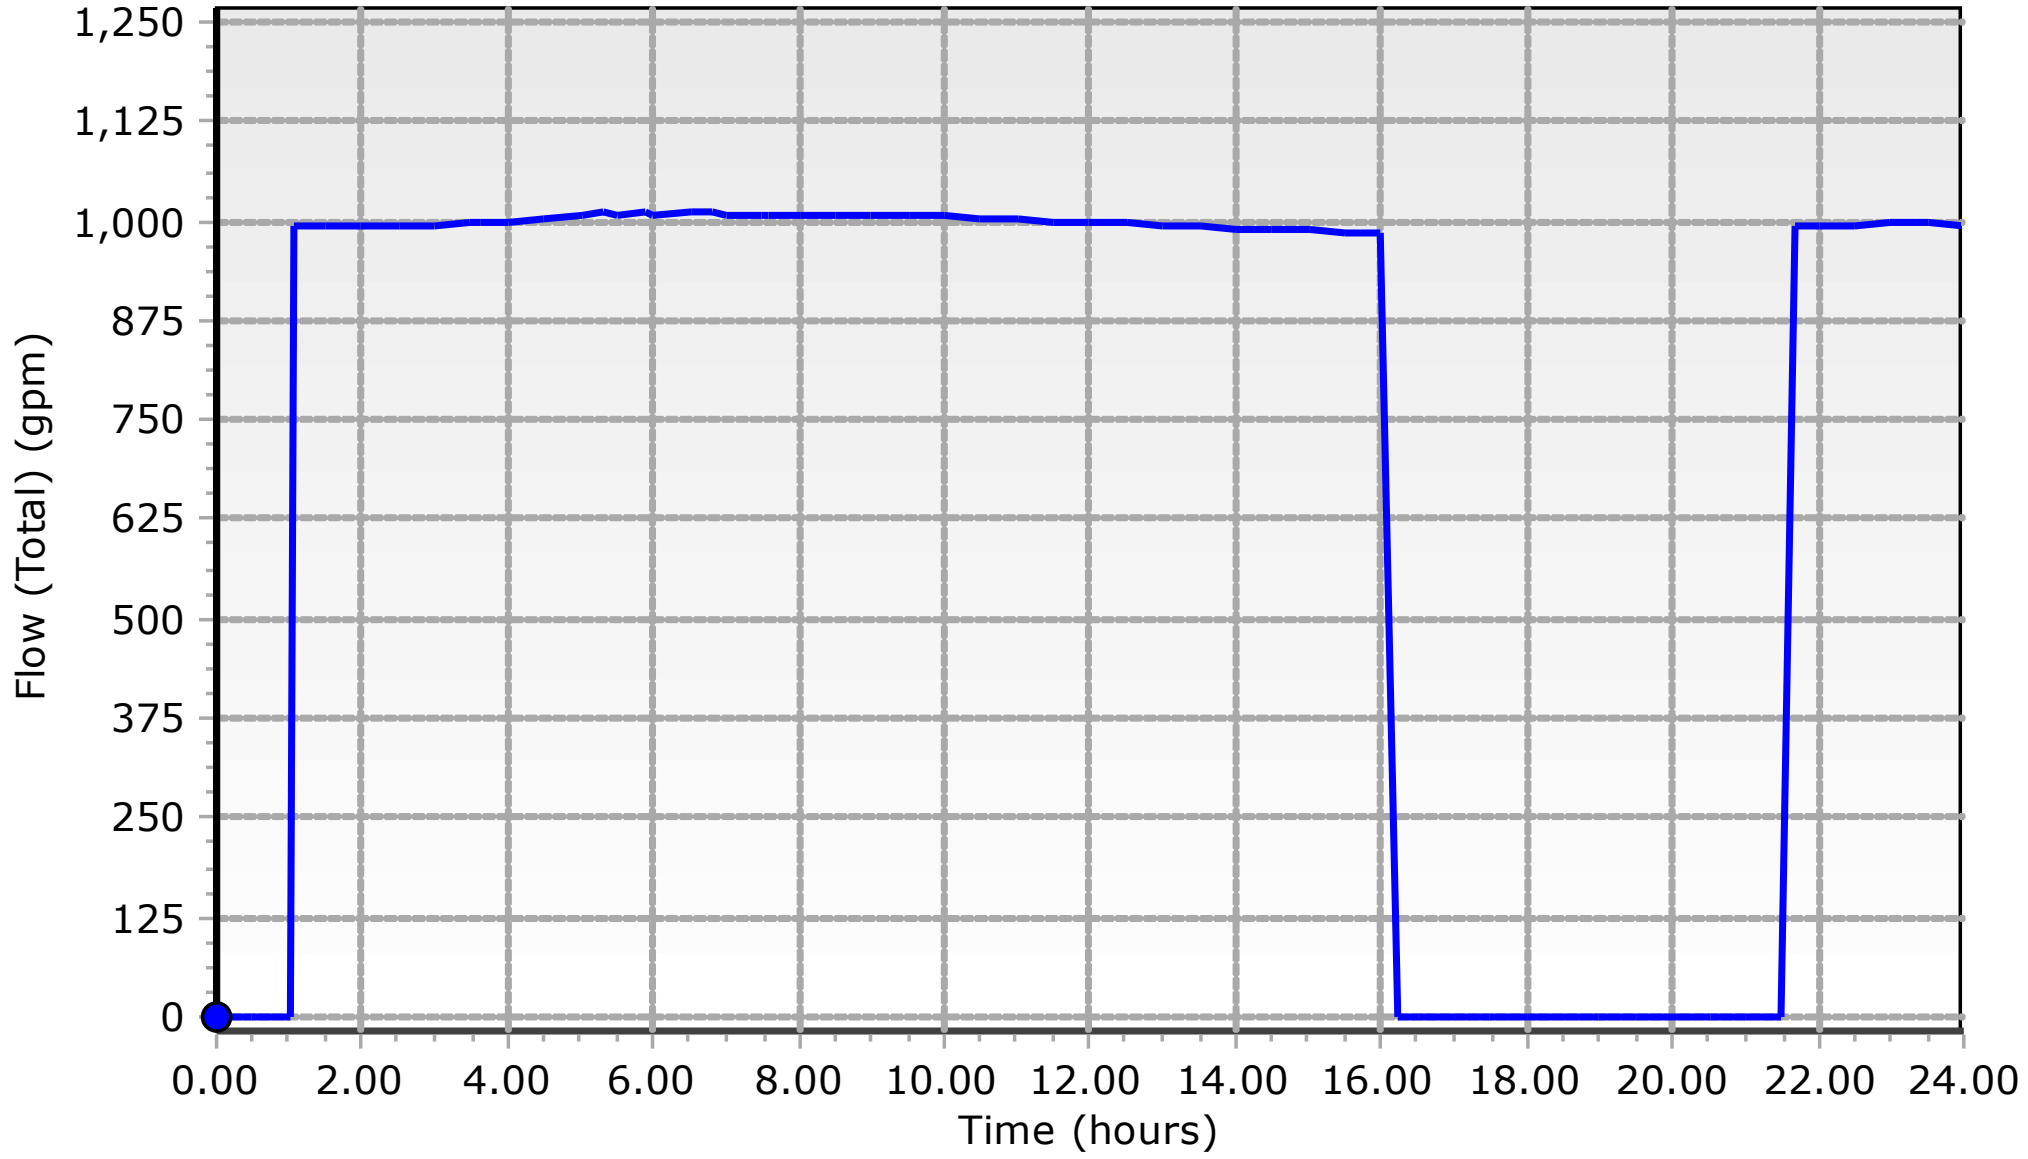

— WW 4 - Average Demand EPS - Summer - Flow (Total)


# **24-Hour Maximum Day Simulation**

Calculation Summary Graph

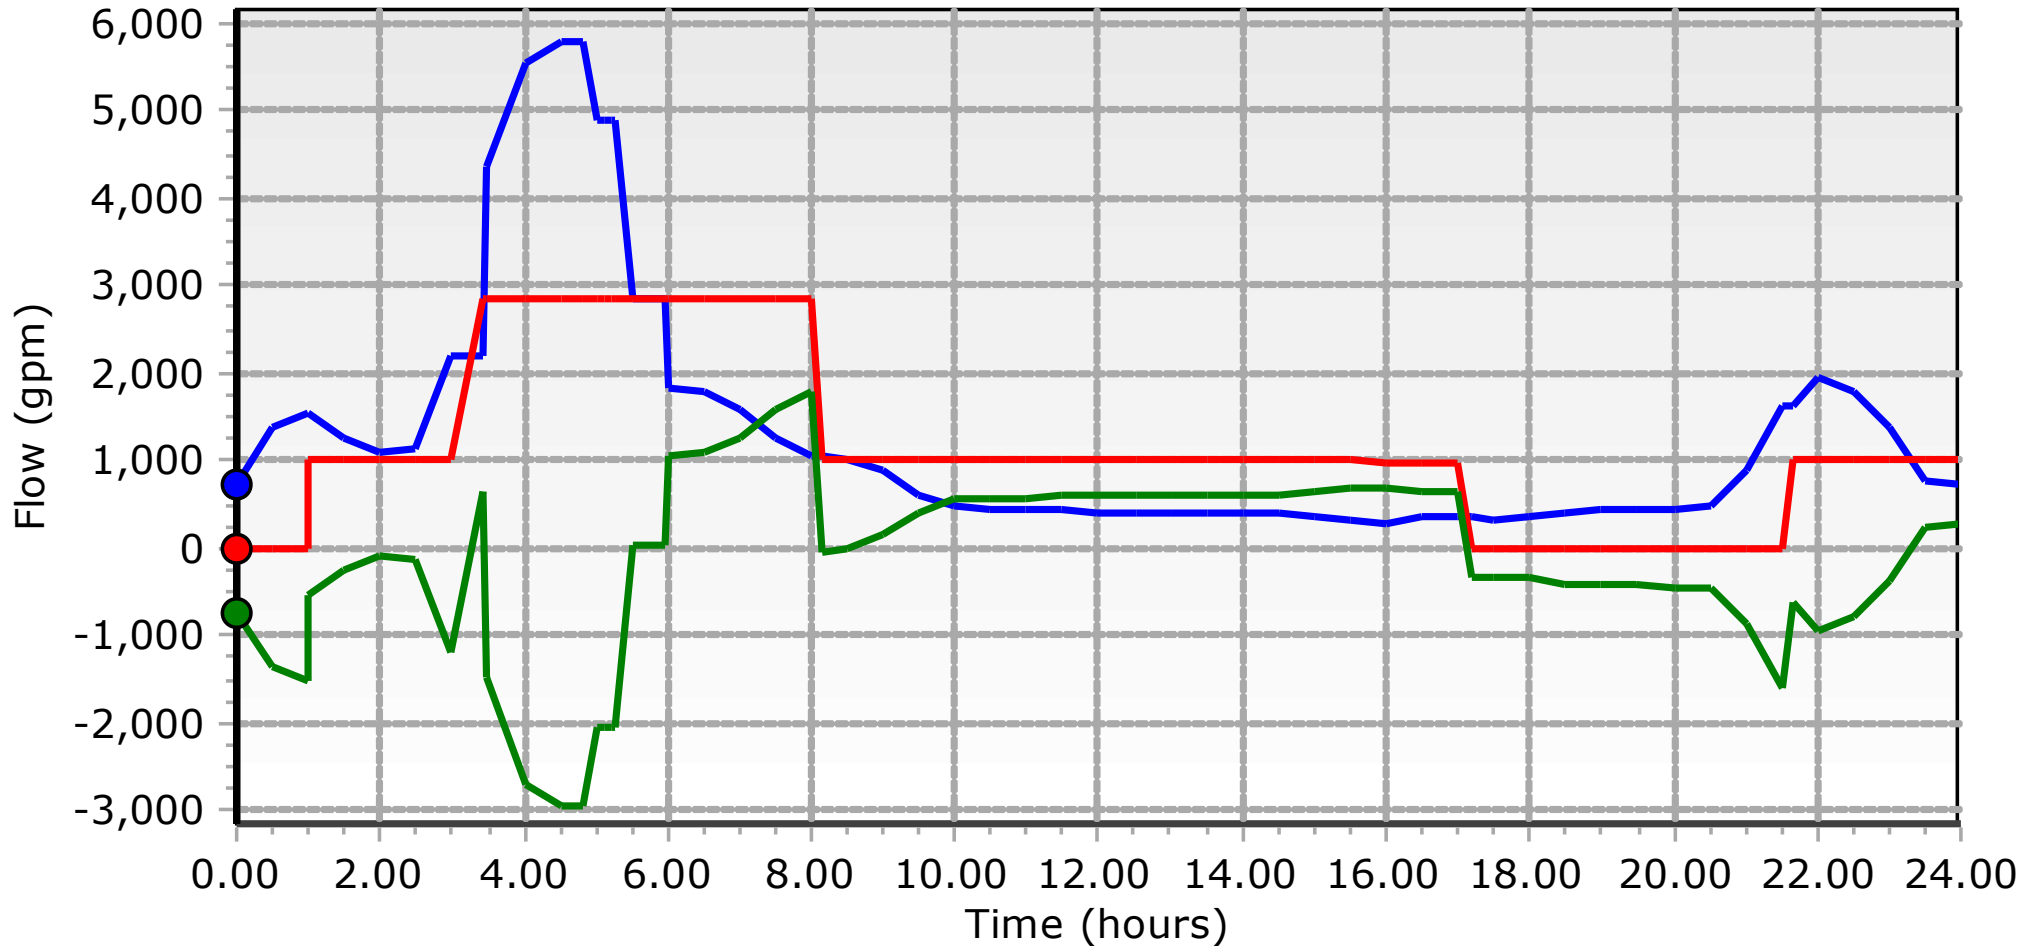


- Maximum Day EPS - Flow Demanded
- Maximum Day EPS - Flow Supplied
- Maximum Day EPS - Flow Stored

WP 1 Tank Levels

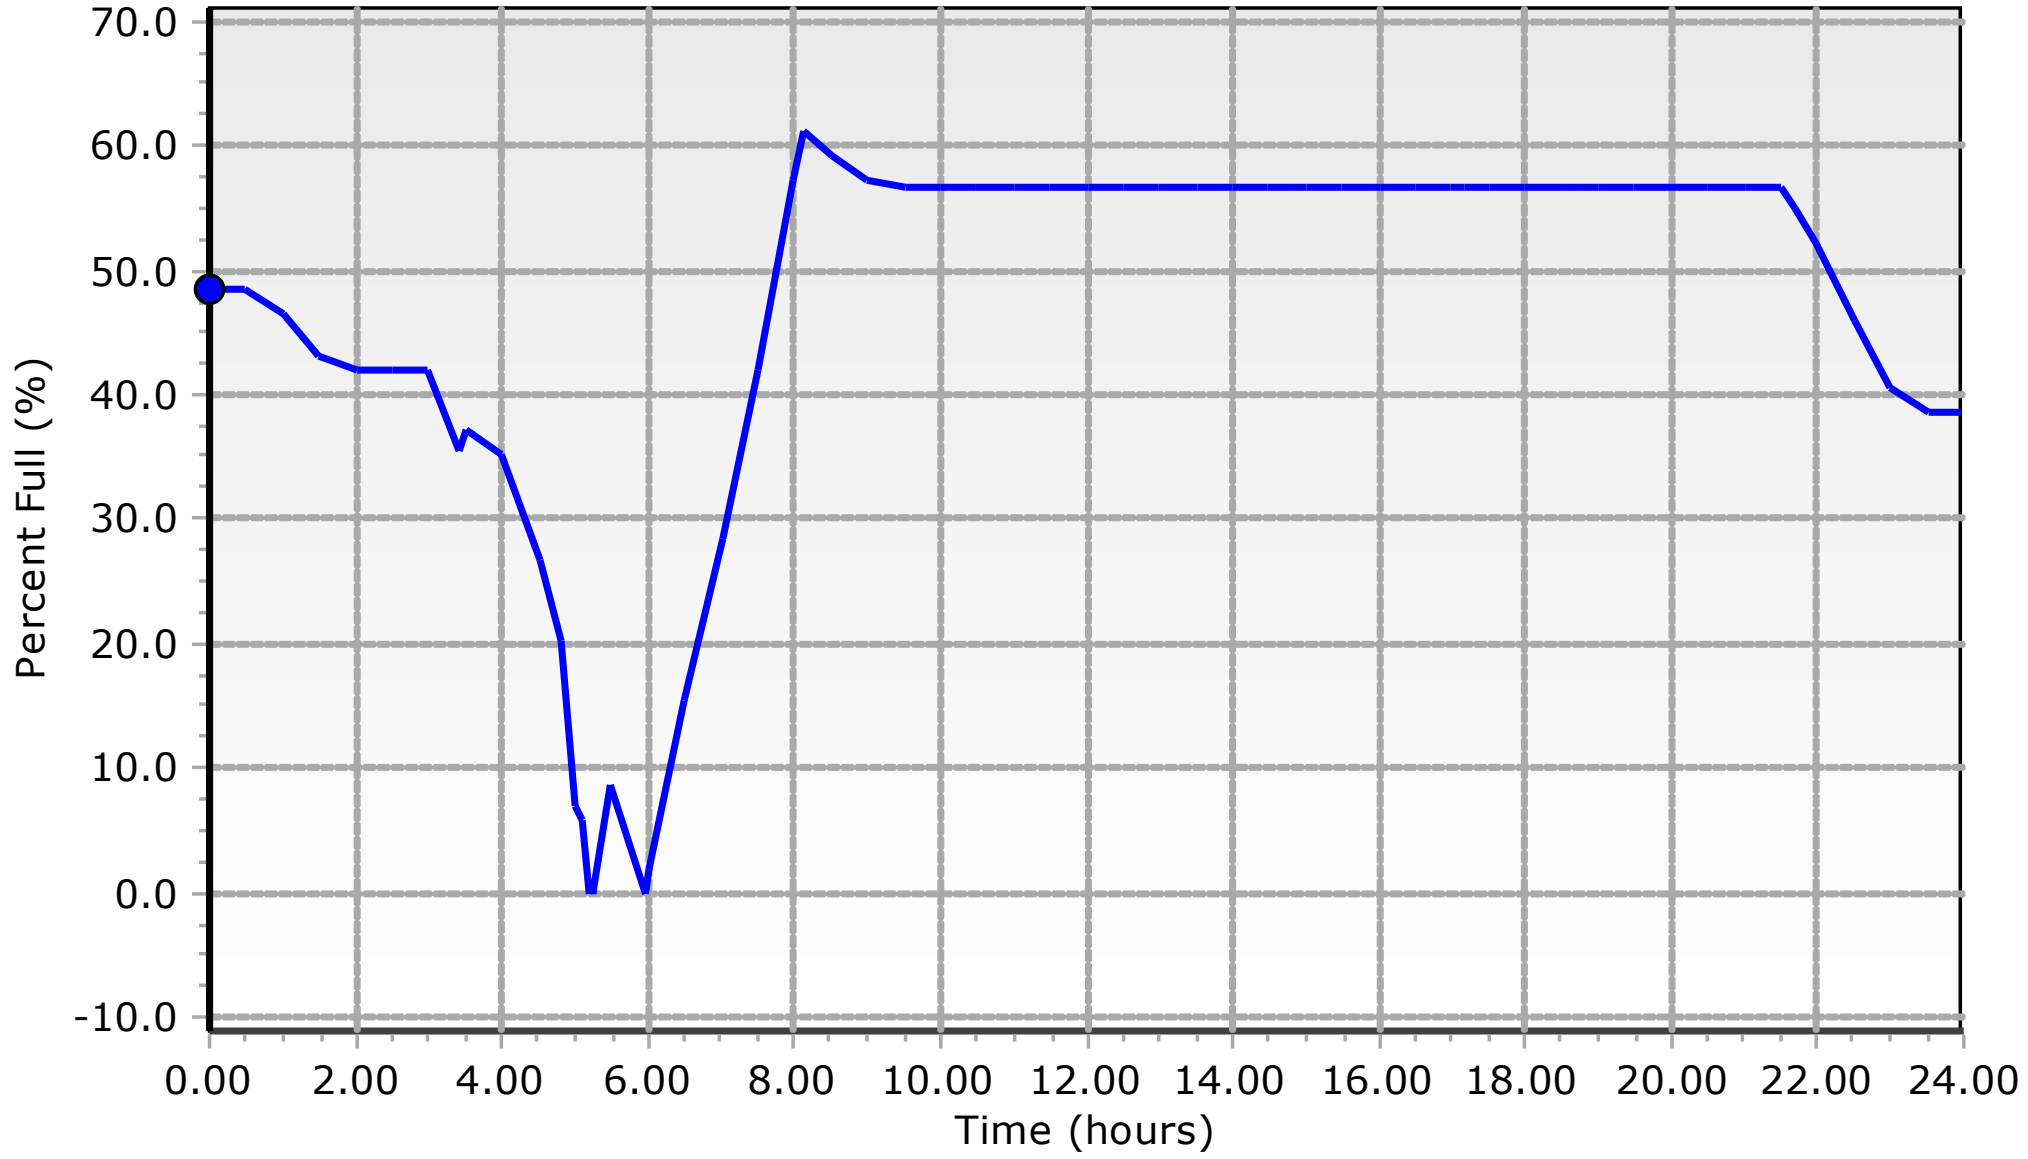


WP 1 GST 1 & 2 - Maximum Day EPS - Percent Full

### WP 1 Water Sources

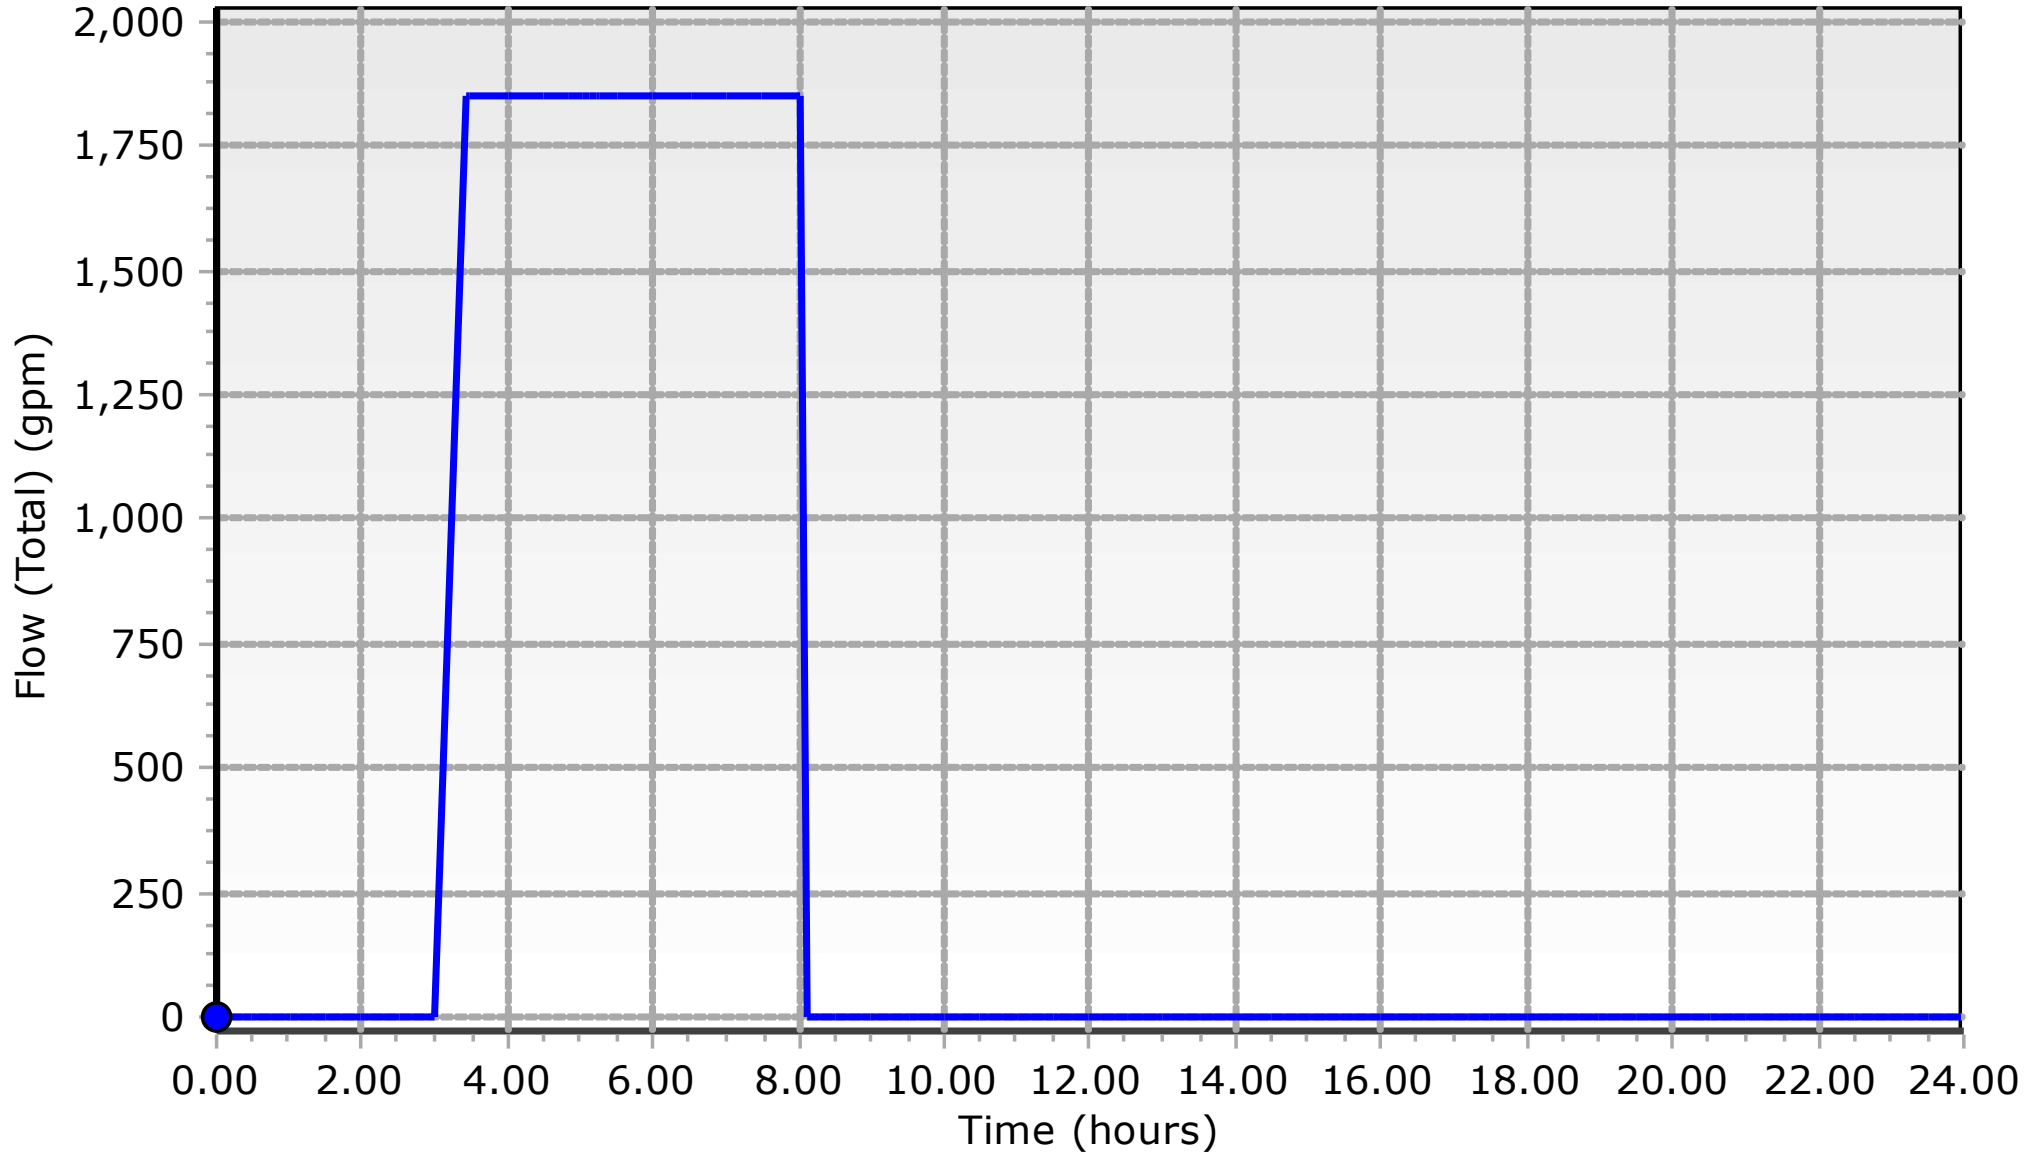


— WW 5 - Maximum Day EPS - Flow (Total)

WP 2 Tank Level

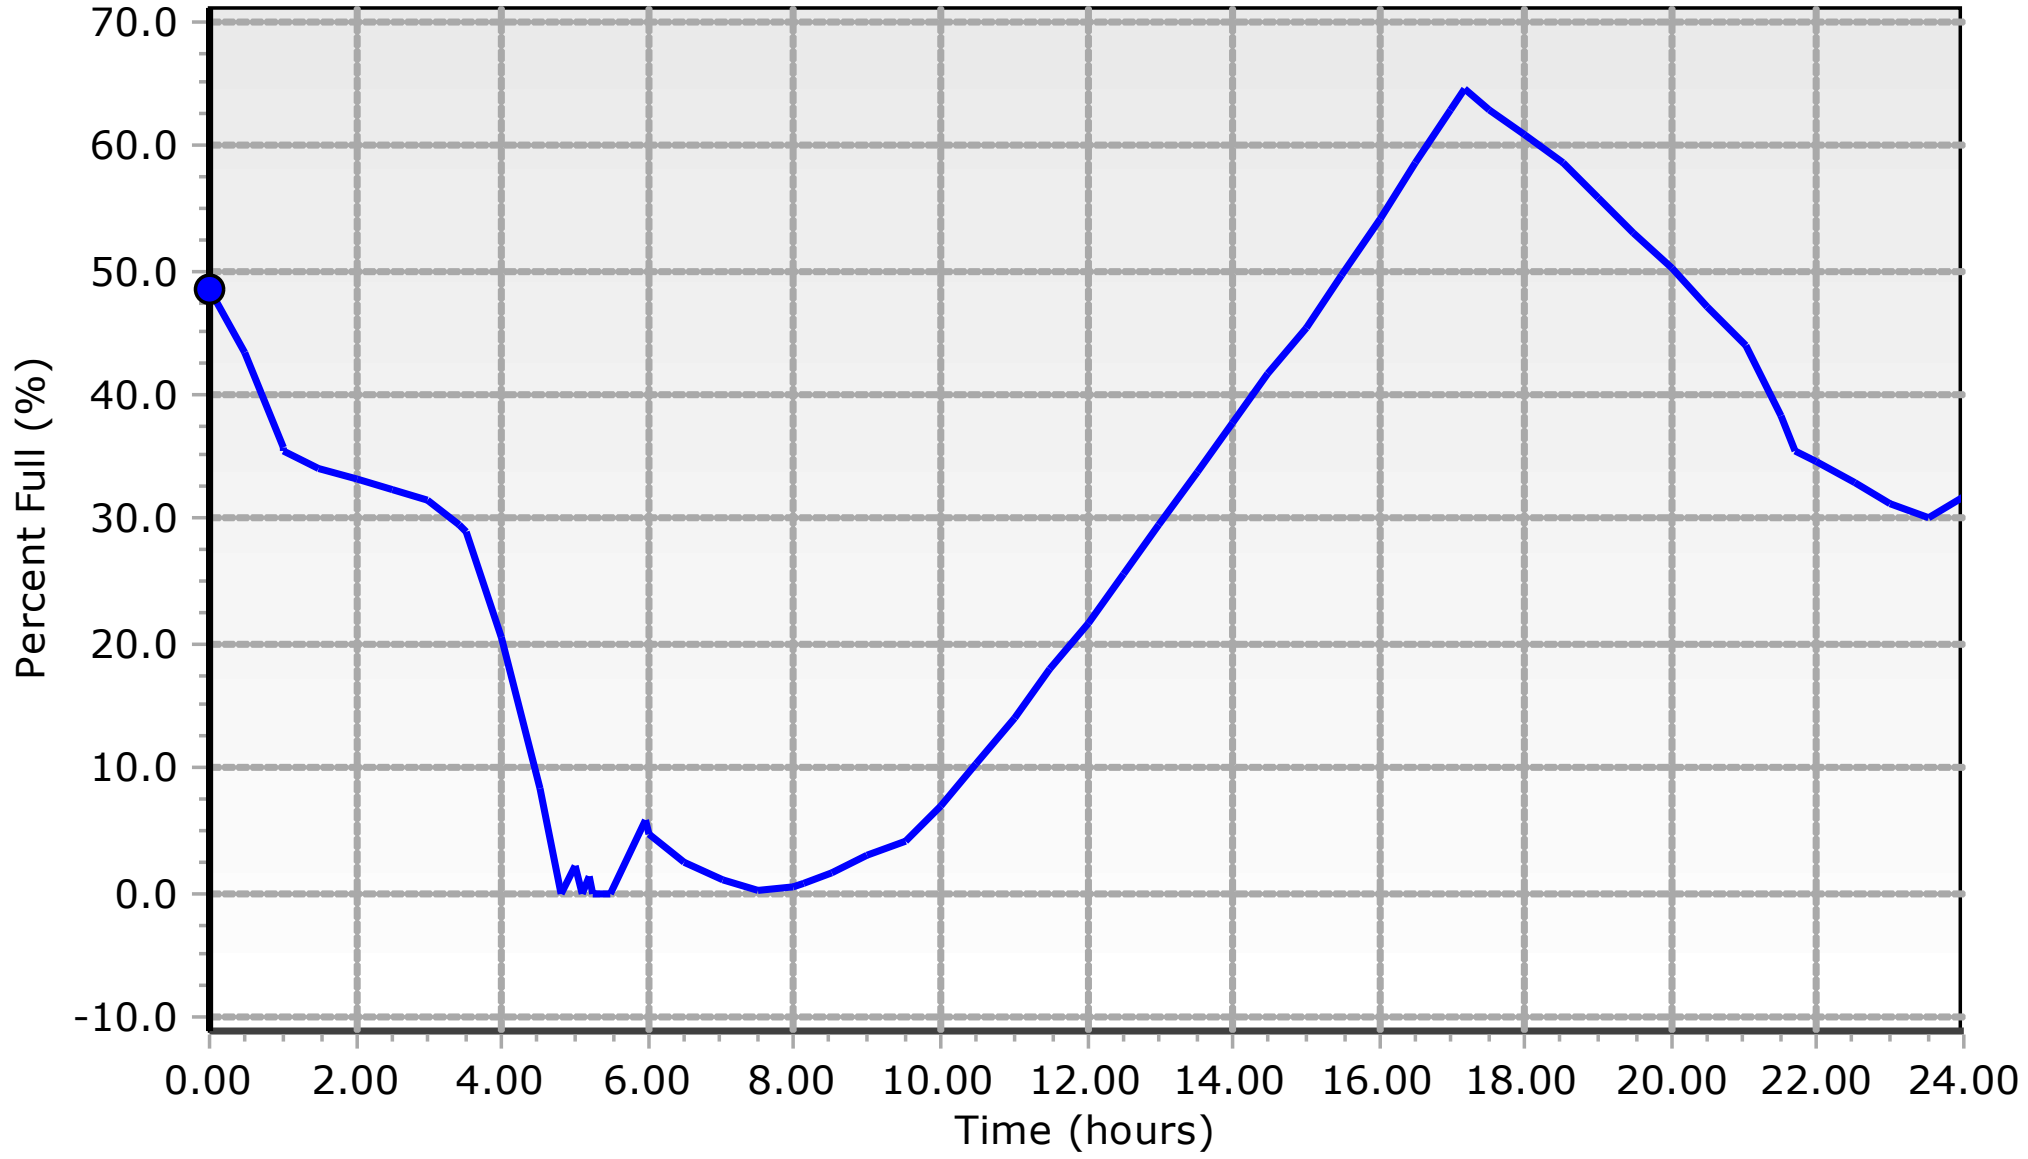

WP 2 GST 1 - Maximum Day EPS - Percent Full

### WP 2 Water Sources

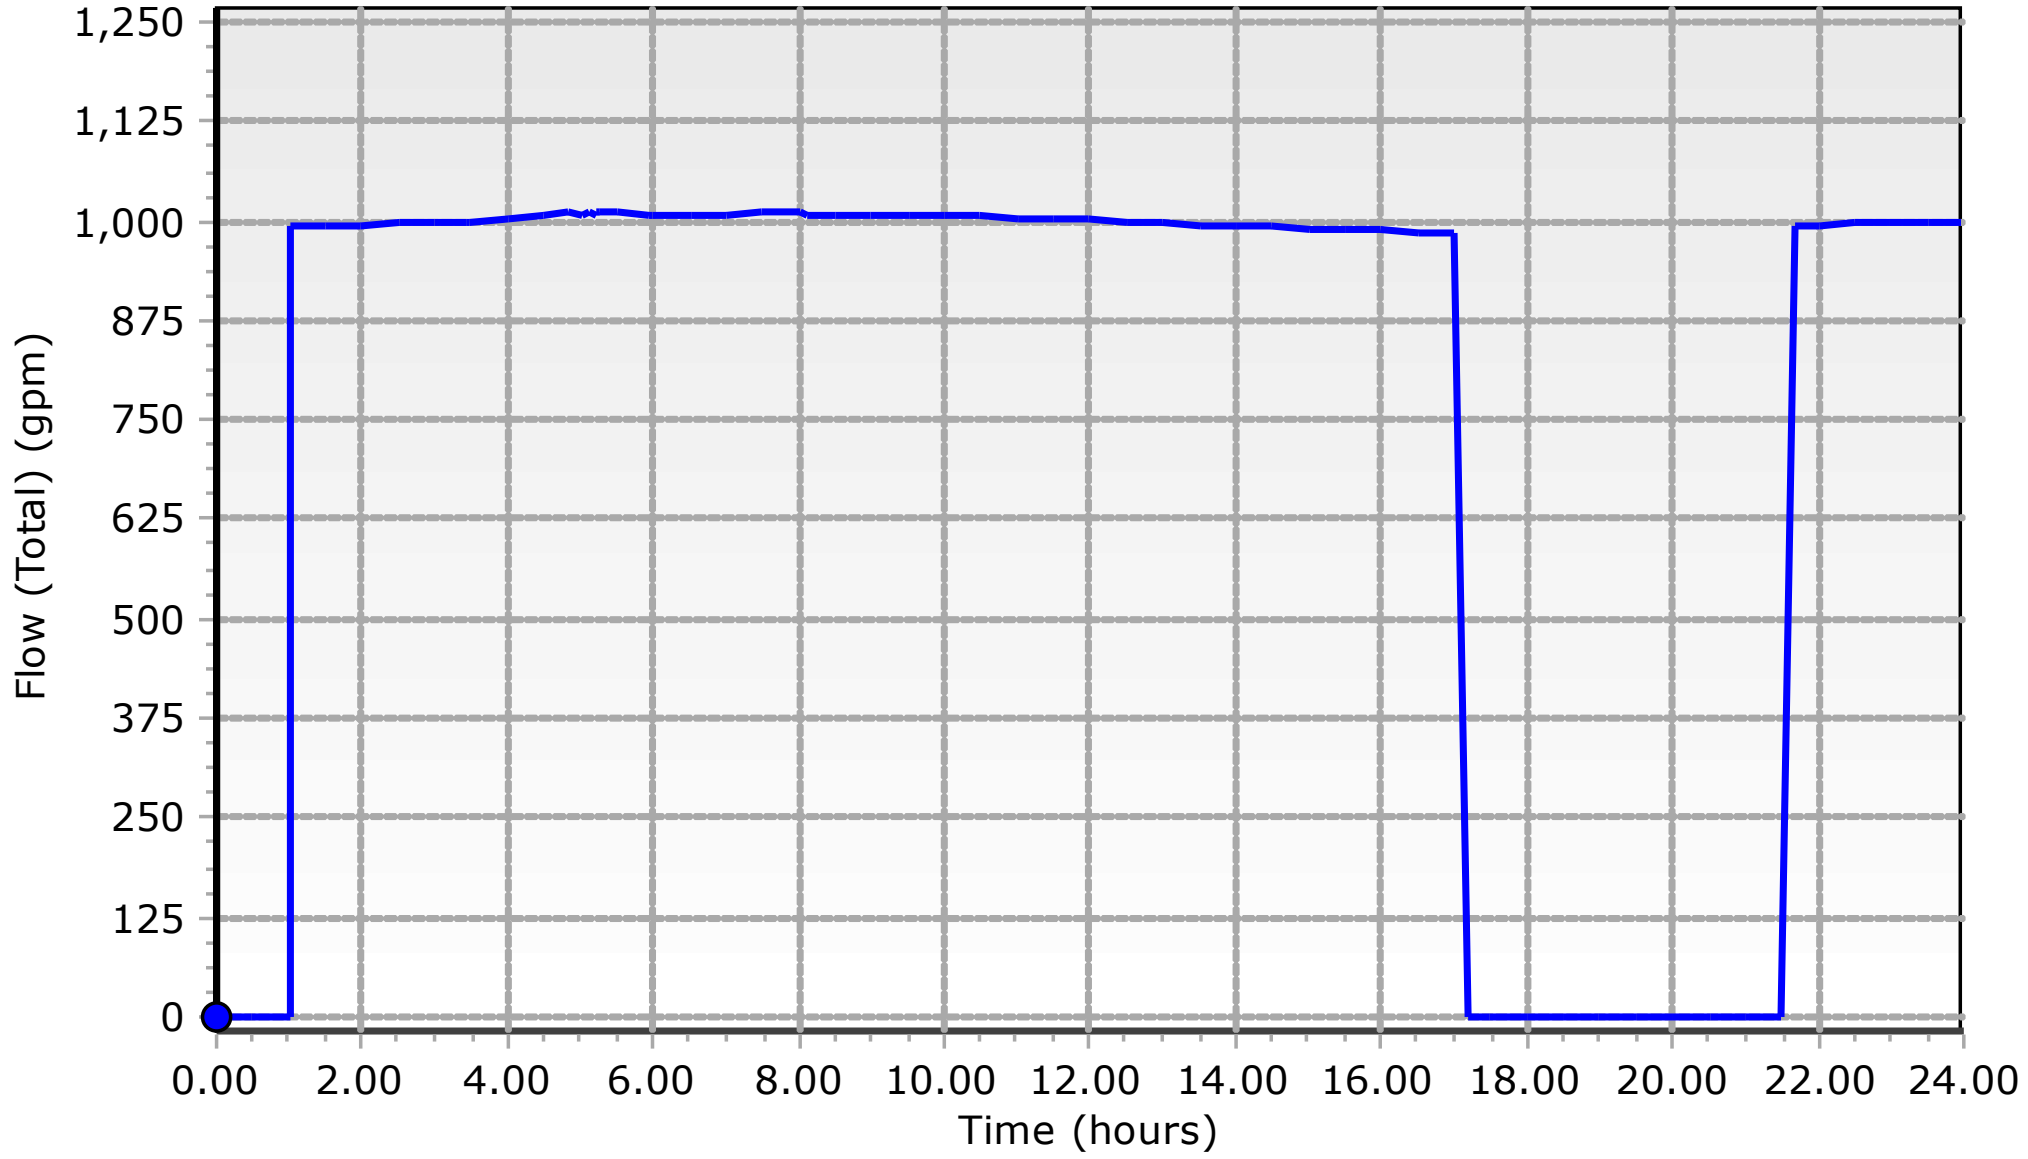

— WW 4 - Maximum Day EPS - Flow (Total)

**Appendix C**  
**Water Line Replacement Cost Estimate**

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - WATER LINE REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>WATER LINE REPLACEMENT (Package 1)</b>						
<b>I</b>	<b>General Items</b>					<b>\$146,706</b>
	Mobilization	1	LS	\$ 62,485.50	\$62,486	
	Site Restoration	8422	LF	\$ 10.00	\$84,220	
<b>II</b>	<b>Water Line Items</b>					<b>\$1,120,490</b>
	6" PVC Waterline by Trenchless Construction	5902	LF	\$ 95.00	\$560,690	
	8" PVC Waterline by Trenchless Construction	1900	LF	\$ 130.00	\$247,000	
	12" PVC Waterline by Trenchless Construction	620	LF	\$ 200.00	\$124,000	
	Cut, Plug, and Abandon 2" Cast Iron Waterline	6	EA	\$ 200.00	\$1,200	
	Cut, Plug, and Abandon 2" Asbestos Cement Waterline	1	EA	\$ 400.00	\$400	
	Cut, Plug, and Abandon 3" Asbestos Cement Waterline	4	EA	\$ 500.00	\$2,000	
	Cut, Plug, and Abandon 4" Asbestos Cement Waterline	2	EA	\$ 600.00	\$1,200	
	Cut, Plug, and Abandon 6" Asbestos Cement Waterline	2	EA	\$ 1,000.00	\$2,000	
	Cut, Plug, and Abandon 8" Asbestos Cement Waterline	2	EA	\$ 1,500.00	\$3,000	
	6"x6" Tapping Sleeve and Valve	4	EA	\$ 5,000.00	\$20,000	
	6"x8" Tapping Sleeve and Valve	4	EA	\$ 10,000.00	\$40,000	
	12"x6" Tapping Sleeve and Valve	2	EA	\$ 12,000.00	\$24,000	
	6" Wet Connection	4	EA	\$ 2,000.00	\$8,000	
	8" Wet Connection	2	EA	\$ 3,500.00	\$7,000	
	12" Wet Connection	1	EA	\$ 5,000.00	\$5,000	
	Fire Hydrant	15	EA	\$ 5,000.00	\$75,000	
<b>IV</b>	<b>Traffic Control</b>					<b>\$40,000</b>
	Traffic Control Measures	1	LS	\$ 40,000.00	\$40,000	
<b>V</b>	<b>Storm Water Pollution Prevention Plan</b>					<b>\$5,000</b>
	Storm Water Pollution Prevention Plan	1	LS	\$ 5,000.00	\$5,000	
<b>VI</b>	<b>Miscellaneous</b>					<b>\$91,854</b>
	Extra Work and Cash Allowances	7	%	\$ 13,121.96	\$91,854	
	<b>Sub-Total Construction Cost (Group 1)</b>					<b>\$1,404,049</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$430,000</b>
	<b>Sub-Total Construction Cost with Contingency (Group 1)</b>					<b>\$1,840,000</b>
	<b>Professional Services</b>					<b>\$437,788</b>
	Professional Engineering Services - Final Design & Surveying	1	LS	\$ 272,188.00	\$272,188	
	Construction Material Testing	1	%	\$ 18,400.00	\$18,400	
	Construction Management and Observation	8	%	\$ 18,400.00	\$147,200	
	<b>TOTAL (Package 1)</b>					<b>\$2,280,000</b>

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - WATER LINE REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>WATERLINE REPLACEMENT (Package 2)</b>						
<b>II</b>	<b>Water Line Items</b>					<b>\$834,400</b>
	6" PVC Waterline by Trenchless Construction	5986	LF	\$ 100.00	\$598,600	
	Cut, Plug, and Abandon 2" Cast Iron Waterline	32	EA	\$ 200.00	\$6,400	
	Cut, Plug, and Abandon 2" PVC Waterline	2	EA	\$ 200.00	\$400	
	6"x6" Tapping Sleeve and Valve	1	EA	\$ 5,000.00	\$5,000	
	8"x6" Tapping Sleeve and Valve	14	EA	\$ 6,000.00	\$84,000	
	Fire Hydrant	14	EA	\$ 10,000.00	\$140,000	
<b>IV</b>	<b>Traffic Control</b>					<b>\$20,000</b>
	Traffic Control Measures	1	LS	\$ 20,000.00	\$20,000	
<b>V</b>	<b>Storm Water Pollution Prevention Plan</b>					<b>\$5,000</b>
	Storm Water Pollution Prevention Plan	1	LS	\$ 5,000.00	\$5,000	
<b>VI</b>	<b>Miscellaneous</b>					<b>\$85,940</b>
	Extra Work and Cash Allowances	10	%	\$ 8,594.00	\$85,940	
	<b>Sub-Total Construction Cost (Group 2)</b>					<b>\$945,340</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$283,602</b>
	<b>Sub-Total Construction Cost with Contingency (Group 2)</b>					<b>\$1,228,942</b>
	<b>Professional Services</b>					<b>\$274,000</b>
	Professional Engineering Services - Final Design & Surveying	12	%	\$ 12,000.00	\$144,000	
	Construction Material Testing	1	LS	\$ 10,000.00	\$10,000	
	Construction Management and Observation	10	%	\$ 12,000.00	\$120,000	
	<b>TOTAL (Package 2)</b>					<b>\$1,510,000</b>

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - WATER LINE REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>WATER LINE REPLACEMENT (Package 3)</b>						
<b>I</b>	<b>General Items</b>					<b>\$76,516</b>
	Mobilization	1	LS	\$ 34,196.00	\$34,196	
	Site Restoration	4232	LF	\$ 10.00	\$42,320	
<b>II</b>	<b>Water Line Items</b>					<b>\$616,600</b>
	6" PVC Waterline by Trenchless Construction	4232	LF	\$ 100.00	\$423,200	
	Cut, Plug, and Abandon 2" Cast Iron Waterline	10	EA	\$ 200.00	\$2,000	
	Cut, Plug, and Abandon 2" PVC Waterline	4	EA	\$ 200.00	\$800	
	Cut, Plug, and Abandon 4" Asbestos Cement Waterline	4	EA	\$ 600.00	\$2,400	
	Cut, Plug, and Abandon 4" Cast Iron Waterline	2	EA	\$ 600.00	\$1,200	
	6"x6" Tapping Sleeve and Valve	3	EA	\$ 5,000.00	\$15,000	
	8"x6" Tapping Sleeve and Valve	4	EA	\$ 7,500.00	\$30,000	
	12"x6" Tapping Sleeve and Valve	5	EA	\$ 10,000.00	\$50,000	
	12"x8" Tapping Sleeve and Valve	1	EA	\$ 12,000.00	\$12,000	
	Fire Hydrant	8	EA	\$ 10,000.00	\$80,000	
<b>IV</b>	<b>Traffic Control</b>					<b>\$20,000</b>
	Traffic Control Measures	1	LS	\$ 20,000.00	\$20,000	
<b>V</b>	<b>Storm Water Pollution Prevention Plan</b>					<b>\$5,000</b>
	Storm Water Pollution Prevention Plan	1	LS	\$ 5,000.00	\$5,000	
<b>VI</b>	<b>Miscellaneous</b>					<b>\$71,812</b>
	Extra Work and Cash Allowances	10	%	\$ 7,181.16	\$71,812	
	<b>Sub-Total Construction Cost (Group 3)</b>					<b>\$789,928</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$236,978</b>
	<b>Sub-Total Construction Cost with Contingency (Group 3)</b>					<b>\$1,026,906</b>
	<b>Professional Services</b>					<b>\$230,000</b>
	Professional Engineering Services - Final Design & Surveying	12	%	\$ 10,000.00	\$120,000	
	Construction Material Testing	1	LS	\$ 10,000.00	\$10,000	
	Construction Management and Observation	10	%	\$ 10,000.00	\$100,000	
	<b>TOTAL (Package 3)</b>					<b>\$1,260,000</b>

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - WATER LINE REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>WATERLINE REPLACEMENT (Package 4)</b>						
<b>II</b>	<b>Water Line Items</b>					<b>\$438,200</b>
	6" PVC Waterline by Trenchless Construction	3423	LF	\$ 100.00	\$342,300	
	Cut, Plug, and Abandon 2" PVC Waterline	2	EA	\$ 200.00	\$400	
	Cut, Plug, and Abandon 3" Asbestos Cement Waterline	2	EA	\$ 500.00	\$1,000	
	Cut, Plug, and Abandon 4" Asbestos Cement Waterline	4	EA	\$ 600.00	\$2,400	
	Cut, Plug, and Abandon 4" Cast Iron Waterline	4	EA	\$ 600.00	\$2,400	
	Cut, Plug, and Abandon 4" PVC Waterline	2	EA	\$ 600.00	\$1,200	
	6"x6" Tapping Sleeve and Valve	5	EA	\$ 5,000.00	\$25,000	
	8"x6" Tapping Sleeve and Valve	1	EA	\$ 7,500.00	\$7,500	
	6" Wet Connection	3	EA	\$ 2,000.00	\$6,000	
	Fire Hydrant	5	EA	\$ 10,000.00	\$50,000	
<b>IV</b>	<b>Traffic Control</b>					<b>\$20,000</b>
	Traffic Control Measures	1	LS	\$ 20,000.00	\$20,000	
<b>V</b>	<b>Storm Water Pollution Prevention Plan</b>					<b>\$5,000</b>
	Storm Water Pollution Prevention Plan	1	LS	\$ 5,000.00	\$5,000	
<b>VI</b>	<b>Miscellaneous</b>					<b>\$46,320</b>
	Extra Work and Cash Allowances	10	%	\$ 4,632.00	\$46,320	
	<b>Sub-Total Construction Cost (Group 4)</b>					<b>\$509,520</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$152,856</b>
	<b>Sub-Total Construction Cost with Contingency (Group 4)</b>					<b>\$662,376</b>
	<b>Professional Services</b>					<b>\$164,000</b>
	Professional Engineering Services - Final Design & Surveying	12	%	\$ 7,000.00	\$84,000	
	Construction Material Testing	1	LS	\$ 10,000.00	\$10,000	
	Construction Management and Observation	10	%	\$ 7,000.00	\$70,000	
	<b>TOTAL (Package 4)</b>					<b>\$830,000</b>

**OPINION OF PROBABLE COST  
 CITY OF BUNKER HILL VILLAGE  
 WATER SYSTEM IMPROVEMENTS - WATER LINE REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>WATER LINE REPLACEMENT (Package 5)</b>						
<b>I</b>	<b>General Items</b>					<b>\$80,687</b>
	Mobilization	1	LS	\$ 35,056.50	\$35,057	
	Site Restoration	4563	LF	\$ 10.00	\$45,630	
<b>II</b>	<b>Water Line Items</b>					<b>\$630,500</b>
	6" PVC Waterline by Trenchless Construction	4563	LF	\$ 100.00	\$456,300	
	Cut, Plug, and Abandon 2" Cast Iron Waterline	12	EA	\$ 200.00	\$2,400	
	Cut, Plug, and Abandon 2" PVC Waterline	2	EA	\$ 200.00	\$400	
	Cut, Plug, and Abandon 3" Asbestos Cement Waterline	6	EA	\$ 500.00	\$3,000	
	Cut, Plug, and Abandon 4" PVC Waterline	4	EA	\$ 600.00	\$2,400	
	8"x6" Tapping Sleeve and Valve	4	EA	\$ 7,500.00	\$30,000	
	12"x6" Tapping Sleeve and Valve	5	EA	\$ 10,000.00	\$50,000	
	6" Wet Connection	3	EA	\$ 2,000.00	\$6,000	
	Fire Hydrant	8	EA	\$ 10,000.00	\$80,000	
<b>IV</b>	<b>Traffic Control</b>					<b>\$20,000</b>
	Traffic Control Measures	1	LS	\$ 20,000.00	\$20,000	
<b>V</b>	<b>Storm Water Pollution Prevention Plan</b>					<b>\$5,000</b>
	Storm Water Pollution Prevention Plan	1	LS	\$ 5,000.00	\$5,000	
<b>VI</b>	<b>Miscellaneous</b>					<b>\$73,619</b>
	Extra Work and Cash Allowances	10	%	\$ 7,361.87	\$73,619	
	<b>Sub-Total Construction Cost (Group 5)</b>					<b>\$809,805</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$242,942</b>
	<b>Sub-Total Construction Cost with Contingency (Group 5)</b>					<b>\$1,052,747</b>
	<b>Professional Services</b>					<b>\$252,000</b>
	Professional Engineering Services - Final Design & Surveying	12	%	\$ 11,000.00	\$132,000	
	Construction Material Testing	1	LS	\$ 10,000.00	\$10,000	
	Construction Management and Observation	10	%	\$ 11,000.00	\$110,000	
	<b>TOTAL (Package 5)</b>					<b>\$1,310,000</b>
<b>GRAND TOTAL WATER LINE REPLACEMENT</b>						<b>\$7,190,000</b>

**Note:**

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix D**  
**Ground Storage Tank Replacement Cost Estimate**

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - TAYLORCREST WP GST NO. 1 REPLACEMENT**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>I</b>	<b>General Items</b>					<b>\$79,100</b>
	Mobilization	1	LS	\$ 39,550.00	\$39,550	
	Site Restoration and Grading Around Foundation	1	LS	\$ 39,550.00	\$39,550	
<b>II</b>	<b>Demolition Items</b>					<b>\$103,816</b>
	Demolish and Remove Existing Tank and Ringwall	1	LS	\$ 100,000.00	\$100,000	
	Excavate and Dispose of Base Material (1 foot clean sand)	53	TONS	\$ 72.00	\$3,816	
	<b>Water Tank Items</b>					<b>\$687,600</b>
	Install 0.25 MH (38' Dia. X 32' H) AWWA D-100 Self Supported Cone Roof Tank with Exterior and Interior Coatings and Foundation	1	LS	\$ 617,600.00	\$617,600	
	Remove and Replace Piping to Tank	1	LS	\$ 50,000.00	\$50,000	
	Galvanic Cathodic Protection	1	LS	\$ 20,000.00	\$20,000	
	<b>Miscellaneous</b>					<b>\$39,550</b>
	Extra Work and Cash Allowances	5	%	\$ 7,910.00	\$39,550	
	<b>Sub-Total Construction Cost</b>					<b>\$910,066</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$273,020</b>
	<b>Sub-Total Construction Cost with Contingency</b>					<b>\$1,183,086</b>
	<b>Professional Services</b>					<b>\$207,584</b>
	Limited Site Topographic Survey	1	LS	\$ 10,900.00	\$10,900	
	Geotechnical Investigation	1	LS	\$ 5,390.00	\$5,390	
	Final Design (Plans and Specifications)	1	LS	\$ 76,638.00	\$76,638	
	Bidding Services	1	LS	\$ 10,334.00	\$10,334	
	Engineering - CPS	1	LS	\$ 29,874.00	\$29,874	
	Construction Observation	1	LS	\$ 69,448.00	\$69,448	
	Contingency	1	LS	\$ 5,000.00	\$5,000	
	<b>TOTAL</b>					<b>\$1,400,000</b>

Note:

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix E**  
**Water Well Addition Cost Estimate**

**OPINION OF PROBABLE COST  
 CITY OF BUNKER HILL VILLAGE  
 WATER SYSTEM IMPROVEMENTS - WATER WELL ADDITION**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>I</b>	<b>General Items</b>					<b>\$426,200</b>
	Mobilization	1	LS	\$ 106,200.00	\$106,200	
	Site Work, including site preparation, grading, and drainage, paving, yard piping, and stormwater pollution prevention plan	1	LS	\$ 100,000.00	\$100,000	
	Electrical Building	1	LS	\$ 200,000.00	\$200,000	
	Fencing and Gate	1	LS	\$ 20,000.00	\$20,000	
<b>II</b>	<b>Water Well Items</b>					<b>\$2,150,000</b>
	Drilling of Water Well Test/Pilot Hole	1	LS	\$ 350,000.00	\$350,000	
	Plugging and Abandonment of Test/Pilot Hole	1	LS	\$ 10,000.00	\$10,000	
	Drill and Intall New Water Well including, casing, screens, gravel pack, well development and pumping tests, chemical analysis, cleaning, disinfection, well video survey and report, and SWPPP	1	LS	\$ 1,400,000.00	\$1,400,000	
	1,000 GPM Submersible Well Pump	1	LS	\$ 300,000.00	\$300,000	
	250 HP Electric Motor	1	LS	\$ 90,000.00	\$90,000	
<b>III</b>	<b>Electrical Items</b>					<b>\$1,070,000</b>
	Electrical Equipment, motor control center, transformer, feeders, starters and lighting, and appurtenances associated with equipment inside and mounted to Electrical Building	1	LS	\$ 200,000.00	\$200,000	
	Generator, load bank, worker platform, and slab foundation.	1	LS	\$ 500,000.00	\$500,000	
	Electrical field equipment, including programming conduit, wire, duct banks, outdoor floodlighting, water well junction boxes, vibration meter, and appurtenances.	1	LS	\$ 350,000.00	\$350,000	
	Electrical service structure, meter, and appurtenances	1	LS	\$ 20,000.00	\$20,000	
<b>IV</b>	<b>Miscellaneous</b>					<b>\$182,310</b>
	Extra Work and Cash Allowances	5	%	\$ 36,462.00	\$182,310	
	<b>Sub-Total Construction Cost</b>					<b>\$3,828,510</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$1,148,553</b>
	<b>Sub-Total Construction Cost with Contingency</b>					<b>\$4,977,063</b>
	<b>Professional Services</b>					<b>\$850,000</b>
	Preliminary Engineering Design and Site Evaluation Study	1	LS	\$ 50,000.00	\$50,000	
	Professional Engineering Services - Final Design & Surveying	10	%	\$ 50,000.00	\$500,000	
	Geotechnical and Hydrogeologist Field Services (Including Lab)	1	LS	\$ 50,000.00	\$50,000	
	Construction Management and Observation	5	%	\$ 50,000.00	\$250,000	
	<b>TOTAL</b>					<b>\$5,830,000</b>

Note:

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix F**  
**Electrical System Rehabilitation at WP No. 1 Cost Estimate**

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - POWER SYSTEM REHAB AT WP NO. 1**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>I</b>	<b>General and Civil Items</b>					<b>\$50,500</b>
	Mobilization	1	LS	\$ 30,500.00	\$30,500	
	Site Work, including site preparation, grading, drainage, and preparation	1	LS	\$ 20,000.00	\$20,000	
<b>II</b>	<b>Electrical Items</b>					<b>\$590,000</b>
	600 Amp Motor Control Center	1	LS	\$ 300,000.00	\$300,000	
	Temporary MCC for Phasing	1	LS	\$ 180,000.00	\$180,000	
	Conduit and Conductors	1	LS	\$ 50,000.00	\$50,000	
	Phasing Installation	1	LS	\$ 10,000.00	\$10,000	
	Wiring Modifications	1	LS	\$ 25,000.00	\$25,000	
	Miscellaneous Eletrical	1	LS	\$ 25,000.00	\$25,000	
<b>III</b>	<b>Miscellaneous</b>					<b>\$32,050</b>
	Extra Work and Cash Allowances	5	%	\$ 6,410.00	\$32,050	
<b>IV</b>	<b>Additive Alternate Items</b>					<b>\$500,000</b>
	Remove and Salvage existing Natural Gas Generator and Replace with New 350 kW Natural Gas Generator.	1	LS	\$ 500,000.00	\$500,000	
	<b>Sub-Total Construction Cost</b>					<b>\$1,172,550</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$351,765</b>
	<b>Sub-Total Construction Cost with Contingency</b>					<b>\$1,524,315</b>
	<b>Professional Services</b>					<b>\$270,000</b>
	Professional Engineering Services - Final Design & Surveying	10	%	\$ 15,000.00	\$150,000	
	Construction Management and Observation	8	LS	\$ 15,000.00	\$120,000	
<b>TOTAL</b>						<b>\$1,800,000</b>

Note:

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix G**  
**Electrical System Rehabilitation at WP No. 2 Cost Estimate**

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - POWER SYSTEM REHAB AT WP NO. 2**

Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>I</b>	<b>General and Civil Items</b>					<b>\$295,250</b>
	Mobilization	1	LS	\$ 35,250.00	\$35,250	
	Site Work, including site preparation, grading, and drainage, paving, yard piping, and stormwater pollution prevention plan	1	LS	\$ 50,000.00	\$50,000	
	Electrical Building	1	LS	\$ 200,000.00	\$200,000	
	Fencing and Gate and Modifications	1	LS	\$ 10,000.00	\$10,000	
<b>II</b>	<b>Electrical Items</b>					<b>\$445,000</b>
	400 Amp Motor Control Center	1	LS	\$ 350,000.00	\$350,000	
	Conduit and Conductors	1	LS	\$ 40,000.00	\$40,000	
	Phasing Installation	1	LS	\$ 15,000.00	\$15,000	
	Wiring Modifications	1	LS	\$ 25,000.00	\$25,000	
	Miscellaneous Eletrical	1	LS	\$ 15,000.00	\$15,000	
<b>III</b>	<b>Miscellaneous</b>					<b>\$37,000</b>
	Extra Work and Cash Allowances	5	%	\$ 7,400.00	\$37,000	
<b>IV</b>	<b>Additive Alternate Items</b>					<b>\$225,000</b>
	Remove and Salvage existing Natural Gas Generator and Replace with New 150 kW Natural Gas Generator.	1	LS	\$ 225,000.00	\$225,000	
	<b>Sub-Total Construction Cost</b>					<b>\$1,002,250</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$300,675</b>
	<b>Sub-Total Construction Cost with Contingency</b>					<b>\$1,302,925</b>
	<b>Professional Services</b>					<b>\$244,000</b>
	Professional Engineering Services - Final Design & Surveying	10	%	\$ 13,000.00	\$130,000	
	Material Testing	1	LS	\$ 10,000.00	\$10,000	
	Construction Management and Observation	8	LS	\$ 13,000.00	\$104,000	
	<b>TOTAL</b>					<b>\$1,550,000</b>

Note:

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix H**  
**Water Plant Back-Up Power Improvements**

**OPINION OF PROBABLE COST**  
**CITY OF BUNKER HILL VILLAGE**  
**WATER SYSTEM IMPROVEMENTS - WATER PLANT BACK-UP POWER**


Item No.	Description	Quantity	Unit	Unit Price	Cost	Subtotal
<b>I</b>	<b>Civil Items</b>					<b>\$30,000</b>
	Civil Site Work, Including Grading, Paving, Drainage, and Site Restoration	1	LS	\$ 30,000.00	\$ 30,000.00	
<b>II</b>	<b>Electrical Items</b>					<b>\$74,000</b>
	Crane Rental	1	LS	\$ 16,000.00	\$ 16,000.00	
	Wiring Modifications	1	LS	\$ 25,000.00	\$ 25,000.00	
	Transportation and Installation Costs	1	LS	\$ 10,000.00	\$ 10,000.00	
	Gas Allowance	1	LS	\$ 8,000.00	\$ 8,000.00	
	Miscellaneous Electrical Items	1	LS	\$ 15,000.00	\$ 15,000.00	
	<b>Sub-Total Construction Cost</b>					<b>\$104,000</b>
	<b>30% Contingency (Construction Cost Only)</b>					<b>\$31,200</b>
	<b>Sub-Total Construction Cost with Contingency</b>					<b>\$135,200</b>
<b>III</b>	<b>Professional Services</b>					<b>\$30,800</b>
	Professional Engineering Services - Final Design	12	%	\$ 1,400.00	\$16,800	
	Construction Management and Observation	10	%	\$ 1,400.00	\$14,000	
	<b>TOTAL</b>					<b>\$140,000</b>

Note:

1. Cost estimates were prepared on the basis of experience and judgment utilizing historical bid costs for similar work if available. Actual bids and ultimate construction costs may vary based on market conditions, inflation, and unforeseen field conditions. The final determination of construction cost is made through the bidding process with contractor(s).

**Appendix I**  
**Texas Hydrants' Data**

# TEXAS HYDRANT SERVICES

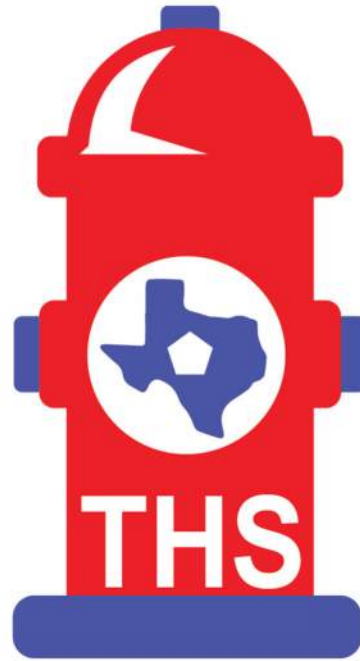

**City of Bunker Hill Village  
Fire Hydrant Hydro Static Flow Test  
November 2025**

12605 I-10 EAST  
BAYTOWN, TX 77523

281-385-1112  
281-839-8446

[ERICK@TXHYDRANT.COM](mailto:ERICK@TXHYDRANT.COM)



CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC FLOW TEST

NOVEMBER 2025

HYDRANT	Location	Q (total gallons flowing)	29.83	Coefficient C = .88	diameter (d) of outlet flowed in inches	Number of outlets flowing	Pitot (p)	Available Fire Flow (AFF)	Total Gallons Flowing	Static (S)	Residual (R)
TEST HYDRANT #1	306 TAMERLAINE DR	820	29.83	0.88	2.5	1	25	1,290	820	57	41
FLOW HYDRANT #1	243 TAMERLAINE DR	820	29.83	0.88	2.5	1	25	-	820		
TEST HYDRANT #2	C/O STREY LN AND TAYLORCREST CT	971	29.83	0.88	2.5	1	35	1,592	971	55	41
FLOW HYDRANT #2	12007 TAYLORCREST CT (ACROSS FROM)	971	29.83	0.88	2.5	1	35	-	971		
TEST HYDRANT #3	C/O KNIPP RD AND KNIPP OAKS LN	971	29.83	0.88	2.5	1	35	2,350	971	56	49
FLOW HYDRANT #3	C/O KNIPP RD AND MCLEODS LN	971	29.83	0.88	2.5	1	35	-	971		
TEST HYDRANT #4	C/O BUNKER HILL RD AND GREENBAY LN	935	29.83	0.88	2.5	1	32.5	2,424	935	55	49
FLOW HYDRANT #4	351 CARL LN	935	29.83	0.88	2.5	1	32.5	-	935		
TEST HYDRANT #5	C/O BLALOCK RD AND GREEN OAKS RD	1,005	29.83	0.88	2.5	1	37.5	1,899	1,005	59	47
FLOW HYDRANT #5	C/O BLALOCK RD AND BLALOCK FOREST DR	1,005	29.83	0.88	2.5	1	37.5	-	1,005		




CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC  
FLOW TEST #1

NOVEMBER 2025

STATIC PRESSURE (PSI)	57
RESIDUAL PRESSURE (PSI)	41
FLOW RATE (GPM)	820

PRESSURE DROP (%)	28%
GPM AT 20 PSI	1,289

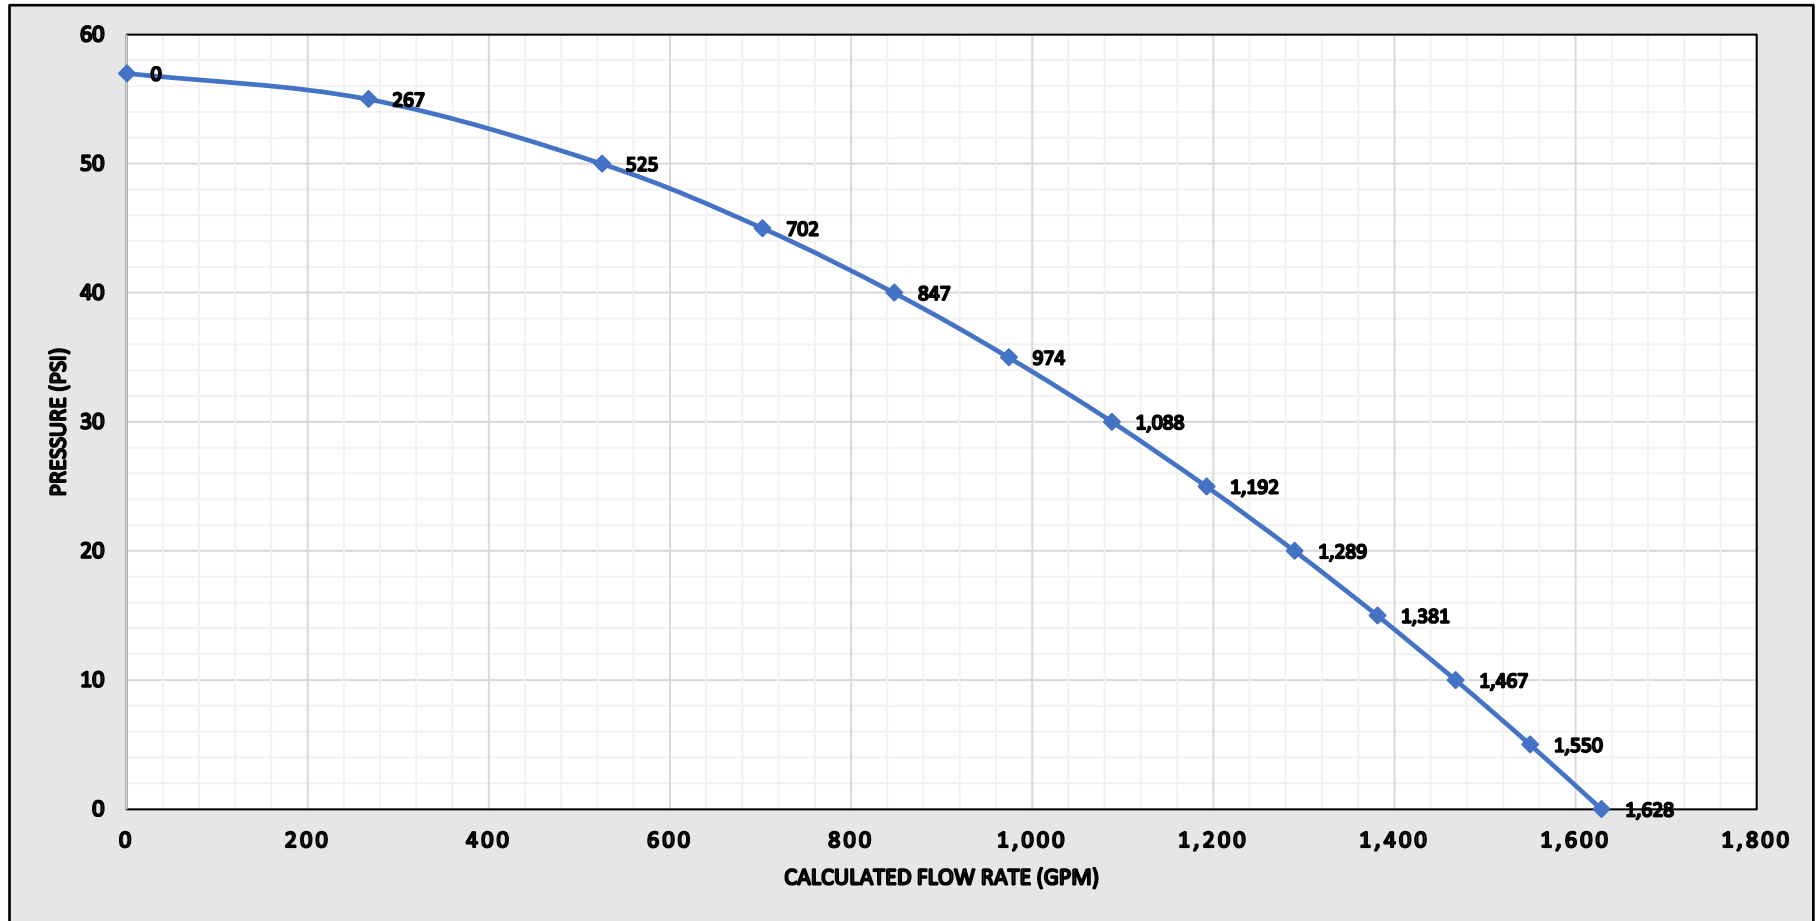




CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC  
FLOW TEST #2

NOVEMBER 2025

STATIC PRESSURE (PSI)	55
RESIDUAL PRESSURE (PSI)	41
FLOW RATE (GPM)	971

PRESSURE DROP (%)	25%
GPM AT 20 PSI	1,593

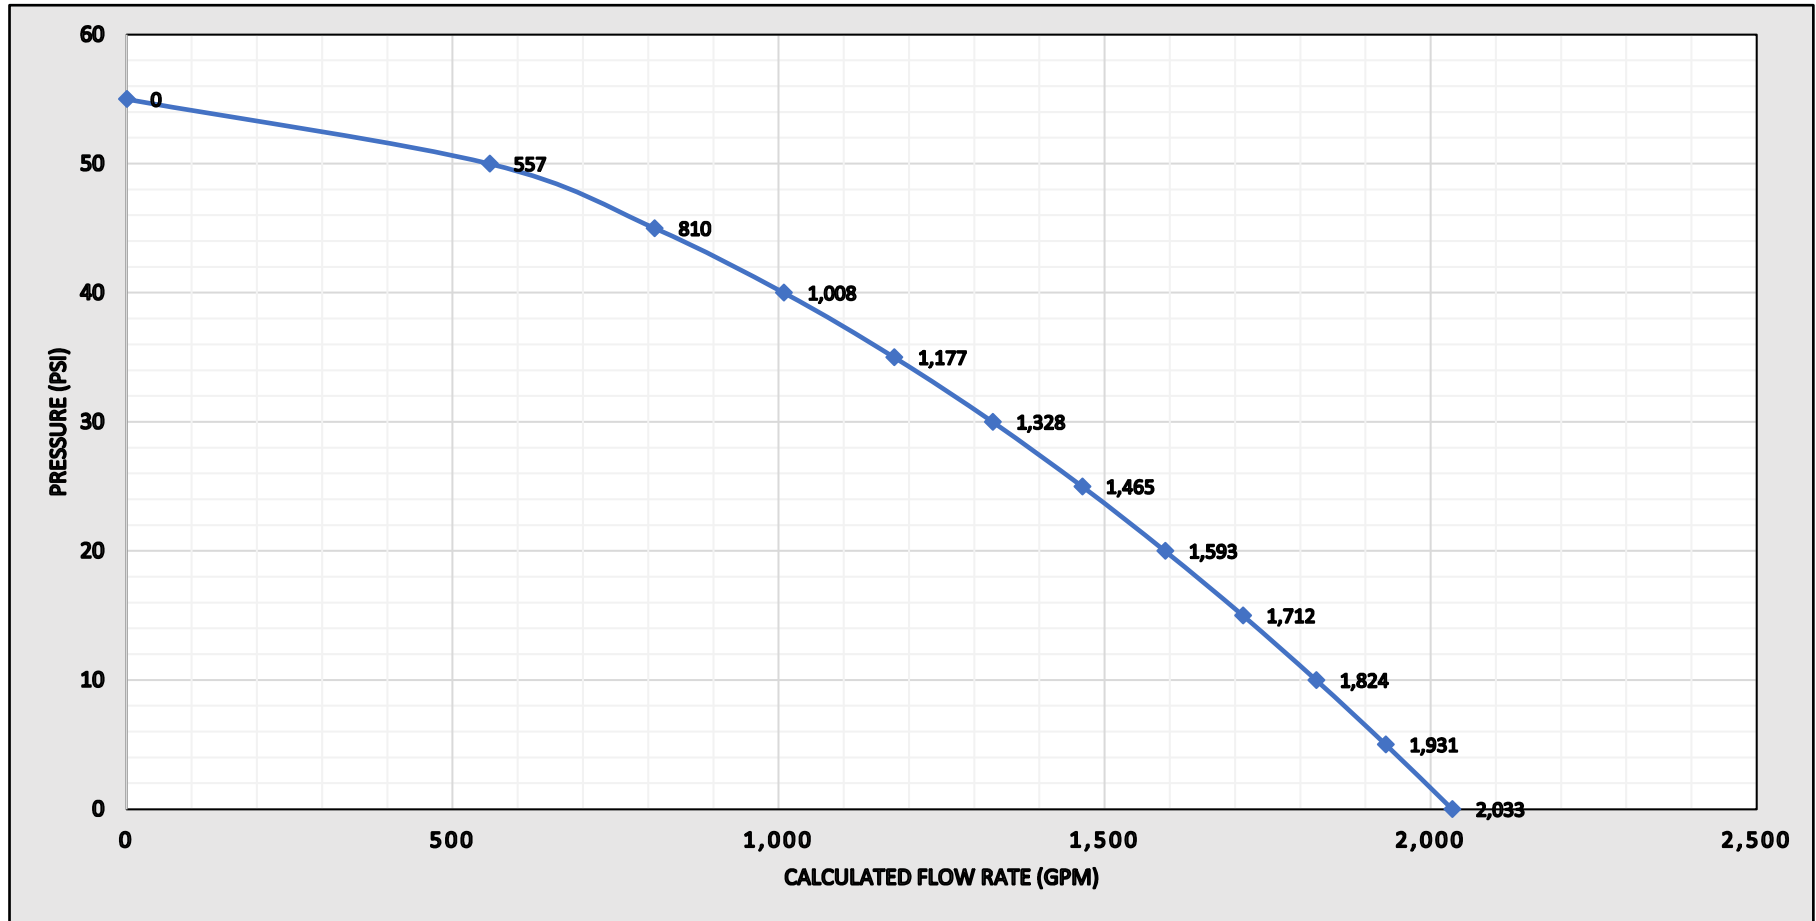




CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC  
FLOW TEST #3

NOVEMBER 2025

STATIC PRESSURE (PSI)	56
RESIDUAL PRESSURE (PSI)	49
FLOW RATE (GPM)	971

PRESSURE DROP (%)	13%
GPM AT 20 PSI	2,351

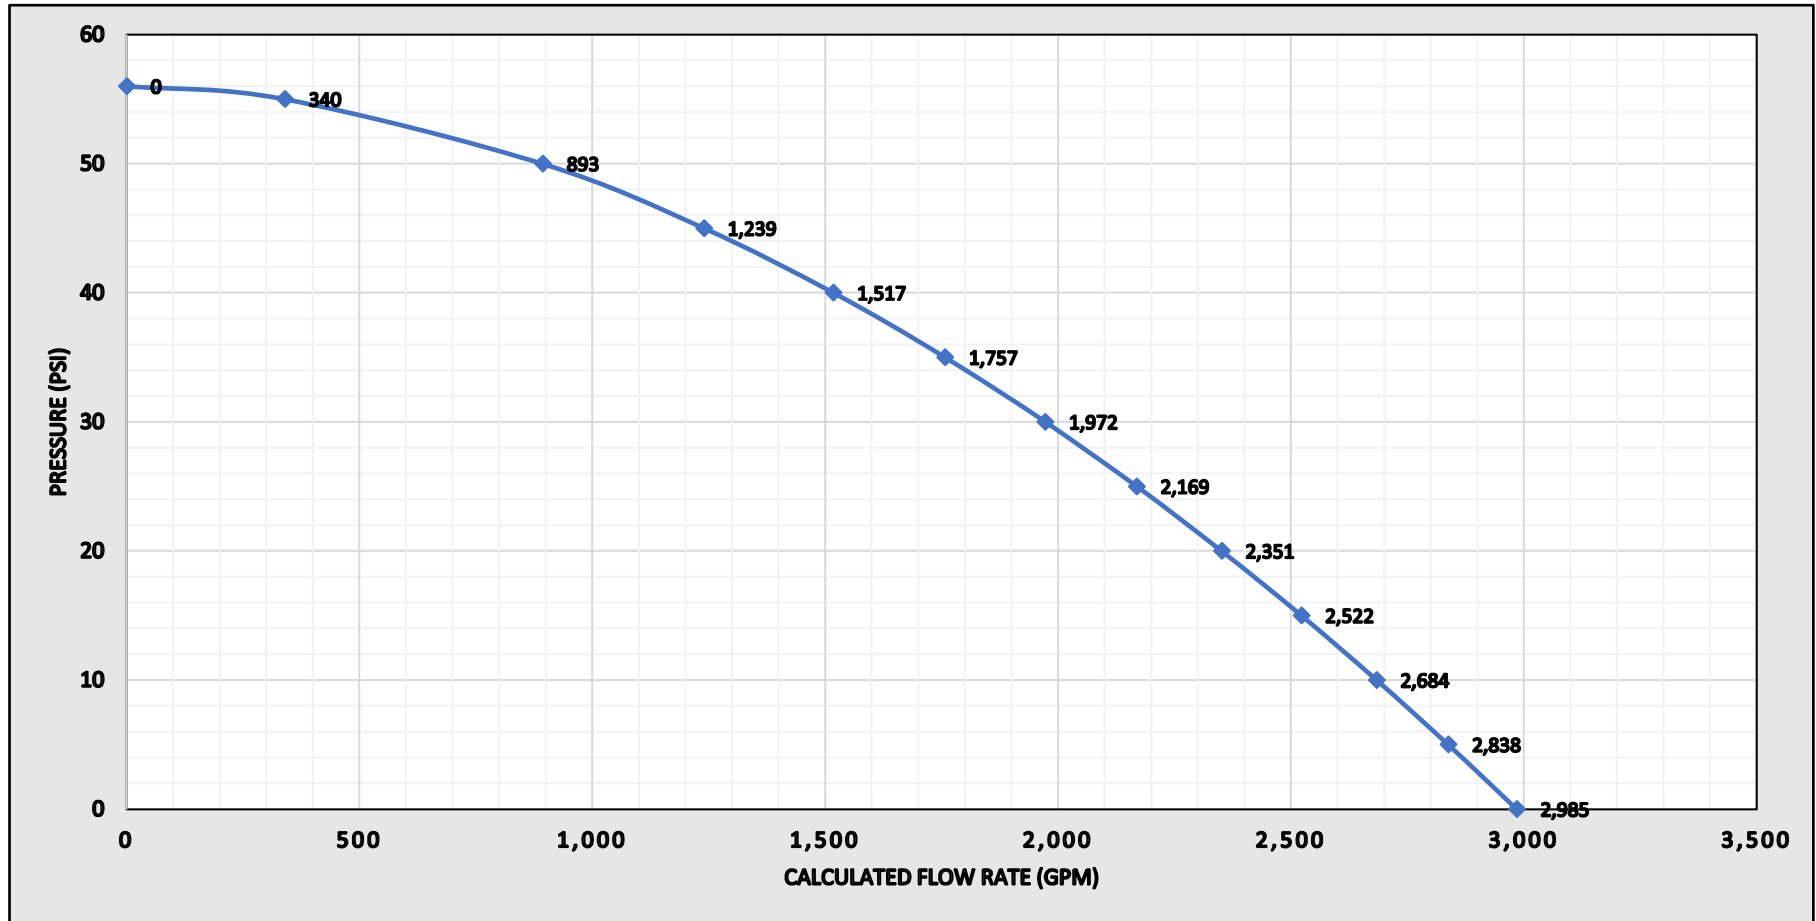




CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC  
FLOW TEST #4

NOVEMBER 2025

STATIC PRESSURE (PSI)	55
RESIDUAL PRESSURE (PSI)	49
FLOW RATE (GPM)	935

PRESSURE DROP (%)	11%
GPM AT 20 PSI	2,423

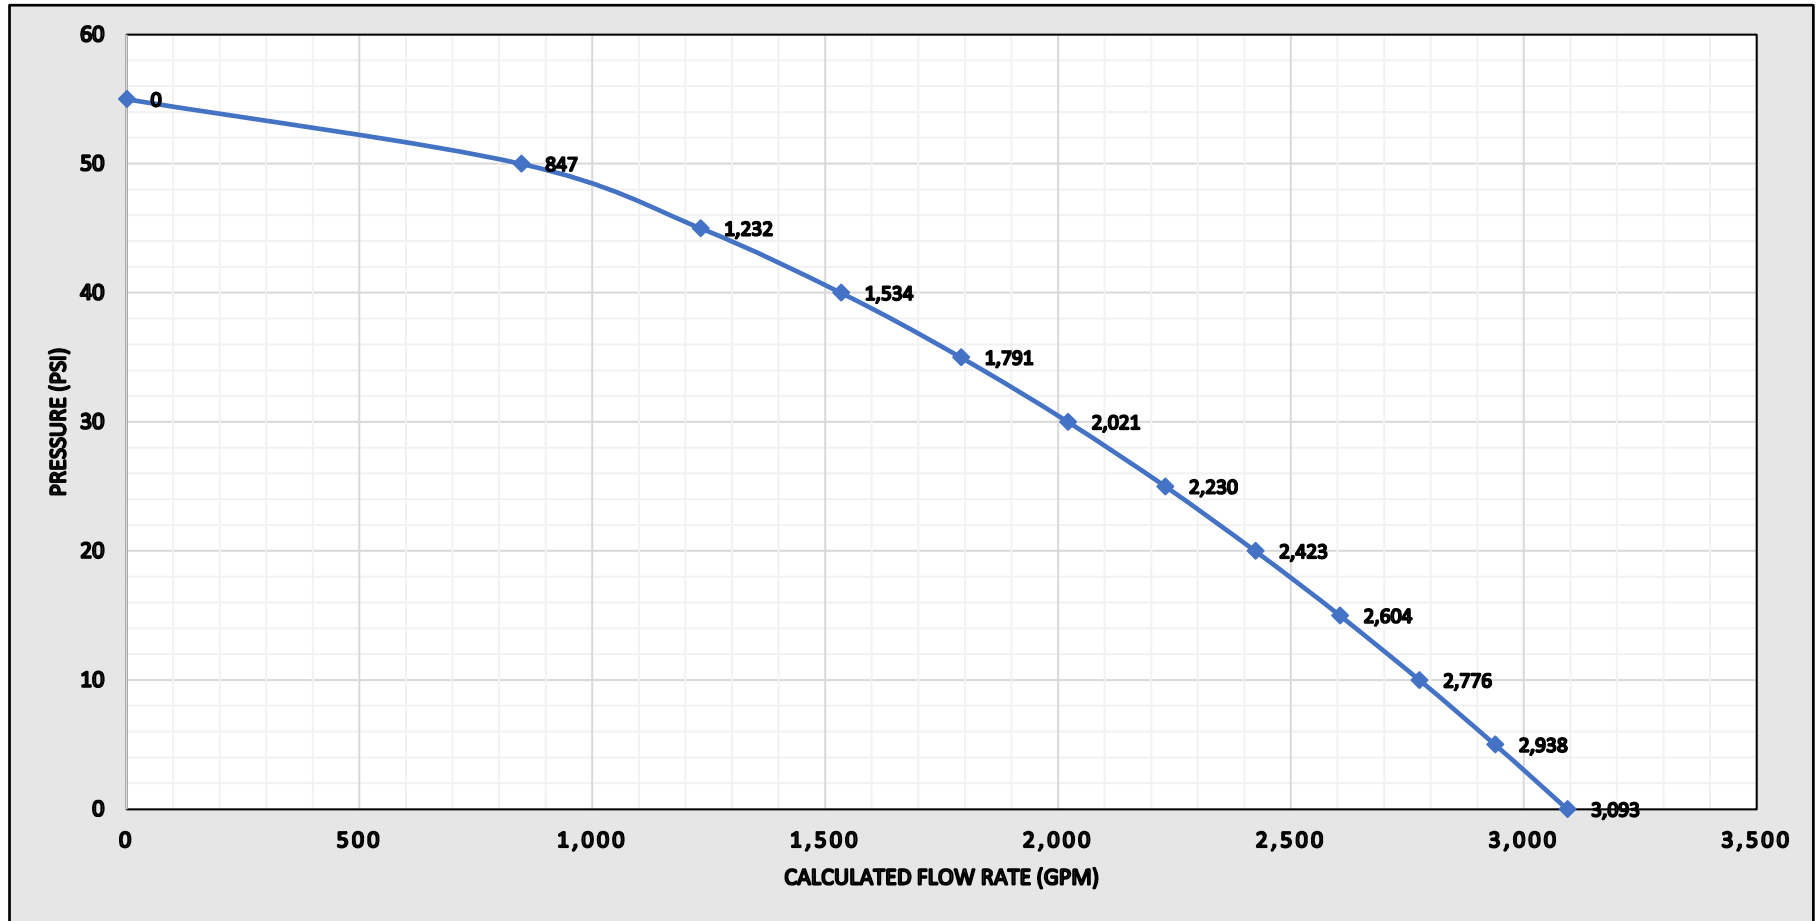




CITY OF BUNKER HILL VILLAGE  
HYDRO STATIC  
FLOW TEST #5

NOVEMBER 2025

STATIC PRESSURE (PSI)	59
RESIDUAL PRESSURE (PSI)	47
FLOW RATE (GPM)	1,005

PRESSURE DROP (%)	20%
GPM AT 20 PSI	1,899

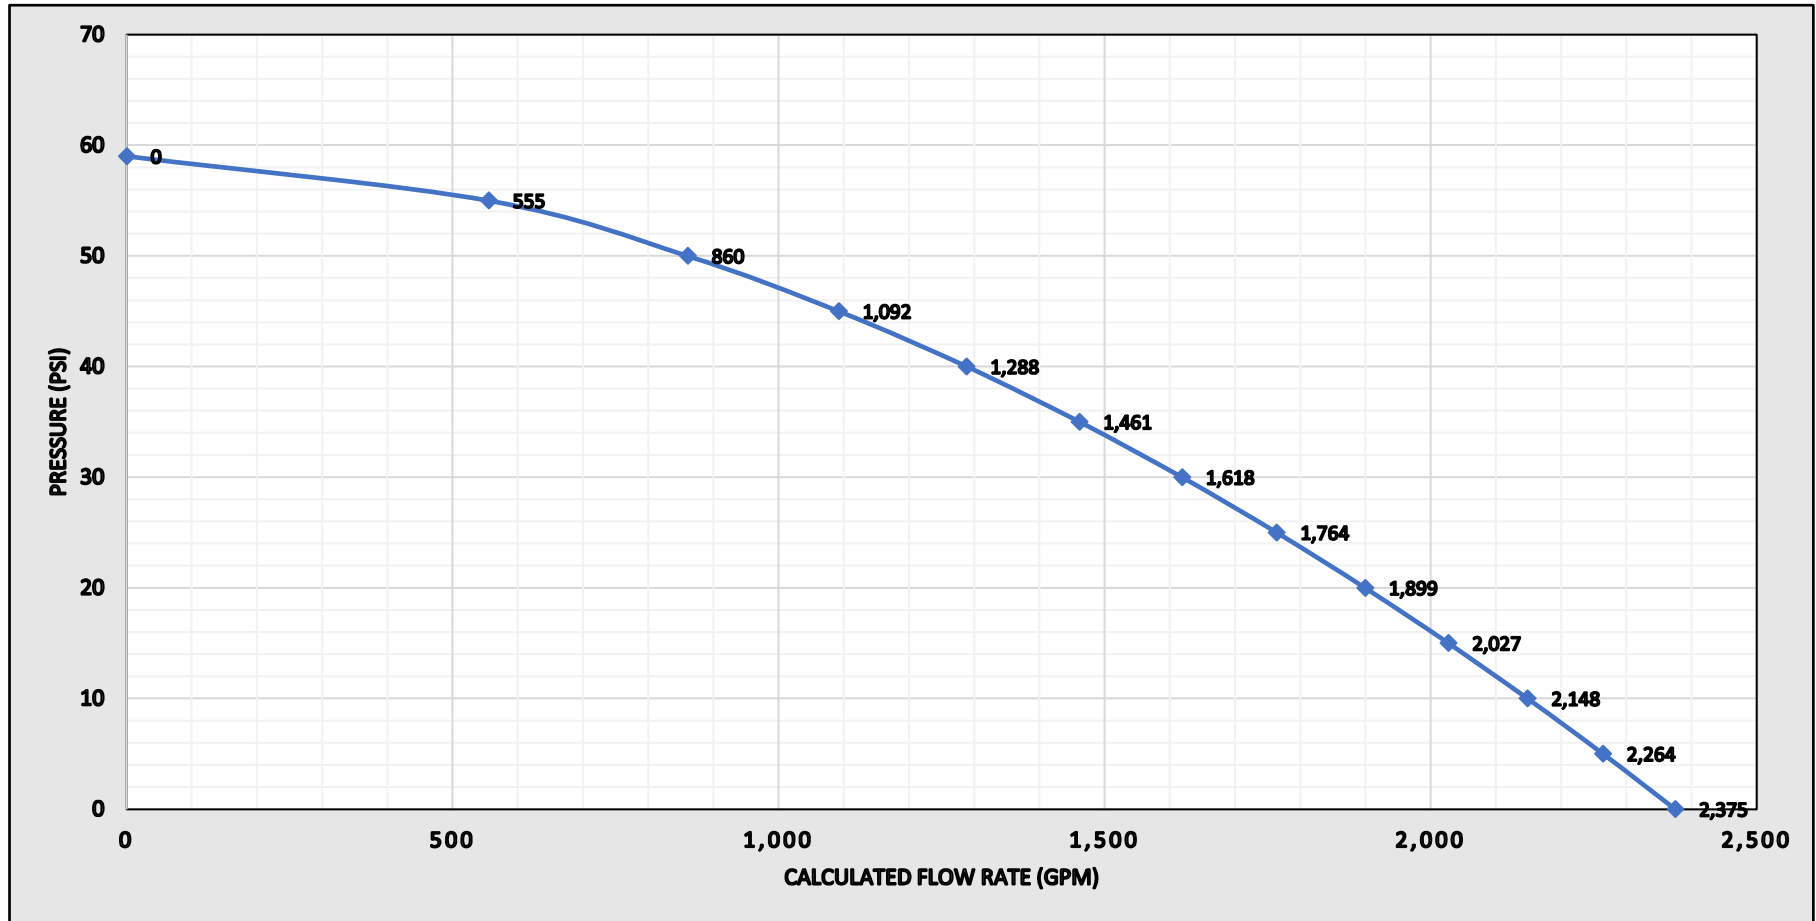



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/27/2025	9:49 AM	53
10/27/2025	10:04 AM	60
10/27/2025	10:19 AM	52
10/27/2025	10:34 AM	55
10/27/2025	10:49 AM	51
10/27/2025	11:04 AM	53
10/27/2025	11:19 AM	54
10/27/2025	11:34 AM	54
10/27/2025	11:49 AM	54
10/27/2025	12:04 PM	50
10/27/2025	12:19 PM	52
10/27/2025	12:34 PM	53
10/27/2025	12:49 PM	52
10/27/2025	1:04 PM	51
10/27/2025	1:19 PM	52
10/27/2025	1:34 PM	52
10/27/2025	1:49 PM	52
10/27/2025	2:04 PM	52
10/27/2025	2:19 PM	51
10/27/2025	2:34 PM	53
10/27/2025	2:49 PM	53
10/27/2025	3:04 PM	51
10/27/2025	3:19 PM	52
10/27/2025	3:34 PM	52
10/27/2025	3:49 PM	53
10/27/2025	4:04 PM	51
10/27/2025	4:19 PM	52
10/27/2025	4:34 PM	52
10/27/2025	4:49 PM	52
10/27/2025	5:04 PM	52
10/27/2025	5:19 PM	52
10/27/2025	5:34 PM	51
10/27/2025	5:49 PM	52
10/27/2025	6:04 PM	51
10/27/2025	6:19 PM	52
10/27/2025	6:34 PM	52
10/27/2025	6:49 PM	52
10/27/2025	7:04 PM	52
10/27/2025	7:19 PM	51
10/27/2025	7:34 PM	52
10/27/2025	7:49 PM	52
10/27/2025	8:04 PM	51
10/27/2025	8:19 PM	51
10/27/2025	8:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/27/2025	8:49 PM	52
10/27/2025	9:04 PM	51
10/27/2025	9:19 PM	52
10/27/2025	9:34 PM	52
10/27/2025	9:49 PM	52
10/27/2025	10:04 PM	52
10/27/2025	10:19 PM	52
10/27/2025	10:34 PM	52
10/27/2025	10:49 PM	52
10/27/2025	11:04 PM	52
10/27/2025	11:19 PM	52
10/27/2025	11:34 PM	52
10/27/2025	11:49 PM	52
10/28/2025	12:04 AM	52
10/28/2025	12:19 AM	52
10/28/2025	12:34 AM	52
10/28/2025	12:49 AM	52
10/28/2025	1:04 AM	52
10/28/2025	1:19 AM	52
10/28/2025	1:34 AM	52
10/28/2025	1:49 AM	52
10/28/2025	2:04 AM	50
10/28/2025	2:19 AM	51
10/28/2025	2:34 AM	53
10/28/2025	2:49 AM	52
10/28/2025	3:04 AM	51
10/28/2025	3:19 AM	50
10/28/2025	3:34 AM	48
10/28/2025	3:49 AM	49
10/28/2025	4:04 AM	54
10/28/2025	4:19 AM	50
10/28/2025	4:34 AM	50
10/28/2025	4:49 AM	51
10/28/2025	5:04 AM	49
10/28/2025	5:19 AM	50
10/28/2025	5:34 AM	49
10/28/2025	5:49 AM	51
10/28/2025	6:04 AM	50
10/28/2025	6:19 AM	51
10/28/2025	6:34 AM	52
10/28/2025	6:49 AM	52
10/28/2025	7:04 AM	51
10/28/2025	7:19 AM	51
10/28/2025	7:34 AM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/28/2025	7:49 AM	50
10/28/2025	8:04 AM	50
10/28/2025	8:19 AM	50
10/28/2025	8:34 AM	51
10/28/2025	8:49 AM	50
10/28/2025	9:04 AM	52
10/28/2025	9:19 AM	51
10/28/2025	9:34 AM	52
10/28/2025	9:49 AM	52
10/28/2025	10:04 AM	52
10/28/2025	10:19 AM	52
10/28/2025	10:34 AM	52
10/28/2025	10:49 AM	52
10/28/2025	11:04 AM	52
10/28/2025	11:19 AM	52
10/28/2025	11:34 AM	52
10/28/2025	11:49 AM	51
10/28/2025	12:04 PM	51
10/28/2025	12:19 PM	51
10/28/2025	12:34 PM	52
10/28/2025	12:49 PM	53
10/28/2025	1:04 PM	52
10/28/2025	1:19 PM	52
10/28/2025	1:34 PM	52
10/28/2025	1:49 PM	53
10/28/2025	2:04 PM	52
10/28/2025	2:19 PM	52
10/28/2025	2:34 PM	52
10/28/2025	2:49 PM	52
10/28/2025	3:04 PM	52
10/28/2025	3:19 PM	51
10/28/2025	3:34 PM	52
10/28/2025	3:49 PM	52
10/28/2025	4:04 PM	52
10/28/2025	4:19 PM	51
10/28/2025	4:34 PM	52
10/28/2025	4:49 PM	52
10/28/2025	5:04 PM	51
10/28/2025	5:19 PM	52
10/28/2025	5:34 PM	52
10/28/2025	5:49 PM	51
10/28/2025	6:04 PM	52
10/28/2025	6:19 PM	52
10/28/2025	6:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/28/2025	6:49 PM	52
10/28/2025	7:04 PM	52
10/28/2025	7:19 PM	52
10/28/2025	7:34 PM	51
10/28/2025	7:49 PM	52
10/28/2025	8:04 PM	53
10/28/2025	8:19 PM	51
10/28/2025	8:34 PM	52
10/28/2025	8:49 PM	52
10/28/2025	9:04 PM	52
10/28/2025	9:19 PM	52
10/28/2025	9:34 PM	52
10/28/2025	9:49 PM	52
10/28/2025	10:04 PM	52
10/28/2025	10:19 PM	52
10/28/2025	10:34 PM	52
10/28/2025	10:49 PM	52
10/28/2025	11:04 PM	52
10/28/2025	11:19 PM	52
10/28/2025	11:34 PM	52
10/28/2025	11:49 PM	52
10/29/2025	12:04 AM	52
10/29/2025	12:19 AM	52
10/29/2025	12:34 AM	52
10/29/2025	12:49 AM	52
10/29/2025	1:04 AM	52
10/29/2025	1:19 AM	52
10/29/2025	1:34 AM	52
10/29/2025	1:49 AM	52
10/29/2025	2:04 AM	51
10/29/2025	2:19 AM	53
10/29/2025	2:34 AM	53
10/29/2025	2:49 AM	53
10/29/2025	3:04 AM	51
10/29/2025	3:19 AM	52
10/29/2025	3:34 AM	52
10/29/2025	3:49 AM	52
10/29/2025	4:04 AM	48
10/29/2025	4:19 AM	48
10/29/2025	4:34 AM	47
10/29/2025	4:49 AM	50
10/29/2025	5:04 AM	48
10/29/2025	5:19 AM	46
10/29/2025	5:34 AM	48



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/29/2025	5:49 AM	46
10/29/2025	6:04 AM	47
10/29/2025	6:19 AM	51
10/29/2025	6:34 AM	51
10/29/2025	6:49 AM	50
10/29/2025	7:04 AM	47
10/29/2025	7:19 AM	50
10/29/2025	7:34 AM	52
10/29/2025	7:49 AM	53
10/29/2025	8:04 AM	50
10/29/2025	8:19 AM	52
10/29/2025	8:34 AM	52
10/29/2025	8:49 AM	54
10/29/2025	9:04 AM	52
10/29/2025	9:19 AM	51
10/29/2025	9:34 AM	52
10/29/2025	9:49 AM	52
10/29/2025	10:04 AM	52
10/29/2025	10:19 AM	52
10/29/2025	10:34 AM	52
10/29/2025	10:49 AM	52
10/29/2025	11:04 AM	53
10/29/2025	11:19 AM	52
10/29/2025	11:34 AM	52
10/29/2025	11:49 AM	52
10/29/2025	12:04 PM	51
10/29/2025	12:19 PM	54
10/29/2025	12:34 PM	53
10/29/2025	12:49 PM	52
10/29/2025	1:04 PM	52
10/29/2025	1:19 PM	52
10/29/2025	1:34 PM	53
10/29/2025	1:49 PM	53
10/29/2025	2:04 PM	52
10/29/2025	2:19 PM	53
10/29/2025	2:34 PM	53
10/29/2025	2:49 PM	53
10/29/2025	3:04 PM	52
10/29/2025	3:19 PM	52
10/29/2025	3:34 PM	53
10/29/2025	3:49 PM	52
10/29/2025	4:04 PM	52
10/29/2025	4:19 PM	52
10/29/2025	4:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/29/2025	4:49 PM	52
10/29/2025	5:04 PM	51
10/29/2025	5:19 PM	52
10/29/2025	5:34 PM	51
10/29/2025	5:49 PM	52
10/29/2025	6:04 PM	53
10/29/2025	6:19 PM	52
10/29/2025	6:34 PM	53
10/29/2025	6:49 PM	53
10/29/2025	7:04 PM	52
10/29/2025	7:19 PM	53
10/29/2025	7:34 PM	51
10/29/2025	7:49 PM	53
10/29/2025	8:04 PM	52
10/29/2025	8:19 PM	52
10/29/2025	8:34 PM	52
10/29/2025	8:49 PM	52
10/29/2025	9:04 PM	52
10/29/2025	9:19 PM	52
10/29/2025	9:34 PM	52
10/29/2025	9:49 PM	52
10/29/2025	10:04 PM	52
10/29/2025	10:19 PM	52
10/29/2025	10:34 PM	53
10/29/2025	10:49 PM	52
10/29/2025	11:04 PM	52
10/29/2025	11:19 PM	52
10/29/2025	11:34 PM	52
10/29/2025	11:49 PM	52
10/30/2025	12:04 AM	52
10/30/2025	12:19 AM	52
10/30/2025	12:34 AM	52
10/30/2025	12:49 AM	52
10/30/2025	1:04 AM	52
10/30/2025	1:19 AM	51
10/30/2025	1:34 AM	51
10/30/2025	1:49 AM	51
10/30/2025	2:04 AM	49
10/30/2025	2:19 AM	49
10/30/2025	2:34 AM	50
10/30/2025	2:49 AM	51
10/30/2025	3:04 AM	52
10/30/2025	3:19 AM	48
10/30/2025	3:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/30/2025	3:49 AM	50
10/30/2025	4:04 AM	52
10/30/2025	4:19 AM	51
10/30/2025	4:34 AM	51
10/30/2025	4:49 AM	50
10/30/2025	5:04 AM	50
10/30/2025	5:19 AM	48
10/30/2025	5:34 AM	47
10/30/2025	5:49 AM	50
10/30/2025	6:04 AM	51
10/30/2025	6:19 AM	52
10/30/2025	6:34 AM	52
10/30/2025	6:49 AM	49
10/30/2025	7:04 AM	50
10/30/2025	7:19 AM	51
10/30/2025	7:34 AM	53
10/30/2025	7:49 AM	50
10/30/2025	8:04 AM	50
10/30/2025	8:19 AM	50
10/30/2025	8:34 AM	51
10/30/2025	8:49 AM	52
10/30/2025	9:04 AM	52
10/30/2025	9:19 AM	52
10/30/2025	9:34 AM	53
10/30/2025	9:49 AM	52
10/30/2025	10:04 AM	54
10/30/2025	10:19 AM	52
10/30/2025	10:34 AM	53
10/30/2025	10:49 AM	52
10/30/2025	11:04 AM	54
10/30/2025	11:19 AM	52
10/30/2025	11:34 AM	51
10/30/2025	11:49 AM	52
10/30/2025	12:04 PM	53
10/30/2025	12:19 PM	52
10/30/2025	12:34 PM	52
10/30/2025	12:49 PM	53
10/30/2025	1:04 PM	51
10/30/2025	1:19 PM	51
10/30/2025	1:34 PM	52
10/30/2025	1:49 PM	53
10/30/2025	2:04 PM	52
10/30/2025	2:19 PM	51
10/30/2025	2:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/30/2025	2:49 PM	51
10/30/2025	3:04 PM	52
10/30/2025	3:19 PM	51
10/30/2025	3:34 PM	52
10/30/2025	3:49 PM	52
10/30/2025	4:04 PM	52
10/30/2025	4:19 PM	52
10/30/2025	4:34 PM	54
10/30/2025	4:49 PM	52
10/30/2025	5:04 PM	51
10/30/2025	5:19 PM	52
10/30/2025	5:34 PM	52
10/30/2025	5:49 PM	52
10/30/2025	6:04 PM	53
10/30/2025	6:19 PM	52
10/30/2025	6:34 PM	52
10/30/2025	6:49 PM	52
10/30/2025	7:04 PM	52
10/30/2025	7:19 PM	52
10/30/2025	7:34 PM	52
10/30/2025	7:49 PM	52
10/30/2025	8:04 PM	52
10/30/2025	8:19 PM	53
10/30/2025	8:34 PM	53
10/30/2025	8:49 PM	52
10/30/2025	9:04 PM	51
10/30/2025	9:19 PM	52
10/30/2025	9:34 PM	52
10/30/2025	9:49 PM	51
10/30/2025	10:04 PM	52
10/30/2025	10:19 PM	52
10/30/2025	10:34 PM	52
10/30/2025	10:49 PM	52
10/30/2025	11:04 PM	52
10/30/2025	11:19 PM	52
10/30/2025	11:34 PM	52
10/30/2025	11:49 PM	52
10/31/2025	12:04 AM	52
10/31/2025	12:19 AM	52
10/31/2025	12:34 AM	52
10/31/2025	12:49 AM	52
10/31/2025	1:04 AM	52
10/31/2025	1:19 AM	50
10/31/2025	1:34 AM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/31/2025	1:49 AM	50
10/31/2025	2:04 AM	52
10/31/2025	2:19 AM	47
10/31/2025	2:34 AM	52
10/31/2025	2:49 AM	52
10/31/2025	3:04 AM	51
10/31/2025	3:19 AM	52
10/31/2025	3:34 AM	51
10/31/2025	3:49 AM	51
10/31/2025	4:04 AM	48
10/31/2025	4:19 AM	47
10/31/2025	4:34 AM	50
10/31/2025	4:49 AM	47
10/31/2025	5:04 AM	44
10/31/2025	5:19 AM	47
10/31/2025	5:34 AM	46
10/31/2025	5:49 AM	45
10/31/2025	6:04 AM	45
10/31/2025	6:19 AM	47
10/31/2025	6:34 AM	46
10/31/2025	6:49 AM	50
10/31/2025	7:04 AM	50
10/31/2025	7:19 AM	52
10/31/2025	7:34 AM	53
10/31/2025	7:49 AM	52
10/31/2025	8:04 AM	53
10/31/2025	8:19 AM	54
10/31/2025	8:34 AM	49
10/31/2025	8:49 AM	52
10/31/2025	9:04 AM	50
10/31/2025	9:19 AM	50
10/31/2025	9:34 AM	51
10/31/2025	9:49 AM	52
10/31/2025	10:04 AM	52
10/31/2025	10:19 AM	52
10/31/2025	10:34 AM	53
10/31/2025	10:49 AM	51
10/31/2025	11:04 AM	51
10/31/2025	11:19 AM	52
10/31/2025	11:34 AM	52
10/31/2025	11:49 AM	52
10/31/2025	12:04 PM	52
10/31/2025	12:19 PM	52
10/31/2025	12:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/31/2025	12:49 PM	52
10/31/2025	1:04 PM	53
10/31/2025	1:19 PM	53
10/31/2025	1:34 PM	52
10/31/2025	1:49 PM	52
10/31/2025	2:04 PM	51
10/31/2025	2:19 PM	52
10/31/2025	2:34 PM	51
10/31/2025	2:49 PM	52
10/31/2025	3:04 PM	52
10/31/2025	3:19 PM	52
10/31/2025	3:34 PM	52
10/31/2025	3:49 PM	52
10/31/2025	4:04 PM	52
10/31/2025	4:19 PM	52
10/31/2025	4:34 PM	52
10/31/2025	4:49 PM	52
10/31/2025	5:04 PM	52
10/31/2025	5:19 PM	51
10/31/2025	5:34 PM	52
10/31/2025	5:49 PM	52
10/31/2025	6:04 PM	52
10/31/2025	6:19 PM	52
10/31/2025	6:34 PM	52
10/31/2025	6:49 PM	52
10/31/2025	7:04 PM	52
10/31/2025	7:19 PM	52
10/31/2025	7:34 PM	52
10/31/2025	7:49 PM	52
10/31/2025	8:04 PM	52
10/31/2025	8:19 PM	52
10/31/2025	8:34 PM	52
10/31/2025	8:49 PM	52
10/31/2025	9:04 PM	52
10/31/2025	9:19 PM	52
10/31/2025	9:34 PM	52
10/31/2025	9:49 PM	52
10/31/2025	10:04 PM	52
10/31/2025	10:19 PM	52
10/31/2025	10:34 PM	52
10/31/2025	10:49 PM	52
10/31/2025	11:04 PM	52
10/31/2025	11:19 PM	52
10/31/2025	11:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
10/31/2025	11:49 PM	52
11/1/2025	12:04 AM	51
11/1/2025	12:19 AM	52
11/1/2025	12:34 AM	52
11/1/2025	12:49 AM	50
11/1/2025	1:04 AM	49
11/1/2025	1:19 AM	53
11/1/2025	1:34 AM	50
11/1/2025	1:49 AM	50
11/1/2025	2:04 AM	48
11/1/2025	2:19 AM	52
11/1/2025	2:34 AM	52
11/1/2025	2:49 AM	51
11/1/2025	3:04 AM	50
11/1/2025	3:19 AM	49
11/1/2025	3:34 AM	52
11/1/2025	3:49 AM	46
11/1/2025	4:04 AM	50
11/1/2025	4:19 AM	47
11/1/2025	4:34 AM	47
11/1/2025	4:49 AM	48
11/1/2025	5:04 AM	45
11/1/2025	5:19 AM	46
11/1/2025	5:34 AM	45
11/1/2025	5:49 AM	47
11/1/2025	6:04 AM	47
11/1/2025	6:19 AM	50
11/1/2025	6:34 AM	51
11/1/2025	6:49 AM	52
11/1/2025	7:04 AM	49
11/1/2025	7:19 AM	51
11/1/2025	7:34 AM	52
11/1/2025	7:49 AM	53
11/1/2025	8:04 AM	52
11/1/2025	8:19 AM	50
11/1/2025	8:34 AM	51
11/1/2025	8:49 AM	51
11/1/2025	9:04 AM	49
11/1/2025	9:19 AM	50
11/1/2025	9:34 AM	52
11/1/2025	9:49 AM	52
11/1/2025	10:04 AM	52
11/1/2025	10:19 AM	52
11/1/2025	10:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/1/2025	10:49 AM	52
11/1/2025	11:04 AM	52
11/1/2025	11:19 AM	52
11/1/2025	11:34 AM	52
11/1/2025	11:49 AM	52
11/1/2025	12:04 PM	51
11/1/2025	12:19 PM	52
11/1/2025	12:34 PM	52
11/1/2025	12:49 PM	52
11/1/2025	1:04 PM	52
11/1/2025	1:19 PM	52
11/1/2025	1:34 PM	52
11/1/2025	1:49 PM	52
11/1/2025	2:04 PM	52
11/1/2025	2:19 PM	52
11/1/2025	2:34 PM	52
11/1/2025	2:49 PM	52
11/1/2025	3:04 PM	52
11/1/2025	3:19 PM	52
11/1/2025	3:34 PM	52
11/1/2025	3:49 PM	52
11/1/2025	4:04 PM	51
11/1/2025	4:19 PM	52
11/1/2025	4:34 PM	52
11/1/2025	4:49 PM	51
11/1/2025	5:04 PM	51
11/1/2025	5:19 PM	52
11/1/2025	5:34 PM	52
11/1/2025	5:49 PM	52
11/1/2025	6:04 PM	52
11/1/2025	6:19 PM	52
11/1/2025	6:34 PM	52
11/1/2025	6:49 PM	52
11/1/2025	7:04 PM	52
11/1/2025	7:19 PM	52
11/1/2025	7:34 PM	52
11/1/2025	7:49 PM	52
11/1/2025	8:04 PM	52
11/1/2025	8:19 PM	52
11/1/2025	8:34 PM	52
11/1/2025	8:49 PM	52
11/1/2025	9:04 PM	52
11/1/2025	9:19 PM	52
11/1/2025	9:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/1/2025	9:49 PM	52
11/1/2025	10:04 PM	52
11/1/2025	10:19 PM	51
11/1/2025	10:34 PM	52
11/1/2025	10:49 PM	52
11/1/2025	11:04 PM	52
11/1/2025	11:19 PM	52
11/1/2025	11:34 PM	52
11/1/2025	11:49 PM	52
11/2/2025	12:04 AM	51
11/2/2025	12:19 AM	52
11/2/2025	12:34 AM	50
11/2/2025	12:49 AM	50
11/2/2025	1:04 AM	53
11/2/2025	1:19 AM	51
11/2/2025	1:34 AM	49
11/2/2025	1:49 AM	51
11/2/2025	2:04 AM	52
11/2/2025	2:19 AM	48
11/2/2025	2:34 AM	49
11/2/2025	2:49 AM	50
11/2/2025	3:04 AM	51
11/2/2025	3:19 AM	49
11/2/2025	3:34 AM	48
11/2/2025	3:49 AM	51
11/2/2025	4:04 AM	53
11/2/2025	4:19 AM	51
11/2/2025	4:34 AM	50
11/2/2025	4:49 AM	50
11/2/2025	5:04 AM	46
11/2/2025	5:19 AM	48
11/2/2025	5:34 AM	47
11/2/2025	5:49 AM	48
11/2/2025	6:04 AM	48
11/2/2025	6:19 AM	46
11/2/2025	6:34 AM	50
11/2/2025	6:49 AM	49
11/2/2025	7:04 AM	51
11/2/2025	7:19 AM	52
11/2/2025	7:34 AM	50
11/2/2025	7:49 AM	50
11/2/2025	8:04 AM	51
11/2/2025	8:19 AM	51
11/2/2025	8:34 AM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/2/2025	8:49 AM	52
11/2/2025	9:04 AM	52
11/2/2025	9:19 AM	51
11/2/2025	9:34 AM	51
11/2/2025	9:49 AM	52
11/2/2025	10:04 AM	53
11/2/2025	10:19 AM	52
11/2/2025	10:34 AM	52
11/2/2025	10:49 AM	53
11/2/2025	11:04 AM	52
11/2/2025	11:19 AM	52
11/2/2025	11:34 AM	51
11/2/2025	11:49 AM	52
11/2/2025	12:04 PM	51
11/2/2025	12:19 PM	52
11/2/2025	12:34 PM	52
11/2/2025	12:49 PM	52
11/2/2025	1:04 PM	52
11/2/2025	1:19 PM	51
11/2/2025	1:34 PM	51
11/2/2025	1:49 PM	52
11/2/2025	2:04 PM	52
11/2/2025	2:19 PM	52
11/2/2025	2:34 PM	52
11/2/2025	2:49 PM	53
11/2/2025	3:04 PM	52
11/2/2025	3:19 PM	52
11/2/2025	3:34 PM	53
11/2/2025	3:49 PM	52
11/2/2025	4:04 PM	52
11/2/2025	4:19 PM	52
11/2/2025	4:34 PM	52
11/2/2025	4:49 PM	53
11/2/2025	5:04 PM	52
11/2/2025	5:19 PM	52
11/2/2025	5:34 PM	52
11/2/2025	5:49 PM	52
11/2/2025	6:04 PM	52
11/2/2025	6:19 PM	52
11/2/2025	6:34 PM	52
11/2/2025	6:49 PM	51
11/2/2025	7:04 PM	52
11/2/2025	7:19 PM	53
11/2/2025	7:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/2/2025	7:49 PM	52
11/2/2025	8:04 PM	52
11/2/2025	8:19 PM	52
11/2/2025	8:34 PM	51
11/2/2025	8:49 PM	52
11/2/2025	9:04 PM	53
11/2/2025	9:19 PM	52
11/2/2025	9:34 PM	52
11/2/2025	9:49 PM	52
11/2/2025	10:04 PM	51
11/2/2025	10:19 PM	52
11/2/2025	10:34 PM	52
11/2/2025	10:49 PM	52
11/2/2025	11:04 PM	52
11/2/2025	11:19 PM	51
11/2/2025	11:34 PM	52
11/2/2025	11:49 PM	52
11/3/2025	12:04 AM	52
11/3/2025	12:19 AM	50
11/3/2025	12:34 AM	54
11/3/2025	12:49 AM	49
11/3/2025	1:04 AM	51
11/3/2025	1:19 AM	51
11/3/2025	1:34 AM	52
11/3/2025	1:49 AM	50
11/3/2025	2:04 AM	51
11/3/2025	2:19 AM	50
11/3/2025	2:34 AM	50
11/3/2025	2:49 AM	49
11/3/2025	3:04 AM	53
11/3/2025	3:19 AM	52
11/3/2025	3:34 AM	51
11/3/2025	3:49 AM	51
11/3/2025	4:04 AM	46
11/3/2025	4:19 AM	49
11/3/2025	4:34 AM	44
11/3/2025	4:49 AM	48
11/3/2025	5:04 AM	42
11/3/2025	5:19 AM	48
11/3/2025	5:34 AM	46
11/3/2025	5:49 AM	44
11/3/2025	6:04 AM	44
11/3/2025	6:19 AM	43
11/3/2025	6:34 AM	48



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/3/2025	6:49 AM	48
11/3/2025	7:04 AM	47
11/3/2025	7:19 AM	50
11/3/2025	7:34 AM	52
11/3/2025	7:49 AM	51
11/3/2025	8:04 AM	52
11/3/2025	8:19 AM	51
11/3/2025	8:34 AM	51
11/3/2025	8:49 AM	53
11/3/2025	9:04 AM	49
11/3/2025	9:19 AM	50
11/3/2025	9:34 AM	50
11/3/2025	9:49 AM	52
11/3/2025	10:04 AM	53
11/3/2025	10:19 AM	52
11/3/2025	10:34 AM	51
11/3/2025	10:49 AM	52
11/3/2025	11:04 AM	52
11/3/2025	11:19 AM	52
11/3/2025	11:34 AM	51
11/3/2025	11:49 AM	52
11/3/2025	12:04 PM	51
11/3/2025	12:19 PM	52
11/3/2025	12:34 PM	52
11/3/2025	12:49 PM	53
11/3/2025	1:04 PM	52
11/3/2025	1:19 PM	52
11/3/2025	1:34 PM	52
11/3/2025	1:49 PM	53
11/3/2025	2:04 PM	52
11/3/2025	2:19 PM	53
11/3/2025	2:34 PM	52
11/3/2025	2:49 PM	52
11/3/2025	3:04 PM	51
11/3/2025	3:19 PM	51
11/3/2025	3:34 PM	52
11/3/2025	3:49 PM	51
11/3/2025	4:04 PM	52
11/3/2025	4:19 PM	52
11/3/2025	4:34 PM	52
11/3/2025	4:49 PM	52
11/3/2025	5:04 PM	52
11/3/2025	5:19 PM	52
11/3/2025	5:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/3/2025	5:49 PM	51
11/3/2025	6:04 PM	52
11/3/2025	6:19 PM	52
11/3/2025	6:34 PM	52
11/3/2025	6:49 PM	51
11/3/2025	7:04 PM	53
11/3/2025	7:19 PM	53
11/3/2025	7:34 PM	51
11/3/2025	7:49 PM	50
11/3/2025	8:04 PM	50
11/3/2025	8:19 PM	52
11/3/2025	8:34 PM	52
11/3/2025	8:49 PM	51
11/3/2025	9:04 PM	53
11/3/2025	9:19 PM	51
11/3/2025	9:34 PM	52
11/3/2025	9:49 PM	53
11/3/2025	10:04 PM	51
11/3/2025	10:19 PM	52
11/3/2025	10:34 PM	52
11/3/2025	10:49 PM	52
11/3/2025	11:04 PM	52
11/3/2025	11:19 PM	52
11/3/2025	11:34 PM	52
11/3/2025	11:49 PM	52
11/4/2025	12:04 AM	51
11/4/2025	12:19 AM	52
11/4/2025	12:34 AM	51
11/4/2025	12:49 AM	52
11/4/2025	1:04 AM	51
11/4/2025	1:19 AM	50
11/4/2025	1:34 AM	52
11/4/2025	1:49 AM	52
11/4/2025	2:04 AM	51
11/4/2025	2:19 AM	53
11/4/2025	2:34 AM	51
11/4/2025	2:49 AM	52
11/4/2025	3:04 AM	51
11/4/2025	3:19 AM	52
11/4/2025	3:34 AM	52
11/4/2025	3:49 AM	52
11/4/2025	4:04 AM	52
11/4/2025	4:19 AM	48
11/4/2025	4:34 AM	49



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/4/2025	4:49 AM	50
11/4/2025	5:04 AM	46
11/4/2025	5:19 AM	46
11/4/2025	5:34 AM	46
11/4/2025	5:49 AM	47
11/4/2025	6:04 AM	49
11/4/2025	6:19 AM	47
11/4/2025	6:34 AM	50
11/4/2025	6:49 AM	50
11/4/2025	7:04 AM	51
11/4/2025	7:19 AM	52
11/4/2025	7:34 AM	52
11/4/2025	7:49 AM	51
11/4/2025	8:04 AM	52
11/4/2025	8:19 AM	52
11/4/2025	8:34 AM	52
11/4/2025	8:49 AM	50
11/4/2025	9:04 AM	48
11/4/2025	9:19 AM	49
11/4/2025	9:34 AM	52
11/4/2025	9:49 AM	52
11/4/2025	10:04 AM	53
11/4/2025	10:19 AM	52
11/4/2025	10:34 AM	50
11/4/2025	10:49 AM	52
11/4/2025	11:04 AM	52
11/4/2025	11:19 AM	52
11/4/2025	11:34 AM	52
11/4/2025	11:49 AM	52
11/4/2025	12:04 PM	52
11/4/2025	12:19 PM	52
11/4/2025	12:34 PM	52
11/4/2025	12:49 PM	53
11/4/2025	1:04 PM	53
11/4/2025	1:19 PM	51
11/4/2025	1:34 PM	52
11/4/2025	1:49 PM	52
11/4/2025	2:04 PM	52
11/4/2025	2:19 PM	52
11/4/2025	2:34 PM	51
11/4/2025	2:49 PM	52
11/4/2025	3:04 PM	52
11/4/2025	3:19 PM	52
11/4/2025	3:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/4/2025	3:49 PM	52
11/4/2025	4:04 PM	51
11/4/2025	4:19 PM	51
11/4/2025	4:34 PM	52
11/4/2025	4:49 PM	52
11/4/2025	5:04 PM	51
11/4/2025	5:19 PM	53
11/4/2025	5:34 PM	52
11/4/2025	5:49 PM	52
11/4/2025	6:04 PM	51
11/4/2025	6:19 PM	52
11/4/2025	6:34 PM	51
11/4/2025	6:49 PM	51
11/4/2025	7:04 PM	52
11/4/2025	7:19 PM	52
11/4/2025	7:34 PM	52
11/4/2025	7:49 PM	52
11/4/2025	8:04 PM	52
11/4/2025	8:19 PM	52
11/4/2025	8:34 PM	52
11/4/2025	8:49 PM	52
11/4/2025	9:04 PM	51
11/4/2025	9:19 PM	51
11/4/2025	9:34 PM	51
11/4/2025	9:49 PM	52
11/4/2025	10:04 PM	52
11/4/2025	10:19 PM	52
11/4/2025	10:34 PM	53
11/4/2025	10:49 PM	52
11/4/2025	11:04 PM	52
11/4/2025	11:19 PM	51
11/4/2025	11:34 PM	52
11/4/2025	11:49 PM	52
11/5/2025	12:04 AM	50
11/5/2025	12:19 AM	52
11/5/2025	12:34 AM	51
11/5/2025	12:49 AM	53
11/5/2025	1:04 AM	50
11/5/2025	1:19 AM	50
11/5/2025	1:34 AM	51
11/5/2025	1:49 AM	50
11/5/2025	2:04 AM	50
11/5/2025	2:19 AM	50
11/5/2025	2:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/5/2025	2:49 AM	52
11/5/2025	3:04 AM	49
11/5/2025	3:19 AM	47
11/5/2025	3:34 AM	50
11/5/2025	3:49 AM	51
11/5/2025	4:04 AM	48
11/5/2025	4:19 AM	47
11/5/2025	4:34 AM	44
11/5/2025	4:49 AM	48
11/5/2025	5:04 AM	45
11/5/2025	5:19 AM	43
11/5/2025	5:34 AM	45
11/5/2025	5:49 AM	46
11/5/2025	6:04 AM	46
11/5/2025	6:19 AM	48
11/5/2025	6:34 AM	47
11/5/2025	6:49 AM	48
11/5/2025	7:04 AM	50
11/5/2025	7:19 AM	44
11/5/2025	7:34 AM	50
11/5/2025	7:49 AM	51
11/5/2025	8:04 AM	51
11/5/2025	8:19 AM	52
11/5/2025	8:34 AM	50
11/5/2025	8:49 AM	49
11/5/2025	9:04 AM	49
11/5/2025	9:19 AM	49
11/5/2025	9:34 AM	52
11/5/2025	9:49 AM	53
11/5/2025	10:04 AM	50
11/5/2025	10:19 AM	51
11/5/2025	10:34 AM	51
11/5/2025	10:49 AM	52
11/5/2025	11:04 AM	52
11/5/2025	11:19 AM	53
11/5/2025	11:34 AM	51
11/5/2025	11:49 AM	51
11/5/2025	12:04 PM	52
11/5/2025	12:19 PM	52
11/5/2025	12:34 PM	52
11/5/2025	12:49 PM	51
11/5/2025	1:04 PM	52
11/5/2025	1:19 PM	51
11/5/2025	1:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/5/2025	1:49 PM	52
11/5/2025	2:04 PM	44
11/5/2025	2:19 PM	51
11/5/2025	2:34 PM	51
11/5/2025	2:49 PM	50
11/5/2025	3:04 PM	52
11/5/2025	3:19 PM	52
11/5/2025	3:34 PM	52
11/5/2025	3:49 PM	53
11/5/2025	4:04 PM	51
11/5/2025	4:19 PM	52
11/5/2025	4:34 PM	52
11/5/2025	4:49 PM	51
11/5/2025	5:04 PM	52
11/5/2025	5:19 PM	52
11/5/2025	5:34 PM	51
11/5/2025	5:49 PM	52
11/5/2025	6:04 PM	51
11/5/2025	6:19 PM	52
11/5/2025	6:34 PM	52
11/5/2025	6:49 PM	50
11/5/2025	7:04 PM	52
11/5/2025	7:19 PM	52
11/5/2025	7:34 PM	52
11/5/2025	7:49 PM	51
11/5/2025	8:04 PM	52
11/5/2025	8:19 PM	52
11/5/2025	8:34 PM	52
11/5/2025	8:49 PM	51
11/5/2025	9:04 PM	52
11/5/2025	9:19 PM	50
11/5/2025	9:34 PM	52
11/5/2025	9:49 PM	52
11/5/2025	10:04 PM	50
11/5/2025	10:19 PM	51
11/5/2025	10:34 PM	51
11/5/2025	10:49 PM	52
11/5/2025	11:04 PM	52
11/5/2025	11:19 PM	51
11/5/2025	11:34 PM	50
11/5/2025	11:49 PM	51
11/6/2025	12:04 AM	50
11/6/2025	12:19 AM	52
11/6/2025	12:34 AM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/6/2025	12:49 AM	52
11/6/2025	1:04 AM	51
11/6/2025	1:19 AM	54
11/6/2025	1:34 AM	51
11/6/2025	1:49 AM	50
11/6/2025	2:04 AM	49
11/6/2025	2:19 AM	49
11/6/2025	2:34 AM	53
11/6/2025	2:49 AM	51
11/6/2025	3:04 AM	51
11/6/2025	3:19 AM	49
11/6/2025	3:34 AM	52
11/6/2025	3:49 AM	49
11/6/2025	4:04 AM	51
11/6/2025	4:19 AM	51
11/6/2025	4:34 AM	51
11/6/2025	4:49 AM	47
11/6/2025	5:04 AM	47
11/6/2025	5:19 AM	45
11/6/2025	5:34 AM	48
11/6/2025	5:49 AM	45
11/6/2025	6:04 AM	48
11/6/2025	6:19 AM	46
11/6/2025	6:34 AM	49
11/6/2025	6:49 AM	51
11/6/2025	7:04 AM	51
11/6/2025	7:19 AM	45
11/6/2025	7:34 AM	51
11/6/2025	7:49 AM	51
11/6/2025	8:04 AM	53
11/6/2025	8:19 AM	50
11/6/2025	8:34 AM	53
11/6/2025	8:49 AM	52
11/6/2025	9:04 AM	52
11/6/2025	9:19 AM	53
11/6/2025	9:34 AM	51
11/6/2025	9:49 AM	51
11/6/2025	10:04 AM	52
11/6/2025	10:19 AM	52
11/6/2025	10:34 AM	52
11/6/2025	10:49 AM	53
11/6/2025	11:04 AM	52
11/6/2025	11:19 AM	52
11/6/2025	11:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/6/2025	11:49 AM	52
11/6/2025	12:04 PM	51
11/6/2025	12:19 PM	53
11/6/2025	12:34 PM	52
11/6/2025	12:49 PM	53
11/6/2025	1:04 PM	53
11/6/2025	1:19 PM	52
11/6/2025	1:34 PM	53
11/6/2025	1:49 PM	52
11/6/2025	2:04 PM	52
11/6/2025	2:19 PM	52
11/6/2025	2:34 PM	52
11/6/2025	2:49 PM	52
11/6/2025	3:04 PM	51
11/6/2025	3:19 PM	52
11/6/2025	3:34 PM	52
11/6/2025	3:49 PM	52
11/6/2025	4:04 PM	51
11/6/2025	4:19 PM	51
11/6/2025	4:34 PM	52
11/6/2025	4:49 PM	53
11/6/2025	5:04 PM	52
11/6/2025	5:19 PM	52
11/6/2025	5:34 PM	51
11/6/2025	5:49 PM	53
11/6/2025	6:04 PM	52
11/6/2025	6:19 PM	53
11/6/2025	6:34 PM	52
11/6/2025	6:49 PM	52
11/6/2025	7:04 PM	52
11/6/2025	7:19 PM	52
11/6/2025	7:34 PM	52
11/6/2025	7:49 PM	52
11/6/2025	8:04 PM	52
11/6/2025	8:19 PM	52
11/6/2025	8:34 PM	52
11/6/2025	8:49 PM	52
11/6/2025	9:04 PM	52
11/6/2025	9:19 PM	52
11/6/2025	9:34 PM	52
11/6/2025	9:49 PM	52
11/6/2025	10:04 PM	52
11/6/2025	10:19 PM	52
11/6/2025	10:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/6/2025	10:49 PM	52
11/6/2025	11:04 PM	52
11/6/2025	11:19 PM	52
11/6/2025	11:34 PM	52
11/6/2025	11:49 PM	50
11/7/2025	12:04 AM	54
11/7/2025	12:19 AM	50
11/7/2025	12:34 AM	50
11/7/2025	12:49 AM	52
11/7/2025	1:04 AM	50
11/7/2025	1:19 AM	50
11/7/2025	1:34 AM	52
11/7/2025	1:49 AM	51
11/7/2025	2:04 AM	49
11/7/2025	2:19 AM	49
11/7/2025	2:34 AM	51
11/7/2025	2:49 AM	50
11/7/2025	3:04 AM	52
11/7/2025	3:19 AM	51
11/7/2025	3:34 AM	50
11/7/2025	3:49 AM	52
11/7/2025	4:04 AM	46
11/7/2025	4:19 AM	44
11/7/2025	4:34 AM	46
11/7/2025	4:49 AM	46
11/7/2025	5:04 AM	44
11/7/2025	5:19 AM	45
11/7/2025	5:34 AM	44
11/7/2025	5:49 AM	44
11/7/2025	6:04 AM	44
11/7/2025	6:19 AM	47
11/7/2025	6:34 AM	49
11/7/2025	6:49 AM	46
11/7/2025	7:04 AM	48
11/7/2025	7:19 AM	50
11/7/2025	7:34 AM	50
11/7/2025	7:49 AM	50
11/7/2025	8:04 AM	48
11/7/2025	8:19 AM	52
11/7/2025	8:34 AM	50
11/7/2025	8:49 AM	50
11/7/2025	9:04 AM	49
11/7/2025	9:19 AM	52
11/7/2025	9:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/7/2025	9:49 AM	49
11/7/2025	10:04 AM	53
11/7/2025	10:19 AM	53
11/7/2025	10:34 AM	49
11/7/2025	10:49 AM	49
11/7/2025	11:04 AM	50
11/7/2025	11:19 AM	52
11/7/2025	11:34 AM	50
11/7/2025	11:49 AM	51
11/7/2025	12:04 PM	53
11/7/2025	12:19 PM	51
11/7/2025	12:34 PM	52
11/7/2025	12:49 PM	51
11/7/2025	1:04 PM	53
11/7/2025	1:19 PM	52
11/7/2025	1:34 PM	53
11/7/2025	1:49 PM	52
11/7/2025	2:04 PM	52
11/7/2025	2:19 PM	52
11/7/2025	2:34 PM	52
11/7/2025	2:49 PM	51
11/7/2025	3:04 PM	52
11/7/2025	3:19 PM	52
11/7/2025	3:34 PM	51
11/7/2025	3:49 PM	52
11/7/2025	4:04 PM	51
11/7/2025	4:19 PM	52
11/7/2025	4:34 PM	52
11/7/2025	4:49 PM	52
11/7/2025	5:04 PM	52
11/7/2025	5:19 PM	52
11/7/2025	5:34 PM	52
11/7/2025	5:49 PM	52
11/7/2025	6:04 PM	51
11/7/2025	6:19 PM	50
11/7/2025	6:34 PM	50
11/7/2025	6:49 PM	52
11/7/2025	7:04 PM	52
11/7/2025	7:19 PM	52
11/7/2025	7:34 PM	51
11/7/2025	7:49 PM	52
11/7/2025	8:04 PM	52
11/7/2025	8:19 PM	52
11/7/2025	8:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/7/2025	8:49 PM	52
11/7/2025	9:04 PM	52
11/7/2025	9:19 PM	52
11/7/2025	9:34 PM	51
11/7/2025	9:49 PM	52
11/7/2025	10:04 PM	52
11/7/2025	10:19 PM	52
11/7/2025	10:34 PM	52
11/7/2025	10:49 PM	52
11/7/2025	11:04 PM	51
11/7/2025	11:19 PM	51
11/7/2025	11:34 PM	51
11/7/2025	11:49 PM	50
11/8/2025	12:04 AM	51
11/8/2025	12:19 AM	49
11/8/2025	12:34 AM	51
11/8/2025	12:49 AM	52
11/8/2025	1:04 AM	50
11/8/2025	1:19 AM	50
11/8/2025	1:34 AM	49
11/8/2025	1:49 AM	52
11/8/2025	2:04 AM	51
11/8/2025	2:19 AM	52
11/8/2025	2:34 AM	52
11/8/2025	2:49 AM	52
11/8/2025	3:04 AM	48
11/8/2025	3:19 AM	51
11/8/2025	3:34 AM	52
11/8/2025	3:49 AM	51
11/8/2025	4:04 AM	49
11/8/2025	4:19 AM	50
11/8/2025	4:34 AM	49
11/8/2025	4:49 AM	48
11/8/2025	5:04 AM	47
11/8/2025	5:19 AM	47
11/8/2025	5:34 AM	47
11/8/2025	5:49 AM	45
11/8/2025	6:04 AM	48
11/8/2025	6:19 AM	45
11/8/2025	6:34 AM	47
11/8/2025	6:49 AM	50
11/8/2025	7:04 AM	51
11/8/2025	7:19 AM	49
11/8/2025	7:34 AM	49



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/8/2025	7:49 AM	50
11/8/2025	8:04 AM	51
11/8/2025	8:19 AM	50
11/8/2025	8:34 AM	50
11/8/2025	8:49 AM	52
11/8/2025	9:04 AM	50
11/8/2025	9:19 AM	51
11/8/2025	9:34 AM	51
11/8/2025	9:49 AM	52
11/8/2025	10:04 AM	52
11/8/2025	10:19 AM	52
11/8/2025	10:34 AM	52
11/8/2025	10:49 AM	52
11/8/2025	11:04 AM	51
11/8/2025	11:19 AM	52
11/8/2025	11:34 AM	52
11/8/2025	11:49 AM	52
11/8/2025	12:04 PM	51
11/8/2025	12:19 PM	52
11/8/2025	12:34 PM	52
11/8/2025	12:49 PM	52
11/8/2025	1:04 PM	52
11/8/2025	1:19 PM	53
11/8/2025	1:34 PM	52
11/8/2025	1:49 PM	51
11/8/2025	2:04 PM	53
11/8/2025	2:19 PM	52
11/8/2025	2:34 PM	52
11/8/2025	2:49 PM	51
11/8/2025	3:04 PM	52
11/8/2025	3:19 PM	53
11/8/2025	3:34 PM	52
11/8/2025	3:49 PM	52
11/8/2025	4:04 PM	52
11/8/2025	4:19 PM	51
11/8/2025	4:34 PM	51
11/8/2025	4:49 PM	52
11/8/2025	5:04 PM	51
11/8/2025	5:19 PM	51
11/8/2025	5:34 PM	52
11/8/2025	5:49 PM	52
11/8/2025	6:04 PM	52
11/8/2025	6:19 PM	51
11/8/2025	6:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/8/2025	6:49 PM	51
11/8/2025	7:04 PM	51
11/8/2025	7:19 PM	51
11/8/2025	7:34 PM	52
11/8/2025	7:49 PM	52
11/8/2025	8:04 PM	52
11/8/2025	8:19 PM	52
11/8/2025	8:34 PM	52
11/8/2025	8:49 PM	52
11/8/2025	9:04 PM	52
11/8/2025	9:19 PM	52
11/8/2025	9:34 PM	51
11/8/2025	9:49 PM	52
11/8/2025	10:04 PM	52
11/8/2025	10:19 PM	52
11/8/2025	10:34 PM	52
11/8/2025	10:49 PM	52
11/8/2025	11:04 PM	52
11/8/2025	11:19 PM	53
11/8/2025	11:34 PM	52
11/8/2025	11:49 PM	52
11/9/2025	12:04 AM	51
11/9/2025	12:19 AM	52
11/9/2025	12:34 AM	50
11/9/2025	12:49 AM	51
11/9/2025	1:04 AM	50
11/9/2025	1:19 AM	50
11/9/2025	1:34 AM	51
11/9/2025	1:49 AM	49
11/9/2025	2:04 AM	48
11/9/2025	2:19 AM	50
11/9/2025	2:34 AM	51
11/9/2025	2:49 AM	52
11/9/2025	3:04 AM	47
11/9/2025	3:19 AM	51
11/9/2025	3:34 AM	51
11/9/2025	3:49 AM	48
11/9/2025	4:04 AM	50
11/9/2025	4:19 AM	50
11/9/2025	4:34 AM	50
11/9/2025	4:49 AM	50
11/9/2025	5:04 AM	45
11/9/2025	5:19 AM	46
11/9/2025	5:34 AM	49



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/9/2025	5:49 AM	46
11/9/2025	6:04 AM	45
11/9/2025	6:19 AM	49
11/9/2025	6:34 AM	51
11/9/2025	6:49 AM	48
11/9/2025	7:04 AM	46
11/9/2025	7:19 AM	50
11/9/2025	7:34 AM	51
11/9/2025	7:49 AM	50
11/9/2025	8:04 AM	49
11/9/2025	8:19 AM	52
11/9/2025	8:34 AM	52
11/9/2025	8:49 AM	49
11/9/2025	9:04 AM	52
11/9/2025	9:19 AM	50
11/9/2025	9:34 AM	50
11/9/2025	9:49 AM	52
11/9/2025	10:04 AM	51
11/9/2025	10:19 AM	51
11/9/2025	10:34 AM	52
11/9/2025	10:49 AM	51
11/9/2025	11:04 AM	52
11/9/2025	11:19 AM	52
11/9/2025	11:34 AM	52
11/9/2025	11:49 AM	52
11/9/2025	12:04 PM	53
11/9/2025	12:19 PM	52
11/9/2025	12:34 PM	51
11/9/2025	12:49 PM	52
11/9/2025	1:04 PM	52
11/9/2025	1:19 PM	52
11/9/2025	1:34 PM	52
11/9/2025	1:49 PM	52
11/9/2025	2:04 PM	53
11/9/2025	2:19 PM	52
11/9/2025	2:34 PM	52
11/9/2025	2:49 PM	52
11/9/2025	3:04 PM	52
11/9/2025	3:19 PM	52
11/9/2025	3:34 PM	52
11/9/2025	3:49 PM	52
11/9/2025	4:04 PM	52
11/9/2025	4:19 PM	52
11/9/2025	4:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/9/2025	4:49 PM	52
11/9/2025	5:04 PM	51
11/9/2025	5:19 PM	52
11/9/2025	5:34 PM	53
11/9/2025	5:49 PM	52
11/9/2025	6:04 PM	52
11/9/2025	6:19 PM	52
11/9/2025	6:34 PM	52
11/9/2025	6:49 PM	52
11/9/2025	7:04 PM	52
11/9/2025	7:19 PM	52
11/9/2025	7:34 PM	52
11/9/2025	7:49 PM	52
11/9/2025	8:04 PM	52
11/9/2025	8:19 PM	52
11/9/2025	8:34 PM	51
11/9/2025	8:49 PM	52
11/9/2025	9:04 PM	54
11/9/2025	9:19 PM	50
11/9/2025	9:34 PM	51
11/9/2025	9:49 PM	50
11/9/2025	10:04 PM	53
11/9/2025	10:19 PM	52
11/9/2025	10:34 PM	52
11/9/2025	10:49 PM	52
11/9/2025	11:04 PM	52
11/9/2025	11:19 PM	53
11/9/2025	11:34 PM	52
11/9/2025	11:49 PM	52
11/10/2025	12:04 AM	51
11/10/2025	12:19 AM	52
11/10/2025	12:34 AM	50
11/10/2025	12:49 AM	50
11/10/2025	1:04 AM	50
11/10/2025	1:19 AM	52
11/10/2025	1:34 AM	50
11/10/2025	1:49 AM	51
11/10/2025	2:04 AM	50
11/10/2025	2:19 AM	50
11/10/2025	2:34 AM	48
11/10/2025	2:49 AM	50
11/10/2025	3:04 AM	51
11/10/2025	3:19 AM	51
11/10/2025	3:34 AM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/10/2025	3:49 AM	50
11/10/2025	4:04 AM	48
11/10/2025	4:19 AM	48
11/10/2025	4:34 AM	45
11/10/2025	4:49 AM	46
11/10/2025	5:04 AM	43
11/10/2025	5:19 AM	42
11/10/2025	5:34 AM	45
11/10/2025	5:49 AM	46
11/10/2025	6:04 AM	45
11/10/2025	6:19 AM	46
11/10/2025	6:34 AM	44
11/10/2025	6:49 AM	46
11/10/2025	7:04 AM	45
11/10/2025	7:19 AM	49
11/10/2025	7:34 AM	49
11/10/2025	7:49 AM	52
11/10/2025	8:04 AM	50
11/10/2025	8:19 AM	53
11/10/2025	8:34 AM	52
11/10/2025	8:49 AM	51
11/10/2025	9:04 AM	48
11/10/2025	9:19 AM	53
11/10/2025	9:34 AM	50
11/10/2025	9:49 AM	51
11/10/2025	10:04 AM	51
11/10/2025	10:19 AM	52
11/10/2025	10:34 AM	53
11/10/2025	10:49 AM	52
11/10/2025	11:04 AM	52
11/10/2025	11:19 AM	52
11/10/2025	11:34 AM	53
11/10/2025	11:49 AM	52
11/10/2025	12:04 PM	53
11/10/2025	12:19 PM	53
11/10/2025	12:34 PM	51
11/10/2025	12:49 PM	52
11/10/2025	1:04 PM	51
11/10/2025	1:19 PM	52
11/10/2025	1:34 PM	52
11/10/2025	1:49 PM	53
11/10/2025	2:04 PM	52
11/10/2025	2:19 PM	52
11/10/2025	2:34 PM	53



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/10/2025	2:49 PM	52
11/10/2025	3:04 PM	53
11/10/2025	3:19 PM	52
11/10/2025	3:34 PM	52
11/10/2025	3:49 PM	51
11/10/2025	4:04 PM	53
11/10/2025	4:19 PM	52
11/10/2025	4:34 PM	52
11/10/2025	4:49 PM	52
11/10/2025	5:04 PM	53
11/10/2025	5:19 PM	52
11/10/2025	5:34 PM	52
11/10/2025	5:49 PM	52
11/10/2025	6:04 PM	51
11/10/2025	6:19 PM	52
11/10/2025	6:34 PM	51
11/10/2025	6:49 PM	51
11/10/2025	7:04 PM	52
11/10/2025	7:19 PM	52
11/10/2025	7:34 PM	52
11/10/2025	7:49 PM	52
11/10/2025	8:04 PM	52
11/10/2025	8:19 PM	52
11/10/2025	8:34 PM	53
11/10/2025	8:49 PM	52
11/10/2025	9:04 PM	50
11/10/2025	9:19 PM	52
11/10/2025	9:34 PM	52
11/10/2025	9:49 PM	52
11/10/2025	10:04 PM	52
11/10/2025	10:19 PM	52
11/10/2025	10:34 PM	52
11/10/2025	10:49 PM	52
11/10/2025	11:04 PM	50
11/10/2025	11:19 PM	51
11/10/2025	11:34 PM	52
11/10/2025	11:49 PM	50
11/11/2025	12:04 AM	52
11/11/2025	12:19 AM	50
11/11/2025	12:34 AM	51
11/11/2025	12:49 AM	51
11/11/2025	1:04 AM	50
11/11/2025	1:19 AM	51
11/11/2025	1:34 AM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/11/2025	1:49 AM	51
11/11/2025	2:04 AM	50
11/11/2025	2:19 AM	51
11/11/2025	2:34 AM	52
11/11/2025	2:49 AM	52
11/11/2025	3:04 AM	50
11/11/2025	3:19 AM	52
11/11/2025	3:34 AM	52
11/11/2025	3:49 AM	52
11/11/2025	4:04 AM	51
11/11/2025	4:19 AM	52
11/11/2025	4:34 AM	51
11/11/2025	4:49 AM	50
11/11/2025	5:04 AM	46
11/11/2025	5:19 AM	47
11/11/2025	5:34 AM	51
11/11/2025	5:49 AM	48
11/11/2025	6:04 AM	47
11/11/2025	6:19 AM	48
11/11/2025	6:34 AM	52
11/11/2025	6:49 AM	52
11/11/2025	7:04 AM	52
11/11/2025	7:19 AM	52
11/11/2025	7:34 AM	51
11/11/2025	7:49 AM	52
11/11/2025	8:04 AM	49
11/11/2025	8:19 AM	51
11/11/2025	8:34 AM	52
11/11/2025	8:49 AM	51
11/11/2025	9:04 AM	51
11/11/2025	9:19 AM	49
11/11/2025	9:34 AM	52
11/11/2025	9:49 AM	50
11/11/2025	10:04 AM	52
11/11/2025	10:19 AM	51
11/11/2025	10:34 AM	50
11/11/2025	10:49 AM	51
11/11/2025	11:04 AM	50
11/11/2025	11:19 AM	51
11/11/2025	11:34 AM	52
11/11/2025	11:49 AM	53
11/11/2025	12:04 PM	52
11/11/2025	12:19 PM	50
11/11/2025	12:34 PM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/11/2025	12:49 PM	51
11/11/2025	1:04 PM	52
11/11/2025	1:19 PM	52
11/11/2025	1:34 PM	53
11/11/2025	1:49 PM	51
11/11/2025	2:04 PM	51
11/11/2025	2:19 PM	53
11/11/2025	2:34 PM	51
11/11/2025	2:49 PM	52
11/11/2025	3:04 PM	52
11/11/2025	3:19 PM	52
11/11/2025	3:34 PM	51
11/11/2025	3:49 PM	52
11/11/2025	4:04 PM	51
11/11/2025	4:19 PM	53
11/11/2025	4:34 PM	52
11/11/2025	4:49 PM	52
11/11/2025	5:04 PM	51
11/11/2025	5:19 PM	52
11/11/2025	5:34 PM	51
11/11/2025	5:49 PM	52
11/11/2025	6:04 PM	51
11/11/2025	6:19 PM	52
11/11/2025	6:34 PM	52
11/11/2025	6:49 PM	53
11/11/2025	7:04 PM	52
11/11/2025	7:19 PM	52
11/11/2025	7:34 PM	52
11/11/2025	7:49 PM	52
11/11/2025	8:04 PM	52
11/11/2025	8:19 PM	52
11/11/2025	8:34 PM	51
11/11/2025	8:49 PM	52
11/11/2025	9:04 PM	50
11/11/2025	9:19 PM	49
11/11/2025	9:34 PM	51
11/11/2025	9:49 PM	50
11/11/2025	10:04 PM	51
11/11/2025	10:19 PM	52
11/11/2025	10:34 PM	52
11/11/2025	10:49 PM	52
11/11/2025	11:04 PM	51
11/11/2025	11:19 PM	51
11/11/2025	11:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/11/2025	11:49 PM	52
11/12/2025	12:04 AM	50
11/12/2025	12:19 AM	50
11/12/2025	12:34 AM	51
11/12/2025	12:49 AM	51
11/12/2025	1:04 AM	50
11/12/2025	1:19 AM	50
11/12/2025	1:34 AM	51
11/12/2025	1:49 AM	50
11/12/2025	2:04 AM	50
11/12/2025	2:19 AM	49
11/12/2025	2:34 AM	49
11/12/2025	2:49 AM	49
11/12/2025	3:04 AM	51
11/12/2025	3:19 AM	50
11/12/2025	3:34 AM	50
11/12/2025	3:49 AM	46
11/12/2025	4:04 AM	46
11/12/2025	4:19 AM	47
11/12/2025	4:34 AM	48
11/12/2025	4:49 AM	48
11/12/2025	5:04 AM	47
11/12/2025	5:19 AM	48
11/12/2025	5:34 AM	46
11/12/2025	5:49 AM	47
11/12/2025	6:04 AM	45
11/12/2025	6:19 AM	45
11/12/2025	6:34 AM	47
11/12/2025	6:49 AM	48
11/12/2025	7:04 AM	46
11/12/2025	7:19 AM	48
11/12/2025	7:34 AM	51
11/12/2025	7:49 AM	48
11/12/2025	8:04 AM	51
11/12/2025	8:19 AM	51
11/12/2025	8:34 AM	48
11/12/2025	8:49 AM	51
11/12/2025	9:04 AM	51
11/12/2025	9:19 AM	50
11/12/2025	9:34 AM	53
11/12/2025	9:49 AM	50
11/12/2025	10:04 AM	52
11/12/2025	10:19 AM	50
11/12/2025	10:34 AM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/12/2025	10:49 AM	52
11/12/2025	11:04 AM	53
11/12/2025	11:19 AM	52
11/12/2025	11:34 AM	52
11/12/2025	11:49 AM	52
11/12/2025	12:04 PM	54
11/12/2025	12:19 PM	53
11/12/2025	12:34 PM	51
11/12/2025	12:49 PM	52
11/12/2025	1:04 PM	52
11/12/2025	1:19 PM	53
11/12/2025	1:34 PM	54
11/12/2025	1:49 PM	51
11/12/2025	2:04 PM	52
11/12/2025	2:19 PM	52
11/12/2025	2:34 PM	52
11/12/2025	2:49 PM	52
11/12/2025	3:04 PM	52
11/12/2025	3:19 PM	52
11/12/2025	3:34 PM	52
11/12/2025	3:49 PM	52
11/12/2025	4:04 PM	51
11/12/2025	4:19 PM	53
11/12/2025	4:34 PM	52
11/12/2025	4:49 PM	52
11/12/2025	5:04 PM	52
11/12/2025	5:19 PM	51
11/12/2025	5:34 PM	53
11/12/2025	5:49 PM	52
11/12/2025	6:04 PM	52
11/12/2025	6:19 PM	52
11/12/2025	6:34 PM	52
11/12/2025	6:49 PM	52
11/12/2025	7:04 PM	52
11/12/2025	7:19 PM	52
11/12/2025	7:34 PM	52
11/12/2025	7:49 PM	52
11/12/2025	8:04 PM	52
11/12/2025	8:19 PM	51
11/12/2025	8:34 PM	52
11/12/2025	8:49 PM	52
11/12/2025	9:04 PM	51
11/12/2025	9:19 PM	51
11/12/2025	9:34 PM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/12/2025	9:49 PM	52
11/12/2025	10:04 PM	51
11/12/2025	10:19 PM	52
11/12/2025	10:34 PM	53
11/12/2025	10:49 PM	53
11/12/2025	11:04 PM	51
11/12/2025	11:19 PM	52
11/12/2025	11:34 PM	52
11/12/2025	11:49 PM	52
11/13/2025	12:04 AM	50
11/13/2025	12:19 AM	50
11/13/2025	12:34 AM	51
11/13/2025	12:49 AM	50
11/13/2025	1:04 AM	53
11/13/2025	1:19 AM	50
11/13/2025	1:34 AM	50
11/13/2025	1:49 AM	52
11/13/2025	2:04 AM	49
11/13/2025	2:19 AM	51
11/13/2025	2:34 AM	49
11/13/2025	2:49 AM	50
11/13/2025	3:04 AM	52
11/13/2025	3:19 AM	48
11/13/2025	3:34 AM	52
11/13/2025	3:49 AM	50
11/13/2025	4:04 AM	51
11/13/2025	4:19 AM	52
11/13/2025	4:34 AM	51
11/13/2025	4:49 AM	51
11/13/2025	5:04 AM	46
11/13/2025	5:19 AM	44
11/13/2025	5:34 AM	44
11/13/2025	5:49 AM	47
11/13/2025	6:04 AM	47
11/13/2025	6:19 AM	48
11/13/2025	6:34 AM	51
11/13/2025	6:49 AM	51
11/13/2025	7:04 AM	46
11/13/2025	7:19 AM	51
11/13/2025	7:34 AM	51
11/13/2025	7:49 AM	51
11/13/2025	8:04 AM	52
11/13/2025	8:19 AM	52
11/13/2025	8:34 AM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/13/2025	8:49 AM	51
11/13/2025	9:04 AM	52
11/13/2025	9:19 AM	52
11/13/2025	9:34 AM	49
11/13/2025	9:49 AM	52
11/13/2025	10:04 AM	51
11/13/2025	10:19 AM	52
11/13/2025	10:34 AM	51
11/13/2025	10:49 AM	52
11/13/2025	11:04 AM	51
11/13/2025	11:19 AM	52
11/13/2025	11:34 AM	52
11/13/2025	11:49 AM	52
11/13/2025	12:04 PM	52
11/13/2025	12:19 PM	52
11/13/2025	12:34 PM	52
11/13/2025	12:49 PM	51
11/13/2025	1:04 PM	52
11/13/2025	1:19 PM	51
11/13/2025	1:34 PM	52
11/13/2025	1:49 PM	52
11/13/2025	2:04 PM	51
11/13/2025	2:19 PM	52
11/13/2025	2:34 PM	52
11/13/2025	2:49 PM	52
11/13/2025	3:04 PM	52
11/13/2025	3:19 PM	51
11/13/2025	3:34 PM	51
11/13/2025	3:49 PM	50
11/13/2025	4:04 PM	53
11/13/2025	4:19 PM	50
11/13/2025	4:34 PM	52
11/13/2025	4:49 PM	52
11/13/2025	5:04 PM	52
11/13/2025	5:19 PM	51
11/13/2025	5:34 PM	52
11/13/2025	5:49 PM	52
11/13/2025	6:04 PM	52
11/13/2025	6:19 PM	53
11/13/2025	6:34 PM	52
11/13/2025	6:49 PM	51
11/13/2025	7:04 PM	52
11/13/2025	7:19 PM	52
11/13/2025	7:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/13/2025	7:49 PM	52
11/13/2025	8:04 PM	52
11/13/2025	8:19 PM	52
11/13/2025	8:34 PM	52
11/13/2025	8:49 PM	52
11/13/2025	9:04 PM	52
11/13/2025	9:19 PM	52
11/13/2025	9:34 PM	51
11/13/2025	9:49 PM	52
11/13/2025	10:04 PM	50
11/13/2025	10:19 PM	51
11/13/2025	10:34 PM	50
11/13/2025	10:49 PM	53
11/13/2025	11:04 PM	52
11/13/2025	11:19 PM	52
11/13/2025	11:34 PM	52
11/13/2025	11:49 PM	53
11/14/2025	12:04 AM	52
11/14/2025	12:19 AM	50
11/14/2025	12:34 AM	50
11/14/2025	12:49 AM	54
11/14/2025	1:04 AM	49
11/14/2025	1:19 AM	53
11/14/2025	1:34 AM	50
11/14/2025	1:49 AM	51
11/14/2025	2:04 AM	48
11/14/2025	2:19 AM	52
11/14/2025	2:34 AM	49
11/14/2025	2:49 AM	49
11/14/2025	3:04 AM	52
11/14/2025	3:19 AM	51
11/14/2025	3:34 AM	51
11/14/2025	3:49 AM	52
11/14/2025	4:04 AM	49
11/14/2025	4:19 AM	48
11/14/2025	4:34 AM	46
11/14/2025	4:49 AM	46
11/14/2025	5:04 AM	48
11/14/2025	5:19 AM	46
11/14/2025	5:34 AM	44
11/14/2025	5:49 AM	46
11/14/2025	6:04 AM	45
11/14/2025	6:19 AM	45
11/14/2025	6:34 AM	44



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/14/2025	6:49 AM	46
11/14/2025	7:04 AM	47
11/14/2025	7:19 AM	49
11/14/2025	7:34 AM	50
11/14/2025	7:49 AM	52
11/14/2025	8:04 AM	52
11/14/2025	8:19 AM	52
11/14/2025	8:34 AM	52
11/14/2025	8:49 AM	50
11/14/2025	9:04 AM	51
11/14/2025	9:19 AM	51
11/14/2025	9:34 AM	49
11/14/2025	9:49 AM	52
11/14/2025	10:04 AM	50
11/14/2025	10:19 AM	53
11/14/2025	10:34 AM	51
11/14/2025	10:49 AM	52
11/14/2025	11:04 AM	49
11/14/2025	11:19 AM	52
11/14/2025	11:34 AM	50
11/14/2025	11:49 AM	50
11/14/2025	12:04 PM	52
11/14/2025	12:19 PM	51
11/14/2025	12:34 PM	52
11/14/2025	12:49 PM	52
11/14/2025	1:04 PM	51
11/14/2025	1:19 PM	52
11/14/2025	1:34 PM	52
11/14/2025	1:49 PM	52
11/14/2025	2:04 PM	51
11/14/2025	2:19 PM	52
11/14/2025	2:34 PM	52
11/14/2025	2:49 PM	52
11/14/2025	3:04 PM	52
11/14/2025	3:19 PM	52
11/14/2025	3:34 PM	52
11/14/2025	3:49 PM	52
11/14/2025	4:04 PM	51
11/14/2025	4:19 PM	51
11/14/2025	4:34 PM	52
11/14/2025	4:49 PM	52
11/14/2025	5:04 PM	51
11/14/2025	5:19 PM	52
11/14/2025	5:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/14/2025	5:49 PM	51
11/14/2025	6:04 PM	52
11/14/2025	6:19 PM	52
11/14/2025	6:34 PM	51
11/14/2025	6:49 PM	52
11/14/2025	7:04 PM	52
11/14/2025	7:19 PM	51
11/14/2025	7:34 PM	52
11/14/2025	7:49 PM	52
11/14/2025	8:04 PM	52
11/14/2025	8:19 PM	52
11/14/2025	8:34 PM	52
11/14/2025	8:49 PM	52
11/14/2025	9:04 PM	52
11/14/2025	9:19 PM	51
11/14/2025	9:34 PM	51
11/14/2025	9:49 PM	52
11/14/2025	10:04 PM	51
11/14/2025	10:19 PM	52
11/14/2025	10:34 PM	52
11/14/2025	10:49 PM	52
11/14/2025	11:04 PM	52
11/14/2025	11:19 PM	52
11/14/2025	11:34 PM	52
11/14/2025	11:49 PM	51
11/15/2025	12:04 AM	50
11/15/2025	12:19 AM	51
11/15/2025	12:34 AM	50
11/15/2025	12:49 AM	51
11/15/2025	1:04 AM	50
11/15/2025	1:19 AM	50
11/15/2025	1:34 AM	49
11/15/2025	1:49 AM	51
11/15/2025	2:04 AM	50
11/15/2025	2:19 AM	52
11/15/2025	2:34 AM	52
11/15/2025	2:49 AM	52
11/15/2025	3:04 AM	47
11/15/2025	3:19 AM	51
11/15/2025	3:34 AM	51
11/15/2025	3:49 AM	51
11/15/2025	4:04 AM	49
11/15/2025	4:19 AM	48
11/15/2025	4:34 AM	45



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/15/2025	4:49 AM	46
11/15/2025	5:04 AM	44
11/15/2025	5:19 AM	49
11/15/2025	5:34 AM	49
11/15/2025	5:49 AM	46
11/15/2025	6:04 AM	48
11/15/2025	6:19 AM	47
11/15/2025	6:34 AM	51
11/15/2025	6:49 AM	50
11/15/2025	7:04 AM	51
11/15/2025	7:19 AM	49
11/15/2025	7:34 AM	48
11/15/2025	7:49 AM	51
11/15/2025	8:04 AM	52
11/15/2025	8:19 AM	50
11/15/2025	8:34 AM	50
11/15/2025	8:49 AM	48
11/15/2025	9:04 AM	49
11/15/2025	9:19 AM	50
11/15/2025	9:34 AM	49
11/15/2025	9:49 AM	52
11/15/2025	10:04 AM	51
11/15/2025	10:19 AM	52
11/15/2025	10:34 AM	52
11/15/2025	10:49 AM	51
11/15/2025	11:04 AM	51
11/15/2025	11:19 AM	52
11/15/2025	11:34 AM	51
11/15/2025	11:49 AM	51
11/15/2025	12:04 PM	52
11/15/2025	12:19 PM	52
11/15/2025	12:34 PM	52
11/15/2025	12:49 PM	52
11/15/2025	1:04 PM	53
11/15/2025	1:19 PM	52
11/15/2025	1:34 PM	52
11/15/2025	1:49 PM	52
11/15/2025	2:04 PM	52
11/15/2025	2:19 PM	52
11/15/2025	2:34 PM	52
11/15/2025	2:49 PM	53
11/15/2025	3:04 PM	53
11/15/2025	3:19 PM	52
11/15/2025	3:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/15/2025	3:49 PM	52
11/15/2025	4:04 PM	52
11/15/2025	4:19 PM	51
11/15/2025	4:34 PM	52
11/15/2025	4:49 PM	52
11/15/2025	5:04 PM	52
11/15/2025	5:19 PM	52
11/15/2025	5:34 PM	52
11/15/2025	5:49 PM	52
11/15/2025	6:04 PM	52
11/15/2025	6:19 PM	52
11/15/2025	6:34 PM	52
11/15/2025	6:49 PM	52
11/15/2025	7:04 PM	52
11/15/2025	7:19 PM	51
11/15/2025	7:34 PM	52
11/15/2025	7:49 PM	52
11/15/2025	8:04 PM	52
11/15/2025	8:19 PM	51
11/15/2025	8:34 PM	52
11/15/2025	8:49 PM	51
11/15/2025	9:04 PM	52
11/15/2025	9:19 PM	52
11/15/2025	9:34 PM	52
11/15/2025	9:49 PM	52
11/15/2025	10:04 PM	51
11/15/2025	10:19 PM	52
11/15/2025	10:34 PM	51
11/15/2025	10:49 PM	52
11/15/2025	11:04 PM	50
11/15/2025	11:19 PM	50
11/15/2025	11:34 PM	50
11/15/2025	11:49 PM	51
11/16/2025	12:04 AM	51
11/16/2025	12:19 AM	51
11/16/2025	12:34 AM	52
11/16/2025	12:49 AM	50
11/16/2025	1:04 AM	51
11/16/2025	1:19 AM	49
11/16/2025	1:34 AM	51
11/16/2025	1:49 AM	53
11/16/2025	2:04 AM	48
11/16/2025	2:19 AM	51
11/16/2025	2:34 AM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/16/2025	2:49 AM	49
11/16/2025	3:04 AM	50
11/16/2025	3:19 AM	47
11/16/2025	3:34 AM	51
11/16/2025	3:49 AM	51
11/16/2025	4:04 AM	50
11/16/2025	4:19 AM	50
11/16/2025	4:34 AM	50
11/16/2025	4:49 AM	50
11/16/2025	5:04 AM	45
11/16/2025	5:19 AM	46
11/16/2025	5:34 AM	48
11/16/2025	5:49 AM	48
11/16/2025	6:04 AM	46
11/16/2025	6:19 AM	50
11/16/2025	6:34 AM	50
11/16/2025	6:49 AM	50
11/16/2025	7:04 AM	49
11/16/2025	7:19 AM	51
11/16/2025	7:34 AM	52
11/16/2025	7:49 AM	52
11/16/2025	8:04 AM	54
11/16/2025	8:19 AM	53
11/16/2025	8:34 AM	51
11/16/2025	8:49 AM	53
11/16/2025	9:04 AM	51
11/16/2025	9:19 AM	53
11/16/2025	9:34 AM	50
11/16/2025	9:49 AM	51
11/16/2025	10:04 AM	51
11/16/2025	10:19 AM	52
11/16/2025	10:34 AM	52
11/16/2025	10:49 AM	52
11/16/2025	11:04 AM	51
11/16/2025	11:19 AM	52
11/16/2025	11:34 AM	51
11/16/2025	11:49 AM	53
11/16/2025	12:04 PM	51
11/16/2025	12:19 PM	52
11/16/2025	12:34 PM	52
11/16/2025	12:49 PM	51
11/16/2025	1:04 PM	52
11/16/2025	1:19 PM	52
11/16/2025	1:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/16/2025	1:49 PM	52
11/16/2025	2:04 PM	52
11/16/2025	2:19 PM	52
11/16/2025	2:34 PM	52
11/16/2025	2:49 PM	52
11/16/2025	3:04 PM	52
11/16/2025	3:19 PM	52
11/16/2025	3:34 PM	51
11/16/2025	3:49 PM	51
11/16/2025	4:04 PM	52
11/16/2025	4:19 PM	52
11/16/2025	4:34 PM	52
11/16/2025	4:49 PM	52
11/16/2025	5:04 PM	51
11/16/2025	5:19 PM	52
11/16/2025	5:34 PM	51
11/16/2025	5:49 PM	51
11/16/2025	6:04 PM	52
11/16/2025	6:19 PM	51
11/16/2025	6:34 PM	51
11/16/2025	6:49 PM	52
11/16/2025	7:04 PM	51
11/16/2025	7:19 PM	51
11/16/2025	7:34 PM	52
11/16/2025	7:49 PM	51
11/16/2025	8:04 PM	52
11/16/2025	8:19 PM	52
11/16/2025	8:34 PM	52
11/16/2025	8:49 PM	52
11/16/2025	9:04 PM	51
11/16/2025	9:19 PM	50
11/16/2025	9:34 PM	51
11/16/2025	9:49 PM	52
11/16/2025	10:04 PM	52
11/16/2025	10:19 PM	51
11/16/2025	10:34 PM	52
11/16/2025	10:49 PM	52
11/16/2025	11:04 PM	52
11/16/2025	11:19 PM	52
11/16/2025	11:34 PM	52
11/16/2025	11:49 PM	52
11/17/2025	12:04 AM	51
11/17/2025	12:19 AM	51
11/17/2025	12:34 AM	50



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/17/2025	12:49 AM	50
11/17/2025	1:04 AM	52
11/17/2025	1:19 AM	51
11/17/2025	1:34 AM	51
11/17/2025	1:49 AM	49
11/17/2025	2:04 AM	50
11/17/2025	2:19 AM	51
11/17/2025	2:34 AM	47
11/17/2025	2:49 AM	49
11/17/2025	3:04 AM	50
11/17/2025	3:19 AM	50
11/17/2025	3:34 AM	50
11/17/2025	3:49 AM	50
11/17/2025	4:04 AM	47
11/17/2025	4:19 AM	48
11/17/2025	4:34 AM	49
11/17/2025	4:49 AM	49
11/17/2025	5:04 AM	43
11/17/2025	5:19 AM	42
11/17/2025	5:34 AM	42
11/17/2025	5:49 AM	44
11/17/2025	6:04 AM	42
11/17/2025	6:19 AM	44
11/17/2025	6:34 AM	45
11/17/2025	6:49 AM	46
11/17/2025	7:04 AM	49
11/17/2025	7:19 AM	49
11/17/2025	7:34 AM	48
11/17/2025	7:49 AM	51
11/17/2025	8:04 AM	51
11/17/2025	8:19 AM	52
11/17/2025	8:34 AM	51
11/17/2025	8:49 AM	50
11/17/2025	9:04 AM	52
11/17/2025	9:19 AM	51
11/17/2025	9:34 AM	52
11/17/2025	9:49 AM	54
11/17/2025	10:04 AM	51
11/17/2025	10:19 AM	53
11/17/2025	10:34 AM	51
11/17/2025	10:49 AM	52
11/17/2025	11:04 AM	52
11/17/2025	11:19 AM	51
11/17/2025	11:34 AM	53



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/17/2025	11:49 AM	52
11/17/2025	12:04 PM	51
11/17/2025	12:19 PM	51
11/17/2025	12:34 PM	51
11/17/2025	12:49 PM	51
11/17/2025	1:04 PM	52
11/17/2025	1:19 PM	52
11/17/2025	1:34 PM	50
11/17/2025	1:49 PM	52
11/17/2025	2:04 PM	52
11/17/2025	2:19 PM	51
11/17/2025	2:34 PM	52
11/17/2025	2:49 PM	52
11/17/2025	3:04 PM	52
11/17/2025	3:19 PM	52
11/17/2025	3:34 PM	52
11/17/2025	3:49 PM	52
11/17/2025	4:04 PM	52
11/17/2025	4:19 PM	52
11/17/2025	4:34 PM	52
11/17/2025	4:49 PM	52
11/17/2025	5:04 PM	52
11/17/2025	5:19 PM	52
11/17/2025	5:34 PM	52
11/17/2025	5:49 PM	52
11/17/2025	6:04 PM	51
11/17/2025	6:19 PM	52
11/17/2025	6:34 PM	52
11/17/2025	6:49 PM	51
11/17/2025	7:04 PM	52
11/17/2025	7:19 PM	52
11/17/2025	7:34 PM	52
11/17/2025	7:49 PM	52
11/17/2025	8:04 PM	52
11/17/2025	8:19 PM	52
11/17/2025	8:34 PM	53
11/17/2025	8:49 PM	52
11/17/2025	9:04 PM	52
11/17/2025	9:19 PM	52
11/17/2025	9:34 PM	52
11/17/2025	9:49 PM	51
11/17/2025	10:04 PM	52
11/17/2025	10:19 PM	51
11/17/2025	10:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/17/2025	10:49 PM	52
11/17/2025	11:04 PM	52
11/17/2025	11:19 PM	52
11/17/2025	11:34 PM	52
11/17/2025	11:49 PM	52
11/18/2025	12:04 AM	51
11/18/2025	12:19 AM	51
11/18/2025	12:34 AM	50
11/18/2025	12:49 AM	52
11/18/2025	1:04 AM	52
11/18/2025	1:19 AM	52
11/18/2025	1:34 AM	50
11/18/2025	1:49 AM	51
11/18/2025	2:04 AM	52
11/18/2025	2:19 AM	52
11/18/2025	2:34 AM	53
11/18/2025	2:49 AM	52
11/18/2025	3:04 AM	51
11/18/2025	3:19 AM	51
11/18/2025	3:34 AM	51
11/18/2025	3:49 AM	51
11/18/2025	4:04 AM	50
11/18/2025	4:19 AM	49
11/18/2025	4:34 AM	50
11/18/2025	4:49 AM	49
11/18/2025	5:04 AM	49
11/18/2025	5:19 AM	47
11/18/2025	5:34 AM	48
11/18/2025	5:49 AM	48
11/18/2025	6:04 AM	47
11/18/2025	6:19 AM	48
11/18/2025	6:34 AM	50
11/18/2025	6:49 AM	50
11/18/2025	7:04 AM	52
11/18/2025	7:19 AM	51
11/18/2025	7:34 AM	51
11/18/2025	7:49 AM	52
11/18/2025	8:04 AM	52
11/18/2025	8:19 AM	49
11/18/2025	8:34 AM	49
11/18/2025	8:49 AM	51
11/18/2025	9:04 AM	52
11/18/2025	9:19 AM	49
11/18/2025	9:34 AM	48



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/18/2025	9:49 AM	52
11/18/2025	10:04 AM	51
11/18/2025	10:19 AM	51
11/18/2025	10:34 AM	51
11/18/2025	10:49 AM	50
11/18/2025	11:04 AM	51
11/18/2025	11:19 AM	51
11/18/2025	11:34 AM	51
11/18/2025	11:49 AM	53
11/18/2025	12:04 PM	52
11/18/2025	12:19 PM	52
11/18/2025	12:34 PM	52
11/18/2025	12:49 PM	53
11/18/2025	1:04 PM	52
11/18/2025	1:19 PM	52
11/18/2025	1:34 PM	51
11/18/2025	1:49 PM	52
11/18/2025	2:04 PM	53
11/18/2025	2:19 PM	51
11/18/2025	2:34 PM	51
11/18/2025	2:49 PM	52
11/18/2025	3:04 PM	52
11/18/2025	3:19 PM	51
11/18/2025	3:34 PM	52
11/18/2025	3:49 PM	53
11/18/2025	4:04 PM	52
11/18/2025	4:19 PM	52
11/18/2025	4:34 PM	52
11/18/2025	4:49 PM	52
11/18/2025	5:04 PM	52
11/18/2025	5:19 PM	51
11/18/2025	5:34 PM	52
11/18/2025	5:49 PM	52
11/18/2025	6:04 PM	52
11/18/2025	6:19 PM	52
11/18/2025	6:34 PM	51
11/18/2025	6:49 PM	52
11/18/2025	7:04 PM	52
11/18/2025	7:19 PM	52
11/18/2025	7:34 PM	52
11/18/2025	7:49 PM	52
11/18/2025	8:04 PM	52
11/18/2025	8:19 PM	51
11/18/2025	8:34 PM	52



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/18/2025	8:49 PM	51
11/18/2025	9:04 PM	52
11/18/2025	9:19 PM	51
11/18/2025	9:34 PM	50
11/18/2025	9:49 PM	52
11/18/2025	10:04 PM	52
11/18/2025	10:19 PM	52
11/18/2025	10:34 PM	51
11/18/2025	10:49 PM	51
11/18/2025	11:04 PM	52
11/18/2025	11:19 PM	52
11/18/2025	11:34 PM	51
11/18/2025	11:49 PM	52
11/19/2025	12:04 AM	48
11/19/2025	12:19 AM	48
11/19/2025	12:34 AM	48
11/19/2025	12:49 AM	50
11/19/2025	1:04 AM	49
11/19/2025	1:19 AM	49
11/19/2025	1:34 AM	51
11/19/2025	1:49 AM	48
11/19/2025	2:04 AM	49
11/19/2025	2:19 AM	47
11/19/2025	2:34 AM	48
11/19/2025	2:49 AM	48
11/19/2025	3:04 AM	42
11/19/2025	3:19 AM	42
11/19/2025	3:34 AM	41
11/19/2025	3:49 AM	41
11/19/2025	4:04 AM	43
11/19/2025	4:19 AM	42
11/19/2025	4:34 AM	42
11/19/2025	4:49 AM	42
11/19/2025	5:04 AM	39
11/19/2025	5:19 AM	37
11/19/2025	5:34 AM	37
11/19/2025	5:49 AM	38
11/19/2025	6:04 AM	38
11/19/2025	6:19 AM	41
11/19/2025	6:34 AM	43
11/19/2025	6:49 AM	40
11/19/2025	7:04 AM	47
11/19/2025	7:19 AM	42
11/19/2025	7:34 AM	46



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/19/2025	7:49 AM	44
11/19/2025	8:04 AM	46
11/19/2025	8:19 AM	50
11/19/2025	8:34 AM	51
11/19/2025	8:49 AM	50
11/19/2025	9:04 AM	50
11/19/2025	9:19 AM	51
11/19/2025	9:34 AM	51
11/19/2025	9:49 AM	51
11/19/2025	10:04 AM	51
11/19/2025	10:19 AM	50
11/19/2025	10:34 AM	52
11/19/2025	10:49 AM	52
11/19/2025	11:04 AM	53
11/19/2025	11:19 AM	52
11/19/2025	11:34 AM	50
11/19/2025	11:49 AM	52
11/19/2025	12:04 PM	52
11/19/2025	12:19 PM	52
11/19/2025	12:34 PM	51
11/19/2025	12:49 PM	52
11/19/2025	1:04 PM	53
11/19/2025	1:19 PM	52
11/19/2025	1:34 PM	52
11/19/2025	1:49 PM	51
11/19/2025	2:04 PM	53
11/19/2025	2:19 PM	52
11/19/2025	2:34 PM	52
11/19/2025	2:49 PM	52
11/19/2025	3:04 PM	51
11/19/2025	3:19 PM	52
11/19/2025	3:34 PM	52
11/19/2025	3:49 PM	52
11/19/2025	4:04 PM	52
11/19/2025	4:19 PM	51
11/19/2025	4:34 PM	52
11/19/2025	4:49 PM	52
11/19/2025	5:04 PM	52
11/19/2025	5:19 PM	52
11/19/2025	5:34 PM	53
11/19/2025	5:49 PM	52
11/19/2025	6:04 PM	51
11/19/2025	6:19 PM	52
11/19/2025	6:34 PM	51



306 TAMERLAINE DR.  
DATA PRESSURE LOGGING

NOVEMBER 2025

Date	Time	PSI
11/19/2025	6:49 PM	52
11/19/2025	7:04 PM	52
11/19/2025	7:19 PM	51
11/19/2025	7:34 PM	52
11/19/2025	7:49 PM	52
11/19/2025	8:04 PM	51
11/19/2025	8:19 PM	52
11/19/2025	8:34 PM	51
11/19/2025	8:49 PM	50
11/19/2025	9:04 PM	51
11/19/2025	9:19 PM	49
11/19/2025	9:34 PM	52
11/19/2025	9:49 PM	52
11/19/2025	10:04 PM	52
11/19/2025	10:19 PM	51
11/19/2025	10:34 PM	52
11/19/2025	10:49 PM	52
11/19/2025	11:04 PM	51
11/19/2025	11:19 PM	52
11/19/2025	11:34 PM	50
11/19/2025	11:49 PM	52
11/20/2025	12:04 AM	50
11/20/2025	12:19 AM	50
11/20/2025	12:34 AM	49
11/20/2025	12:49 AM	50
11/20/2025	1:04 AM	52
11/20/2025	1:19 AM	49
11/20/2025	1:34 AM	51
11/20/2025	1:49 AM	51
11/20/2025	2:04 AM	50
11/20/2025	2:19 AM	51
11/20/2025	2:34 AM	50
11/20/2025	2:49 AM	50
11/20/2025	3:04 AM	49
11/20/2025	3:19 AM	47
11/20/2025	3:34 AM	46
11/20/2025	3:49 AM	45
11/20/2025	4:04 AM	41
11/20/2025	4:19 AM	47
11/20/2025	4:34 AM	43
11/20/2025	4:49 AM	41
11/20/2025	5:04 AM	44
11/20/2025	5:19 AM	44
11/20/2025	5:34 AM	44



**306 TAMERLAINE DR.  
DATA PRESSURE LOGGING**

**NOVEMBER 2025**

Date	Time	PSI
11/20/2025	5:49 AM	46
11/20/2025	6:04 AM	45
11/20/2025	6:19 AM	46
11/20/2025	6:34 AM	44
11/20/2025	6:49 AM	42
11/20/2025	7:04 AM	44
11/20/2025	7:19 AM	46
11/20/2025	7:34 AM	48
11/20/2025	7:49 AM	50
11/20/2025	8:04 AM	50
11/20/2025	8:19 AM	49
11/20/2025	8:34 AM	50
11/20/2025	8:49 AM	48
11/20/2025	9:04 AM	51
11/20/2025	9:19 AM	51
11/20/2025	9:34 AM	49
11/20/2025	9:49 AM	50
11/20/2025	10:04 AM	53
11/20/2025	10:19 AM	53
11/20/2025	10:34 AM	52
11/20/2025	10:49 AM	52



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/27/2025	11:34 AM	53
10/27/2025	11:49 AM	51
10/27/2025	12:04 PM	50
10/27/2025	12:19 PM	51
10/27/2025	12:34 PM	50
10/27/2025	12:49 PM	50
10/27/2025	1:04 PM	50
10/27/2025	1:19 PM	51
10/27/2025	1:34 PM	51
10/27/2025	1:49 PM	51
10/27/2025	2:04 PM	50
10/27/2025	2:19 PM	51
10/27/2025	2:34 PM	51
10/27/2025	2:49 PM	50
10/27/2025	3:04 PM	50
10/27/2025	3:19 PM	50
10/27/2025	3:34 PM	53
10/27/2025	3:49 PM	51
10/27/2025	4:04 PM	50
10/27/2025	4:19 PM	51
10/27/2025	4:34 PM	51
10/27/2025	4:49 PM	51
10/27/2025	5:04 PM	50
10/27/2025	5:19 PM	50
10/27/2025	5:34 PM	50
10/27/2025	5:49 PM	50
10/27/2025	6:04 PM	51
10/27/2025	6:19 PM	50
10/27/2025	6:34 PM	50
10/27/2025	6:49 PM	51
10/27/2025	7:04 PM	50
10/27/2025	7:19 PM	51
10/27/2025	7:34 PM	50
10/27/2025	7:49 PM	50
10/27/2025	8:04 PM	51
10/27/2025	8:19 PM	51
10/27/2025	8:34 PM	51
10/27/2025	8:49 PM	51
10/27/2025	9:04 PM	51
10/27/2025	9:19 PM	51
10/27/2025	9:34 PM	51
10/27/2025	9:49 PM	51
10/27/2025	10:04 PM	51
10/27/2025	10:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
10/27/2025	10:34 PM	51
10/27/2025	10:49 PM	51
10/27/2025	11:04 PM	51
10/27/2025	11:19 PM	51
10/27/2025	11:34 PM	51
10/27/2025	11:49 PM	51
10/28/2025	12:04 AM	50
10/28/2025	12:19 AM	50
10/28/2025	12:34 AM	51
10/28/2025	12:49 AM	51
10/28/2025	1:04 AM	51
10/28/2025	1:19 AM	50
10/28/2025	1:34 AM	50
10/28/2025	1:49 AM	50
10/28/2025	2:04 AM	48
10/28/2025	2:19 AM	49
10/28/2025	2:34 AM	51
10/28/2025	2:49 AM	50
10/28/2025	3:04 AM	49
10/28/2025	3:19 AM	49
10/28/2025	3:34 AM	47
10/28/2025	3:49 AM	48
10/28/2025	4:04 AM	46
10/28/2025	4:19 AM	48
10/28/2025	4:34 AM	49
10/28/2025	4:49 AM	49
10/28/2025	5:04 AM	47
10/28/2025	5:19 AM	47
10/28/2025	5:34 AM	47
10/28/2025	5:49 AM	49
10/28/2025	6:04 AM	49
10/28/2025	6:19 AM	50
10/28/2025	6:34 AM	50
10/28/2025	6:49 AM	51
10/28/2025	7:04 AM	51
10/28/2025	7:19 AM	50
10/28/2025	7:34 AM	49
10/28/2025	7:49 AM	51
10/28/2025	8:04 AM	49
10/28/2025	8:19 AM	48
10/28/2025	8:34 AM	50
10/28/2025	8:49 AM	48
10/28/2025	9:04 AM	50
10/28/2025	9:19 AM	50



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/28/2025	9:34 AM	51
10/28/2025	9:49 AM	51
10/28/2025	10:04 AM	49
10/28/2025	10:19 AM	51
10/28/2025	10:34 AM	51
10/28/2025	10:49 AM	51
10/28/2025	11:04 AM	51
10/28/2025	11:19 AM	51
10/28/2025	11:34 AM	51
10/28/2025	11:49 AM	51
10/28/2025	12:04 PM	51
10/28/2025	12:19 PM	51
10/28/2025	12:34 PM	51
10/28/2025	12:49 PM	51
10/28/2025	1:04 PM	51
10/28/2025	1:19 PM	51
10/28/2025	1:34 PM	51
10/28/2025	1:49 PM	51
10/28/2025	2:04 PM	51
10/28/2025	2:19 PM	51
10/28/2025	2:34 PM	51
10/28/2025	2:49 PM	52
10/28/2025	3:04 PM	51
10/28/2025	3:19 PM	51
10/28/2025	3:34 PM	51
10/28/2025	3:49 PM	51
10/28/2025	4:04 PM	51
10/28/2025	4:19 PM	51
10/28/2025	4:34 PM	51
10/28/2025	4:49 PM	51
10/28/2025	5:04 PM	50
10/28/2025	5:19 PM	51
10/28/2025	5:34 PM	51
10/28/2025	5:49 PM	51
10/28/2025	6:04 PM	51
10/28/2025	6:19 PM	51
10/28/2025	6:34 PM	51
10/28/2025	6:49 PM	51
10/28/2025	7:04 PM	51
10/28/2025	7:19 PM	51
10/28/2025	7:34 PM	51
10/28/2025	7:49 PM	51
10/28/2025	8:04 PM	51
10/28/2025	8:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
10/28/2025	8:34 PM	51
10/28/2025	8:49 PM	51
10/28/2025	9:04 PM	51
10/28/2025	9:19 PM	51
10/28/2025	9:34 PM	51
10/28/2025	9:49 PM	51
10/28/2025	10:04 PM	52
10/28/2025	10:19 PM	51
10/28/2025	10:34 PM	51
10/28/2025	10:49 PM	51
10/28/2025	11:04 PM	51
10/28/2025	11:19 PM	51
10/28/2025	11:34 PM	52
10/28/2025	11:49 PM	50
10/29/2025	12:04 AM	51
10/29/2025	12:19 AM	51
10/29/2025	12:34 AM	51
10/29/2025	12:49 AM	51
10/29/2025	1:04 AM	50
10/29/2025	1:19 AM	50
10/29/2025	1:34 AM	51
10/29/2025	1:49 AM	51
10/29/2025	2:04 AM	50
10/29/2025	2:19 AM	51
10/29/2025	2:34 AM	52
10/29/2025	2:49 AM	51
10/29/2025	3:04 AM	50
10/29/2025	3:19 AM	51
10/29/2025	3:34 AM	51
10/29/2025	3:49 AM	51
10/29/2025	4:04 AM	48
10/29/2025	4:19 AM	45
10/29/2025	4:34 AM	47
10/29/2025	4:49 AM	48
10/29/2025	5:04 AM	45
10/29/2025	5:19 AM	44
10/29/2025	5:34 AM	47
10/29/2025	5:49 AM	43
10/29/2025	6:04 AM	46
10/29/2025	6:19 AM	49
10/29/2025	6:34 AM	50
10/29/2025	6:49 AM	50
10/29/2025	7:04 AM	47
10/29/2025	7:19 AM	49



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/29/2025	7:34 AM	52
10/29/2025	7:49 AM	53
10/29/2025	8:04 AM	52
10/29/2025	8:19 AM	51
10/29/2025	8:34 AM	52
10/29/2025	8:49 AM	52
10/29/2025	9:04 AM	51
10/29/2025	9:19 AM	50
10/29/2025	9:34 AM	50
10/29/2025	9:49 AM	50
10/29/2025	10:04 AM	51
10/29/2025	10:19 AM	51
10/29/2025	10:34 AM	51
10/29/2025	10:49 AM	51
10/29/2025	11:04 AM	51
10/29/2025	11:19 AM	52
10/29/2025	11:34 AM	51
10/29/2025	11:49 AM	52
10/29/2025	12:04 PM	50
10/29/2025	12:19 PM	52
10/29/2025	12:34 PM	52
10/29/2025	12:49 PM	52
10/29/2025	1:04 PM	50
10/29/2025	1:19 PM	52
10/29/2025	1:34 PM	52
10/29/2025	1:49 PM	53
10/29/2025	2:04 PM	52
10/29/2025	2:19 PM	52
10/29/2025	2:34 PM	54
10/29/2025	2:49 PM	52
10/29/2025	3:04 PM	51
10/29/2025	3:19 PM	52
10/29/2025	3:34 PM	52
10/29/2025	3:49 PM	52
10/29/2025	4:04 PM	51
10/29/2025	4:19 PM	51
10/29/2025	4:34 PM	51
10/29/2025	4:49 PM	51
10/29/2025	5:04 PM	50
10/29/2025	5:19 PM	51
10/29/2025	5:34 PM	50
10/29/2025	5:49 PM	51
10/29/2025	6:04 PM	52
10/29/2025	6:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
10/29/2025	6:34 PM	52
10/29/2025	6:49 PM	51
10/29/2025	7:04 PM	52
10/29/2025	7:19 PM	51
10/29/2025	7:34 PM	51
10/29/2025	7:49 PM	52
10/29/2025	8:04 PM	51
10/29/2025	8:19 PM	51
10/29/2025	8:34 PM	50
10/29/2025	8:49 PM	51
10/29/2025	9:04 PM	51
10/29/2025	9:19 PM	51
10/29/2025	9:34 PM	51
10/29/2025	9:49 PM	51
10/29/2025	10:04 PM	51
10/29/2025	10:19 PM	51
10/29/2025	10:34 PM	51
10/29/2025	10:49 PM	51
10/29/2025	11:04 PM	51
10/29/2025	11:19 PM	51
10/29/2025	11:34 PM	51
10/29/2025	11:49 PM	51
10/30/2025	12:04 AM	51
10/30/2025	12:19 AM	50
10/30/2025	12:34 AM	51
10/30/2025	12:49 AM	50
10/30/2025	1:04 AM	51
10/30/2025	1:19 AM	50
10/30/2025	1:34 AM	50
10/30/2025	1:49 AM	49
10/30/2025	2:04 AM	48
10/30/2025	2:19 AM	48
10/30/2025	2:34 AM	48
10/30/2025	2:49 AM	48
10/30/2025	3:04 AM	51
10/30/2025	3:19 AM	47
10/30/2025	3:34 AM	50
10/30/2025	3:49 AM	49
10/30/2025	4:04 AM	50
10/30/2025	4:19 AM	49
10/30/2025	4:34 AM	49
10/30/2025	4:49 AM	49
10/30/2025	5:04 AM	48
10/30/2025	5:19 AM	45



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/30/2025	5:34 AM	45
10/30/2025	5:49 AM	47
10/30/2025	6:04 AM	49
10/30/2025	6:19 AM	50
10/30/2025	6:34 AM	51
10/30/2025	6:49 AM	47
10/30/2025	7:04 AM	49
10/30/2025	7:19 AM	49
10/30/2025	7:34 AM	51
10/30/2025	7:49 AM	48
10/30/2025	8:04 AM	48
10/30/2025	8:19 AM	48
10/30/2025	8:34 AM	49
10/30/2025	8:49 AM	49
10/30/2025	9:04 AM	50
10/30/2025	9:19 AM	50
10/30/2025	9:34 AM	51
10/30/2025	9:49 AM	51
10/30/2025	10:04 AM	51
10/30/2025	10:19 AM	50
10/30/2025	10:34 AM	51
10/30/2025	10:49 AM	51
10/30/2025	11:04 AM	51
10/30/2025	11:19 AM	51
10/30/2025	11:34 AM	51
10/30/2025	11:49 AM	51
10/30/2025	12:04 PM	52
10/30/2025	12:19 PM	51
10/30/2025	12:34 PM	51
10/30/2025	12:49 PM	51
10/30/2025	1:04 PM	51
10/30/2025	1:19 PM	51
10/30/2025	1:34 PM	51
10/30/2025	1:49 PM	51
10/30/2025	2:04 PM	51
10/30/2025	2:19 PM	51
10/30/2025	2:34 PM	53
10/30/2025	2:49 PM	50
10/30/2025	3:04 PM	52
10/30/2025	3:19 PM	50
10/30/2025	3:34 PM	53
10/30/2025	3:49 PM	52
10/30/2025	4:04 PM	51
10/30/2025	4:19 PM	51



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/30/2025	4:34 PM	52
10/30/2025	4:49 PM	51
10/30/2025	5:04 PM	50
10/30/2025	5:19 PM	51
10/30/2025	5:34 PM	51
10/30/2025	5:49 PM	51
10/30/2025	6:04 PM	51
10/30/2025	6:19 PM	51
10/30/2025	6:34 PM	52
10/30/2025	6:49 PM	51
10/30/2025	7:04 PM	51
10/30/2025	7:19 PM	51
10/30/2025	7:34 PM	51
10/30/2025	7:49 PM	51
10/30/2025	8:04 PM	51
10/30/2025	8:19 PM	51
10/30/2025	8:34 PM	51
10/30/2025	8:49 PM	50
10/30/2025	9:04 PM	51
10/30/2025	9:19 PM	50
10/30/2025	9:34 PM	51
10/30/2025	9:49 PM	51
10/30/2025	10:04 PM	51
10/30/2025	10:19 PM	51
10/30/2025	10:34 PM	51
10/30/2025	10:49 PM	51
10/30/2025	11:04 PM	51
10/30/2025	11:19 PM	51
10/30/2025	11:34 PM	50
10/30/2025	11:49 PM	51
10/31/2025	12:04 AM	51
10/31/2025	12:19 AM	50
10/31/2025	12:34 AM	51
10/31/2025	12:49 AM	50
10/31/2025	1:04 AM	50
10/31/2025	1:19 AM	49
10/31/2025	1:34 AM	49
10/31/2025	1:49 AM	47
10/31/2025	2:04 AM	51
10/31/2025	2:19 AM	46
10/31/2025	2:34 AM	52
10/31/2025	2:49 AM	51
10/31/2025	3:04 AM	46
10/31/2025	3:19 AM	49



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/31/2025	3:34 AM	49
10/31/2025	3:49 AM	49
10/31/2025	4:04 AM	46
10/31/2025	4:19 AM	46
10/31/2025	4:34 AM	48
10/31/2025	4:49 AM	45
10/31/2025	5:04 AM	42
10/31/2025	5:19 AM	46
10/31/2025	5:34 AM	45
10/31/2025	5:49 AM	44
10/31/2025	6:04 AM	43
10/31/2025	6:19 AM	45
10/31/2025	6:34 AM	44
10/31/2025	6:49 AM	47
10/31/2025	7:04 AM	49
10/31/2025	7:19 AM	50
10/31/2025	7:34 AM	51
10/31/2025	7:49 AM	52
10/31/2025	8:04 AM	53
10/31/2025	8:19 AM	52
10/31/2025	8:34 AM	48
10/31/2025	8:49 AM	50
10/31/2025	9:04 AM	49
10/31/2025	9:19 AM	48
10/31/2025	9:34 AM	50
10/31/2025	9:49 AM	51
10/31/2025	10:04 AM	50
10/31/2025	10:19 AM	50
10/31/2025	10:34 AM	50
10/31/2025	10:49 AM	51
10/31/2025	11:04 AM	49
10/31/2025	11:19 AM	51
10/31/2025	11:34 AM	50
10/31/2025	11:49 AM	50
10/31/2025	12:04 PM	52
10/31/2025	12:19 PM	51
10/31/2025	12:34 PM	51
10/31/2025	12:49 PM	51
10/31/2025	1:04 PM	51
10/31/2025	1:19 PM	51
10/31/2025	1:34 PM	50
10/31/2025	1:49 PM	51
10/31/2025	2:04 PM	50
10/31/2025	2:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
10/31/2025	2:34 PM	50
10/31/2025	2:49 PM	51
10/31/2025	3:04 PM	51
10/31/2025	3:19 PM	51
10/31/2025	3:34 PM	51
10/31/2025	3:49 PM	51
10/31/2025	4:04 PM	51
10/31/2025	4:19 PM	51
10/31/2025	4:34 PM	51
10/31/2025	4:49 PM	51
10/31/2025	5:04 PM	50
10/31/2025	5:19 PM	51
10/31/2025	5:34 PM	51
10/31/2025	5:49 PM	51
10/31/2025	6:04 PM	51
10/31/2025	6:19 PM	51
10/31/2025	6:34 PM	51
10/31/2025	6:49 PM	51
10/31/2025	7:04 PM	51
10/31/2025	7:19 PM	51
10/31/2025	7:34 PM	51
10/31/2025	7:49 PM	51
10/31/2025	8:04 PM	51
10/31/2025	8:19 PM	51
10/31/2025	8:34 PM	51
10/31/2025	8:49 PM	51
10/31/2025	9:04 PM	51
10/31/2025	9:19 PM	51
10/31/2025	9:34 PM	52
10/31/2025	9:49 PM	51
10/31/2025	10:04 PM	51
10/31/2025	10:19 PM	50
10/31/2025	10:34 PM	51
10/31/2025	10:49 PM	51
10/31/2025	11:04 PM	51
10/31/2025	11:19 PM	51
10/31/2025	11:34 PM	51
10/31/2025	11:49 PM	51
11/1/2025	12:04 AM	50
11/1/2025	12:19 AM	50
11/1/2025	12:34 AM	50
11/1/2025	12:49 AM	48
11/1/2025	1:04 AM	47
11/1/2025	1:19 AM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	1:34 AM	49
11/1/2025	1:49 AM	48
11/1/2025	2:04 AM	48
11/1/2025	2:19 AM	51
11/1/2025	2:34 AM	52
11/1/2025	2:49 AM	50
11/1/2025	3:04 AM	48
11/1/2025	3:19 AM	49
11/1/2025	3:34 AM	49
11/1/2025	3:49 AM	45
11/1/2025	4:04 AM	48
11/1/2025	4:19 AM	44
11/1/2025	4:34 AM	44
11/1/2025	4:49 AM	46
11/1/2025	5:04 AM	43
11/1/2025	5:19 AM	43
11/1/2025	5:34 AM	43
11/1/2025	5:49 AM	45
11/1/2025	6:04 AM	45
11/1/2025	6:19 AM	47
11/1/2025	6:34 AM	49
11/1/2025	6:49 AM	49
11/1/2025	7:04 AM	48
11/1/2025	7:19 AM	49
11/1/2025	7:34 AM	50
11/1/2025	7:49 AM	52
11/1/2025	8:04 AM	51
11/1/2025	8:19 AM	48
11/1/2025	8:34 AM	48
11/1/2025	8:49 AM	50
11/1/2025	9:04 AM	49
11/1/2025	9:19 AM	49
11/1/2025	9:34 AM	50
11/1/2025	9:49 AM	51
11/1/2025	10:04 AM	50
11/1/2025	10:19 AM	51
11/1/2025	10:34 AM	51
11/1/2025	10:49 AM	51
11/1/2025	11:04 AM	51
11/1/2025	11:19 AM	51
11/1/2025	11:34 AM	51
11/1/2025	11:49 AM	50
11/1/2025	12:04 PM	50
11/1/2025	12:19 PM	50



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	12:34 PM	50
11/1/2025	12:49 PM	51
11/1/2025	1:04 PM	50
11/1/2025	1:19 PM	51
11/1/2025	1:34 PM	51
11/1/2025	1:49 PM	51
11/1/2025	2:04 PM	51
11/1/2025	2:19 PM	51
11/1/2025	2:34 PM	51
11/1/2025	2:49 PM	51
11/1/2025	3:04 PM	51
11/1/2025	3:19 PM	51
11/1/2025	3:34 PM	51
11/1/2025	3:49 PM	51
11/1/2025	4:04 PM	50
11/1/2025	4:19 PM	51
11/1/2025	4:34 PM	50
11/1/2025	4:49 PM	50
11/1/2025	5:04 PM	49
11/1/2025	5:19 PM	50
11/1/2025	5:34 PM	50
11/1/2025	5:49 PM	51
11/1/2025	6:04 PM	51
11/1/2025	6:19 PM	51
11/1/2025	6:34 PM	50
11/1/2025	6:49 PM	51
11/1/2025	7:04 PM	51
11/1/2025	7:19 PM	51
11/1/2025	7:34 PM	51
11/1/2025	7:49 PM	51
11/1/2025	8:04 PM	50
11/1/2025	8:19 PM	51
11/1/2025	8:34 PM	50
11/1/2025	8:49 PM	51
11/1/2025	9:04 PM	50
11/1/2025	9:19 PM	50
11/1/2025	9:34 PM	51
11/1/2025	9:49 PM	51
11/1/2025	10:04 PM	51
11/1/2025	10:19 PM	50
11/1/2025	10:34 PM	51
11/1/2025	10:49 PM	51
11/1/2025	11:04 PM	51
11/1/2025	11:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	11:34 PM	51
11/1/2025	11:49 PM	51
11/2/2025	12:04 AM	50
11/2/2025	12:19 AM	51
11/2/2025	12:34 AM	49
11/2/2025	12:49 AM	49
11/2/2025	1:04 AM	52
11/2/2025	1:19 AM	50
11/2/2025	1:34 AM	48
11/2/2025	1:49 AM	49
11/2/2025	2:04 AM	51
11/2/2025	2:19 AM	47
11/2/2025	2:34 AM	49
11/2/2025	2:49 AM	49
11/2/2025	3:04 AM	50
11/2/2025	3:19 AM	48
11/2/2025	3:34 AM	47
11/2/2025	3:49 AM	49
11/2/2025	4:04 AM	47
11/2/2025	4:19 AM	49
11/2/2025	4:34 AM	48
11/2/2025	4:49 AM	48
11/2/2025	5:04 AM	44
11/2/2025	5:19 AM	46
11/2/2025	5:34 AM	45
11/2/2025	5:49 AM	46
11/2/2025	6:04 AM	47
11/2/2025	6:19 AM	45
11/2/2025	6:34 AM	48
11/2/2025	6:49 AM	48
11/2/2025	7:04 AM	51
11/2/2025	7:19 AM	51
11/2/2025	7:34 AM	48
11/2/2025	7:49 AM	49
11/2/2025	8:04 AM	49
11/2/2025	8:19 AM	49
11/2/2025	8:34 AM	48
11/2/2025	8:49 AM	50
11/2/2025	9:04 AM	50
11/2/2025	9:19 AM	49
11/2/2025	9:34 AM	50
11/2/2025	9:49 AM	50
11/2/2025	10:04 AM	51
11/2/2025	10:19 AM	50



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/2/2025	10:34 AM	51
11/2/2025	10:49 AM	50
11/2/2025	11:04 AM	51
11/2/2025	11:19 AM	50
11/2/2025	11:34 AM	51
11/2/2025	11:49 AM	52
11/2/2025	12:04 PM	51
11/2/2025	12:19 PM	51
11/2/2025	12:34 PM	51
11/2/2025	12:49 PM	51
11/2/2025	1:04 PM	51
11/2/2025	1:19 PM	50
11/2/2025	1:34 PM	49
11/2/2025	1:49 PM	51
11/2/2025	2:04 PM	51
11/2/2025	2:19 PM	51
11/2/2025	2:34 PM	51
11/2/2025	2:49 PM	51
11/2/2025	3:04 PM	51
11/2/2025	3:19 PM	51
11/2/2025	3:34 PM	51
11/2/2025	3:49 PM	51
11/2/2025	4:04 PM	51
11/2/2025	4:19 PM	52
11/2/2025	4:34 PM	51
11/2/2025	4:49 PM	50
11/2/2025	5:04 PM	51
11/2/2025	5:19 PM	51
11/2/2025	5:34 PM	51
11/2/2025	5:49 PM	50
11/2/2025	6:04 PM	50
11/2/2025	6:19 PM	51
11/2/2025	6:34 PM	51
11/2/2025	6:49 PM	51
11/2/2025	7:04 PM	51
11/2/2025	7:19 PM	51
11/2/2025	7:34 PM	50
11/2/2025	7:49 PM	51
11/2/2025	8:04 PM	52
11/2/2025	8:19 PM	52
11/2/2025	8:34 PM	51
11/2/2025	8:49 PM	51
11/2/2025	9:04 PM	51
11/2/2025	9:19 PM	51



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/2/2025	9:34 PM	52
11/2/2025	9:49 PM	51
11/2/2025	10:04 PM	51
11/2/2025	10:19 PM	51
11/2/2025	10:34 PM	51
11/2/2025	10:49 PM	51
11/2/2025	11:04 PM	50
11/2/2025	11:19 PM	49
11/2/2025	11:34 PM	51
11/2/2025	11:49 PM	51
11/3/2025	12:04 AM	50
11/3/2025	12:19 AM	50
11/3/2025	12:34 AM	52
11/3/2025	12:49 AM	48
11/3/2025	1:04 AM	49
11/3/2025	1:19 AM	50
11/3/2025	1:34 AM	51
11/3/2025	1:49 AM	48
11/3/2025	2:04 AM	50
11/3/2025	2:19 AM	49
11/3/2025	2:34 AM	50
11/3/2025	2:49 AM	48
11/3/2025	3:04 AM	46
11/3/2025	3:19 AM	49
11/3/2025	3:34 AM	49
11/3/2025	3:49 AM	49
11/3/2025	4:04 AM	43
11/3/2025	4:19 AM	48
11/3/2025	4:34 AM	42
11/3/2025	4:49 AM	46
11/3/2025	5:04 AM	41
11/3/2025	5:19 AM	45
11/3/2025	5:34 AM	44
11/3/2025	5:49 AM	43
11/3/2025	6:04 AM	42
11/3/2025	6:19 AM	43
11/3/2025	6:34 AM	47
11/3/2025	6:49 AM	46
11/3/2025	7:04 AM	45
11/3/2025	7:19 AM	48
11/3/2025	7:34 AM	50
11/3/2025	7:49 AM	49
11/3/2025	8:04 AM	51
11/3/2025	8:19 AM	49



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/3/2025	8:34 AM	50
11/3/2025	8:49 AM	51
11/3/2025	9:04 AM	48
11/3/2025	9:19 AM	48
11/3/2025	9:34 AM	48
11/3/2025	9:49 AM	50
11/3/2025	10:04 AM	50
11/3/2025	10:19 AM	51
11/3/2025	10:34 AM	50
11/3/2025	10:49 AM	51
11/3/2025	11:04 AM	50
11/3/2025	11:19 AM	50
11/3/2025	11:34 AM	51
11/3/2025	11:49 AM	50
11/3/2025	12:04 PM	51
11/3/2025	12:19 PM	51
11/3/2025	12:34 PM	51
11/3/2025	12:49 PM	52
11/3/2025	1:04 PM	52
11/3/2025	1:19 PM	51
11/3/2025	1:34 PM	51
11/3/2025	1:49 PM	51
11/3/2025	2:04 PM	51
11/3/2025	2:19 PM	53
11/3/2025	2:34 PM	52
11/3/2025	2:49 PM	11
11/3/2025	3:04 PM	9
11/3/2025	3:19 PM	8
11/3/2025	3:34 PM	8
11/3/2025	3:49 PM	7
11/3/2025	4:04 PM	7
11/3/2025	4:19 PM	7
11/3/2025	4:34 PM	6
11/3/2025	4:49 PM	6
11/3/2025	5:04 PM	6
11/3/2025	5:19 PM	6
11/3/2025	5:34 PM	6
11/3/2025	5:49 PM	6
11/3/2025	6:04 PM	5
11/3/2025	6:19 PM	5
11/3/2025	6:34 PM	5
11/3/2025	6:49 PM	5
11/3/2025	7:04 PM	5
11/3/2025	7:19 PM	5



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/3/2025	7:34 PM	5
11/3/2025	7:49 PM	5
11/3/2025	8:04 PM	5
11/3/2025	8:19 PM	4
11/3/2025	8:34 PM	4
11/3/2025	8:49 PM	4
11/3/2025	9:04 PM	4
11/3/2025	9:19 PM	4
11/3/2025	9:34 PM	4
11/3/2025	9:49 PM	4
11/3/2025	10:04 PM	4
11/3/2025	10:19 PM	4
11/3/2025	10:34 PM	4
11/3/2025	10:49 PM	4
11/3/2025	11:04 PM	4
11/3/2025	11:19 PM	4
11/3/2025	11:34 PM	4
11/3/2025	11:49 PM	4
11/4/2025	12:04 AM	4
11/4/2025	12:19 AM	4
11/4/2025	12:34 AM	4
11/4/2025	12:49 AM	4
11/4/2025	1:04 AM	3
11/4/2025	1:19 AM	3
11/4/2025	1:34 AM	3
11/4/2025	1:49 AM	3
11/4/2025	2:04 AM	3
11/4/2025	2:19 AM	3
11/4/2025	2:34 AM	3
11/4/2025	2:49 AM	3
11/4/2025	3:04 AM	4
11/4/2025	3:19 AM	4
11/4/2025	3:34 AM	4
11/4/2025	3:49 AM	4
11/4/2025	4:04 AM	4
11/4/2025	4:19 AM	4
11/4/2025	4:34 AM	4
11/4/2025	4:49 AM	4
11/4/2025	5:04 AM	4
11/4/2025	5:19 AM	4
11/4/2025	5:34 AM	4
11/4/2025	5:49 AM	4
11/4/2025	6:04 AM	4
11/4/2025	6:19 AM	4



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/4/2025	6:34 AM	4
11/4/2025	6:49 AM	4
11/4/2025	7:04 AM	3
11/4/2025	7:19 AM	3
11/4/2025	7:34 AM	3
11/4/2025	7:49 AM	3
11/4/2025	8:04 AM	3
11/4/2025	8:19 AM	3
11/4/2025	8:34 AM	2
11/4/2025	8:49 AM	2
11/4/2025	9:04 AM	2
11/4/2025	9:19 AM	2
11/4/2025	9:34 AM	2
11/4/2025	9:49 AM	2
11/4/2025	10:04 AM	2
11/4/2025	10:19 AM	2
11/4/2025	10:34 AM	2
11/4/2025	10:49 AM	2
11/4/2025	11:04 AM	2
11/4/2025	11:19 AM	2
11/4/2025	11:34 AM	2
11/4/2025	11:49 AM	2
11/4/2025	12:04 PM	2
11/4/2025	12:19 PM	2
11/4/2025	12:34 PM	2
11/4/2025	12:49 PM	2
11/4/2025	1:04 PM	2
11/4/2025	1:19 PM	2
11/4/2025	1:34 PM	2
11/4/2025	1:49 PM	2
11/4/2025	2:04 PM	2
11/4/2025	2:19 PM	2
11/4/2025	2:34 PM	2
11/4/2025	2:49 PM	2
11/4/2025	3:04 PM	2
11/4/2025	3:19 PM	2
11/4/2025	3:34 PM	2
11/4/2025	3:49 PM	2
11/4/2025	4:04 PM	2
11/4/2025	4:19 PM	2
11/4/2025	4:34 PM	2
11/4/2025	4:49 PM	2
11/4/2025	5:04 PM	2
11/4/2025	5:19 PM	2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/4/2025	5:34 PM	2
11/4/2025	5:49 PM	2
11/4/2025	6:04 PM	2
11/4/2025	6:19 PM	2
11/4/2025	6:34 PM	2
11/4/2025	6:49 PM	2
11/4/2025	7:04 PM	2
11/4/2025	7:19 PM	2
11/4/2025	7:34 PM	2
11/4/2025	7:49 PM	2
11/4/2025	8:04 PM	2
11/4/2025	8:19 PM	2
11/4/2025	8:34 PM	2
11/4/2025	8:49 PM	2
11/4/2025	9:04 PM	2
11/4/2025	9:19 PM	2
11/4/2025	9:34 PM	2
11/4/2025	9:49 PM	1
11/4/2025	10:04 PM	1
11/4/2025	10:19 PM	2
11/4/2025	10:34 PM	2
11/4/2025	10:49 PM	2
11/4/2025	11:04 PM	2
11/4/2025	11:19 PM	2
11/4/2025	11:34 PM	1
11/4/2025	11:49 PM	1
11/5/2025	12:04 AM	2
11/5/2025	12:19 AM	2
11/5/2025	12:34 AM	1
11/5/2025	12:49 AM	1
11/5/2025	1:04 AM	1
11/5/2025	1:19 AM	1
11/5/2025	1:34 AM	1
11/5/2025	1:49 AM	1
11/5/2025	2:04 AM	1
11/5/2025	2:19 AM	1
11/5/2025	2:34 AM	1
11/5/2025	2:49 AM	2
11/5/2025	3:04 AM	2
11/5/2025	3:19 AM	2
11/5/2025	3:34 AM	2
11/5/2025	3:49 AM	2
11/5/2025	4:04 AM	2
11/5/2025	4:19 AM	2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/5/2025	4:34 AM	2
11/5/2025	4:49 AM	2
11/5/2025	5:04 AM	2
11/5/2025	5:19 AM	1
11/5/2025	5:34 AM	1
11/5/2025	5:49 AM	1
11/5/2025	6:04 AM	1
11/5/2025	6:19 AM	1
11/5/2025	6:34 AM	1
11/5/2025	6:49 AM	1
11/5/2025	7:04 AM	1
11/5/2025	7:19 AM	1
11/5/2025	7:34 AM	1
11/5/2025	7:49 AM	1
11/5/2025	8:04 AM	1
11/5/2025	8:19 AM	1
11/5/2025	8:34 AM	1
11/5/2025	8:49 AM	1
11/5/2025	9:04 AM	1
11/5/2025	9:19 AM	1
11/5/2025	9:34 AM	1
11/5/2025	9:49 AM	1
11/5/2025	10:04 AM	1
11/5/2025	10:19 AM	1
11/5/2025	10:34 AM	1
11/5/2025	10:49 AM	1
11/5/2025	11:04 AM	1
11/5/2025	11:19 AM	1
11/5/2025	11:34 AM	1
11/5/2025	11:49 AM	1
11/5/2025	12:04 PM	1
11/5/2025	12:19 PM	1
11/5/2025	12:34 PM	1
11/5/2025	12:49 PM	1
11/5/2025	1:04 PM	1
11/5/2025	1:19 PM	1
11/5/2025	1:34 PM	1
11/5/2025	1:49 PM	1
11/5/2025	2:04 PM	1
11/5/2025	2:19 PM	1
11/5/2025	2:34 PM	1
11/5/2025	2:49 PM	1
11/5/2025	3:04 PM	1
11/5/2025	3:19 PM	1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/5/2025	3:34 PM	1
11/5/2025	3:49 PM	1
11/5/2025	4:04 PM	0
11/5/2025	4:19 PM	1
11/5/2025	4:34 PM	1
11/5/2025	4:49 PM	1
11/5/2025	5:04 PM	1
11/5/2025	5:19 PM	1
11/5/2025	5:34 PM	1
11/5/2025	5:49 PM	0
11/5/2025	6:04 PM	1
11/5/2025	6:19 PM	1
11/5/2025	6:34 PM	1
11/5/2025	6:49 PM	1
11/5/2025	7:04 PM	0
11/5/2025	7:19 PM	0
11/5/2025	7:34 PM	0
11/5/2025	7:49 PM	0
11/5/2025	8:04 PM	0
11/5/2025	8:19 PM	0
11/5/2025	8:34 PM	0
11/5/2025	8:49 PM	0
11/5/2025	9:04 PM	0
11/5/2025	9:19 PM	0
11/5/2025	9:34 PM	0
11/5/2025	9:49 PM	0
11/5/2025	10:04 PM	0
11/5/2025	10:19 PM	0
11/5/2025	10:34 PM	0
11/5/2025	10:49 PM	0
11/5/2025	11:04 PM	0
11/5/2025	11:19 PM	0
11/5/2025	11:34 PM	0
11/5/2025	11:49 PM	0
11/6/2025	12:04 AM	0
11/6/2025	12:19 AM	0
11/6/2025	12:34 AM	0
11/6/2025	12:49 AM	0
11/6/2025	1:04 AM	0
11/6/2025	1:19 AM	0
11/6/2025	1:34 AM	0
11/6/2025	1:49 AM	0
11/6/2025	2:04 AM	0
11/6/2025	2:19 AM	0



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

DATE	TIME	PSI
11/6/2025	2:34 AM	0
11/6/2025	2:49 AM	0
11/6/2025	3:04 AM	0
11/6/2025	3:19 AM	0
11/6/2025	3:34 AM	1
11/6/2025	3:49 AM	0
11/6/2025	4:04 AM	0
11/6/2025	4:19 AM	0
11/6/2025	4:34 AM	0
11/6/2025	4:49 AM	1
11/6/2025	5:04 AM	0
11/6/2025	5:19 AM	0
11/6/2025	5:34 AM	0
11/6/2025	5:49 AM	1
11/6/2025	6:04 AM	0
11/6/2025	6:19 AM	0
11/6/2025	6:34 AM	0
11/6/2025	6:49 AM	0
11/6/2025	7:04 AM	0
11/6/2025	7:19 AM	0
11/6/2025	7:34 AM	0
11/6/2025	7:49 AM	0
11/6/2025	8:04 AM	0
11/6/2025	8:19 AM	0
11/6/2025	8:34 AM	0
11/6/2025	8:49 AM	0
11/6/2025	9:04 AM	0
11/6/2025	9:19 AM	0
11/6/2025	9:34 AM	0
11/6/2025	9:49 AM	0
11/6/2025	10:04 AM	0
11/6/2025	10:19 AM	0
11/6/2025	10:34 AM	0
11/6/2025	10:49 AM	0
11/6/2025	11:04 AM	0
11/6/2025	11:19 AM	0
11/6/2025	11:34 AM	0
11/6/2025	11:49 AM	0
11/6/2025	12:04 PM	0
11/6/2025	12:19 PM	0
11/6/2025	12:34 PM	0
11/6/2025	12:49 PM	0
11/6/2025	1:04 PM	0
11/6/2025	1:19 PM	0



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/6/2025	1:34 PM	0
11/6/2025	1:49 PM	0
11/6/2025	2:04 PM	0
11/6/2025	2:19 PM	0
11/6/2025	2:34 PM	0
11/6/2025	2:49 PM	0
11/6/2025	3:04 PM	0
11/6/2025	3:19 PM	0
11/6/2025	3:34 PM	0
11/6/2025	3:49 PM	0
11/6/2025	4:04 PM	0
11/6/2025	4:19 PM	0
11/6/2025	4:34 PM	0
11/6/2025	4:49 PM	0
11/6/2025	5:04 PM	0
11/6/2025	5:19 PM	0
11/6/2025	5:34 PM	0
11/6/2025	5:49 PM	0
11/6/2025	6:04 PM	0
11/6/2025	6:19 PM	0
11/6/2025	6:34 PM	0
11/6/2025	6:49 PM	0
11/6/2025	7:04 PM	0
11/6/2025	7:19 PM	0
11/6/2025	7:34 PM	0
11/6/2025	7:49 PM	0
11/6/2025	8:04 PM	0
11/6/2025	8:19 PM	0
11/6/2025	8:34 PM	0
11/6/2025	8:49 PM	0
11/6/2025	9:04 PM	0
11/6/2025	9:19 PM	0
11/6/2025	9:34 PM	0
11/6/2025	9:49 PM	0
11/6/2025	10:04 PM	0
11/6/2025	10:19 PM	0
11/6/2025	10:34 PM	0
11/6/2025	10:49 PM	0
11/6/2025	11:04 PM	0
11/6/2025	11:19 PM	0
11/6/2025	11:34 PM	0
11/6/2025	11:49 PM	-1
11/7/2025	12:04 AM	0
11/7/2025	12:19 AM	0



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/7/2025	12:34 AM	0
11/7/2025	12:49 AM	0
11/7/2025	1:04 AM	0
11/7/2025	1:19 AM	0
11/7/2025	1:34 AM	-1
11/7/2025	1:49 AM	-1
11/7/2025	2:04 AM	0
11/7/2025	2:19 AM	-1
11/7/2025	2:34 AM	0
11/7/2025	2:49 AM	0
11/7/2025	3:04 AM	0
11/7/2025	3:19 AM	0
11/7/2025	3:34 AM	0
11/7/2025	3:49 AM	0
11/7/2025	4:04 AM	0
11/7/2025	4:19 AM	0
11/7/2025	4:34 AM	0
11/7/2025	4:49 AM	0
11/7/2025	5:04 AM	0
11/7/2025	5:19 AM	0
11/7/2025	5:34 AM	0
11/7/2025	5:49 AM	-1
11/7/2025	6:04 AM	-1
11/7/2025	6:19 AM	-1
11/7/2025	6:34 AM	-1
11/7/2025	6:49 AM	-1
11/7/2025	7:04 AM	-1
11/7/2025	7:19 AM	-1
11/7/2025	7:34 AM	-1
11/7/2025	7:49 AM	-1
11/7/2025	8:04 AM	-1
11/7/2025	8:19 AM	-1
11/7/2025	8:34 AM	-1
11/7/2025	8:49 AM	-1
11/7/2025	9:04 AM	-1
11/7/2025	9:19 AM	-1
11/7/2025	9:34 AM	-1
11/7/2025	9:49 AM	-1
11/7/2025	10:04 AM	-1
11/7/2025	10:19 AM	-1
11/7/2025	10:34 AM	-1
11/7/2025	10:49 AM	0
11/7/2025	11:04 AM	-1
11/7/2025	11:19 AM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/7/2025	11:34 AM	-1
11/7/2025	11:49 AM	-1
11/7/2025	12:04 PM	-1
11/7/2025	12:19 PM	-1
11/7/2025	12:34 PM	-1
11/7/2025	12:49 PM	-1
11/7/2025	1:04 PM	-1
11/7/2025	1:19 PM	-1
11/7/2025	1:34 PM	-1
11/7/2025	1:49 PM	-1
11/7/2025	2:04 PM	-1
11/7/2025	2:19 PM	-1
11/7/2025	2:34 PM	-1
11/7/2025	2:49 PM	-1
11/7/2025	3:04 PM	-1
11/7/2025	3:19 PM	-1
11/7/2025	3:34 PM	-1
11/7/2025	3:49 PM	-1
11/7/2025	4:04 PM	-1
11/7/2025	4:19 PM	-1
11/7/2025	4:34 PM	-1
11/7/2025	4:49 PM	-1
11/7/2025	5:04 PM	-1
11/7/2025	5:19 PM	-1
11/7/2025	5:34 PM	-1
11/7/2025	5:49 PM	-1
11/7/2025	6:04 PM	-1
11/7/2025	6:19 PM	-1
11/7/2025	6:34 PM	-1
11/7/2025	6:49 PM	-1
11/7/2025	7:04 PM	-1
11/7/2025	7:19 PM	-1
11/7/2025	7:34 PM	-1
11/7/2025	7:49 PM	-1
11/7/2025	8:04 PM	-1
11/7/2025	8:19 PM	-1
11/7/2025	8:34 PM	-1
11/7/2025	8:49 PM	-1
11/7/2025	9:04 PM	-1
11/7/2025	9:19 PM	-1
11/7/2025	9:34 PM	-1
11/7/2025	9:49 PM	-1
11/7/2025	10:04 PM	-1
11/7/2025	10:19 PM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/7/2025	10:34 PM	-1
11/7/2025	10:49 PM	-1
11/7/2025	11:04 PM	-1
11/7/2025	11:19 PM	-1
11/7/2025	11:34 PM	-1
11/7/2025	11:49 PM	-1
11/8/2025	12:04 AM	-1
11/8/2025	12:19 AM	-1
11/8/2025	12:34 AM	-1
11/8/2025	12:49 AM	-1
11/8/2025	1:04 AM	-1
11/8/2025	1:19 AM	-1
11/8/2025	1:34 AM	-1
11/8/2025	1:49 AM	-1
11/8/2025	2:04 AM	-1
11/8/2025	2:19 AM	-1
11/8/2025	2:34 AM	-1
11/8/2025	2:49 AM	-1
11/8/2025	3:04 AM	-1
11/8/2025	3:19 AM	-1
11/8/2025	3:34 AM	-1
11/8/2025	3:49 AM	-1
11/8/2025	4:04 AM	-1
11/8/2025	4:19 AM	-1
11/8/2025	4:34 AM	-1
11/8/2025	4:49 AM	-1
11/8/2025	5:04 AM	-1
11/8/2025	5:19 AM	-1
11/8/2025	5:34 AM	-1
11/8/2025	5:49 AM	-1
11/8/2025	6:04 AM	-1
11/8/2025	6:19 AM	-1
11/8/2025	6:34 AM	-1
11/8/2025	6:49 AM	-1
11/8/2025	7:04 AM	-1
11/8/2025	7:19 AM	-1
11/8/2025	7:34 AM	-1
11/8/2025	7:49 AM	-1
11/8/2025	8:04 AM	-1
11/8/2025	8:19 AM	-1
11/8/2025	8:34 AM	-1
11/8/2025	8:49 AM	-1
11/8/2025	9:04 AM	-1
11/8/2025	9:19 AM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/8/2025	9:34 AM	-1
11/8/2025	9:49 AM	-1
11/8/2025	10:04 AM	-1
11/8/2025	10:19 AM	-1
11/8/2025	10:34 AM	-1
11/8/2025	10:49 AM	-1
11/8/2025	11:04 AM	-1
11/8/2025	11:19 AM	-1
11/8/2025	11:34 AM	-1
11/8/2025	11:49 AM	-1
11/8/2025	12:04 PM	-1
11/8/2025	12:19 PM	-1
11/8/2025	12:34 PM	-1
11/8/2025	12:49 PM	-1
11/8/2025	1:04 PM	-1
11/8/2025	1:19 PM	-1
11/8/2025	1:34 PM	-1
11/8/2025	1:49 PM	-1
11/8/2025	2:04 PM	-1
11/8/2025	2:19 PM	-1
11/8/2025	2:34 PM	-1
11/8/2025	2:49 PM	-1
11/8/2025	3:04 PM	-1
11/8/2025	3:19 PM	-1
11/8/2025	3:34 PM	-1
11/8/2025	3:49 PM	-1
11/8/2025	4:04 PM	-1
11/8/2025	4:19 PM	-1
11/8/2025	4:34 PM	-1
11/8/2025	4:49 PM	-1
11/8/2025	5:04 PM	-1
11/8/2025	5:19 PM	-1
11/8/2025	5:34 PM	-1
11/8/2025	5:49 PM	-1
11/8/2025	6:04 PM	-1
11/8/2025	6:19 PM	-1
11/8/2025	6:34 PM	-1
11/8/2025	6:49 PM	-1
11/8/2025	7:04 PM	-1
11/8/2025	7:19 PM	-1
11/8/2025	7:34 PM	-1
11/8/2025	7:49 PM	-1
11/8/2025	8:04 PM	-1
11/8/2025	8:19 PM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/8/2025	8:34 PM	-1
11/8/2025	8:49 PM	-1
11/8/2025	9:04 PM	-1
11/8/2025	9:19 PM	-1
11/8/2025	9:34 PM	-1
11/8/2025	9:49 PM	-1
11/8/2025	10:04 PM	-1
11/8/2025	10:19 PM	-1
11/8/2025	10:34 PM	-1
11/8/2025	10:49 PM	-1
11/8/2025	11:04 PM	-1
11/8/2025	11:19 PM	-1
11/8/2025	11:34 PM	-1
11/8/2025	11:49 PM	-1
11/9/2025	12:04 AM	-1
11/9/2025	12:19 AM	-1
11/9/2025	12:34 AM	-1
11/9/2025	12:49 AM	-1
11/9/2025	1:04 AM	-1
11/9/2025	1:19 AM	-1
11/9/2025	1:34 AM	-1
11/9/2025	1:49 AM	-1
11/9/2025	2:04 AM	-1
11/9/2025	2:19 AM	-1
11/9/2025	2:34 AM	-1
11/9/2025	2:49 AM	-1
11/9/2025	3:04 AM	-1
11/9/2025	3:19 AM	-1
11/9/2025	3:34 AM	-1
11/9/2025	3:49 AM	-1
11/9/2025	4:04 AM	-1
11/9/2025	4:19 AM	-1
11/9/2025	4:34 AM	-1
11/9/2025	4:49 AM	-1
11/9/2025	5:04 AM	-1
11/9/2025	5:19 AM	-1
11/9/2025	5:34 AM	-1
11/9/2025	5:49 AM	0
11/9/2025	6:04 AM	0
11/9/2025	6:19 AM	-1
11/9/2025	6:34 AM	-1
11/9/2025	6:49 AM	0
11/9/2025	7:04 AM	0
11/9/2025	7:19 AM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/9/2025	7:34 AM	-1
11/9/2025	7:49 AM	-1
11/9/2025	8:04 AM	-1
11/9/2025	8:19 AM	-1
11/9/2025	8:34 AM	-1
11/9/2025	8:49 AM	-1
11/9/2025	9:04 AM	-1
11/9/2025	9:19 AM	-1
11/9/2025	9:34 AM	-1
11/9/2025	9:49 AM	-1
11/9/2025	10:04 AM	-1
11/9/2025	10:19 AM	-1
11/9/2025	10:34 AM	-1
11/9/2025	10:49 AM	-1
11/9/2025	11:04 AM	-1
11/9/2025	11:19 AM	-1
11/9/2025	11:34 AM	-1
11/9/2025	11:49 AM	-1
11/9/2025	12:04 PM	-1
11/9/2025	12:19 PM	-1
11/9/2025	12:34 PM	-1
11/9/2025	12:49 PM	-1
11/9/2025	1:04 PM	-1
11/9/2025	1:19 PM	-1
11/9/2025	1:34 PM	-1
11/9/2025	1:49 PM	-1
11/9/2025	2:04 PM	-1
11/9/2025	2:19 PM	-1
11/9/2025	2:34 PM	-1
11/9/2025	2:49 PM	-1
11/9/2025	3:04 PM	-1
11/9/2025	3:19 PM	-1
11/9/2025	3:34 PM	-1
11/9/2025	3:49 PM	-1
11/9/2025	4:04 PM	-1
11/9/2025	4:19 PM	-1
11/9/2025	4:34 PM	-1
11/9/2025	4:49 PM	-1
11/9/2025	5:04 PM	-1
11/9/2025	5:19 PM	-1
11/9/2025	5:34 PM	-1
11/9/2025	5:49 PM	-1
11/9/2025	6:04 PM	-1
11/9/2025	6:19 PM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/9/2025	6:34 PM	-1
11/9/2025	6:49 PM	-1
11/9/2025	7:04 PM	-1
11/9/2025	7:19 PM	-1
11/9/2025	7:34 PM	-1
11/9/2025	7:49 PM	-1
11/9/2025	8:04 PM	-1
11/9/2025	8:19 PM	-1
11/9/2025	8:34 PM	-1
11/9/2025	8:49 PM	-1
11/9/2025	9:04 PM	-1
11/9/2025	9:19 PM	-1
11/9/2025	9:34 PM	-1
11/9/2025	9:49 PM	-1
11/9/2025	10:04 PM	-1
11/9/2025	10:19 PM	-1
11/9/2025	10:34 PM	-1
11/9/2025	10:49 PM	-1
11/9/2025	11:04 PM	-1
11/9/2025	11:19 PM	-1
11/9/2025	11:34 PM	-1
11/9/2025	11:49 PM	-1
11/10/2025	12:04 AM	-1
11/10/2025	12:19 AM	-1
11/10/2025	12:34 AM	-1
11/10/2025	12:49 AM	-1
11/10/2025	1:04 AM	-1
11/10/2025	1:19 AM	-1
11/10/2025	1:34 AM	-1
11/10/2025	1:49 AM	-1
11/10/2025	2:04 AM	-1
11/10/2025	2:19 AM	-1
11/10/2025	2:34 AM	-1
11/10/2025	2:49 AM	-1
11/10/2025	3:04 AM	-1
11/10/2025	3:19 AM	-1
11/10/2025	3:34 AM	-1
11/10/2025	3:49 AM	-1
11/10/2025	4:04 AM	-1
11/10/2025	4:19 AM	-1
11/10/2025	4:34 AM	0
11/10/2025	4:49 AM	0
11/10/2025	5:04 AM	0
11/10/2025	5:19 AM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/10/2025	5:34 AM	-1
11/10/2025	5:49 AM	-1
11/10/2025	6:04 AM	-1
11/10/2025	6:19 AM	-1
11/10/2025	6:34 AM	-1
11/10/2025	6:49 AM	-1
11/10/2025	7:04 AM	-1
11/10/2025	7:19 AM	-1
11/10/2025	7:34 AM	-1
11/10/2025	7:49 AM	-1
11/10/2025	8:04 AM	-1
11/10/2025	8:19 AM	-1
11/10/2025	8:34 AM	-1
11/10/2025	8:49 AM	-1
11/10/2025	9:04 AM	-1
11/10/2025	9:19 AM	-1
11/10/2025	9:34 AM	-1
11/10/2025	9:49 AM	-1
11/10/2025	10:04 AM	-1
11/10/2025	10:19 AM	-1
11/10/2025	10:34 AM	-1
11/10/2025	10:49 AM	-1
11/10/2025	11:04 AM	-1
11/10/2025	11:19 AM	-1
11/10/2025	11:34 AM	-1
11/10/2025	11:49 AM	-1
11/10/2025	12:04 PM	-1
11/10/2025	12:19 PM	-1
11/10/2025	12:34 PM	-1
11/10/2025	12:49 PM	-1
11/10/2025	1:04 PM	-1
11/10/2025	1:19 PM	-1
11/10/2025	1:34 PM	-1
11/10/2025	1:49 PM	-1
11/10/2025	2:04 PM	-1
11/10/2025	2:19 PM	-1
11/10/2025	2:34 PM	-1
11/10/2025	2:49 PM	-1
11/10/2025	3:04 PM	-1
11/10/2025	3:19 PM	-1
11/10/2025	3:34 PM	-1
11/10/2025	3:49 PM	-1
11/10/2025	4:04 PM	-1
11/10/2025	4:19 PM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/10/2025	4:34 PM	-1
11/10/2025	4:49 PM	-1
11/10/2025	5:04 PM	-1
11/10/2025	5:19 PM	-1
11/10/2025	5:34 PM	-1
11/10/2025	5:49 PM	-1
11/10/2025	6:04 PM	-1
11/10/2025	6:19 PM	-1
11/10/2025	6:34 PM	-1
11/10/2025	6:49 PM	-1
11/10/2025	7:04 PM	-1
11/10/2025	7:19 PM	-1
11/10/2025	7:34 PM	-1
11/10/2025	7:49 PM	-1
11/10/2025	8:04 PM	-1
11/10/2025	8:19 PM	-1
11/10/2025	8:34 PM	-1
11/10/2025	8:49 PM	-1
11/10/2025	9:04 PM	-1
11/10/2025	9:19 PM	-1
11/10/2025	9:34 PM	-1
11/10/2025	9:49 PM	-1
11/10/2025	10:04 PM	-1
11/10/2025	10:19 PM	-1
11/10/2025	10:34 PM	-1
11/10/2025	10:49 PM	-1
11/10/2025	11:04 PM	-1
11/10/2025	11:19 PM	-1
11/10/2025	11:34 PM	-1
11/10/2025	11:49 PM	-1
11/11/2025	12:04 AM	-1
11/11/2025	12:19 AM	-1
11/11/2025	12:34 AM	-1
11/11/2025	12:49 AM	-1
11/11/2025	1:04 AM	-1
11/11/2025	1:19 AM	-1
11/11/2025	1:34 AM	-1
11/11/2025	1:49 AM	-1
11/11/2025	2:04 AM	-1
11/11/2025	2:19 AM	-1
11/11/2025	2:34 AM	-1
11/11/2025	2:49 AM	-1
11/11/2025	3:04 AM	-1
11/11/2025	3:19 AM	-1



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/11/2025	3:34 AM	-1
11/11/2025	3:49 AM	-1
11/11/2025	4:04 AM	-1
11/11/2025	4:19 AM	-1
11/11/2025	4:34 AM	-1
11/11/2025	4:49 AM	-1
11/11/2025	5:04 AM	-1
11/11/2025	5:19 AM	-1
11/11/2025	5:34 AM	-1
11/11/2025	5:49 AM	-1
11/11/2025	6:04 AM	-1
11/11/2025	6:19 AM	-1
11/11/2025	6:34 AM	-1
11/11/2025	6:49 AM	-1
11/11/2025	7:04 AM	-1
11/11/2025	7:19 AM	-1
11/11/2025	7:34 AM	-1
11/11/2025	7:49 AM	-1
11/11/2025	8:04 AM	-1
11/11/2025	8:19 AM	-1
11/11/2025	8:34 AM	-1
11/11/2025	8:49 AM	-1
11/11/2025	9:04 AM	-1
11/11/2025	9:19 AM	-2
11/11/2025	9:34 AM	-2
11/11/2025	9:49 AM	-2
11/11/2025	10:04 AM	-2
11/11/2025	10:19 AM	-1
11/11/2025	10:34 AM	-1
11/11/2025	10:49 AM	-2
11/11/2025	11:04 AM	-2
11/11/2025	11:19 AM	-2
11/11/2025	11:34 AM	-1
11/11/2025	11:49 AM	-2
11/11/2025	12:04 PM	-2
11/11/2025	12:19 PM	-2
11/11/2025	12:34 PM	-2
11/11/2025	12:49 PM	-2
11/11/2025	1:04 PM	-2
11/11/2025	1:19 PM	-2
11/11/2025	1:34 PM	-2
11/11/2025	1:49 PM	-2
11/11/2025	2:04 PM	-2
11/11/2025	2:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/11/2025	2:34 PM	-2
11/11/2025	2:49 PM	-2
11/11/2025	3:04 PM	-2
11/11/2025	3:19 PM	-2
11/11/2025	3:34 PM	-2
11/11/2025	3:49 PM	-2
11/11/2025	4:04 PM	-2
11/11/2025	4:19 PM	-2
11/11/2025	4:34 PM	-2
11/11/2025	4:49 PM	-2
11/11/2025	5:04 PM	-2
11/11/2025	5:19 PM	-2
11/11/2025	5:34 PM	-2
11/11/2025	5:49 PM	-2
11/11/2025	6:04 PM	-2
11/11/2025	6:19 PM	-2
11/11/2025	6:34 PM	-2
11/11/2025	6:49 PM	-2
11/11/2025	7:04 PM	-2
11/11/2025	7:19 PM	-2
11/11/2025	7:34 PM	-2
11/11/2025	7:49 PM	-2
11/11/2025	8:04 PM	-2
11/11/2025	8:19 PM	-2
11/11/2025	8:34 PM	-2
11/11/2025	8:49 PM	-2
11/11/2025	9:04 PM	-2
11/11/2025	9:19 PM	-2
11/11/2025	9:34 PM	-2
11/11/2025	9:49 PM	-2
11/11/2025	10:04 PM	-2
11/11/2025	10:19 PM	-2
11/11/2025	10:34 PM	-2
11/11/2025	10:49 PM	-2
11/11/2025	11:04 PM	-2
11/11/2025	11:19 PM	-2
11/11/2025	11:34 PM	-2
11/11/2025	11:49 PM	-2
11/12/2025	12:04 AM	-2
11/12/2025	12:19 AM	-2
11/12/2025	12:34 AM	-2
11/12/2025	12:49 AM	-2
11/12/2025	1:04 AM	-2
11/12/2025	1:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	1:34 AM	-2
11/12/2025	1:49 AM	-2
11/12/2025	2:04 AM	-2
11/12/2025	2:19 AM	-2
11/12/2025	2:34 AM	-1
11/12/2025	2:49 AM	-1
11/12/2025	3:04 AM	-1
11/12/2025	3:19 AM	-1
11/12/2025	3:34 AM	-1
11/12/2025	3:49 AM	-1
11/12/2025	4:04 AM	-1
11/12/2025	4:19 AM	-1
11/12/2025	4:34 AM	-1
11/12/2025	4:49 AM	-1
11/12/2025	5:04 AM	-1
11/12/2025	5:19 AM	-1
11/12/2025	5:34 AM	-1
11/12/2025	5:49 AM	-1
11/12/2025	6:04 AM	-1
11/12/2025	6:19 AM	-2
11/12/2025	6:34 AM	-2
11/12/2025	6:49 AM	-2
11/12/2025	7:04 AM	-2
11/12/2025	7:19 AM	-2
11/12/2025	7:34 AM	-2
11/12/2025	7:49 AM	-2
11/12/2025	8:04 AM	-2
11/12/2025	8:19 AM	-2
11/12/2025	8:34 AM	-2
11/12/2025	8:49 AM	-2
11/12/2025	9:04 AM	-2
11/12/2025	9:19 AM	-2
11/12/2025	9:34 AM	-2
11/12/2025	9:49 AM	-2
11/12/2025	10:04 AM	-2
11/12/2025	10:19 AM	-2
11/12/2025	10:34 AM	-2
11/12/2025	10:49 AM	-2
11/12/2025	11:04 AM	-2
11/12/2025	11:19 AM	-2
11/12/2025	11:34 AM	-2
11/12/2025	11:49 AM	-2
11/12/2025	12:04 PM	-2
11/12/2025	12:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	12:34 PM	-2
11/12/2025	12:49 PM	-2
11/12/2025	1:04 PM	-1
11/12/2025	1:19 PM	-2
11/12/2025	1:34 PM	-1
11/12/2025	1:49 PM	-1
11/12/2025	2:04 PM	-2
11/12/2025	2:19 PM	-2
11/12/2025	2:34 PM	-2
11/12/2025	2:49 PM	-2
11/12/2025	3:04 PM	-2
11/12/2025	3:19 PM	-2
11/12/2025	3:34 PM	-2
11/12/2025	3:49 PM	-2
11/12/2025	4:04 PM	-2
11/12/2025	4:19 PM	-2
11/12/2025	4:34 PM	-2
11/12/2025	4:49 PM	-2
11/12/2025	5:04 PM	-2
11/12/2025	5:19 PM	-2
11/12/2025	5:34 PM	-2
11/12/2025	5:49 PM	-2
11/12/2025	6:04 PM	-2
11/12/2025	6:19 PM	-2
11/12/2025	6:34 PM	-2
11/12/2025	6:49 PM	-2
11/12/2025	7:04 PM	-2
11/12/2025	7:19 PM	-2
11/12/2025	7:34 PM	-2
11/12/2025	7:49 PM	-2
11/12/2025	8:04 PM	-2
11/12/2025	8:19 PM	-2
11/12/2025	8:34 PM	-2
11/12/2025	8:49 PM	-2
11/12/2025	9:04 PM	-2
11/12/2025	9:19 PM	-2
11/12/2025	9:34 PM	-2
11/12/2025	9:49 PM	-2
11/12/2025	10:04 PM	-2
11/12/2025	10:19 PM	-2
11/12/2025	10:34 PM	-2
11/12/2025	10:49 PM	-2
11/12/2025	11:04 PM	-2
11/12/2025	11:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	11:34 PM	-2
11/12/2025	11:49 PM	-2
11/13/2025	12:04 AM	-2
11/13/2025	12:19 AM	-2
11/13/2025	12:34 AM	-2
11/13/2025	12:49 AM	-2
11/13/2025	1:04 AM	-2
11/13/2025	1:19 AM	-2
11/13/2025	1:34 AM	-2
11/13/2025	1:49 AM	-2
11/13/2025	2:04 AM	-2
11/13/2025	2:19 AM	-2
11/13/2025	2:34 AM	-2
11/13/2025	2:49 AM	-2
11/13/2025	3:04 AM	-2
11/13/2025	3:19 AM	-2
11/13/2025	3:34 AM	-2
11/13/2025	3:49 AM	-2
11/13/2025	4:04 AM	-2
11/13/2025	4:19 AM	-2
11/13/2025	4:34 AM	-2
11/13/2025	4:49 AM	-2
11/13/2025	5:04 AM	-2
11/13/2025	5:19 AM	-1
11/13/2025	5:34 AM	-2
11/13/2025	5:49 AM	-2
11/13/2025	6:04 AM	-2
11/13/2025	6:19 AM	-2
11/13/2025	6:34 AM	-2
11/13/2025	6:49 AM	-2
11/13/2025	7:04 AM	-2
11/13/2025	7:19 AM	-2
11/13/2025	7:34 AM	-2
11/13/2025	7:49 AM	-2
11/13/2025	8:04 AM	-2
11/13/2025	8:19 AM	-2
11/13/2025	8:34 AM	-2
11/13/2025	8:49 AM	-2
11/13/2025	9:04 AM	-2
11/13/2025	9:19 AM	-2
11/13/2025	9:34 AM	-2
11/13/2025	9:49 AM	-2
11/13/2025	10:04 AM	-2
11/13/2025	10:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/13/2025	10:34 AM	-2
11/13/2025	10:49 AM	-2
11/13/2025	11:04 AM	-2
11/13/2025	11:19 AM	-2
11/13/2025	11:34 AM	-2
11/13/2025	11:49 AM	-2
11/13/2025	12:04 PM	-2
11/13/2025	12:19 PM	-2
11/13/2025	12:34 PM	-2
11/13/2025	12:49 PM	-2
11/13/2025	1:04 PM	-2
11/13/2025	1:19 PM	-2
11/13/2025	1:34 PM	-2
11/13/2025	1:49 PM	-2
11/13/2025	2:04 PM	-2
11/13/2025	2:19 PM	-2
11/13/2025	2:34 PM	-2
11/13/2025	2:49 PM	-2
11/13/2025	3:04 PM	-2
11/13/2025	3:19 PM	-2
11/13/2025	3:34 PM	-2
11/13/2025	3:49 PM	-2
11/13/2025	4:04 PM	-2
11/13/2025	4:19 PM	-2
11/13/2025	4:34 PM	-2
11/13/2025	4:49 PM	-2
11/13/2025	5:04 PM	-2
11/13/2025	5:19 PM	-2
11/13/2025	5:34 PM	-2
11/13/2025	5:49 PM	-2
11/13/2025	6:04 PM	-2
11/13/2025	6:19 PM	-2
11/13/2025	6:34 PM	-2
11/13/2025	6:49 PM	-2
11/13/2025	7:04 PM	-2
11/13/2025	7:19 PM	-2
11/13/2025	7:34 PM	-2
11/13/2025	7:49 PM	-2
11/13/2025	8:04 PM	-2
11/13/2025	8:19 PM	-2
11/13/2025	8:34 PM	-2
11/13/2025	8:49 PM	-2
11/13/2025	9:04 PM	-2
11/13/2025	9:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/13/2025	9:34 PM	-2
11/13/2025	9:49 PM	-2
11/13/2025	10:04 PM	-2
11/13/2025	10:19 PM	-2
11/13/2025	10:34 PM	-2
11/13/2025	10:49 PM	-2
11/13/2025	11:04 PM	-2
11/13/2025	11:19 PM	-2
11/13/2025	11:34 PM	-2
11/13/2025	11:49 PM	-2
11/14/2025	12:04 AM	-2
11/14/2025	12:19 AM	-2
11/14/2025	12:34 AM	-2
11/14/2025	12:49 AM	-2
11/14/2025	1:04 AM	-2
11/14/2025	1:19 AM	-2
11/14/2025	1:34 AM	-2
11/14/2025	1:49 AM	-2
11/14/2025	2:04 AM	-2
11/14/2025	2:19 AM	-2
11/14/2025	2:34 AM	-2
11/14/2025	2:49 AM	-2
11/14/2025	3:04 AM	-2
11/14/2025	3:19 AM	-2
11/14/2025	3:34 AM	-2
11/14/2025	3:49 AM	-2
11/14/2025	4:04 AM	-2
11/14/2025	4:19 AM	-2
11/14/2025	4:34 AM	-2
11/14/2025	4:49 AM	-2
11/14/2025	5:04 AM	-2
11/14/2025	5:19 AM	-2
11/14/2025	5:34 AM	-2
11/14/2025	5:49 AM	-2
11/14/2025	6:04 AM	-2
11/14/2025	6:19 AM	-2
11/14/2025	6:34 AM	-2
11/14/2025	6:49 AM	-2
11/14/2025	7:04 AM	-2
11/14/2025	7:19 AM	-2
11/14/2025	7:34 AM	-2
11/14/2025	7:49 AM	-2
11/14/2025	8:04 AM	-2
11/14/2025	8:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/14/2025	8:34 AM	-2
11/14/2025	8:49 AM	-2
11/14/2025	9:04 AM	-2
11/14/2025	9:19 AM	-2
11/14/2025	9:34 AM	-2
11/14/2025	9:49 AM	-2
11/14/2025	10:04 AM	-2
11/14/2025	10:19 AM	-2
11/14/2025	10:34 AM	-2
11/14/2025	10:49 AM	-2
11/14/2025	11:04 AM	-2
11/14/2025	11:19 AM	-2
11/14/2025	11:34 AM	-2
11/14/2025	11:49 AM	-2
11/14/2025	12:04 PM	-2
11/14/2025	12:19 PM	-2
11/14/2025	12:34 PM	-2
11/14/2025	12:49 PM	-2
11/14/2025	1:04 PM	-2
11/14/2025	1:19 PM	-2
11/14/2025	1:34 PM	-2
11/14/2025	1:49 PM	-2
11/14/2025	2:04 PM	-2
11/14/2025	2:19 PM	-2
11/14/2025	2:34 PM	-2
11/14/2025	2:49 PM	-2
11/14/2025	3:04 PM	-2
11/14/2025	3:19 PM	-2
11/14/2025	3:34 PM	-2
11/14/2025	3:49 PM	-2
11/14/2025	4:04 PM	-2
11/14/2025	4:19 PM	-2
11/14/2025	4:34 PM	-2
11/14/2025	4:49 PM	-2
11/14/2025	5:04 PM	-2
11/14/2025	5:19 PM	-2
11/14/2025	5:34 PM	-2
11/14/2025	5:49 PM	-2
11/14/2025	6:04 PM	-2
11/14/2025	6:19 PM	-2
11/14/2025	6:34 PM	-2
11/14/2025	6:49 PM	-2
11/14/2025	7:04 PM	-2
11/14/2025	7:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/14/2025	7:34 PM	-2
11/14/2025	7:49 PM	-2
11/14/2025	8:04 PM	-2
11/14/2025	8:19 PM	-2
11/14/2025	8:34 PM	-2
11/14/2025	8:49 PM	-2
11/14/2025	9:04 PM	-2
11/14/2025	9:19 PM	-2
11/14/2025	9:34 PM	-2
11/14/2025	9:49 PM	-2
11/14/2025	10:04 PM	-2
11/14/2025	10:19 PM	-2
11/14/2025	10:34 PM	-2
11/14/2025	10:49 PM	-2
11/14/2025	11:04 PM	-2
11/14/2025	11:19 PM	-2
11/14/2025	11:34 PM	-2
11/14/2025	11:49 PM	-2
11/15/2025	12:04 AM	-2
11/15/2025	12:19 AM	-2
11/15/2025	12:34 AM	-2
11/15/2025	12:49 AM	-2
11/15/2025	1:04 AM	-2
11/15/2025	1:19 AM	-2
11/15/2025	1:34 AM	-2
11/15/2025	1:49 AM	-2
11/15/2025	2:04 AM	-2
11/15/2025	2:19 AM	-2
11/15/2025	2:34 AM	-2
11/15/2025	2:49 AM	-2
11/15/2025	3:04 AM	-2
11/15/2025	3:19 AM	-2
11/15/2025	3:34 AM	-2
11/15/2025	3:49 AM	-2
11/15/2025	4:04 AM	-2
11/15/2025	4:19 AM	-2
11/15/2025	4:34 AM	-2
11/15/2025	4:49 AM	-2
11/15/2025	5:04 AM	-2
11/15/2025	5:19 AM	-2
11/15/2025	5:34 AM	-2
11/15/2025	5:49 AM	-2
11/15/2025	6:04 AM	-2
11/15/2025	6:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/15/2025	6:34 AM	-2
11/15/2025	6:49 AM	-2
11/15/2025	7:04 AM	-2
11/15/2025	7:19 AM	-2
11/15/2025	7:34 AM	-2
11/15/2025	7:49 AM	-2
11/15/2025	8:04 AM	-2
11/15/2025	8:19 AM	-2
11/15/2025	8:34 AM	-2
11/15/2025	8:49 AM	-2
11/15/2025	9:04 AM	-2
11/15/2025	9:19 AM	-2
11/15/2025	9:34 AM	-2
11/15/2025	9:49 AM	-2
11/15/2025	10:04 AM	-2
11/15/2025	10:19 AM	-2
11/15/2025	10:34 AM	-2
11/15/2025	10:49 AM	-2
11/15/2025	11:04 AM	-2
11/15/2025	11:19 AM	-2
11/15/2025	11:34 AM	-2
11/15/2025	11:49 AM	-2
11/15/2025	12:04 PM	-2
11/15/2025	12:19 PM	-2
11/15/2025	12:34 PM	-2
11/15/2025	12:49 PM	-2
11/15/2025	1:04 PM	-2
11/15/2025	1:19 PM	-2
11/15/2025	1:34 PM	-2
11/15/2025	1:49 PM	-2
11/15/2025	2:04 PM	-2
11/15/2025	2:19 PM	-2
11/15/2025	2:34 PM	-2
11/15/2025	2:49 PM	-2
11/15/2025	3:04 PM	-2
11/15/2025	3:19 PM	-2
11/15/2025	3:34 PM	-2
11/15/2025	3:49 PM	-2
11/15/2025	4:04 PM	-2
11/15/2025	4:19 PM	-2
11/15/2025	4:34 PM	-2
11/15/2025	4:49 PM	-2
11/15/2025	5:04 PM	-2
11/15/2025	5:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/15/2025	5:34 PM	-2
11/15/2025	5:49 PM	-2
11/15/2025	6:04 PM	-2
11/15/2025	6:19 PM	-2
11/15/2025	6:34 PM	-2
11/15/2025	6:49 PM	-2
11/15/2025	7:04 PM	-2
11/15/2025	7:19 PM	-2
11/15/2025	7:34 PM	-2
11/15/2025	7:49 PM	-2
11/15/2025	8:04 PM	-2
11/15/2025	8:19 PM	-2
11/15/2025	8:34 PM	-2
11/15/2025	8:49 PM	-2
11/15/2025	9:04 PM	-2
11/15/2025	9:19 PM	-2
11/15/2025	9:34 PM	-2
11/15/2025	9:49 PM	-2
11/15/2025	10:04 PM	-2
11/15/2025	10:19 PM	-2
11/15/2025	10:34 PM	-2
11/15/2025	10:49 PM	-2
11/15/2025	11:04 PM	-2
11/15/2025	11:19 PM	-2
11/15/2025	11:34 PM	-2
11/15/2025	11:49 PM	-2
11/16/2025	12:04 AM	-2
11/16/2025	12:19 AM	-2
11/16/2025	12:34 AM	-2
11/16/2025	12:49 AM	-2
11/16/2025	1:04 AM	-2
11/16/2025	1:19 AM	-2
11/16/2025	1:34 AM	-2
11/16/2025	1:49 AM	-2
11/16/2025	2:04 AM	-2
11/16/2025	2:19 AM	-2
11/16/2025	2:34 AM	-2
11/16/2025	2:49 AM	-2
11/16/2025	3:04 AM	-2
11/16/2025	3:19 AM	-2
11/16/2025	3:34 AM	-2
11/16/2025	3:49 AM	-2
11/16/2025	4:04 AM	-2
11/16/2025	4:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/16/2025	4:34 AM	-2
11/16/2025	4:49 AM	-2
11/16/2025	5:04 AM	-2
11/16/2025	5:19 AM	-2
11/16/2025	5:34 AM	-2
11/16/2025	5:49 AM	-2
11/16/2025	6:04 AM	-2
11/16/2025	6:19 AM	-2
11/16/2025	6:34 AM	-2
11/16/2025	6:49 AM	-2
11/16/2025	7:04 AM	-2
11/16/2025	7:19 AM	-2
11/16/2025	7:34 AM	-2
11/16/2025	7:49 AM	-2
11/16/2025	8:04 AM	-2
11/16/2025	8:19 AM	-2
11/16/2025	8:34 AM	-2
11/16/2025	8:49 AM	-2
11/16/2025	9:04 AM	-2
11/16/2025	9:19 AM	-2
11/16/2025	9:34 AM	-2
11/16/2025	9:49 AM	-2
11/16/2025	10:04 AM	-2
11/16/2025	10:19 AM	-2
11/16/2025	10:34 AM	-2
11/16/2025	10:49 AM	-2
11/16/2025	11:04 AM	-2
11/16/2025	11:19 AM	-2
11/16/2025	11:34 AM	-2
11/16/2025	11:49 AM	-2
11/16/2025	12:04 PM	-2
11/16/2025	12:19 PM	-2
11/16/2025	12:34 PM	-2
11/16/2025	12:49 PM	-2
11/16/2025	1:04 PM	-2
11/16/2025	1:19 PM	-2
11/16/2025	1:34 PM	-2
11/16/2025	1:49 PM	-2
11/16/2025	2:04 PM	-2
11/16/2025	2:19 PM	-2
11/16/2025	2:34 PM	-2
11/16/2025	2:49 PM	-2
11/16/2025	3:04 PM	-2
11/16/2025	3:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/16/2025	3:34 PM	-2
11/16/2025	3:49 PM	-2
11/16/2025	4:04 PM	-2
11/16/2025	4:19 PM	-2
11/16/2025	4:34 PM	-2
11/16/2025	4:49 PM	-2
11/16/2025	5:04 PM	-2
11/16/2025	5:19 PM	-2
11/16/2025	5:34 PM	-2
11/16/2025	5:49 PM	-2
11/16/2025	6:04 PM	-2
11/16/2025	6:19 PM	-2
11/16/2025	6:34 PM	-2
11/16/2025	6:49 PM	-2
11/16/2025	7:04 PM	-2
11/16/2025	7:19 PM	-2
11/16/2025	7:34 PM	-2
11/16/2025	7:49 PM	-2
11/16/2025	8:04 PM	-2
11/16/2025	8:19 PM	-2
11/16/2025	8:34 PM	-2
11/16/2025	8:49 PM	-2
11/16/2025	9:04 PM	-2
11/16/2025	9:19 PM	-2
11/16/2025	9:34 PM	-2
11/16/2025	9:49 PM	-2
11/16/2025	10:04 PM	-2
11/16/2025	10:19 PM	-2
11/16/2025	10:34 PM	-2
11/16/2025	10:49 PM	-2
11/16/2025	11:04 PM	-2
11/16/2025	11:19 PM	-2
11/16/2025	11:34 PM	-2
11/16/2025	11:49 PM	-2
11/17/2025	12:04 AM	-2
11/17/2025	12:19 AM	-2
11/17/2025	12:34 AM	-2
11/17/2025	12:49 AM	-2
11/17/2025	1:04 AM	-2
11/17/2025	1:19 AM	-2
11/17/2025	1:34 AM	-2
11/17/2025	1:49 AM	-2
11/17/2025	2:04 AM	-2
11/17/2025	2:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/17/2025	2:34 AM	-2
11/17/2025	2:49 AM	-2
11/17/2025	3:04 AM	-2
11/17/2025	3:19 AM	-2
11/17/2025	3:34 AM	-2
11/17/2025	3:49 AM	-2
11/17/2025	4:04 AM	-2
11/17/2025	4:19 AM	-2
11/17/2025	4:34 AM	-2
11/17/2025	4:49 AM	-2
11/17/2025	5:04 AM	-2
11/17/2025	5:19 AM	-2
11/17/2025	5:34 AM	-2
11/17/2025	5:49 AM	-2
11/17/2025	6:04 AM	-2
11/17/2025	6:19 AM	-2
11/17/2025	6:34 AM	-2
11/17/2025	6:49 AM	-2
11/17/2025	7:04 AM	-2
11/17/2025	7:19 AM	-2
11/17/2025	7:34 AM	-2
11/17/2025	7:49 AM	-2
11/17/2025	8:04 AM	-2
11/17/2025	8:19 AM	-2
11/17/2025	8:34 AM	-2
11/17/2025	8:49 AM	-2
11/17/2025	9:04 AM	-2
11/17/2025	9:19 AM	-2
11/17/2025	9:34 AM	-2
11/17/2025	9:49 AM	-2
11/17/2025	10:04 AM	-2
11/17/2025	10:19 AM	-2
11/17/2025	10:34 AM	-2
11/17/2025	10:49 AM	-2
11/17/2025	11:04 AM	-2
11/17/2025	11:19 AM	-2
11/17/2025	11:34 AM	-2
11/17/2025	11:49 AM	-2
11/17/2025	12:04 PM	-2
11/17/2025	12:19 PM	-2
11/17/2025	12:34 PM	-2
11/17/2025	12:49 PM	-2
11/17/2025	1:04 PM	-2
11/17/2025	1:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/17/2025	1:34 PM	-2
11/17/2025	1:49 PM	-2
11/17/2025	2:04 PM	-2
11/17/2025	2:19 PM	-2
11/17/2025	2:34 PM	-2
11/17/2025	2:49 PM	-2
11/17/2025	3:04 PM	-2
11/17/2025	3:19 PM	-2
11/17/2025	3:34 PM	-2
11/17/2025	3:49 PM	-2
11/17/2025	4:04 PM	-2
11/17/2025	4:19 PM	-2
11/17/2025	4:34 PM	-2
11/17/2025	4:49 PM	-2
11/17/2025	5:04 PM	-2
11/17/2025	5:19 PM	-2
11/17/2025	5:34 PM	-2
11/17/2025	5:49 PM	-2
11/17/2025	6:04 PM	-2
11/17/2025	6:19 PM	-2
11/17/2025	6:34 PM	-2
11/17/2025	6:49 PM	-2
11/17/2025	7:04 PM	-2
11/17/2025	7:19 PM	-2
11/17/2025	7:34 PM	-2
11/17/2025	7:49 PM	-2
11/17/2025	8:04 PM	-2
11/17/2025	8:19 PM	-2
11/17/2025	8:34 PM	-2
11/17/2025	8:49 PM	-2
11/17/2025	9:04 PM	-2
11/17/2025	9:19 PM	-2
11/17/2025	9:34 PM	-2
11/17/2025	9:49 PM	-2
11/17/2025	10:04 PM	-2
11/17/2025	10:19 PM	-2
11/17/2025	10:34 PM	-2
11/17/2025	10:49 PM	-2
11/17/2025	11:04 PM	-2
11/17/2025	11:19 PM	-2
11/17/2025	11:34 PM	-2
11/17/2025	11:49 PM	-2
11/18/2025	12:04 AM	-2
11/18/2025	12:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/18/2025	12:34 AM	-2
11/18/2025	12:49 AM	-2
11/18/2025	1:04 AM	-3
11/18/2025	1:19 AM	-3
11/18/2025	1:34 AM	-2
11/18/2025	1:49 AM	-3
11/18/2025	2:04 AM	-2
11/18/2025	2:19 AM	-3
11/18/2025	2:34 AM	-2
11/18/2025	2:49 AM	-2
11/18/2025	3:04 AM	-2
11/18/2025	3:19 AM	-2
11/18/2025	3:34 AM	-2
11/18/2025	3:49 AM	-2
11/18/2025	4:04 AM	-2
11/18/2025	4:19 AM	-2
11/18/2025	4:34 AM	-2
11/18/2025	4:49 AM	-2
11/18/2025	5:04 AM	-2
11/18/2025	5:19 AM	-2
11/18/2025	5:34 AM	-2
11/18/2025	5:49 AM	-2
11/18/2025	6:04 AM	-2
11/18/2025	6:19 AM	-2
11/18/2025	6:34 AM	-2
11/18/2025	6:49 AM	-2
11/18/2025	7:04 AM	-2
11/18/2025	7:19 AM	-2
11/18/2025	7:34 AM	-2
11/18/2025	7:49 AM	-2
11/18/2025	8:04 AM	-2
11/18/2025	8:19 AM	-2
11/18/2025	8:34 AM	-2
11/18/2025	8:49 AM	-2
11/18/2025	9:04 AM	-3
11/18/2025	9:19 AM	-2
11/18/2025	9:34 AM	-2
11/18/2025	9:49 AM	-2
11/18/2025	10:04 AM	-2
11/18/2025	10:19 AM	-2
11/18/2025	10:34 AM	-2
11/18/2025	10:49 AM	-2
11/18/2025	11:04 AM	-2
11/18/2025	11:19 AM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/18/2025	11:34 AM	-2
11/18/2025	11:49 AM	-2
11/18/2025	12:04 PM	-2
11/18/2025	12:19 PM	-2
11/18/2025	12:34 PM	-2
11/18/2025	12:49 PM	-2
11/18/2025	1:04 PM	-2
11/18/2025	1:19 PM	-2
11/18/2025	1:34 PM	-2
11/18/2025	1:49 PM	-2
11/18/2025	2:04 PM	-2
11/18/2025	2:19 PM	-2
11/18/2025	2:34 PM	-2
11/18/2025	2:49 PM	-2
11/18/2025	3:04 PM	-2
11/18/2025	3:19 PM	-2
11/18/2025	3:34 PM	-2
11/18/2025	3:49 PM	-2
11/18/2025	4:04 PM	-2
11/18/2025	4:19 PM	-2
11/18/2025	4:34 PM	-2
11/18/2025	4:49 PM	-2
11/18/2025	5:04 PM	-2
11/18/2025	5:19 PM	-2
11/18/2025	5:34 PM	-2
11/18/2025	5:49 PM	-2
11/18/2025	6:04 PM	-2
11/18/2025	6:19 PM	-2
11/18/2025	6:34 PM	-2
11/18/2025	6:49 PM	-2
11/18/2025	7:04 PM	-2
11/18/2025	7:19 PM	-2
11/18/2025	7:34 PM	-2
11/18/2025	7:49 PM	-2
11/18/2025	8:04 PM	-2
11/18/2025	8:19 PM	-2
11/18/2025	8:34 PM	-2
11/18/2025	8:49 PM	-2
11/18/2025	9:04 PM	-2
11/18/2025	9:19 PM	-3
11/18/2025	9:34 PM	-2
11/18/2025	9:49 PM	-2
11/18/2025	10:04 PM	-2
11/18/2025	10:19 PM	-2



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/18/2025	10:34 PM	-3
11/18/2025	10:49 PM	-3
11/18/2025	11:04 PM	-2
11/18/2025	11:19 PM	-3
11/18/2025	11:34 PM	-3
11/18/2025	11:49 PM	-3
11/19/2025	12:04 AM	-3
11/19/2025	12:19 AM	-3
11/19/2025	12:34 AM	-3
11/19/2025	12:49 AM	-3
11/19/2025	1:04 AM	-3
11/19/2025	1:19 AM	-3
11/19/2025	1:34 AM	-3
11/19/2025	1:49 AM	-3
11/19/2025	2:04 AM	-3
11/19/2025	2:19 AM	-3
11/19/2025	2:34 AM	-3
11/19/2025	2:49 AM	-3
11/19/2025	3:04 AM	-3
11/19/2025	3:19 AM	-3
11/19/2025	3:34 AM	-3
11/19/2025	3:49 AM	-3
11/19/2025	4:04 AM	-3
11/19/2025	4:19 AM	-3
11/19/2025	4:34 AM	-3
11/19/2025	4:49 AM	-3
11/19/2025	5:04 AM	-3
11/19/2025	5:19 AM	-3
11/19/2025	5:34 AM	-3
11/19/2025	5:49 AM	-3
11/19/2025	6:04 AM	-3
11/19/2025	6:19 AM	-3
11/19/2025	6:34 AM	-3
11/19/2025	6:49 AM	-3
11/19/2025	7:04 AM	-3
11/19/2025	7:19 AM	-3
11/19/2025	7:34 AM	-3
11/19/2025	7:49 AM	-3
11/19/2025	8:04 AM	-3
11/19/2025	8:19 AM	-3
11/19/2025	8:34 AM	-3
11/19/2025	8:49 AM	-3
11/19/2025	9:04 AM	-3
11/19/2025	9:19 AM	-3



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/19/2025	9:34 AM	-3
11/19/2025	9:49 AM	-3
11/19/2025	10:04 AM	-3
11/19/2025	10:19 AM	-3
11/19/2025	10:34 AM	-3
11/19/2025	10:49 AM	-3
11/19/2025	11:04 AM	-3
11/19/2025	11:19 AM	-3
11/19/2025	11:34 AM	-3
11/19/2025	11:49 AM	-3
11/19/2025	12:04 PM	-3
11/19/2025	12:19 PM	-3
11/19/2025	12:34 PM	-3
11/19/2025	12:49 PM	-3
11/19/2025	1:04 PM	-3
11/19/2025	1:19 PM	-3
11/19/2025	1:34 PM	-3
11/19/2025	1:49 PM	-3
11/19/2025	2:04 PM	-3
11/19/2025	2:19 PM	-3
11/19/2025	2:34 PM	-3
11/19/2025	2:49 PM	-3
11/19/2025	3:04 PM	-3
11/19/2025	3:19 PM	-3
11/19/2025	3:34 PM	-3
11/19/2025	3:49 PM	-3
11/19/2025	4:04 PM	-3
11/19/2025	4:19 PM	-3
11/19/2025	4:34 PM	-3
11/19/2025	4:49 PM	-3
11/19/2025	5:04 PM	-3
11/19/2025	5:19 PM	-3
11/19/2025	5:34 PM	-3
11/19/2025	5:49 PM	-3
11/19/2025	6:04 PM	-3
11/19/2025	6:19 PM	-3
11/19/2025	6:34 PM	-3
11/19/2025	6:49 PM	-3
11/19/2025	7:04 PM	-3
11/19/2025	7:19 PM	-3
11/19/2025	7:34 PM	-3
11/19/2025	7:49 PM	-3
11/19/2025	8:04 PM	-3
11/19/2025	8:19 PM	-3



C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/19/2025	8:34 PM	-3
11/19/2025	8:49 PM	-3
11/19/2025	9:04 PM	-3
11/19/2025	9:19 PM	-3
11/19/2025	9:34 PM	-3
11/19/2025	9:49 PM	-3
11/19/2025	10:04 PM	-3
11/19/2025	10:19 PM	-3
11/19/2025	10:34 PM	-3
11/19/2025	10:49 PM	-3
11/19/2025	11:04 PM	-3
11/19/2025	11:19 PM	-3
11/19/2025	11:34 PM	-3
11/19/2025	11:49 PM	-3
11/20/2025	12:04 AM	-3
11/20/2025	12:19 AM	-3
11/20/2025	12:34 AM	-3
11/20/2025	12:49 AM	-3
11/20/2025	1:04 AM	-3
11/20/2025	1:19 AM	-3
11/20/2025	1:34 AM	-3
11/20/2025	1:49 AM	-3
11/20/2025	2:04 AM	-3
11/20/2025	2:19 AM	-3
11/20/2025	2:34 AM	-3
11/20/2025	2:49 AM	-3
11/20/2025	3:04 AM	-3
11/20/2025	3:19 AM	-3
11/20/2025	3:34 AM	-3
11/20/2025	3:49 AM	-3
11/20/2025	4:04 AM	-3
11/20/2025	4:19 AM	-3
11/20/2025	4:34 AM	-3
11/20/2025	4:49 AM	-3
11/20/2025	5:04 AM	-3
11/20/2025	5:19 AM	-3
11/20/2025	5:34 AM	-3
11/20/2025	5:49 AM	-3
11/20/2025	6:04 AM	-3
11/20/2025	6:19 AM	-3
11/20/2025	6:34 AM	-3
11/20/2025	6:49 AM	-3
11/20/2025	7:04 AM	-3
11/20/2025	7:19 AM	-3



**C/O BLALOCK RD AND GREEN OAKS RD  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/20/2025	7:34 AM	-3
11/20/2025	7:49 AM	-3
11/20/2025	8:04 AM	-3
11/20/2025	8:19 AM	-3
11/20/2025	8:34 AM	-3
11/20/2025	8:49 AM	-3
11/20/2025	9:04 AM	-3
11/20/2025	9:19 AM	-3
11/20/2025	9:34 AM	-3
11/20/2025	9:49 AM	-3
11/20/2025	10:04 AM	-3
11/20/2025	10:19 AM	-3



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/27/2025	10:41 AM	52
10/27/2025	10:56 AM	51
10/27/2025	11:11 AM	54
10/27/2025	11:26 AM	50
10/27/2025	11:41 AM	53
10/27/2025	11:56 AM	51
10/27/2025	12:11 PM	51
10/27/2025	12:26 PM	51
10/27/2025	12:41 PM	52
10/27/2025	12:56 PM	51
10/27/2025	1:11 PM	50
10/27/2025	1:26 PM	51
10/27/2025	1:41 PM	51
10/27/2025	1:56 PM	51
10/27/2025	2:11 PM	52
10/27/2025	2:26 PM	51
10/27/2025	2:41 PM	52
10/27/2025	2:56 PM	52
10/27/2025	3:11 PM	51
10/27/2025	3:26 PM	51
10/27/2025	3:41 PM	51
10/27/2025	3:56 PM	51
10/27/2025	4:11 PM	52
10/27/2025	4:26 PM	51
10/27/2025	4:41 PM	51
10/27/2025	4:56 PM	52
10/27/2025	5:11 PM	51
10/27/2025	5:26 PM	51
10/27/2025	5:41 PM	51
10/27/2025	5:56 PM	51
10/27/2025	6:11 PM	51
10/27/2025	6:26 PM	52
10/27/2025	6:41 PM	51
10/27/2025	6:56 PM	52
10/27/2025	7:11 PM	51
10/27/2025	7:26 PM	51
10/27/2025	7:41 PM	51
10/27/2025	7:56 PM	51
10/27/2025	8:11 PM	51
10/27/2025	8:26 PM	51
10/27/2025	8:41 PM	51
10/27/2025	8:56 PM	51
10/27/2025	9:11 PM	51
10/27/2025	9:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/27/2025	9:41 PM	51
10/27/2025	9:56 PM	51
10/27/2025	10:11 PM	52
10/27/2025	10:26 PM	51
10/27/2025	10:41 PM	52
10/27/2025	10:56 PM	52
10/27/2025	11:11 PM	52
10/27/2025	11:26 PM	51
10/27/2025	11:41 PM	52
10/27/2025	11:56 PM	52
10/28/2025	12:11 AM	51
10/28/2025	12:26 AM	51
10/28/2025	12:41 AM	51
10/28/2025	12:56 AM	51
10/28/2025	1:11 AM	51
10/28/2025	1:26 AM	51
10/28/2025	1:41 AM	51
10/28/2025	1:56 AM	51
10/28/2025	2:11 AM	52
10/28/2025	2:26 AM	49
10/28/2025	2:41 AM	50
10/28/2025	2:56 AM	49
10/28/2025	3:11 AM	50
10/28/2025	3:26 AM	49
10/28/2025	3:41 AM	47
10/28/2025	3:56 AM	49
10/28/2025	4:11 AM	49
10/28/2025	4:26 AM	49
10/28/2025	4:41 AM	49
10/28/2025	4:56 AM	46
10/28/2025	5:11 AM	47
10/28/2025	5:26 AM	49
10/28/2025	5:41 AM	48
10/28/2025	5:56 AM	49
10/28/2025	6:11 AM	50
10/28/2025	6:26 AM	50
10/28/2025	6:41 AM	52
10/28/2025	6:56 AM	52
10/28/2025	7:11 AM	49
10/28/2025	7:26 AM	50
10/28/2025	7:41 AM	51
10/28/2025	7:56 AM	50
10/28/2025	8:11 AM	49
10/28/2025	8:26 AM	49



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/28/2025	8:41 AM	51
10/28/2025	8:56 AM	49
10/28/2025	9:11 AM	51
10/28/2025	9:26 AM	51
10/28/2025	9:41 AM	52
10/28/2025	9:56 AM	52
10/28/2025	10:11 AM	52
10/28/2025	10:26 AM	52
10/28/2025	10:41 AM	51
10/28/2025	10:56 AM	52
10/28/2025	11:11 AM	51
10/28/2025	11:26 AM	51
10/28/2025	11:41 AM	52
10/28/2025	11:56 AM	51
10/28/2025	12:11 PM	51
10/28/2025	12:26 PM	51
10/28/2025	12:41 PM	52
10/28/2025	12:56 PM	51
10/28/2025	1:11 PM	51
10/28/2025	1:26 PM	51
10/28/2025	1:41 PM	52
10/28/2025	1:56 PM	52
10/28/2025	2:11 PM	51
10/28/2025	2:26 PM	51
10/28/2025	2:41 PM	52
10/28/2025	2:56 PM	52
10/28/2025	3:11 PM	52
10/28/2025	3:26 PM	51
10/28/2025	3:41 PM	52
10/28/2025	3:56 PM	52
10/28/2025	4:11 PM	51
10/28/2025	4:26 PM	51
10/28/2025	4:41 PM	52
10/28/2025	4:56 PM	52
10/28/2025	5:11 PM	51
10/28/2025	5:26 PM	51
10/28/2025	5:41 PM	52
10/28/2025	5:56 PM	51
10/28/2025	6:11 PM	51
10/28/2025	6:26 PM	51
10/28/2025	6:41 PM	52
10/28/2025	6:56 PM	51
10/28/2025	7:11 PM	51
10/28/2025	7:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/28/2025	7:41 PM	52
10/28/2025	7:56 PM	51
10/28/2025	8:11 PM	52
10/28/2025	8:26 PM	51
10/28/2025	8:41 PM	52
10/28/2025	8:56 PM	51
10/28/2025	9:11 PM	51
10/28/2025	9:26 PM	51
10/28/2025	9:41 PM	51
10/28/2025	9:56 PM	52
10/28/2025	10:11 PM	51
10/28/2025	10:26 PM	51
10/28/2025	10:41 PM	51
10/28/2025	10:56 PM	51
10/28/2025	11:11 PM	51
10/28/2025	11:26 PM	51
10/28/2025	11:41 PM	52
10/28/2025	11:56 PM	51
10/29/2025	12:11 AM	51
10/29/2025	12:26 AM	51
10/29/2025	12:41 AM	51
10/29/2025	12:56 AM	51
10/29/2025	1:11 AM	51
10/29/2025	1:26 AM	51
10/29/2025	1:41 AM	51
10/29/2025	1:56 AM	50
10/29/2025	2:11 AM	48
10/29/2025	2:26 AM	49
10/29/2025	2:41 AM	48
10/29/2025	2:56 AM	48
10/29/2025	3:11 AM	51
10/29/2025	3:26 AM	51
10/29/2025	3:41 AM	52
10/29/2025	3:56 AM	51
10/29/2025	4:11 AM	50
10/29/2025	4:26 AM	49
10/29/2025	4:41 AM	50
10/29/2025	4:56 AM	50
10/29/2025	5:11 AM	44
10/29/2025	5:26 AM	44
10/29/2025	5:41 AM	45
10/29/2025	5:56 AM	47
10/29/2025	6:11 AM	47
10/29/2025	6:26 AM	49



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/29/2025	6:41 AM	49
10/29/2025	6:56 AM	50
10/29/2025	7:11 AM	51
10/29/2025	7:26 AM	49
10/29/2025	7:41 AM	50
10/29/2025	7:56 AM	49
10/29/2025	8:11 AM	50
10/29/2025	8:26 AM	51
10/29/2025	8:41 AM	49
10/29/2025	8:56 AM	51
10/29/2025	9:11 AM	51
10/29/2025	9:26 AM	51
10/29/2025	9:41 AM	51
10/29/2025	9:56 AM	51
10/29/2025	10:11 AM	51
10/29/2025	10:26 AM	52
10/29/2025	10:41 AM	52
10/29/2025	10:56 AM	51
10/29/2025	11:11 AM	51
10/29/2025	11:26 AM	52
10/29/2025	11:41 AM	51
10/29/2025	11:56 AM	51
10/29/2025	12:11 PM	51
10/29/2025	12:26 PM	52
10/29/2025	12:41 PM	51
10/29/2025	12:56 PM	52
10/29/2025	1:11 PM	52
10/29/2025	1:26 PM	52
10/29/2025	1:41 PM	52
10/29/2025	1:56 PM	51
10/29/2025	2:11 PM	51
10/29/2025	2:26 PM	52
10/29/2025	2:41 PM	52
10/29/2025	2:56 PM	52
10/29/2025	3:11 PM	51
10/29/2025	3:26 PM	53
10/29/2025	3:41 PM	52
10/29/2025	3:56 PM	51
10/29/2025	4:11 PM	51
10/29/2025	4:26 PM	52
10/29/2025	4:41 PM	51
10/29/2025	4:56 PM	52
10/29/2025	5:11 PM	52
10/29/2025	5:26 PM	52



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

DATE	TIME	PSI
10/29/2025	5:41 PM	52
10/29/2025	5:56 PM	52
10/29/2025	6:11 PM	51
10/29/2025	6:26 PM	51
10/29/2025	6:41 PM	52
10/29/2025	6:56 PM	52
10/29/2025	7:11 PM	52
10/29/2025	7:26 PM	52
10/29/2025	7:41 PM	51
10/29/2025	7:56 PM	52
10/29/2025	8:11 PM	51
10/29/2025	8:26 PM	52
10/29/2025	8:41 PM	51
10/29/2025	8:56 PM	51
10/29/2025	9:11 PM	51
10/29/2025	9:26 PM	52
10/29/2025	9:41 PM	52
10/29/2025	9:56 PM	52
10/29/2025	10:11 PM	52
10/29/2025	10:26 PM	51
10/29/2025	10:41 PM	51
10/29/2025	10:56 PM	52
10/29/2025	11:11 PM	52
10/29/2025	11:26 PM	52
10/29/2025	11:41 PM	52
10/29/2025	11:56 PM	51
10/30/2025	12:11 AM	52
10/30/2025	12:26 AM	51
10/30/2025	12:41 AM	52
10/30/2025	12:56 AM	51
10/30/2025	1:11 AM	51
10/30/2025	1:26 AM	49
10/30/2025	1:41 AM	49
10/30/2025	1:56 AM	49
10/30/2025	2:11 AM	51
10/30/2025	2:26 AM	51
10/30/2025	2:41 AM	51
10/30/2025	2:56 AM	49
10/30/2025	3:11 AM	49
10/30/2025	3:26 AM	51
10/30/2025	3:41 AM	50
10/30/2025	3:56 AM	48
10/30/2025	4:11 AM	50
10/30/2025	4:26 AM	50



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/30/2025	4:41 AM	45
10/30/2025	4:56 AM	50
10/30/2025	5:11 AM	46
10/30/2025	5:26 AM	46
10/30/2025	5:41 AM	46
10/30/2025	5:56 AM	50
10/30/2025	6:11 AM	50
10/30/2025	6:26 AM	51
10/30/2025	6:41 AM	49
10/30/2025	6:56 AM	51
10/30/2025	7:11 AM	52
10/30/2025	7:26 AM	53
10/30/2025	7:41 AM	49
10/30/2025	7:56 AM	49
10/30/2025	8:11 AM	50
10/30/2025	8:26 AM	49
10/30/2025	8:41 AM	50
10/30/2025	8:56 AM	52
10/30/2025	9:11 AM	51
10/30/2025	9:26 AM	52
10/30/2025	9:41 AM	51
10/30/2025	9:56 AM	50
10/30/2025	10:11 AM	52
10/30/2025	10:26 AM	51
10/30/2025	10:41 AM	52
10/30/2025	10:56 AM	51
10/30/2025	11:11 AM	52
10/30/2025	11:26 AM	51
10/30/2025	11:41 AM	51
10/30/2025	11:56 AM	51
10/30/2025	12:11 PM	52
10/30/2025	12:26 PM	53
10/30/2025	12:41 PM	52
10/30/2025	12:56 PM	51
10/30/2025	1:11 PM	52
10/30/2025	1:26 PM	51
10/30/2025	1:41 PM	51
10/30/2025	1:56 PM	51
10/30/2025	2:11 PM	53
10/30/2025	2:26 PM	51
10/30/2025	2:41 PM	52
10/30/2025	2:56 PM	51
10/30/2025	3:11 PM	51
10/30/2025	3:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/30/2025	3:41 PM	52
10/30/2025	3:56 PM	52
10/30/2025	4:11 PM	52
10/30/2025	4:26 PM	52
10/30/2025	4:41 PM	53
10/30/2025	4:56 PM	52
10/30/2025	5:11 PM	51
10/30/2025	5:26 PM	52
10/30/2025	5:41 PM	51
10/30/2025	5:56 PM	51
10/30/2025	6:11 PM	51
10/30/2025	6:26 PM	52
10/30/2025	6:41 PM	52
10/30/2025	6:56 PM	52
10/30/2025	7:11 PM	51
10/30/2025	7:26 PM	52
10/30/2025	7:41 PM	52
10/30/2025	7:56 PM	51
10/30/2025	8:11 PM	51
10/30/2025	8:26 PM	52
10/30/2025	8:41 PM	52
10/30/2025	8:56 PM	51
10/30/2025	9:11 PM	52
10/30/2025	9:26 PM	51
10/30/2025	9:41 PM	52
10/30/2025	9:56 PM	51
10/30/2025	10:11 PM	52
10/30/2025	10:26 PM	52
10/30/2025	10:41 PM	52
10/30/2025	10:56 PM	52
10/30/2025	11:11 PM	52
10/30/2025	11:26 PM	51
10/30/2025	11:41 PM	52
10/30/2025	11:56 PM	51
10/31/2025	12:11 AM	52
10/31/2025	12:26 AM	51
10/31/2025	12:41 AM	51
10/31/2025	12:56 AM	51
10/31/2025	1:11 AM	50
10/31/2025	1:26 AM	49
10/31/2025	1:41 AM	51
10/31/2025	1:56 AM	52
10/31/2025	2:11 AM	51
10/31/2025	2:26 AM	50



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/31/2025	2:41 AM	50
10/31/2025	2:56 AM	47
10/31/2025	3:11 AM	50
10/31/2025	3:26 AM	50
10/31/2025	3:41 AM	49
10/31/2025	3:56 AM	50
10/31/2025	4:11 AM	47
10/31/2025	4:26 AM	46
10/31/2025	4:41 AM	45
10/31/2025	4:56 AM	46
10/31/2025	5:11 AM	44
10/31/2025	5:26 AM	45
10/31/2025	5:41 AM	47
10/31/2025	5:56 AM	45
10/31/2025	6:11 AM	45
10/31/2025	6:26 AM	48
10/31/2025	6:41 AM	46
10/31/2025	6:56 AM	51
10/31/2025	7:11 AM	48
10/31/2025	7:26 AM	52
10/31/2025	7:41 AM	50
10/31/2025	7:56 AM	51
10/31/2025	8:11 AM	49
10/31/2025	8:26 AM	48
10/31/2025	8:41 AM	51
10/31/2025	8:56 AM	52
10/31/2025	9:11 AM	49
10/31/2025	9:26 AM	51
10/31/2025	9:41 AM	51
10/31/2025	9:56 AM	52
10/31/2025	10:11 AM	51
10/31/2025	10:26 AM	52
10/31/2025	10:41 AM	52
10/31/2025	10:56 AM	52
10/31/2025	11:11 AM	52
10/31/2025	11:26 AM	51
10/31/2025	11:41 AM	52
10/31/2025	11:56 AM	52
10/31/2025	12:11 PM	52
10/31/2025	12:26 PM	51
10/31/2025	12:41 PM	52
10/31/2025	12:56 PM	52
10/31/2025	1:11 PM	51
10/31/2025	1:26 PM	52



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
10/31/2025	1:41 PM	52
10/31/2025	1:56 PM	52
10/31/2025	2:11 PM	51
10/31/2025	2:26 PM	51
10/31/2025	2:41 PM	52
10/31/2025	2:56 PM	51
10/31/2025	3:11 PM	52
10/31/2025	3:26 PM	51
10/31/2025	3:41 PM	52
10/31/2025	3:56 PM	51
10/31/2025	4:11 PM	52
10/31/2025	4:26 PM	51
10/31/2025	4:41 PM	51
10/31/2025	4:56 PM	52
10/31/2025	5:11 PM	51
10/31/2025	5:26 PM	51
10/31/2025	5:41 PM	51
10/31/2025	5:56 PM	51
10/31/2025	6:11 PM	52
10/31/2025	6:26 PM	51
10/31/2025	6:41 PM	52
10/31/2025	6:56 PM	52
10/31/2025	7:11 PM	52
10/31/2025	7:26 PM	51
10/31/2025	7:41 PM	51
10/31/2025	7:56 PM	52
10/31/2025	8:11 PM	52
10/31/2025	8:26 PM	51
10/31/2025	8:41 PM	52
10/31/2025	8:56 PM	51
10/31/2025	9:11 PM	51
10/31/2025	9:26 PM	51
10/31/2025	9:41 PM	51
10/31/2025	9:56 PM	51
10/31/2025	10:11 PM	52
10/31/2025	10:26 PM	51
10/31/2025	10:41 PM	51
10/31/2025	10:56 PM	51
10/31/2025	11:11 PM	51
10/31/2025	11:26 PM	51
10/31/2025	11:41 PM	51
10/31/2025	11:56 PM	51
11/1/2025	12:11 AM	51
11/1/2025	12:26 AM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	12:41 AM	49
11/1/2025	12:56 AM	49
11/1/2025	1:11 AM	49
11/1/2025	1:26 AM	50
11/1/2025	1:41 AM	49
11/1/2025	1:56 AM	50
11/1/2025	2:11 AM	51
11/1/2025	2:26 AM	51
11/1/2025	2:41 AM	51
11/1/2025	2:56 AM	51
11/1/2025	3:11 AM	48
11/1/2025	3:26 AM	51
11/1/2025	3:41 AM	50
11/1/2025	3:56 AM	50
11/1/2025	4:11 AM	45
11/1/2025	4:26 AM	46
11/1/2025	4:41 AM	47
11/1/2025	4:56 AM	47
11/1/2025	5:11 AM	49
11/1/2025	5:26 AM	44
11/1/2025	5:41 AM	44
11/1/2025	5:56 AM	46
11/1/2025	6:11 AM	46
11/1/2025	6:26 AM	49
11/1/2025	6:41 AM	50
11/1/2025	6:56 AM	50
11/1/2025	7:11 AM	48
11/1/2025	7:26 AM	52
11/1/2025	7:41 AM	52
11/1/2025	7:56 AM	49
11/1/2025	8:11 AM	49
11/1/2025	8:26 AM	49
11/1/2025	8:41 AM	50
11/1/2025	8:56 AM	49
11/1/2025	9:11 AM	49
11/1/2025	9:26 AM	51
11/1/2025	9:41 AM	51
11/1/2025	9:56 AM	51
11/1/2025	10:11 AM	51
11/1/2025	10:26 AM	51
11/1/2025	10:41 AM	52
11/1/2025	10:56 AM	52
11/1/2025	11:11 AM	51
11/1/2025	11:26 AM	52



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	11:41 AM	51
11/1/2025	11:56 AM	52
11/1/2025	12:11 PM	52
11/1/2025	12:26 PM	52
11/1/2025	12:41 PM	52
11/1/2025	12:56 PM	52
11/1/2025	1:11 PM	51
11/1/2025	1:26 PM	52
11/1/2025	1:41 PM	52
11/1/2025	1:56 PM	52
11/1/2025	2:11 PM	52
11/1/2025	2:26 PM	52
11/1/2025	2:41 PM	51
11/1/2025	2:56 PM	51
11/1/2025	3:11 PM	51
11/1/2025	3:26 PM	51
11/1/2025	3:41 PM	52
11/1/2025	3:56 PM	51
11/1/2025	4:11 PM	51
11/1/2025	4:26 PM	51
11/1/2025	4:41 PM	51
11/1/2025	4:56 PM	51
11/1/2025	5:11 PM	51
11/1/2025	5:26 PM	52
11/1/2025	5:41 PM	51
11/1/2025	5:56 PM	51
11/1/2025	6:11 PM	51
11/1/2025	6:26 PM	52
11/1/2025	6:41 PM	51
11/1/2025	6:56 PM	52
11/1/2025	7:11 PM	52
11/1/2025	7:26 PM	52
11/1/2025	7:41 PM	52
11/1/2025	7:56 PM	52
11/1/2025	8:11 PM	51
11/1/2025	8:26 PM	52
11/1/2025	8:41 PM	51
11/1/2025	8:56 PM	51
11/1/2025	9:11 PM	52
11/1/2025	9:26 PM	52
11/1/2025	9:41 PM	52
11/1/2025	9:56 PM	52
11/1/2025	10:11 PM	52
11/1/2025	10:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/1/2025	10:41 PM	52
11/1/2025	10:56 PM	51
11/1/2025	11:11 PM	52
11/1/2025	11:26 PM	51
11/1/2025	11:41 PM	52
11/1/2025	11:56 PM	51
11/2/2025	12:11 AM	51
11/2/2025	12:26 AM	51
11/2/2025	12:41 AM	52
11/2/2025	12:56 AM	51
11/2/2025	1:11 AM	51
11/2/2025	1:26 AM	49
11/2/2025	1:41 AM	50
11/2/2025	1:56 AM	52
11/2/2025	2:11 AM	48
11/2/2025	2:26 AM	50
11/2/2025	2:41 AM	50
11/2/2025	2:56 AM	52
11/2/2025	3:11 AM	49
11/2/2025	3:26 AM	48
11/2/2025	3:41 AM	47
11/2/2025	3:56 AM	49
11/2/2025	4:11 AM	49
11/2/2025	4:26 AM	50
11/2/2025	4:41 AM	49
11/2/2025	4:56 AM	48
11/2/2025	5:11 AM	47
11/2/2025	5:26 AM	46
11/2/2025	5:41 AM	47
11/2/2025	5:56 AM	46
11/2/2025	6:11 AM	49
11/2/2025	6:26 AM	48
11/2/2025	6:41 AM	49
11/2/2025	6:56 AM	51
11/2/2025	7:11 AM	51
11/2/2025	7:26 AM	48
11/2/2025	7:41 AM	48
11/2/2025	7:56 AM	48
11/2/2025	8:11 AM	49
11/2/2025	8:26 AM	49
11/2/2025	8:41 AM	51
11/2/2025	8:56 AM	51
11/2/2025	9:11 AM	51
11/2/2025	9:26 AM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/2/2025	9:41 AM	51
11/2/2025	9:56 AM	51
11/2/2025	10:11 AM	51
11/2/2025	10:26 AM	51
11/2/2025	10:41 AM	51
11/2/2025	10:56 AM	51
11/2/2025	11:11 AM	52
11/2/2025	11:26 AM	51
11/2/2025	11:41 AM	52
11/2/2025	11:56 AM	51
11/2/2025	12:11 PM	51
11/2/2025	12:26 PM	51
11/2/2025	12:41 PM	52
11/2/2025	12:56 PM	52
11/2/2025	1:11 PM	51
11/2/2025	1:26 PM	51
11/2/2025	1:41 PM	51
11/2/2025	1:56 PM	52
11/2/2025	2:11 PM	52
11/2/2025	2:26 PM	52
11/2/2025	2:41 PM	52
11/2/2025	2:56 PM	52
11/2/2025	3:11 PM	51
11/2/2025	3:26 PM	51
11/2/2025	3:41 PM	52
11/2/2025	3:56 PM	52
11/2/2025	4:11 PM	51
11/2/2025	4:26 PM	51
11/2/2025	4:41 PM	52
11/2/2025	4:56 PM	51
11/2/2025	5:11 PM	51
11/2/2025	5:26 PM	51
11/2/2025	5:41 PM	52
11/2/2025	5:56 PM	50
11/2/2025	6:11 PM	51
11/2/2025	6:26 PM	52
11/2/2025	6:41 PM	51
11/2/2025	6:56 PM	51
11/2/2025	7:11 PM	51
11/2/2025	7:26 PM	51
11/2/2025	7:41 PM	51
11/2/2025	7:56 PM	52
11/2/2025	8:11 PM	51
11/2/2025	8:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/2/2025	8:41 PM	51
11/2/2025	8:56 PM	51
11/2/2025	9:11 PM	51
11/2/2025	9:26 PM	51
11/2/2025	9:41 PM	52
11/2/2025	9:56 PM	52
11/2/2025	10:11 PM	52
11/2/2025	10:26 PM	51
11/2/2025	10:41 PM	51
11/2/2025	10:56 PM	51
11/2/2025	11:11 PM	51
11/2/2025	11:26 PM	52
11/2/2025	11:41 PM	51
11/2/2025	11:56 PM	51
11/3/2025	12:11 AM	49
11/3/2025	12:26 AM	49
11/3/2025	12:41 AM	50
11/3/2025	12:56 AM	48
11/3/2025	1:11 AM	49
11/3/2025	1:26 AM	53
11/3/2025	1:41 AM	50
11/3/2025	1:56 AM	50
11/3/2025	2:11 AM	50
11/3/2025	2:26 AM	50
11/3/2025	2:41 AM	48
11/3/2025	2:56 AM	48
11/3/2025	3:11 AM	50
11/3/2025	3:26 AM	50
11/3/2025	3:41 AM	49
11/3/2025	3:56 AM	46
11/3/2025	4:11 AM	48
11/3/2025	4:26 AM	45
11/3/2025	4:41 AM	49
11/3/2025	4:56 AM	46
11/3/2025	5:11 AM	44
11/3/2025	5:26 AM	42
11/3/2025	5:41 AM	42
11/3/2025	5:56 AM	42
11/3/2025	6:11 AM	44
11/3/2025	6:26 AM	47
11/3/2025	6:41 AM	44
11/3/2025	6:56 AM	47
11/3/2025	7:11 AM	46
11/3/2025	7:26 AM	47



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/3/2025	7:41 AM	51
11/3/2025	7:56 AM	52
11/3/2025	8:11 AM	48
11/3/2025	8:26 AM	51
11/3/2025	8:41 AM	53
11/3/2025	8:56 AM	48
11/3/2025	9:11 AM	52
11/3/2025	9:26 AM	50
11/3/2025	9:41 AM	52
11/3/2025	9:56 AM	51
11/3/2025	10:11 AM	52
11/3/2025	10:26 AM	51
11/3/2025	10:41 AM	51
11/3/2025	10:56 AM	51
11/3/2025	11:11 AM	51
11/3/2025	11:26 AM	51
11/3/2025	11:41 AM	52
11/3/2025	11:56 AM	51
11/3/2025	12:11 PM	51
11/3/2025	12:26 PM	52
11/3/2025	12:41 PM	52
11/3/2025	12:56 PM	51
11/3/2025	1:11 PM	51
11/3/2025	1:26 PM	51
11/3/2025	1:41 PM	52
11/3/2025	1:56 PM	51
11/3/2025	2:11 PM	52
11/3/2025	2:26 PM	51
11/3/2025	2:41 PM	51
11/3/2025	2:56 PM	52
11/3/2025	3:11 PM	51
11/3/2025	3:26 PM	52
11/3/2025	3:41 PM	51
11/3/2025	3:56 PM	50
11/3/2025	4:11 PM	50
11/3/2025	4:26 PM	51
11/3/2025	4:41 PM	52
11/3/2025	4:56 PM	52
11/3/2025	5:11 PM	51
11/3/2025	5:26 PM	51
11/3/2025	5:41 PM	52
11/3/2025	5:56 PM	51
11/3/2025	6:11 PM	51
11/3/2025	6:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/3/2025	6:41 PM	51
11/3/2025	6:56 PM	50
11/3/2025	7:11 PM	51
11/3/2025	7:26 PM	51
11/3/2025	7:41 PM	50
11/3/2025	7:56 PM	50
11/3/2025	8:11 PM	52
11/3/2025	8:26 PM	51
11/3/2025	8:41 PM	51
11/3/2025	8:56 PM	51
11/3/2025	9:11 PM	52
11/3/2025	9:26 PM	51
11/3/2025	9:41 PM	51
11/3/2025	9:56 PM	51
11/3/2025	10:11 PM	52
11/3/2025	10:26 PM	52
11/3/2025	10:41 PM	52
11/3/2025	10:56 PM	51
11/3/2025	11:11 PM	51
11/3/2025	11:26 PM	51
11/3/2025	11:41 PM	51
11/3/2025	11:56 PM	51
11/4/2025	12:11 AM	50
11/4/2025	12:26 AM	50
11/4/2025	12:41 AM	50
11/4/2025	12:56 AM	51
11/4/2025	1:11 AM	49
11/4/2025	1:26 AM	51
11/4/2025	1:41 AM	49
11/4/2025	1:56 AM	50
11/4/2025	2:11 AM	52
11/4/2025	2:26 AM	50
11/4/2025	2:41 AM	49
11/4/2025	2:56 AM	50
11/4/2025	3:11 AM	48
11/4/2025	3:26 AM	50
11/4/2025	3:41 AM	51
11/4/2025	3:56 AM	50
11/4/2025	4:11 AM	48
11/4/2025	4:26 AM	47
11/4/2025	4:41 AM	48
11/4/2025	4:56 AM	47
11/4/2025	5:11 AM	47
11/4/2025	5:26 AM	48



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/4/2025	5:41 AM	48
11/4/2025	5:56 AM	45
11/4/2025	6:11 AM	46
11/4/2025	6:26 AM	49
11/4/2025	6:41 AM	51
11/4/2025	6:56 AM	51
11/4/2025	7:11 AM	52
11/4/2025	7:26 AM	52
11/4/2025	7:41 AM	52
11/4/2025	7:56 AM	50
11/4/2025	8:11 AM	50
11/4/2025	8:26 AM	50
11/4/2025	8:41 AM	51
11/4/2025	8:56 AM	51
11/4/2025	9:11 AM	49
11/4/2025	9:26 AM	50
11/4/2025	9:41 AM	51
11/4/2025	9:56 AM	52
11/4/2025	10:11 AM	51
11/4/2025	10:26 AM	51
11/4/2025	10:41 AM	51
11/4/2025	10:56 AM	51
11/4/2025	11:11 AM	52
11/4/2025	11:26 AM	51
11/4/2025	11:41 AM	52
11/4/2025	11:56 AM	51
11/4/2025	12:11 PM	52
11/4/2025	12:26 PM	51
11/4/2025	12:41 PM	51
11/4/2025	12:56 PM	51
11/4/2025	1:11 PM	51
11/4/2025	1:26 PM	51
11/4/2025	1:41 PM	51
11/4/2025	1:56 PM	52
11/4/2025	2:11 PM	52
11/4/2025	2:26 PM	52
11/4/2025	2:41 PM	51
11/4/2025	2:56 PM	51
11/4/2025	3:11 PM	51
11/4/2025	3:26 PM	51
11/4/2025	3:41 PM	51
11/4/2025	3:56 PM	52
11/4/2025	4:11 PM	51
11/4/2025	4:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/4/2025	4:41 PM	51
11/4/2025	4:56 PM	52
11/4/2025	5:11 PM	52
11/4/2025	5:26 PM	52
11/4/2025	5:41 PM	51
11/4/2025	5:56 PM	51
11/4/2025	6:11 PM	51
11/4/2025	6:26 PM	51
11/4/2025	6:41 PM	51
11/4/2025	6:56 PM	51
11/4/2025	7:11 PM	51
11/4/2025	7:26 PM	51
11/4/2025	7:41 PM	51
11/4/2025	7:56 PM	52
11/4/2025	8:11 PM	51
11/4/2025	8:26 PM	51
11/4/2025	8:41 PM	51
11/4/2025	8:56 PM	51
11/4/2025	9:11 PM	51
11/4/2025	9:26 PM	51
11/4/2025	9:41 PM	51
11/4/2025	9:56 PM	51
11/4/2025	10:11 PM	51
11/4/2025	10:26 PM	51
11/4/2025	10:41 PM	51
11/4/2025	10:56 PM	51
11/4/2025	11:11 PM	51
11/4/2025	11:26 PM	51
11/4/2025	11:41 PM	51
11/4/2025	11:56 PM	50
11/5/2025	12:11 AM	51
11/5/2025	12:26 AM	50
11/5/2025	12:41 AM	51
11/5/2025	12:56 AM	50
11/5/2025	1:11 AM	50
11/5/2025	1:26 AM	49
11/5/2025	1:41 AM	51
11/5/2025	1:56 AM	53
11/5/2025	2:11 AM	49
11/5/2025	2:26 AM	52
11/5/2025	2:41 AM	51
11/5/2025	2:56 AM	51
11/5/2025	3:11 AM	50
11/5/2025	3:26 AM	50



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/5/2025	3:41 AM	50
11/5/2025	3:56 AM	48
11/5/2025	4:11 AM	44
11/5/2025	4:26 AM	49
11/5/2025	4:41 AM	45
11/5/2025	4:56 AM	43
11/5/2025	5:11 AM	43
11/5/2025	5:26 AM	46
11/5/2025	5:41 AM	45
11/5/2025	5:56 AM	47
11/5/2025	6:11 AM	44
11/5/2025	6:26 AM	47
11/5/2025	6:41 AM	45
11/5/2025	6:56 AM	49
11/5/2025	7:11 AM	49
11/5/2025	7:26 AM	49
11/5/2025	7:41 AM	51
11/5/2025	7:56 AM	52
11/5/2025	8:11 AM	52
11/5/2025	8:26 AM	50
11/5/2025	8:41 AM	51
11/5/2025	8:56 AM	48
11/5/2025	9:11 AM	49
11/5/2025	9:26 AM	50
11/5/2025	9:41 AM	49
11/5/2025	9:56 AM	52
11/5/2025	10:11 AM	49
11/5/2025	10:26 AM	51
11/5/2025	10:41 AM	50
11/5/2025	10:56 AM	51
11/5/2025	11:11 AM	52
11/5/2025	11:26 AM	51
11/5/2025	11:41 AM	51
11/5/2025	11:56 AM	52
11/5/2025	12:11 PM	51
11/5/2025	12:26 PM	51
11/5/2025	12:41 PM	51
11/5/2025	12:56 PM	51
11/5/2025	1:11 PM	51
11/5/2025	1:26 PM	51
11/5/2025	1:41 PM	51
11/5/2025	1:56 PM	51
11/5/2025	2:11 PM	51
11/5/2025	2:26 PM	52



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/5/2025	2:41 PM	52
11/5/2025	2:56 PM	52
11/5/2025	3:11 PM	52
11/5/2025	3:26 PM	52
11/5/2025	3:41 PM	51
11/5/2025	3:56 PM	52
11/5/2025	4:11 PM	52
11/5/2025	4:26 PM	52
11/5/2025	4:41 PM	51
11/5/2025	4:56 PM	52
11/5/2025	5:11 PM	51
11/5/2025	5:26 PM	51
11/5/2025	5:41 PM	51
11/5/2025	5:56 PM	52
11/5/2025	6:11 PM	51
11/5/2025	6:26 PM	51
11/5/2025	6:41 PM	49
11/5/2025	6:56 PM	52
11/5/2025	7:11 PM	51
11/5/2025	7:26 PM	51
11/5/2025	7:41 PM	52
11/5/2025	7:56 PM	51
11/5/2025	8:11 PM	51
11/5/2025	8:26 PM	51
11/5/2025	8:41 PM	50
11/5/2025	8:56 PM	51
11/5/2025	9:11 PM	49
11/5/2025	9:26 PM	51
11/5/2025	9:41 PM	51
11/5/2025	9:56 PM	50
11/5/2025	10:11 PM	51
11/5/2025	10:26 PM	51
11/5/2025	10:41 PM	52
11/5/2025	10:56 PM	51
11/5/2025	11:11 PM	50
11/5/2025	11:26 PM	50
11/5/2025	11:41 PM	50
11/5/2025	11:56 PM	50
11/6/2025	12:11 AM	51
11/6/2025	12:26 AM	49
11/6/2025	12:41 AM	50
11/6/2025	12:56 AM	51
11/6/2025	1:11 AM	49
11/6/2025	1:26 AM	48



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/6/2025	1:41 AM	51
11/6/2025	1:56 AM	48
11/6/2025	2:11 AM	51
11/6/2025	2:26 AM	49
11/6/2025	2:41 AM	52
11/6/2025	2:56 AM	47
11/6/2025	3:11 AM	48
11/6/2025	3:26 AM	51
11/6/2025	3:41 AM	49
11/6/2025	3:56 AM	49
11/6/2025	4:11 AM	50
11/6/2025	4:26 AM	50
11/6/2025	4:41 AM	50
11/6/2025	4:56 AM	49
11/6/2025	5:11 AM	46
11/6/2025	5:26 AM	44
11/6/2025	5:41 AM	44
11/6/2025	5:56 AM	44
11/6/2025	6:11 AM	44
11/6/2025	6:26 AM	47
11/6/2025	6:41 AM	50
11/6/2025	6:56 AM	48
11/6/2025	7:11 AM	51
11/6/2025	7:26 AM	50
11/6/2025	7:41 AM	50
11/6/2025	7:56 AM	50
11/6/2025	8:11 AM	52
11/6/2025	8:26 AM	49
11/6/2025	8:41 AM	49
11/6/2025	8:56 AM	48
11/6/2025	9:11 AM	49
11/6/2025	9:26 AM	50
11/6/2025	9:41 AM	51
11/6/2025	9:56 AM	50
11/6/2025	10:11 AM	51
11/6/2025	10:26 AM	51
11/6/2025	10:41 AM	52
11/6/2025	10:56 AM	52
11/6/2025	11:11 AM	52
11/6/2025	11:26 AM	52
11/6/2025	11:41 AM	52
11/6/2025	11:56 AM	52
11/6/2025	12:11 PM	52
11/6/2025	12:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/6/2025	12:41 PM	51
11/6/2025	12:56 PM	51
11/6/2025	1:11 PM	52
11/6/2025	1:26 PM	52
11/6/2025	1:41 PM	52
11/6/2025	1:56 PM	51
11/6/2025	2:11 PM	52
11/6/2025	2:26 PM	52
11/6/2025	2:41 PM	52
11/6/2025	2:56 PM	52
11/6/2025	3:11 PM	51
11/6/2025	3:26 PM	52
11/6/2025	3:41 PM	52
11/6/2025	3:56 PM	51
11/6/2025	4:11 PM	52
11/6/2025	4:26 PM	52
11/6/2025	4:41 PM	51
11/6/2025	4:56 PM	52
11/6/2025	5:11 PM	52
11/6/2025	5:26 PM	51
11/6/2025	5:41 PM	51
11/6/2025	5:56 PM	51
11/6/2025	6:11 PM	51
11/6/2025	6:26 PM	51
11/6/2025	6:41 PM	50
11/6/2025	6:56 PM	51
11/6/2025	7:11 PM	51
11/6/2025	7:26 PM	52
11/6/2025	7:41 PM	51
11/6/2025	7:56 PM	51
11/6/2025	8:11 PM	51
11/6/2025	8:26 PM	51
11/6/2025	8:41 PM	51
11/6/2025	8:56 PM	51
11/6/2025	9:11 PM	52
11/6/2025	9:26 PM	52
11/6/2025	9:41 PM	52
11/6/2025	9:56 PM	52
11/6/2025	10:11 PM	51
11/6/2025	10:26 PM	51
11/6/2025	10:41 PM	51
11/6/2025	10:56 PM	51
11/6/2025	11:11 PM	52
11/6/2025	11:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/6/2025	11:41 PM	49
11/6/2025	11:56 PM	49
11/7/2025	12:11 AM	51
11/7/2025	12:26 AM	47
11/7/2025	12:41 AM	50
11/7/2025	12:56 AM	51
11/7/2025	1:11 AM	49
11/7/2025	1:26 AM	49
11/7/2025	1:41 AM	49
11/7/2025	1:56 AM	52
11/7/2025	2:11 AM	48
11/7/2025	2:26 AM	50
11/7/2025	2:41 AM	50
11/7/2025	2:56 AM	49
11/7/2025	3:11 AM	49
11/7/2025	3:26 AM	49
11/7/2025	3:41 AM	50
11/7/2025	3:56 AM	47
11/7/2025	4:11 AM	48
11/7/2025	4:26 AM	48
11/7/2025	4:41 AM	47
11/7/2025	4:56 AM	44
11/7/2025	5:11 AM	44
11/7/2025	5:26 AM	45
11/7/2025	5:41 AM	44
11/7/2025	5:56 AM	45
11/7/2025	6:11 AM	45
11/7/2025	6:26 AM	46
11/7/2025	6:41 AM	45
11/7/2025	6:56 AM	47
11/7/2025	7:11 AM	47
11/7/2025	7:26 AM	47
11/7/2025	7:41 AM	50
11/7/2025	7:56 AM	48
11/7/2025	8:11 AM	51
11/7/2025	8:26 AM	52
11/7/2025	8:41 AM	51
11/7/2025	8:56 AM	50
11/7/2025	9:11 AM	48
11/7/2025	9:26 AM	52
11/7/2025	9:41 AM	53
11/7/2025	9:56 AM	50
11/7/2025	10:11 AM	49
11/7/2025	10:26 AM	49



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/7/2025	10:41 AM	50
11/7/2025	10:56 AM	53
11/7/2025	11:11 AM	50
11/7/2025	11:26 AM	48
11/7/2025	11:41 AM	48
11/7/2025	11:56 AM	50
11/7/2025	12:11 PM	50
11/7/2025	12:26 PM	51
11/7/2025	12:41 PM	52
11/7/2025	12:56 PM	51
11/7/2025	1:11 PM	51
11/7/2025	1:26 PM	51
11/7/2025	1:41 PM	52
11/7/2025	1:56 PM	51
11/7/2025	2:11 PM	51
11/7/2025	2:26 PM	51
11/7/2025	2:41 PM	51
11/7/2025	2:56 PM	51
11/7/2025	3:11 PM	50
11/7/2025	3:26 PM	51
11/7/2025	3:41 PM	52
11/7/2025	3:56 PM	51
11/7/2025	4:11 PM	51
11/7/2025	4:26 PM	51
11/7/2025	4:41 PM	51
11/7/2025	4:56 PM	51
11/7/2025	5:11 PM	51
11/7/2025	5:26 PM	51
11/7/2025	5:41 PM	51
11/7/2025	5:56 PM	51
11/7/2025	6:11 PM	49
11/7/2025	6:26 PM	49
11/7/2025	6:41 PM	50
11/7/2025	6:56 PM	50
11/7/2025	7:11 PM	51
11/7/2025	7:26 PM	51
11/7/2025	7:41 PM	51
11/7/2025	7:56 PM	51
11/7/2025	8:11 PM	52
11/7/2025	8:26 PM	51
11/7/2025	8:41 PM	51
11/7/2025	8:56 PM	51
11/7/2025	9:11 PM	51
11/7/2025	9:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/7/2025	9:41 PM	51
11/7/2025	9:56 PM	51
11/7/2025	10:11 PM	51
11/7/2025	10:26 PM	51
11/7/2025	10:41 PM	51
11/7/2025	10:56 PM	51
11/7/2025	11:11 PM	50
11/7/2025	11:26 PM	50
11/7/2025	11:41 PM	49
11/7/2025	11:56 PM	50
11/8/2025	12:11 AM	49
11/8/2025	12:26 AM	52
11/8/2025	12:41 AM	49
11/8/2025	12:56 AM	49
11/8/2025	1:11 AM	51
11/8/2025	1:26 AM	51
11/8/2025	1:41 AM	49
11/8/2025	1:56 AM	51
11/8/2025	2:11 AM	52
11/8/2025	2:26 AM	52
11/8/2025	2:41 AM	51
11/8/2025	2:56 AM	50
11/8/2025	3:11 AM	50
11/8/2025	3:26 AM	50
11/8/2025	3:41 AM	50
11/8/2025	3:56 AM	49
11/8/2025	4:11 AM	44
11/8/2025	4:26 AM	44
11/8/2025	4:41 AM	47
11/8/2025	4:56 AM	44
11/8/2025	5:11 AM	44
11/8/2025	5:26 AM	44
11/8/2025	5:41 AM	46
11/8/2025	5:56 AM	44
11/8/2025	6:11 AM	44
11/8/2025	6:26 AM	45
11/8/2025	6:41 AM	48
11/8/2025	6:56 AM	50
11/8/2025	7:11 AM	47
11/8/2025	7:26 AM	49
11/8/2025	7:41 AM	50
11/8/2025	7:56 AM	50
11/8/2025	8:11 AM	51
11/8/2025	8:26 AM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/8/2025	8:41 AM	49
11/8/2025	8:56 AM	52
11/8/2025	9:11 AM	49
11/8/2025	9:26 AM	49
11/8/2025	9:41 AM	51
11/8/2025	9:56 AM	51
11/8/2025	10:11 AM	51
11/8/2025	10:26 AM	52
11/8/2025	10:41 AM	51
11/8/2025	10:56 AM	51
11/8/2025	11:11 AM	52
11/8/2025	11:26 AM	51
11/8/2025	11:41 AM	51
11/8/2025	11:56 AM	51
11/8/2025	12:11 PM	51
11/8/2025	12:26 PM	51
11/8/2025	12:41 PM	51
11/8/2025	12:56 PM	51
11/8/2025	1:11 PM	51
11/8/2025	1:26 PM	51
11/8/2025	1:41 PM	51
11/8/2025	1:56 PM	52
11/8/2025	2:11 PM	51
11/8/2025	2:26 PM	51
11/8/2025	2:41 PM	51
11/8/2025	2:56 PM	51
11/8/2025	3:11 PM	51
11/8/2025	3:26 PM	51
11/8/2025	3:41 PM	51
11/8/2025	3:56 PM	51
11/8/2025	4:11 PM	51
11/8/2025	4:26 PM	51
11/8/2025	4:41 PM	51
11/8/2025	4:56 PM	52
11/8/2025	5:11 PM	51
11/8/2025	5:26 PM	51
11/8/2025	5:41 PM	50
11/8/2025	5:56 PM	51
11/8/2025	6:11 PM	51
11/8/2025	6:26 PM	51
11/8/2025	6:41 PM	51
11/8/2025	6:56 PM	51
11/8/2025	7:11 PM	51
11/8/2025	7:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/8/2025	7:41 PM	51
11/8/2025	7:56 PM	51
11/8/2025	8:11 PM	51
11/8/2025	8:26 PM	51
11/8/2025	8:41 PM	51
11/8/2025	8:56 PM	51
11/8/2025	9:11 PM	51
11/8/2025	9:26 PM	51
11/8/2025	9:41 PM	51
11/8/2025	9:56 PM	51
11/8/2025	10:11 PM	51
11/8/2025	10:26 PM	51
11/8/2025	10:41 PM	51
11/8/2025	10:56 PM	51
11/8/2025	11:11 PM	51
11/8/2025	11:26 PM	52
11/8/2025	11:41 PM	51
11/8/2025	11:56 PM	51
11/9/2025	12:11 AM	51
11/9/2025	12:26 AM	50
11/9/2025	12:41 AM	50
11/9/2025	12:56 AM	50
11/9/2025	1:11 AM	50
11/9/2025	1:26 AM	48
11/9/2025	1:41 AM	51
11/9/2025	1:56 AM	51
11/9/2025	2:11 AM	51
11/9/2025	2:26 AM	48
11/9/2025	2:41 AM	51
11/9/2025	2:56 AM	47
11/9/2025	3:11 AM	50
11/9/2025	3:26 AM	49
11/9/2025	3:41 AM	50
11/9/2025	3:56 AM	49
11/9/2025	4:11 AM	48
11/9/2025	4:26 AM	48
11/9/2025	4:41 AM	47
11/9/2025	4:56 AM	46
11/9/2025	5:11 AM	46
11/9/2025	5:26 AM	44
11/9/2025	5:41 AM	45
11/9/2025	5:56 AM	45
11/9/2025	6:11 AM	46
11/9/2025	6:26 AM	49



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/9/2025	6:41 AM	47
11/9/2025	6:56 AM	47
11/9/2025	7:11 AM	51
11/9/2025	7:26 AM	51
11/9/2025	7:41 AM	52
11/9/2025	7:56 AM	52
11/9/2025	8:11 AM	50
11/9/2025	8:26 AM	50
11/9/2025	8:41 AM	49
11/9/2025	8:56 AM	51
11/9/2025	9:11 AM	49
11/9/2025	9:26 AM	50
11/9/2025	9:41 AM	51
11/9/2025	9:56 AM	51
11/9/2025	10:11 AM	51
11/9/2025	10:26 AM	51
11/9/2025	10:41 AM	51
11/9/2025	10:56 AM	51
11/9/2025	11:11 AM	51
11/9/2025	11:26 AM	51
11/9/2025	11:41 AM	51
11/9/2025	11:56 AM	51
11/9/2025	12:11 PM	51
11/9/2025	12:26 PM	52
11/9/2025	12:41 PM	52
11/9/2025	12:56 PM	51
11/9/2025	1:11 PM	52
11/9/2025	1:26 PM	52
11/9/2025	1:41 PM	51
11/9/2025	1:56 PM	51
11/9/2025	2:11 PM	52
11/9/2025	2:26 PM	51
11/9/2025	2:41 PM	52
11/9/2025	2:56 PM	51
11/9/2025	3:11 PM	52
11/9/2025	3:26 PM	52
11/9/2025	3:41 PM	52
11/9/2025	3:56 PM	52
11/9/2025	4:11 PM	52
11/9/2025	4:26 PM	52
11/9/2025	4:41 PM	51
11/9/2025	4:56 PM	51
11/9/2025	5:11 PM	51
11/9/2025	5:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/9/2025	5:41 PM	51
11/9/2025	5:56 PM	51
11/9/2025	6:11 PM	51
11/9/2025	6:26 PM	51
11/9/2025	6:41 PM	51
11/9/2025	6:56 PM	52
11/9/2025	7:11 PM	52
11/9/2025	7:26 PM	51
11/9/2025	7:41 PM	51
11/9/2025	7:56 PM	51
11/9/2025	8:11 PM	51
11/9/2025	8:26 PM	52
11/9/2025	8:41 PM	51
11/9/2025	8:56 PM	49
11/9/2025	9:11 PM	50
11/9/2025	9:26 PM	49
11/9/2025	9:41 PM	49
11/9/2025	9:56 PM	51
11/9/2025	10:11 PM	51
11/9/2025	10:26 PM	51
11/9/2025	10:41 PM	51
11/9/2025	10:56 PM	51
11/9/2025	11:11 PM	51
11/9/2025	11:26 PM	51
11/9/2025	11:41 PM	52
11/9/2025	11:56 PM	51
11/10/2025	12:11 AM	51
11/10/2025	12:26 AM	49
11/10/2025	12:41 AM	49
11/10/2025	12:56 AM	53
11/10/2025	1:11 AM	50
11/10/2025	1:26 AM	53
11/10/2025	1:41 AM	50
11/10/2025	1:56 AM	49
11/10/2025	2:11 AM	52
11/10/2025	2:26 AM	48
11/10/2025	2:41 AM	51
11/10/2025	2:56 AM	50
11/10/2025	3:11 AM	49
11/10/2025	3:26 AM	48
11/10/2025	3:41 AM	49
11/10/2025	3:56 AM	43
11/10/2025	4:11 AM	45
11/10/2025	4:26 AM	48



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/10/2025	4:41 AM	45
11/10/2025	4:56 AM	45
11/10/2025	5:11 AM	43
11/10/2025	5:26 AM	42
11/10/2025	5:41 AM	42
11/10/2025	5:56 AM	43
11/10/2025	6:11 AM	44
11/10/2025	6:26 AM	46
11/10/2025	6:41 AM	49
11/10/2025	6:56 AM	45
11/10/2025	7:11 AM	48
11/10/2025	7:26 AM	48
11/10/2025	7:41 AM	50
11/10/2025	7:56 AM	49
11/10/2025	8:11 AM	48
11/10/2025	8:26 AM	49
11/10/2025	8:41 AM	50
11/10/2025	8:56 AM	51
11/10/2025	9:11 AM	49
11/10/2025	9:26 AM	52
11/10/2025	9:41 AM	50
11/10/2025	9:56 AM	51
11/10/2025	10:11 AM	51
11/10/2025	10:26 AM	51
11/10/2025	10:41 AM	51
11/10/2025	10:56 AM	51
11/10/2025	11:11 AM	51
11/10/2025	11:26 AM	52
11/10/2025	11:41 AM	51
11/10/2025	11:56 AM	52
11/10/2025	12:11 PM	51
11/10/2025	12:26 PM	52
11/10/2025	12:41 PM	51
11/10/2025	12:56 PM	51
11/10/2025	1:11 PM	51
11/10/2025	1:26 PM	51
11/10/2025	1:41 PM	51
11/10/2025	1:56 PM	52
11/10/2025	2:11 PM	52
11/10/2025	2:26 PM	52
11/10/2025	2:41 PM	51
11/10/2025	2:56 PM	52
11/10/2025	3:11 PM	52
11/10/2025	3:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/10/2025	3:41 PM	52
11/10/2025	3:56 PM	52
11/10/2025	4:11 PM	50
11/10/2025	4:26 PM	51
11/10/2025	4:41 PM	51
11/10/2025	4:56 PM	51
11/10/2025	5:11 PM	51
11/10/2025	5:26 PM	51
11/10/2025	5:41 PM	52
11/10/2025	5:56 PM	52
11/10/2025	6:11 PM	52
11/10/2025	6:26 PM	50
11/10/2025	6:41 PM	51
11/10/2025	6:56 PM	51
11/10/2025	7:11 PM	51
11/10/2025	7:26 PM	52
11/10/2025	7:41 PM	52
11/10/2025	7:56 PM	51
11/10/2025	8:11 PM	51
11/10/2025	8:26 PM	52
11/10/2025	8:41 PM	52
11/10/2025	8:56 PM	51
11/10/2025	9:11 PM	52
11/10/2025	9:26 PM	51
11/10/2025	9:41 PM	52
11/10/2025	9:56 PM	51
11/10/2025	10:11 PM	52
11/10/2025	10:26 PM	51
11/10/2025	10:41 PM	51
11/10/2025	10:56 PM	50
11/10/2025	11:11 PM	51
11/10/2025	11:26 PM	52
11/10/2025	11:41 PM	50
11/10/2025	11:56 PM	50
11/11/2025	12:11 AM	50
11/11/2025	12:26 AM	52
11/11/2025	12:41 AM	50
11/11/2025	12:56 AM	49
11/11/2025	1:11 AM	50
11/11/2025	1:26 AM	51
11/11/2025	1:41 AM	50
11/11/2025	1:56 AM	50
11/11/2025	2:11 AM	50
11/11/2025	2:26 AM	50



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/11/2025	2:41 AM	48
11/11/2025	2:56 AM	50
11/11/2025	3:11 AM	51
11/11/2025	3:26 AM	51
11/11/2025	3:41 AM	51
11/11/2025	3:56 AM	50
11/11/2025	4:11 AM	50
11/11/2025	4:26 AM	50
11/11/2025	4:41 AM	49
11/11/2025	4:56 AM	44
11/11/2025	5:11 AM	49
11/11/2025	5:26 AM	44
11/11/2025	5:41 AM	46
11/11/2025	5:56 AM	46
11/11/2025	6:11 AM	46
11/11/2025	6:26 AM	50
11/11/2025	6:41 AM	51
11/11/2025	6:56 AM	47
11/11/2025	7:11 AM	52
11/11/2025	7:26 AM	52
11/11/2025	7:41 AM	51
11/11/2025	7:56 AM	52
11/11/2025	8:11 AM	52
11/11/2025	8:26 AM	50
11/11/2025	8:41 AM	53
11/11/2025	8:56 AM	52
11/11/2025	9:11 AM	51
11/11/2025	9:26 AM	53
11/11/2025	9:41 AM	49
11/11/2025	9:56 AM	51
11/11/2025	10:11 AM	50
11/11/2025	10:26 AM	49
11/11/2025	10:41 AM	50
11/11/2025	10:56 AM	50
11/11/2025	11:11 AM	51
11/11/2025	11:26 AM	51
11/11/2025	11:41 AM	51
11/11/2025	11:56 AM	50
11/11/2025	12:11 PM	50
11/11/2025	12:26 PM	50
11/11/2025	12:41 PM	51
11/11/2025	12:56 PM	51
11/11/2025	1:11 PM	51
11/11/2025	1:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/11/2025	1:41 PM	51
11/11/2025	1:56 PM	50
11/11/2025	2:11 PM	50
11/11/2025	2:26 PM	51
11/11/2025	2:41 PM	51
11/11/2025	2:56 PM	51
11/11/2025	3:11 PM	50
11/11/2025	3:26 PM	51
11/11/2025	3:41 PM	51
11/11/2025	3:56 PM	52
11/11/2025	4:11 PM	51
11/11/2025	4:26 PM	51
11/11/2025	4:41 PM	51
11/11/2025	4:56 PM	52
11/11/2025	5:11 PM	51
11/11/2025	5:26 PM	51
11/11/2025	5:41 PM	51
11/11/2025	5:56 PM	51
11/11/2025	6:11 PM	51
11/11/2025	6:26 PM	51
11/11/2025	6:41 PM	51
11/11/2025	6:56 PM	51
11/11/2025	7:11 PM	51
11/11/2025	7:26 PM	51
11/11/2025	7:41 PM	51
11/11/2025	7:56 PM	51
11/11/2025	8:11 PM	51
11/11/2025	8:26 PM	51
11/11/2025	8:41 PM	51
11/11/2025	8:56 PM	50
11/11/2025	9:11 PM	49
11/11/2025	9:26 PM	53
11/11/2025	9:41 PM	49
11/11/2025	9:56 PM	52
11/11/2025	10:11 PM	50
11/11/2025	10:26 PM	51
11/11/2025	10:41 PM	51
11/11/2025	10:56 PM	50
11/11/2025	11:11 PM	51
11/11/2025	11:26 PM	51
11/11/2025	11:41 PM	51
11/11/2025	11:56 PM	49
11/12/2025	12:11 AM	49
11/12/2025	12:26 AM	50



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	12:41 AM	50
11/12/2025	12:56 AM	50
11/12/2025	1:11 AM	50
11/12/2025	1:26 AM	52
11/12/2025	1:41 AM	49
11/12/2025	1:56 AM	51
11/12/2025	2:11 AM	48
11/12/2025	2:26 AM	49
11/12/2025	2:41 AM	49
11/12/2025	2:56 AM	49
11/12/2025	3:11 AM	49
11/12/2025	3:26 AM	49
11/12/2025	3:41 AM	45
11/12/2025	3:56 AM	46
11/12/2025	4:11 AM	48
11/12/2025	4:26 AM	47
11/12/2025	4:41 AM	44
11/12/2025	4:56 AM	45
11/12/2025	5:11 AM	47
11/12/2025	5:26 AM	46
11/12/2025	5:41 AM	46
11/12/2025	5:56 AM	44
11/12/2025	6:11 AM	48
11/12/2025	6:26 AM	47
11/12/2025	6:41 AM	44
11/12/2025	6:56 AM	45
11/12/2025	7:11 AM	46
11/12/2025	7:26 AM	49
11/12/2025	7:41 AM	48
11/12/2025	7:56 AM	50
11/12/2025	8:11 AM	51
11/12/2025	8:26 AM	51
11/12/2025	8:41 AM	52
11/12/2025	8:56 AM	52
11/12/2025	9:11 AM	51
11/12/2025	9:26 AM	48
11/12/2025	9:41 AM	49
11/12/2025	9:56 AM	51
11/12/2025	10:11 AM	50
11/12/2025	10:26 AM	49
11/12/2025	10:41 AM	51
11/12/2025	10:56 AM	49
11/12/2025	11:11 AM	49
11/12/2025	11:26 AM	50



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	11:41 AM	51
11/12/2025	11:56 AM	50
11/12/2025	12:11 PM	51
11/12/2025	12:26 PM	50
11/12/2025	12:41 PM	51
11/12/2025	12:56 PM	51
11/12/2025	1:11 PM	52
11/12/2025	1:26 PM	51
11/12/2025	1:41 PM	52
11/12/2025	1:56 PM	52
11/12/2025	2:11 PM	51
11/12/2025	2:26 PM	51
11/12/2025	2:41 PM	52
11/12/2025	2:56 PM	51
11/12/2025	3:11 PM	52
11/12/2025	3:26 PM	51
11/12/2025	3:41 PM	51
11/12/2025	3:56 PM	51
11/12/2025	4:11 PM	52
11/12/2025	4:26 PM	50
11/12/2025	4:41 PM	51
11/12/2025	4:56 PM	51
11/12/2025	5:11 PM	51
11/12/2025	5:26 PM	50
11/12/2025	5:41 PM	52
11/12/2025	5:56 PM	51
11/12/2025	6:11 PM	51
11/12/2025	6:26 PM	51
11/12/2025	6:41 PM	52
11/12/2025	6:56 PM	51
11/12/2025	7:11 PM	52
11/12/2025	7:26 PM	51
11/12/2025	7:41 PM	51
11/12/2025	7:56 PM	52
11/12/2025	8:11 PM	51
11/12/2025	8:26 PM	51
11/12/2025	8:41 PM	52
11/12/2025	8:56 PM	51
11/12/2025	9:11 PM	50
11/12/2025	9:26 PM	49
11/12/2025	9:41 PM	51
11/12/2025	9:56 PM	50
11/12/2025	10:11 PM	51
11/12/2025	10:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/12/2025	10:41 PM	52
11/12/2025	10:56 PM	51
11/12/2025	11:11 PM	52
11/12/2025	11:26 PM	52
11/12/2025	11:41 PM	51
11/12/2025	11:56 PM	50
11/13/2025	12:11 AM	50
11/13/2025	12:26 AM	52
11/13/2025	12:41 AM	49
11/13/2025	12:56 AM	49
11/13/2025	1:11 AM	49
11/13/2025	1:26 AM	50
11/13/2025	1:41 AM	49
11/13/2025	1:56 AM	51
11/13/2025	2:11 AM	49
11/13/2025	2:26 AM	50
11/13/2025	2:41 AM	52
11/13/2025	2:56 AM	51
11/13/2025	3:11 AM	48
11/13/2025	3:26 AM	52
11/13/2025	3:41 AM	49
11/13/2025	3:56 AM	51
11/13/2025	4:11 AM	50
11/13/2025	4:26 AM	50
11/13/2025	4:41 AM	50
11/13/2025	4:56 AM	47
11/13/2025	5:11 AM	44
11/13/2025	5:26 AM	44
11/13/2025	5:41 AM	46
11/13/2025	5:56 AM	43
11/13/2025	6:11 AM	45
11/13/2025	6:26 AM	50
11/13/2025	6:41 AM	51
11/13/2025	6:56 AM	48
11/13/2025	7:11 AM	51
11/13/2025	7:26 AM	51
11/13/2025	7:41 AM	52
11/13/2025	7:56 AM	49
11/13/2025	8:11 AM	50
11/13/2025	8:26 AM	51
11/13/2025	8:41 AM	52
11/13/2025	8:56 AM	52
11/13/2025	9:11 AM	52
11/13/2025	9:26 AM	49



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/13/2025	9:41 AM	51
11/13/2025	9:56 AM	51
11/13/2025	10:11 AM	52
11/13/2025	10:26 AM	52
11/13/2025	10:41 AM	51
11/13/2025	10:56 AM	51
11/13/2025	11:11 AM	51
11/13/2025	11:26 AM	51
11/13/2025	11:41 AM	51
11/13/2025	11:56 AM	50
11/13/2025	12:11 PM	51
11/13/2025	12:26 PM	51
11/13/2025	12:41 PM	51
11/13/2025	12:56 PM	50
11/13/2025	1:11 PM	51
11/13/2025	1:26 PM	51
11/13/2025	1:41 PM	52
11/13/2025	1:56 PM	51
11/13/2025	2:11 PM	51
11/13/2025	2:26 PM	51
11/13/2025	2:41 PM	51
11/13/2025	2:56 PM	51
11/13/2025	3:11 PM	52
11/13/2025	3:26 PM	51
11/13/2025	3:41 PM	51
11/13/2025	3:56 PM	51
11/13/2025	4:11 PM	51
11/13/2025	4:26 PM	51
11/13/2025	4:41 PM	52
11/13/2025	4:56 PM	51
11/13/2025	5:11 PM	52
11/13/2025	5:26 PM	51
11/13/2025	5:41 PM	51
11/13/2025	5:56 PM	51
11/13/2025	6:11 PM	51
11/13/2025	6:26 PM	51
11/13/2025	6:41 PM	50
11/13/2025	6:56 PM	49
11/13/2025	7:11 PM	51
11/13/2025	7:26 PM	51
11/13/2025	7:41 PM	51
11/13/2025	7:56 PM	52
11/13/2025	8:11 PM	51
11/13/2025	8:26 PM	51



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/13/2025	8:41 PM	52
11/13/2025	8:56 PM	51
11/13/2025	9:11 PM	51
11/13/2025	9:26 PM	50
11/13/2025	9:41 PM	52
11/13/2025	9:56 PM	49
11/13/2025	10:11 PM	50
11/13/2025	10:26 PM	49
11/13/2025	10:41 PM	51
11/13/2025	10:56 PM	51
11/13/2025	11:11 PM	51
11/13/2025	11:26 PM	51
11/13/2025	11:41 PM	51
11/13/2025	11:56 PM	48
11/14/2025	12:11 AM	50
11/14/2025	12:26 AM	50
11/14/2025	12:41 AM	50
11/14/2025	12:56 AM	49
11/14/2025	1:11 AM	48
11/14/2025	1:26 AM	50
11/14/2025	1:41 AM	51
11/14/2025	1:56 AM	47
11/14/2025	2:11 AM	51
11/14/2025	2:26 AM	49
11/14/2025	2:41 AM	48
11/14/2025	2:56 AM	50
11/14/2025	3:11 AM	50
11/14/2025	3:26 AM	49
11/14/2025	3:41 AM	50
11/14/2025	3:56 AM	44
11/14/2025	4:11 AM	43
11/14/2025	4:26 AM	47
11/14/2025	4:41 AM	45
11/14/2025	4:56 AM	45
11/14/2025	5:11 AM	42
11/14/2025	5:26 AM	46
11/14/2025	5:41 AM	47
11/14/2025	5:56 AM	42
11/14/2025	6:11 AM	46
11/14/2025	6:26 AM	44
11/14/2025	6:41 AM	44
11/14/2025	6:56 AM	46
11/14/2025	7:11 AM	47
11/14/2025	7:26 AM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/14/2025	7:41 AM	51
11/14/2025	7:56 AM	52
11/14/2025	8:11 AM	49
11/14/2025	8:26 AM	50
11/14/2025	8:41 AM	48
11/14/2025	8:56 AM	51
11/14/2025	9:11 AM	52
11/14/2025	9:26 AM	49
11/14/2025	9:41 AM	51
11/14/2025	9:56 AM	49
11/14/2025	10:11 AM	50
11/14/2025	10:26 AM	50
11/14/2025	10:41 AM	51
11/14/2025	10:56 AM	49
11/14/2025	11:11 AM	51
11/14/2025	11:26 AM	49
11/14/2025	11:41 AM	49
11/14/2025	11:56 AM	51
11/14/2025	12:11 PM	51
11/14/2025	12:26 PM	52
11/14/2025	12:41 PM	51
11/14/2025	12:56 PM	52
11/14/2025	1:11 PM	51
11/14/2025	1:26 PM	51
11/14/2025	1:41 PM	52
11/14/2025	1:56 PM	51
11/14/2025	2:11 PM	51
11/14/2025	2:26 PM	52
11/14/2025	2:41 PM	51
11/14/2025	2:56 PM	51
11/14/2025	3:11 PM	51
11/14/2025	3:26 PM	51
11/14/2025	3:41 PM	51
11/14/2025	3:56 PM	52
11/14/2025	4:11 PM	51
11/14/2025	4:26 PM	51
11/14/2025	4:41 PM	52
11/14/2025	4:56 PM	51
11/14/2025	5:11 PM	51
11/14/2025	5:26 PM	51
11/14/2025	5:41 PM	51
11/14/2025	5:56 PM	50
11/14/2025	6:11 PM	51
11/14/2025	6:26 PM	48



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/14/2025	6:41 PM	50
11/14/2025	6:56 PM	51
11/14/2025	7:11 PM	51
11/14/2025	7:26 PM	51
11/14/2025	7:41 PM	51
11/14/2025	7:56 PM	51
11/14/2025	8:11 PM	52
11/14/2025	8:26 PM	51
11/14/2025	8:41 PM	51
11/14/2025	8:56 PM	51
11/14/2025	9:11 PM	50
11/14/2025	9:26 PM	51
11/14/2025	9:41 PM	51
11/14/2025	9:56 PM	50
11/14/2025	10:11 PM	51
11/14/2025	10:26 PM	51
11/14/2025	10:41 PM	51
11/14/2025	10:56 PM	51
11/14/2025	11:11 PM	51
11/14/2025	11:26 PM	51
11/14/2025	11:41 PM	51
11/14/2025	11:56 PM	50
11/15/2025	12:11 AM	49
11/15/2025	12:26 AM	50
11/15/2025	12:41 AM	51
11/15/2025	12:56 AM	50
11/15/2025	1:11 AM	50
11/15/2025	1:26 AM	49
11/15/2025	1:41 AM	52
11/15/2025	1:56 AM	49
11/15/2025	2:11 AM	52
11/15/2025	2:26 AM	51
11/15/2025	2:41 AM	51
11/15/2025	2:56 AM	46
11/15/2025	3:11 AM	50
11/15/2025	3:26 AM	50
11/15/2025	3:41 AM	50
11/15/2025	3:56 AM	48
11/15/2025	4:11 AM	47
11/15/2025	4:26 AM	44
11/15/2025	4:41 AM	45
11/15/2025	4:56 AM	43
11/15/2025	5:11 AM	47
11/15/2025	5:26 AM	48



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/15/2025	5:41 AM	45
11/15/2025	5:56 AM	47
11/15/2025	6:11 AM	45
11/15/2025	6:26 AM	49
11/15/2025	6:41 AM	50
11/15/2025	6:56 AM	50
11/15/2025	7:11 AM	48
11/15/2025	7:26 AM	48
11/15/2025	7:41 AM	50
11/15/2025	7:56 AM	51
11/15/2025	8:11 AM	49
11/15/2025	8:26 AM	50
11/15/2025	8:41 AM	50
11/15/2025	8:56 AM	50
11/15/2025	9:11 AM	50
11/15/2025	9:26 AM	49
11/15/2025	9:41 AM	51
11/15/2025	9:56 AM	51
11/15/2025	10:11 AM	51
11/15/2025	10:26 AM	51
11/15/2025	10:41 AM	51
11/15/2025	10:56 AM	51
11/15/2025	11:11 AM	51
11/15/2025	11:26 AM	50
11/15/2025	11:41 AM	51
11/15/2025	11:56 AM	50
11/15/2025	12:11 PM	51
11/15/2025	12:26 PM	51
11/15/2025	12:41 PM	51
11/15/2025	12:56 PM	51
11/15/2025	1:11 PM	51
11/15/2025	1:26 PM	51
11/15/2025	1:41 PM	51
11/15/2025	1:56 PM	51
11/15/2025	2:11 PM	51
11/15/2025	2:26 PM	51
11/15/2025	2:41 PM	51
11/15/2025	2:56 PM	51
11/15/2025	3:11 PM	51
11/15/2025	3:26 PM	51
11/15/2025	3:41 PM	51
11/15/2025	3:56 PM	51
11/15/2025	4:11 PM	51
11/15/2025	4:26 PM	52



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

DATE	TIME	PSI
11/15/2025	4:41 PM	51
11/15/2025	4:56 PM	51
11/15/2025	5:11 PM	51
11/15/2025	5:26 PM	51
11/15/2025	5:41 PM	51
11/15/2025	5:56 PM	51
11/15/2025	6:11 PM	51
11/15/2025	6:26 PM	51
11/15/2025	6:41 PM	51
11/15/2025	6:56 PM	51
11/15/2025	7:11 PM	51
11/15/2025	7:26 PM	51
11/15/2025	7:41 PM	52
11/15/2025	7:56 PM	51
11/15/2025	8:11 PM	51
11/15/2025	8:26 PM	51
11/15/2025	8:41 PM	52
11/15/2025	8:56 PM	51
11/15/2025	9:11 PM	51
11/15/2025	9:26 PM	51
11/15/2025	9:41 PM	51
11/15/2025	9:56 PM	51
11/15/2025	10:11 PM	51
11/15/2025	10:26 PM	51
11/15/2025	10:41 PM	51
11/15/2025	10:56 PM	49
11/15/2025	11:11 PM	49
11/15/2025	11:26 PM	49
11/15/2025	11:41 PM	51
11/15/2025	11:56 PM	50
11/16/2025	12:11 AM	49
11/16/2025	12:26 AM	53
11/16/2025	12:41 AM	50
11/16/2025	12:56 AM	51
11/16/2025	1:11 AM	48
11/16/2025	1:26 AM	50
11/16/2025	1:41 AM	52
11/16/2025	1:56 AM	48
11/16/2025	2:11 AM	52
11/16/2025	2:26 AM	50
11/16/2025	2:41 AM	49
11/16/2025	2:56 AM	49
11/16/2025	3:11 AM	47
11/16/2025	3:26 AM	50



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/16/2025	3:41 AM	50
11/16/2025	3:56 AM	49
11/16/2025	4:11 AM	49
11/16/2025	4:26 AM	49
11/16/2025	4:41 AM	49
11/16/2025	4:56 AM	45
11/16/2025	5:11 AM	44
11/16/2025	5:26 AM	46
11/16/2025	5:41 AM	46
11/16/2025	5:56 AM	46
11/16/2025	6:11 AM	49
11/16/2025	6:26 AM	49
11/16/2025	6:41 AM	50
11/16/2025	6:56 AM	48
11/16/2025	7:11 AM	52
11/16/2025	7:26 AM	51
11/16/2025	7:41 AM	50
11/16/2025	7:56 AM	52
11/16/2025	8:11 AM	52
11/16/2025	8:26 AM	48
11/16/2025	8:41 AM	52
11/16/2025	8:56 AM	50
11/16/2025	9:11 AM	53
11/16/2025	9:26 AM	49
11/16/2025	9:41 AM	51
11/16/2025	9:56 AM	51
11/16/2025	10:11 AM	51
11/16/2025	10:26 AM	51
11/16/2025	10:41 AM	51
11/16/2025	10:56 AM	51
11/16/2025	11:11 AM	51
11/16/2025	11:26 AM	51
11/16/2025	11:41 AM	51
11/16/2025	11:56 AM	51
11/16/2025	12:11 PM	51
11/16/2025	12:26 PM	52
11/16/2025	12:41 PM	51
11/16/2025	12:56 PM	51
11/16/2025	1:11 PM	51
11/16/2025	1:26 PM	52
11/16/2025	1:41 PM	51
11/16/2025	1:56 PM	52
11/16/2025	2:11 PM	51
11/16/2025	2:26 PM	52



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/16/2025	2:41 PM	51
11/16/2025	2:56 PM	51
11/16/2025	3:11 PM	51
11/16/2025	3:26 PM	50
11/16/2025	3:41 PM	51
11/16/2025	3:56 PM	51
11/16/2025	4:11 PM	51
11/16/2025	4:26 PM	51
11/16/2025	4:41 PM	51
11/16/2025	4:56 PM	51
11/16/2025	5:11 PM	51
11/16/2025	5:26 PM	51
11/16/2025	5:41 PM	51
11/16/2025	5:56 PM	51
11/16/2025	6:11 PM	51
11/16/2025	6:26 PM	50
11/16/2025	6:41 PM	51
11/16/2025	6:56 PM	51
11/16/2025	7:11 PM	51
11/16/2025	7:26 PM	51
11/16/2025	7:41 PM	51
11/16/2025	7:56 PM	51
11/16/2025	8:11 PM	51
11/16/2025	8:26 PM	51
11/16/2025	8:41 PM	51
11/16/2025	8:56 PM	50
11/16/2025	9:11 PM	49
11/16/2025	9:26 PM	50
11/16/2025	9:41 PM	51
11/16/2025	9:56 PM	51
11/16/2025	10:11 PM	51
11/16/2025	10:26 PM	51
11/16/2025	10:41 PM	52
11/16/2025	10:56 PM	51
11/16/2025	11:11 PM	51
11/16/2025	11:26 PM	51
11/16/2025	11:41 PM	51
11/16/2025	11:56 PM	50
11/17/2025	12:11 AM	51
11/17/2025	12:26 AM	49
11/17/2025	12:41 AM	49
11/17/2025	12:56 AM	51
11/17/2025	1:11 AM	50
11/17/2025	1:26 AM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

DATE	TIME	PSI
11/17/2025	1:41 AM	48
11/17/2025	1:56 AM	50
11/17/2025	2:11 AM	51
11/17/2025	2:26 AM	47
11/17/2025	2:41 AM	49
11/17/2025	2:56 AM	49
11/17/2025	3:11 AM	48
11/17/2025	3:26 AM	48
11/17/2025	3:41 AM	48
11/17/2025	3:56 AM	45
11/17/2025	4:11 AM	47
11/17/2025	4:26 AM	47
11/17/2025	4:41 AM	47
11/17/2025	4:56 AM	42
11/17/2025	5:11 AM	41
11/17/2025	5:26 AM	41
11/17/2025	5:41 AM	43
11/17/2025	5:56 AM	42
11/17/2025	6:11 AM	44
11/17/2025	6:26 AM	44
11/17/2025	6:41 AM	45
11/17/2025	6:56 AM	48
11/17/2025	7:11 AM	48
11/17/2025	7:26 AM	46
11/17/2025	7:41 AM	50
11/17/2025	7:56 AM	51
11/17/2025	8:11 AM	52
11/17/2025	8:26 AM	49
11/17/2025	8:41 AM	49
11/17/2025	8:56 AM	52
11/17/2025	9:11 AM	53
11/17/2025	9:26 AM	52
11/17/2025	9:41 AM	53
11/17/2025	9:56 AM	50
11/17/2025	10:11 AM	51
11/17/2025	10:26 AM	50
11/17/2025	10:41 AM	51
11/17/2025	10:56 AM	51
11/17/2025	11:11 AM	50
11/17/2025	11:26 AM	51
11/17/2025	11:41 AM	52
11/17/2025	11:56 AM	51
11/17/2025	12:11 PM	51
11/17/2025	12:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/17/2025	12:41 PM	51
11/17/2025	12:56 PM	51
11/17/2025	1:11 PM	52
11/17/2025	1:26 PM	50
11/17/2025	1:41 PM	52
11/17/2025	1:56 PM	51
11/17/2025	2:11 PM	52
11/17/2025	2:26 PM	50
11/17/2025	2:41 PM	51
11/17/2025	2:56 PM	51
11/17/2025	3:11 PM	52
11/17/2025	3:26 PM	51
11/17/2025	3:41 PM	51
11/17/2025	3:56 PM	52
11/17/2025	4:11 PM	52
11/17/2025	4:26 PM	51
11/17/2025	4:41 PM	51
11/17/2025	4:56 PM	52
11/17/2025	5:11 PM	51
11/17/2025	5:26 PM	52
11/17/2025	5:41 PM	51
11/17/2025	5:56 PM	51
11/17/2025	6:11 PM	51
11/17/2025	6:26 PM	51
11/17/2025	6:41 PM	51
11/17/2025	6:56 PM	52
11/17/2025	7:11 PM	50
11/17/2025	7:26 PM	51
11/17/2025	7:41 PM	51
11/17/2025	7:56 PM	51
11/17/2025	8:11 PM	51
11/17/2025	8:26 PM	51
11/17/2025	8:41 PM	51
11/17/2025	8:56 PM	51
11/17/2025	9:11 PM	51
11/17/2025	9:26 PM	51
11/17/2025	9:41 PM	52
11/17/2025	9:56 PM	51
11/17/2025	10:11 PM	51
11/17/2025	10:26 PM	50
11/17/2025	10:41 PM	51
11/17/2025	10:56 PM	51
11/17/2025	11:11 PM	51
11/17/2025	11:26 PM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/17/2025	11:41 PM	51
11/17/2025	11:56 PM	50
11/18/2025	12:11 AM	50
11/18/2025	12:26 AM	50
11/18/2025	12:41 AM	51
11/18/2025	12:56 AM	51
11/18/2025	1:11 AM	50
11/18/2025	1:26 AM	50
11/18/2025	1:41 AM	50
11/18/2025	1:56 AM	51
11/18/2025	2:11 AM	52
11/18/2025	2:26 AM	52
11/18/2025	2:41 AM	51
11/18/2025	2:56 AM	51
11/18/2025	3:11 AM	49
11/18/2025	3:26 AM	50
11/18/2025	3:41 AM	50
11/18/2025	3:56 AM	49
11/18/2025	4:11 AM	48
11/18/2025	4:26 AM	48
11/18/2025	4:41 AM	47
11/18/2025	4:56 AM	47
11/18/2025	5:11 AM	46
11/18/2025	5:26 AM	46
11/18/2025	5:41 AM	47
11/18/2025	5:56 AM	45
11/18/2025	6:11 AM	47
11/18/2025	6:26 AM	49
11/18/2025	6:41 AM	49
11/18/2025	6:56 AM	50
11/18/2025	7:11 AM	50
11/18/2025	7:26 AM	50
11/18/2025	7:41 AM	51
11/18/2025	7:56 AM	52
11/18/2025	8:11 AM	50
11/18/2025	8:26 AM	50
11/18/2025	8:41 AM	49
11/18/2025	8:56 AM	52
11/18/2025	9:11 AM	50
11/18/2025	9:26 AM	49
11/18/2025	9:41 AM	51
11/18/2025	9:56 AM	50
11/18/2025	10:11 AM	52
11/18/2025	10:26 AM	51



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/18/2025	10:41 AM	51
11/18/2025	10:56 AM	51
11/18/2025	11:11 AM	51
11/18/2025	11:26 AM	51
11/18/2025	11:41 AM	51
11/18/2025	11:56 AM	51
11/18/2025	12:11 PM	51
11/18/2025	12:26 PM	51
11/18/2025	12:41 PM	51
11/18/2025	12:56 PM	51
11/18/2025	1:11 PM	51
11/18/2025	1:26 PM	52
11/18/2025	1:41 PM	52
11/18/2025	1:56 PM	50
11/18/2025	2:11 PM	52
11/18/2025	2:26 PM	52
11/18/2025	2:41 PM	51
11/18/2025	2:56 PM	51
11/18/2025	3:11 PM	51
11/18/2025	3:26 PM	52
11/18/2025	3:41 PM	51
11/18/2025	3:56 PM	51
11/18/2025	4:11 PM	50
11/18/2025	4:26 PM	51
11/18/2025	4:41 PM	51
11/18/2025	4:56 PM	51
11/18/2025	5:11 PM	51
11/18/2025	5:26 PM	51
11/18/2025	5:41 PM	51
11/18/2025	5:56 PM	51
11/18/2025	6:11 PM	51
11/18/2025	6:26 PM	51
11/18/2025	6:41 PM	51
11/18/2025	6:56 PM	51
11/18/2025	7:11 PM	51
11/18/2025	7:26 PM	51
11/18/2025	7:41 PM	51
11/18/2025	7:56 PM	51
11/18/2025	8:11 PM	51
11/18/2025	8:26 PM	51
11/18/2025	8:41 PM	51
11/18/2025	8:56 PM	51
11/18/2025	9:11 PM	51
11/18/2025	9:26 PM	50



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/18/2025	9:41 PM	51
11/18/2025	9:56 PM	51
11/18/2025	10:11 PM	51
11/18/2025	10:26 PM	51
11/18/2025	10:41 PM	51
11/18/2025	10:56 PM	51
11/18/2025	11:11 PM	51
11/18/2025	11:26 PM	51
11/18/2025	11:41 PM	51
11/18/2025	11:56 PM	46
11/19/2025	12:11 AM	47
11/19/2025	12:26 AM	49
11/19/2025	12:41 AM	49
11/19/2025	12:56 AM	47
11/19/2025	1:11 AM	47
11/19/2025	1:26 AM	50
11/19/2025	1:41 AM	47
11/19/2025	1:56 AM	47
11/19/2025	2:11 AM	46
11/19/2025	2:26 AM	46
11/19/2025	2:41 AM	45
11/19/2025	2:56 AM	39
11/19/2025	3:11 AM	38
11/19/2025	3:26 AM	41
11/19/2025	3:41 AM	38
11/19/2025	3:56 AM	38
11/19/2025	4:11 AM	37
11/19/2025	4:26 AM	36
11/19/2025	4:41 AM	36
11/19/2025	4:56 AM	33
11/19/2025	5:11 AM	31
11/19/2025	5:26 AM	31
11/19/2025	5:41 AM	32
11/19/2025	5:56 AM	32
11/19/2025	6:11 AM	35
11/19/2025	6:26 AM	38
11/19/2025	6:41 AM	39
11/19/2025	6:56 AM	42
11/19/2025	7:11 AM	40
11/19/2025	7:26 AM	42
11/19/2025	7:41 AM	40
11/19/2025	7:56 AM	43
11/19/2025	8:11 AM	47
11/19/2025	8:26 AM	49



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

<b>DATE</b>	<b>TIME</b>	<b>PSI</b>
11/19/2025	8:41 AM	49
11/19/2025	8:56 AM	49
11/19/2025	9:11 AM	50
11/19/2025	9:26 AM	51
11/19/2025	9:41 AM	51
11/19/2025	9:56 AM	50
11/19/2025	10:11 AM	51
11/19/2025	10:26 AM	51
11/19/2025	10:41 AM	51
11/19/2025	10:56 AM	51
11/19/2025	11:11 AM	51
11/19/2025	11:26 AM	50
11/19/2025	11:41 AM	52
11/19/2025	11:56 AM	51
11/19/2025	12:11 PM	51
11/19/2025	12:26 PM	51
11/19/2025	12:41 PM	52
11/19/2025	12:56 PM	51
11/19/2025	1:11 PM	51
11/19/2025	1:26 PM	52
11/19/2025	1:41 PM	52
11/19/2025	1:56 PM	52
11/19/2025	2:11 PM	51
11/19/2025	2:26 PM	51
11/19/2025	2:41 PM	51
11/19/2025	2:56 PM	52
11/19/2025	3:11 PM	51
11/19/2025	3:26 PM	52
11/19/2025	3:41 PM	51
11/19/2025	3:56 PM	50
11/19/2025	4:11 PM	51
11/19/2025	4:26 PM	52
11/19/2025	4:41 PM	52
11/19/2025	4:56 PM	51
11/19/2025	5:11 PM	52
11/19/2025	5:26 PM	51
11/19/2025	5:41 PM	51
11/19/2025	5:56 PM	51
11/19/2025	6:11 PM	51
11/19/2025	6:26 PM	51
11/19/2025	6:41 PM	51
11/19/2025	6:56 PM	51
11/19/2025	7:11 PM	51
11/19/2025	7:26 PM	52



C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST

NOVEMBER 2025

DATE	TIME	PSI
11/19/2025	7:41 PM	51
11/19/2025	7:56 PM	51
11/19/2025	8:11 PM	51
11/19/2025	8:26 PM	51
11/19/2025	8:41 PM	50
11/19/2025	8:56 PM	50
11/19/2025	9:11 PM	49
11/19/2025	9:26 PM	51
11/19/2025	9:41 PM	51
11/19/2025	9:56 PM	50
11/19/2025	10:11 PM	51
11/19/2025	10:26 PM	50
11/19/2025	10:41 PM	51
11/19/2025	10:56 PM	51
11/19/2025	11:11 PM	50
11/19/2025	11:26 PM	49
11/19/2025	11:41 PM	51
11/19/2025	11:56 PM	49
11/20/2025	12:11 AM	49
11/20/2025	12:26 AM	48
11/20/2025	12:41 AM	49
11/20/2025	12:56 AM	50
11/20/2025	1:11 AM	48
11/20/2025	1:26 AM	51
11/20/2025	1:41 AM	50
11/20/2025	1:56 AM	49
11/20/2025	2:11 AM	46
11/20/2025	2:26 AM	47
11/20/2025	2:41 AM	44
11/20/2025	2:56 AM	45
11/20/2025	3:11 AM	43
11/20/2025	3:26 AM	42
11/20/2025	3:41 AM	41
11/20/2025	3:56 AM	38
11/20/2025	4:11 AM	42
11/20/2025	4:26 AM	39
11/20/2025	4:41 AM	40
11/20/2025	4:56 AM	40
11/20/2025	5:11 AM	40
11/20/2025	5:26 AM	39
11/20/2025	5:41 AM	42
11/20/2025	5:56 AM	40
11/20/2025	6:11 AM	40
11/20/2025	6:26 AM	41



**C/O KNIPP RD AND KNIPP OAKS LN  
STATIC PRESSURE TEST**

**NOVEMBER 2025**

DATE	TIME	PSI
11/20/2025	6:41 AM	40
11/20/2025	6:56 AM	41
11/20/2025	7:11 AM	44
11/20/2025	7:26 AM	46
11/20/2025	7:41 AM	48
11/20/2025	7:56 AM	50
11/20/2025	8:11 AM	47
11/20/2025	8:26 AM	49
11/20/2025	8:41 AM	48
11/20/2025	8:56 AM	50
11/20/2025	9:11 AM	50
11/20/2025	9:26 AM	48
11/20/2025	9:41 AM	49
11/20/2025	9:56 AM	51
11/20/2025	10:11 AM	51
11/20/2025	10:26 AM	52
11/20/2025	10:41 AM	51
11/20/2025	10:56 AM	51